INCH-POUND
MIL-PRF-15160/22C
17 August 2006
SUPERSEDING
MIL-F-15160/22B
29 October 1990


PERFORMANCE SPECIFICATION SHEET

FUSES: INSTRUMENT, POWER, AND TELEPHONE (NONINDICATING), STYLE F22

INACTIVE FOR NEW DESIGN
AFTER 19 NOVEMBER 1997

This specification is approved for use by all Departments and Agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification and MIL-PRF-15160.

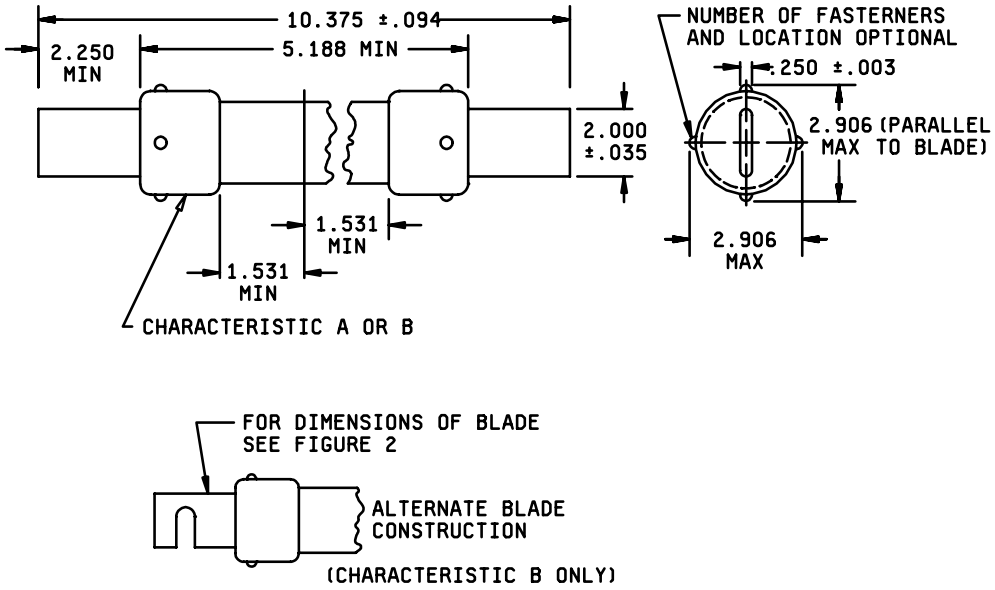


INCHES	MM
0.003	0.08
0.035	0.89
0.094	2.39
0.250	6.63
1.531	38.89
2.000	50.80
2.250	57.15
2.906	73.81
5.188	131.78
10.375	263.52

NOTES:
1. Dimensions are in inches.

FIGURE 1. Style F22, characteristic A and B.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T05:44Z
Check the source to verify that this is the current version before use.

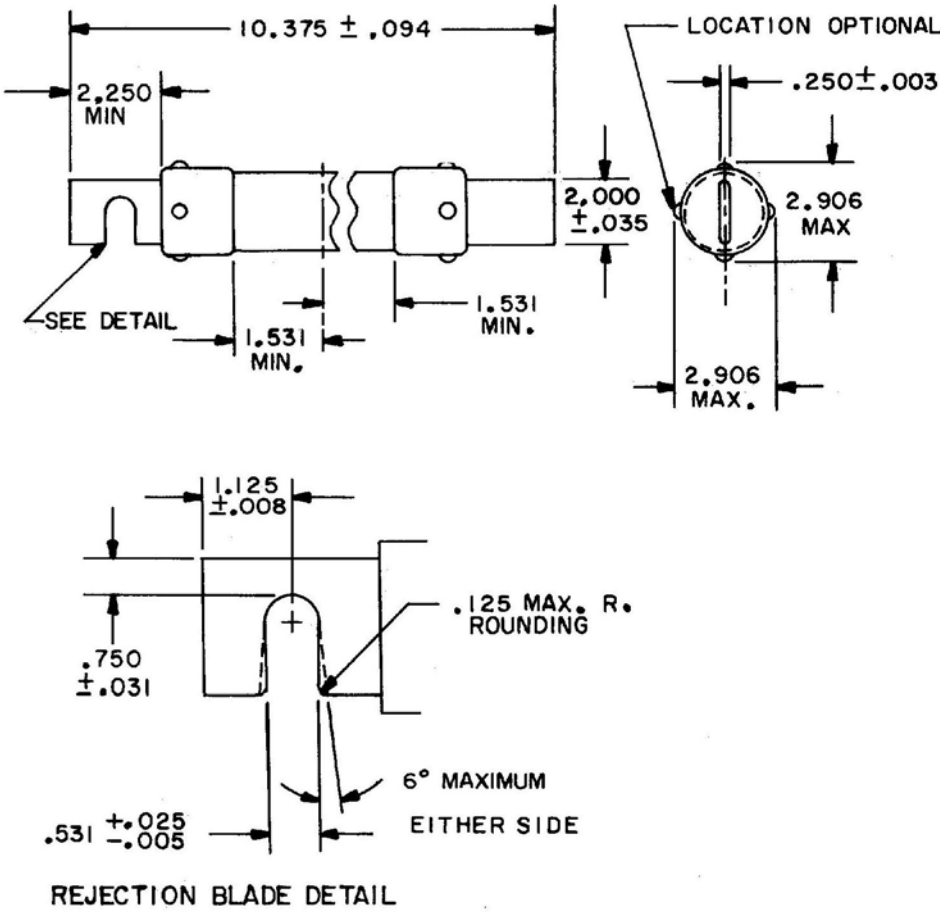

Inches	mm	Inches	mm	Inches	mm
0.003	0.08	0.094	2.39	1.531	38.89
0.005	0.13	0.125	3.18	2.000	50.80
0.008	0.20	0.250	6.63	2.250	57.15
0.025	0.64	0.531	5.31	2.906	73.81
0.031	0.79	0.750	19.05	10.375	263.52
0.035	0.89	1.125	28.58		

NOTES:
1. Dimensions are in inches.

FIGURE 2. Style F22, characteristic BR.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T05:44Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Interface and physical dimensions: See figures 1 and 2.

Case: Fiber or alternate material.
(Alternate to fiber material (tube) shall have an average burst strength of 1,700 pounds per square inch with a value of not less than 1,400 pounds per square inch).

Knifeblade: Copper.

Finish: Nickel, bright alloy, or bright dipped, silver plated when specified.

Terminal strength: Method 211 of MIL-STD-202, test condition E, 5 inch-pound torque between ferrules and fuse body.

Electrical:

Electrical requirements shall be as specified in table I.

Shock: Method 207 of MIL-STD-202, HI shock.

Vibration: Method 204 of MIL-STD-202, test condition A (except 5g peak).

Temperature rise: Temperature rise shall be not greater than the values shown in table II.

Type designation: Type designation shall be as shown in table III.

Qualification: Not required.

TABLE I Electrical requirements.

	Characteristics		
	A 2/	B	BR
Voltage rating	250 Vac 250 Vdc	250 Vac 250 Vdc	250 Vac 250 Vdc
Overload test 1/ 135% 500%	 0 - 2 hour -	 0 - 2 hour 10 - 25 sec.	 0 - 2 hour 10 - 25 sec.
Short circuit test at 250 Vdc, At 250 Vac	 10,000A 10,000A	 10,000A 10,000A	 10,000A 200,000A (20% PF max.)
Short circuit test at 450 Vac, Single phase, (50% PF max.)	 10,000A	 -	 -

1/ Overload is shown as a percentage of the current rating of the fuse.
2/ Characteristic A fuses may be used at 450 Vac with reduced interrupting capacity.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T05:44Z
Check the source to verify that this is the current version before use.

TABLE II. Allowable temperature rise in degrees Celsius (°C).

Casing of body		Terminals	
Thermometer	Thermocouple	Thermometer	Thermocouple
50 °C	90 °C	75 °C	90 °C

TABLE III Type designations and electrical rating. 1/

Style	Characteristic	Maximum voltage	Current rating
F22	A	250V	450A
F22	A	250V	500A
F22	A	250V	600A
F22	B 2/ 4/	250V	450A
F22	B	250V	500A
F22	B	250V	600A
F22	BR 3/	250V	450A
F22	BR	250V	500A
F22	BR	250V	600A

1/ For silver plated terminals, the designator “S” is added after the current rating.
2/ The characteristic B fuse is cancelled upon the issue of this document And the establishment of a QPL for the type BR fuse.
3/ The characteristic BR fuse may be used to replace the characteristic B fuse of the same current rating, even in nonrejection type fuse clips.
4/ Characteristic B fuses shall not be used to replace characteristic BR fuses.

VERIFICATION:

Qualification inspections: Not applicable for this specification sheet.

Quality conformance inspections: Groups A and B tests of MIL-PRF-15160 shall be applicable.

PACKAGING:

Unit packaging. The standard unit pack shall be 1 piece.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T05:44Z
Check the source to verify that this is the current version before use.

Referenced documents. In addition to MIL-PRF-15160, this document references the following:

MIL-STD-202

The margins of this specification are marked with vertical lines to indicate where changes from the previous issue were made. This was done as a convenience only and the Government assumes no liability whatsoever for any inaccuracies in these notations. Bidders and contractors are cautioned to evaluate the requirements of this document based on the entire content irrespective of the marginal notations and relationship to the last previous issue.

Custodians:
Army - CR
Navy - SH
Air Force - 11
DLA - CC

Preparing activity:
DLA - CC

(5920-2005-015)

Review activities:
Army - AR, AT, CR4, MI
Navy - AS, MC, OS
Air Force - 19, 99

NOTE: The activities listed above were interested in this document as of the date of this document. Since organizations and responsibilities can change, you should verify the currency of the information above using the ASSIST Online database at http://assist.daps.dla.mil.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T05:44Z
Check the source to verify that this is the current version before use.