COMMERCIAL ITEM DESCRIPTION

FUSE CARTRIDGE, SEMICONDUCTOR TYPE, 250 VOLTS

The General Services Administration has authorized the use of this commercial item description (CID) for all federal agencies

1 SCOPE. This CID covers the general requirements for 250 volt semiconductor fuse cartridges. Fuse cartridges covered by this CID are intended for commercial/industrial applications.

2 CLASSIFICATION. This CID uses a classification system which is included in the Part or Identification Number (PIN) as shown in the following example (see 6.1).

AA55494 - 012

AA55494: CID number

012: Dash number (see table I)

3. SALIENT CHARACTERISTICS

3.1 Design and construction. Fuse cartridges supplied to this CID shall be as specified herein (see figure 1)

3 2 Ampere rating. The ampere rating shall be as specified in table I.

3.3 Voltage rating. The voltage rating shall be 250 V ac maximum.

3.4 Short circuit interrupt rating. The short circuit interrupt rating shall be 200,000 amperes RMS symmetrical.


3.5 Maximum current clearing I^2t. The maximum current clearing I^2t shall be as specified in table I

3.6 Marking. Fuse cartridges supplied to this CID shall be marked with the manufacturer's standard commercial PIN.

Beneficial comments, recommendations, additions, deletions, clarifications, etc., and any data which may improve this document should be sent to: Defense Electronics Supply Center, ATTN. DESC-ELDM, 1507 Wilmington Pike, Dayton, OH 45444-5765, or telephone (513) 296-6189, or facsimile (FAX) (513) 296-8868.

DISTRIBUTION STATEMENT A Approved for public release, distribution is unlimited

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.

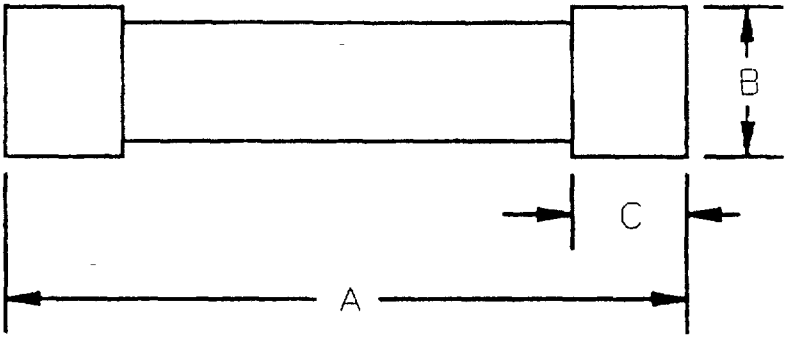


AA55494-	Dimensions		
	A	B	C
001 through 006	50.80 (2.0)	14.30 (.563)	12.83 (.505) 10.98 (.432)

Configuration I

NOTES
1 Dimensions are in millimeters.
2 Tolerance is ± 0.13 mm (0.005 inch), unless otherwise specified.
3 The US government preferred system of measurement is the metric SI system. However, this item was originally designed using inch-pound units of measurement. In the event of conflict between the metric and inch-pound units, the inch-pound units shall take precedence

Figure 1. Configuration and dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.

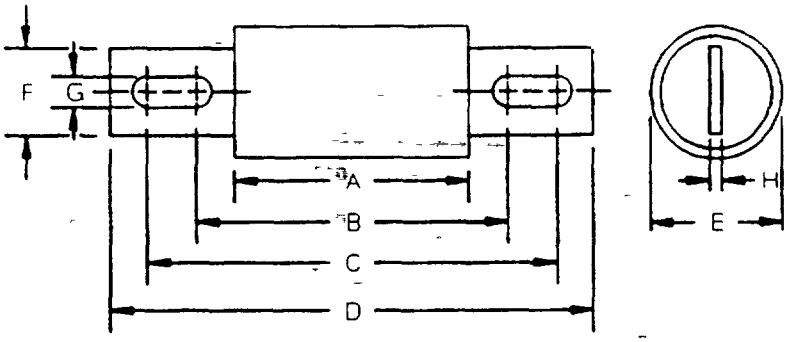

AA55494-	Dimensions							
	A	B	C	D	E	F	G	H
007 through 011	41.43 (1.631) 39.56 (1.557)	57.18 (2.251)	66.03 (2.600) 63.37 (2.495)	80 98 (3.188)	20.65 (.813)	19.18 (.755) 15.77 (.621)	8.72 (.343)	3.19 (.126)
012 through 017	41.43 (1.631) 40.37 (1.589)	59.26 (2.333) 55.47 (2.184)	61.90 (2.437)	79.39 (3 126)	30.97 (1.219)	25 41 (1.000) 19.04 (.750)	8.87 (.349) 7.80 (.307)	4.78 (.188)
018 through 023	40.49 (1.594)	61.25 (2.41) 57.07 (2.247)	74.73 (2.942) 73.67 (2 900)	97.62 (3.843)	38.10 (1.5)	25.40 (1.0)	10.31 (406)	6.38 (.251)

Configuration II

NOTES
1. Dimensions are in millimeters.
2. Tolerance is ± 0.13 mm (0.005 inch), unless otherwise specified.
3 The US government preferred system of measurement is the metric SI system However, this item was originally designed using inch-pound units of measurement. In the event of conflict between the metric and inch-pound units, the inch-pound units shall take precedence.

Figure 2 Configuration and dimensions

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.

TABLE I Electrical characteristics

AA55494-	Ampere rating	I^2t (A^2s)	AA55494-	Ampere rating	I^2t (A^2s)
001	5	100	013	80	3,000
002	10	200	014	100	5,000
003	15	250	015	125	7,500
004	20	300	016	150	12,000
005	25	350	017	200	20,000
006	30	390	018	250	38,000
007	35	460	019	300	55,000
008	40	560	020	350	73,000
009	45	720	021	400	100,000
010	50	880	022	500	190,000
011	60	1,300	023	600	260,000
012	70	2,200			

4 QUALITY ASSURANCE PROVISIONS

4 1 Contractor certification. The contractor shall certify and maintain substantiating evidence that the product offered meets the salient characteristics of this CID, and that the product conforms to the producer's own drawings, specifications, standards, and quality assurance practices, and is the same product offered for sale in the commercial marketplace. The Government reserves the right to require proof of such conformance prior to first delivery and thereafter as may be otherwise provided for under the provisions of the contract

4 2 Certificate of compliance. Each contractor desiring to be listed as a suggested source of supply shall submit a DESC certificate of compliance to DESC-ELDM. This certificate shall state that the contractor's product meets all the requirements of this CID. In addition, a certificate of compliance shall accompany all fuse cartridges supplied to this CID.

4.3 Market acceptability. The following market acceptability criteria are necessary to document the quality of the product to be provided under this CID.

a The company producing the item must have been producing a product meeting the requirements of this CID for at least 2 years.

b The company must have sold 1,000 units meeting this CID in the commercial market place over the past 2 years

5 PACKAGING

5 1 Preservation, packing, and marking Preservation, packing, and marking shall be as specified in the contract or order.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.

6 NOTES

6 1 PIN The PIN should be used for Government purposes to buy commercial products to this CID See section 2 for PIN format example.

6.2 Government users. To acquire information on obtaining these semiconductor fuses from the Government inventory system, please contact Defense Electronics Supply Center, ATTN DESC-EOM, 1507 Wilmington Pike, Dayton, OH 45444-5270, or telephone (513) 296-5106.

6 3 Ordering data. The contract or order should specify the following

a CID document number, revision, and CID PIN.

b. Quality assurance provisions.

c. If a bid sample is required

d. Packaging requirements.

6 4 Suggested sources of supply. Suggested sources of supply are listed below. Additional sources will be added as they become available. The vendors listed have submitted a certificate of compliance to DESC-ELDM and meet the market acceptability requirements of this CID.

CID dash number (see table 1) AA55494-	Vendor commercial PIN CAGE 12092	Vendor commercial PIN CAGE 71400	Vendor commercial PIN CAGE 75915
001	A025F005	FWX 5A	L25S5
002	A025F010	FWX 10A	L25S10
003	A025F015	FWX 15A	L25S15
004	A025F020	FWX 20A	L25S20
005	A025F025	FWX 25A	L25S25
006	A025F030	FWX 30A	L25S30
007	A025F035	FWX 35A	L25S35
008	A025F040	FWX 40A	L25S40
009	A025F045	FWX 45A	L25S45
010	A025F050	FWX 50A	L25S50
011	A025F060	FWX 60A	L25S60
012	A025R070	FWX 70A	L25S70
013	A025R080	FWX 80A	L25S80
014	A025R100	FWX 100A	L25S100
015	A025R125	FWX 125A	L25S125
016	A025R150	FWX 150A	L25S150
017	A025R200	FWX 200A	L25S200
018	A025R250	FWX 250A	L25S250
019	A025R300	FWX 300A	L25S300
020	A025R350	FWX 350A	L25S350
021	A025R400	FWX 400A	L25S400
022	A025R500	FWX 500A	L25S500
023	A025R600	FWX 600A	L25S600

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.

Vendor CAGE number	Vendor name and address
12092	Carbone Lorraine, Incorporated 14 Eastmans Road Parsippany, NJ 07054-3703 (201) 428-8400
71400	Bussmann P.O Box 14460 St. Louis, MO 63178-4460 (314) 394-2877
75915	Littelfuse, Incorporated 800 E. Northwest Highway Des Plaines, IL 60016-3096 (312) 824-1188

CIVIL AGENCY COORDINATING ACTIVITY

GSA - 7FXE

PREPARING ACTIVITY

DLA-ES

Project 5920-0216

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.