[INCH-POUND]
A-A-55495A
April 14, 1997
SUPERSEDING
A-A-55495
February 3, 1995

COMMERCIAL ITEM DESCRIPTION

FUSE CARTRIDGE, SEMICONDUCTOR TYPE, 500 VOLTS

The General Services Administration has authorized the use of this commercial item description (CID) for all federal agencies.

1. SCOPE. This CID covers the general requirements for 500 volt semiconductor fuse cartridges. Fuse cartridges covered by this CID are intended for commercial/industrial applications.

2. CLASSIFICATION. This CID uses a classification system which is included in the Part Identification Number (PIN) as shown in the following example (see 6.1).

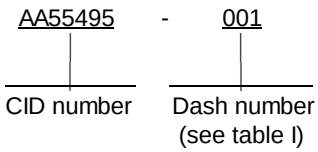

3. SALIENT CHARACTERISTICS

3.1 Design and construction. Fuse cartridges supplied to this CID shall be as specified herein (see figure 1).

3.2 Ampere rating. The ampere rating shall be as specified in table I.

3.3 Voltage rating. The voltage rating shall be 500 V ac maximum.

3.4 Short circuit interrupt rating. The short circuit interrupt rating shall be 200,000 amperes root mean square (RMS) at symmetrical.

3.5 Maximum current clearing I^2t. The maximum current clearing I^2t shall be as specified in table I.

3.6 Recycled/recovered materials. The offeror/contractor is encouraged to use recovered materials to the maximum extent practicable, in accordance with paragraph 23.403 of the Federal Acquisition Regulation (FAR).

3.7 Marking. Fuse cartridges supplied to this CID shall be marked with the manufacturer's standard commercial PIN.

Beneficial comments, recommendations, additions, deletions, clarifications, etc., and any data which may improve this document should be sent to: Defense Supply Center, Columbus, ATTN: DSCC-VAM, 3990 East Broad Street, Columbus, OH 43216-5000, or telephone (614) 692-0548, or facsimile (FAX) (614) 692-6939.

AMSC N/A FSC 5920

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.

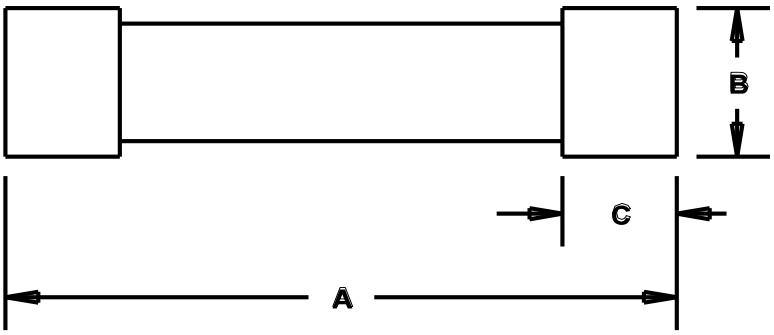

AA55495-	Dimensions		
	A	B	C
001 through 006	50.80 (2.0)	14.29 (.563)	12.70 (.500)

Configuration I

NOTES:
1. Dimensions are in millimeters.
2. Tolerance is ± 0.13 mm (0.005 inch), unless otherwise specified.
3. The U. S. Government preferred system of measurement is the metric SI system. However, this item was originally designed using inch-pound units of measurement. In the event of conflict between the metric and inch-pound units, the inch-pound units shall take precedence.

Figure 1. Configuration and dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.

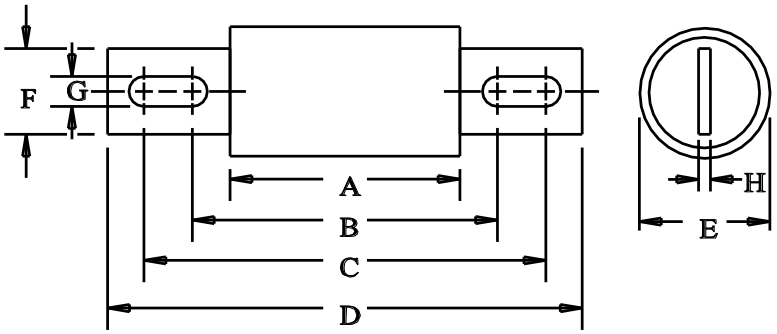

AA55495-	Dimensions							
	A	B	C	D	E	F	G	H
007 through 011	41.41 (1.630) 39.55 (1.557)	57.18 (2.251)	66.03 (2.600) 63.37 (2.495)	80.98 (3.188)	20.65 (.813) 19.5 (.768)	19.8 (.780) 15.77 (.621)	8.72 (.343)	3.19 (.126)
012 through 014	53.95 (2.124)	71.96 (2.833) 68.17 (2.684)	77.13 (3.037) 74.48 (2.932)	92.09 (3.626)	25.40 (1.0)	19.08 (.751)	8.83 (.348) 7.81 (.307)	3.19 (.126)
015 through 017	54.13 (2.131) 53.07 (2.089)	71.96 (2.833) 69.72 (2.745)	74.52 (2.934)	92.09 (3.626)	30.98 (1.220)	25.53 (1.005) 18.92 (.745)	8.83 (.348) 7.77 (.306)	4.78 (.188)
018 through 021	53.19 (2.094)	70.77 (2.786) 70.47 (2.774)	87.43 (3.442)	110.32 (4.343)	38.10 (1.5)	25.40 (1.0)	10.31 (.406)	6.38 (.251)
022 through 023	56.53 (2.226) 53.07 (2.089)	77.12 (3.036) 70.47 (2.774)	89.70 (3.531)	113.64 (4.474) 110.17 (4.337)	50.80 (2.0)	38.10 (1.5)	10.31 (.406)	6.38 (.251)
024	56.53 (2.226) 53.07 (2.089)	109.73 (4.320) 87.17 (3.432)	126.33 (4.974) 117.35 (4.620)	164.44 (6.474) 160.97 (6.337)	63.50 (2.5) 60.5 (2.38)	50.80 (2.0)	13.50 (.531)	9.52 (.375)

Configuration II

NOTES:

1. Dimensions are in millimeters.
2. Tolerance is ± 0.13 mm (0.005 inch), unless otherwise specified.
3. The U. S. Government preferred system of measurement is the metric SI system. However, this item was originally designed using inch-pound units of measurement. In the event of conflict between the metric and inch-pound units, the inch-pound units shall take precedence.

Figure 2. Configuration and dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.

TABLE I. Electrical characteristics.

AA55495-	Ampere rating	I^2t (A^2s)	AA55495-	Ampere rating	I^2t (A^2s)
001	5	100	013	80	5,000
002	10	200	014	100	7,500
003	15	250	015	125	10,600
004	20	300	016	150	16,000
005	25	350	017	200	28,000
006	30	400	018	250	50,000
007	35	2,000	019	300	60,000
008	40	2,250	020	350	80,000
009	45	2,500	021	400	120,000
010	50	2,750	022	500	190,000
011	60	3,000	023	600	300,000
012	70	4,000	024	800	600,000

4. QUALITY ASSURANCE PROVISIONS

4.1 Product conformance. The products provided shall meet the salient characteristics of this CID, conform to the producer's own drawings, specifications, standards, and quality assurance practices, and be the same product offered for sale in the commercial market. The Government reserves the right to require proof of such conformance.

4.2 Market acceptance. The following market acceptance criteria are necessary to document the quality of the product to be provided under this CID:

a. The company producing the item must have been producing a product meeting the requirements of this CID for at least 6 months.

b. The company must have sold 1,000 units meeting this CID in the commercial marketplace over the past 6 months.

5. PACKAGING

5.1 Preservation, packing, and marking. Preservation, packing, and marking shall be as specified in the contract or order.

6. NOTES

6.1 PIN. The PIN should be used for Government purposes to buy commercial products to this CID. See section 2 for PIN format example.

6.2 CAGE code. For ordering purposes, inventory control, and submission of these fuse cartridges to DSCC under the Military Parts Control Advisory Group (MPCAG) evaluation program, CAGE code 58536 should be used.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.

6.3 Ordering data. The contract or order should specify the following:

a. CID document number, revision, and CID PIN.

b. Quality assurance provisions.

c. Packaging requirements.

6.5 Commercial products. As part of the market analysis and research effort, this CID was coordinated with the following manufacturers of commercial products. At the time of CID preparation and coordination, these manufacturers were known to have commercial products that would meet the requirements of this CID. (NOTE: This information should not be considered as a list of approved manufacturers or be used to restrict procurement to only the manufacturers shown.)

Manufacturer's CAGE	Manufacturer's name and address
067U2	Den Mar Transit Industrial Fuses 10488 S. W. 211 Street Miami, FL 33189-3000 (305) 235-1000
12092	Carbone Lorraine, Incorporated 14 Eastmans Road Parsippany, NJ 07054-3703 (201) 428-8400
71424	Gould Shawmut , Incorporated 374 Merrimac Street Newburyport, MA 01950-1930 (508) 462-6662
71400	Bussmann P.O. Box 14460 St. Louis, MO 63178-4460 (314) 394-2877
75915	Littelfuse, Incorporated 800 E. Northwest Highway Des Plaines, IL 60016-3096 (312) 824-1188

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.

6.6 Part number supersession data. This CID supersedes the following manufacturer's P/N's as shown. This information is being provided to assist in reducing proliferation in the government inventory system.

CID dash number (see table I) AA55495-	Vendor commercial PIN CAGE 067U2	Vendor commercial PIN CAGE 12092	Vendor commercial PIN CAGE 71424	Vendor commercial PIN CAGE 71400	Vendor commercial PIN CAGE 75915
001	UFR50P005	A050F005	---	FWH 5A	---
002	UFR50P010	A050F010	A50P10-1	FWH 10A	L50S10
003	UFR50P015	A050F015	A50P15-1	FWH 15A	L50S15
004	UFR50P020	A050F020	A50P20-1	FWH 20A	L50S20
005	UFR50P025	A050F025	A50P25-1	FWH 25A	L50S25
006	UFR50P030	A050F030	A50P30-1	FWH 30A	L50S30
007	UFR50P035	A050F035	A50P35-4	FWH 35A	L50S35
008	UFR50P040	A050F040	A50P40-4	FWH 40A	L50S40
009	UFR50P045	A050F045	A50P45-4	FWH 45A	L50S45
010	UFR50P050	A050F050	A50P50-4	FWH 50A	L50S50
011	UFR50P060	A050F060	A50P60-4	FWH 60A	L50S60
012	UFR50P070	A050F070	A50P70-4	FWH 70A	L50S70
013	UFR50P080	A050F080	A50P80-4	FWH 80A	L50S80
014	UFR50P100	A050F100	A50P100-4	FWH 100A	L50S100
015	UFR50P125	A050F125	A50P125-4	FWH 125A	L50S125
016	UFR50P150	A050F150	A50P150-4	FWH 150A	L50S150
017	UFR50P200	A050F200	A50P200-4	FWH 200A	L50S200
018	UFR50P250	A050F250	A50P250-4	FWH 250A	L50S250
019	UFR50P300	A050F300	A50P300-4	FWH 300A	L50S300
020	UFR50P350	A050F350	A50P350-4	FWH 350A	L50S350
021	UFR50P400	A050F400	A50P400-4	FWH 400A	L50S400
022	UFR50P500	A050F500	A50P500-4	FWH 500A	L50S500
023	UFR50P600	A050F600	A50P600-4	FWH 600A	L50S600
024	UFR50P800	A050F800	A50P800-4	FWH 800A	L50S800

1/ The manufacturer's P/N shall not be used for procurement to the requirements of this CID. At the time of preparation of this CID, the aforementioned commercial products were reviewed and could be replaced by the CID PIN shown.

6.7 Government users. To acquire information on obtaining these fuses from the Government inventory system, contact Defense Supply Center, Columbus, ATTN: DSCC-CM, 3990 East Broad Street, Columbus, OH 43216-5000, or telephone (614) 692-7884.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.

MILITARY INTERESTS:

Custodians:
Navy - EC

CIVIL AGENCY COORDINATING ACTIVITY:

GSA - 7FXE

Preparing Activity:

DLA-CC

Project 5920-0545

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.