
FED. SUP CLASS
5970

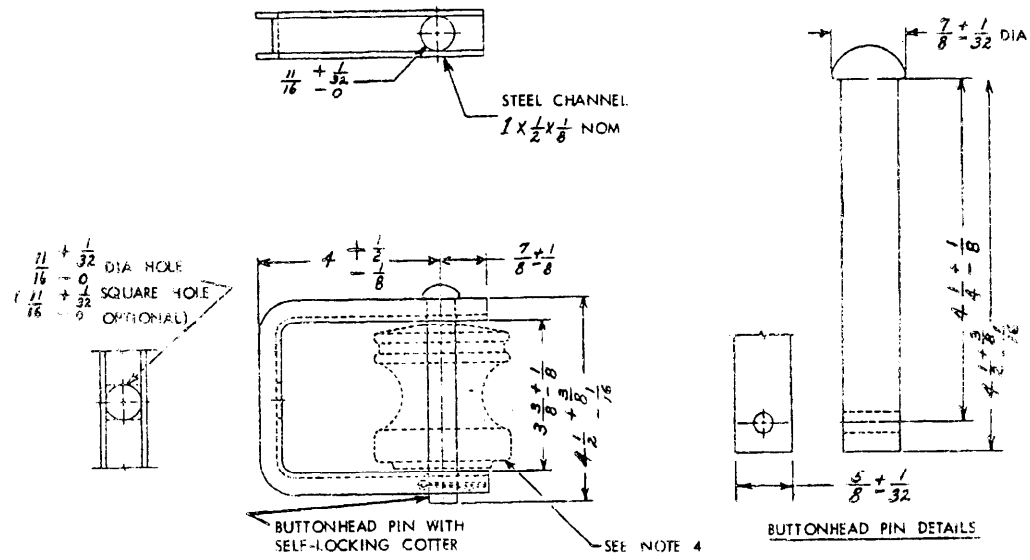

LOW FREQUENCY FLASHOVER - WET (kv)		MINIMUM ULTIMATE STRENGTH OF INSULATED CLEVIS (pounds)
Horizontal	Vertical	
25	18	3000

NOTES:

1. ALL DIMENSIONS ARE IN INCHES.
2. REFERENCED DOCUMENTS SHALL BE OF THE ISSUE IN EFFECT ON DATE OF INVITATION FOR BID.
3. MATERIALS AND FINISH FOR CLEVISES AND CLEVIS PINS SHALL BE IN ACCORDANCE WITH EDISON ELECTRIC INSTITUTE SPECIFICATION TD-20.
4. INSULATING COMPOUND FOR PORCELAIN INSULATORS (SOCKET TYPE) SHALL BE IN ACCORDANCE WITH MIL-I-10, GRADE L222, WITH CONFIGURATION AND DIMENSIONS IN ACCORDANCE WITH EDISON ELECTRIC INSTITUTE SPECIFICATION TDJ-53, CLASS 53-2.
5. STRAIN INSULATORS WITH CLEVISES SHALL BE FREE OF BURRS, SPLINTERS, SPLITS, SHARP POINTS AND EDGES WHICH COULD DAMAGE CONDUCTORS.

APPROVED 6 November 1968 REVISED

P.A.	EC	TITLE	MILITARY STANDARD
Other Cust	EC	INSULATOR, STRAIN, WITH CLEVIS	MS75077
	85		
PROCUREMENT SPECIFICATION NONE		SUPERSEDES.	SHEET 1 OF 1

DD FORM 1527 1 672 -1 (Coordinated) PREVIOUS EDITIONS OF THIS FORM ARE OBSOLETE. Project 5970-0268

Reviewer/user information is current as of the date of this document. For future coordination of changes to this document, draft circulation should be based on the information in the current DODISS (FSC Grouping).
AF 85* Army ME@ Navy EC* HC*

This military standard has been approved by the Department of Defense and is mandatory for use by all Departments and Agencies of the Department of Defense. Selection for all new engineering and design applications and for repetitive use shall be made from this document.

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T20:28Z
Check the source to verify that this is the current version before use.