INCH-POUND

MIL-DTL-24558/20A
w/AMENDMENT 1
17 February 2006
SUPERSEDING
MIL-DTL-24558/20A
9 December 2004

DETAIL SPECIFICATION SHEET

TERMINAL BOX, CONNECTION, SUBMERSIBLE (15-FOOT), 10-TERMINAL, 20-WIRE, 1000 VOLTS, SYMBOL NO. 529

This specification sheet is approved for use by all departments and agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and MIL-DTL-24558, "Terminal Boxes, Connection, for Electrical and Electronic Systems, General Specification for".

REQUIREMENTS: The terminal box shall be as specified herein and in accordance with table I and figures 1, 2, and 3.

1. Electrical rating. The terminal box shall have an electrical rating of 1,000 volts rms/DC. The maximum current shall be 40 amperes per stud of terminal board.

2. Dimensions and configuration. For dimensions and configuration see figures 1 through 3. All dimensions in figures 1 through 3 are expressed in inches. Overall terminal box dimensions are approximate. Exact dimensions are shown in MIL-E-24142/3, "Enclosure for Electrical Fittings and Fixtures, Submersible, Size 6 By 9 (15-Foot)".

3. Tolerance. All tolerances, other than specified herein, shall be in accordance with MIL-DTL-24558.

4. Standard parts. The standard parts shown in table I shall be used in the construction of the connection box specified herein. The numbers in circles shown on figures 1 through 3 are the same as those shown in the "Item" column of table I.

5. Enclosure. The enclosure shall be a 15-foot submersible type.

6. Finish. The interior of enclosure may be unpainted or painted at contractor's option.

7. Weight. The weight of the connection box shall be 9.0 lbs. maximum.

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:44Z
Check the source to verify that this is the current version before use.

8. Maximum number of wires. The maximum number of wires (including spares) shall not exceed two times the number of terminals and the maximum number of wires to be connected to a single terminal shall not exceed four.

QUALITY ASSURANCE: First article inspection and quality conformance inspection shall be as specified in MIL-DTL-24558.

GENERAL INFORMATION:

1. Drawing. The terminal box specified by MIL-DTL-24558/20A was formerly covered on NAVSHIPS Drawing No. 815-1197015.

2. Part or identification number (PIN). The PIN to be used for terminal boxes acquired to this specification is created as follows:


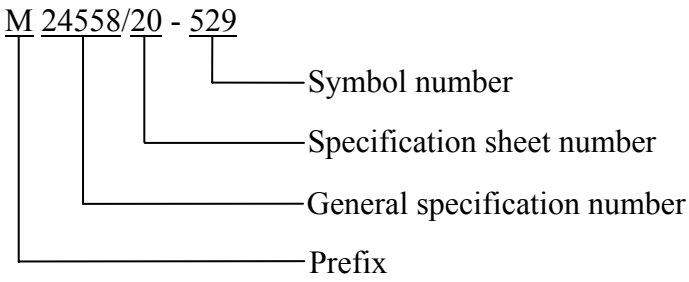


TABLE I. Parts list.

Item	Description	Qty.	Part no. or specification	Remarks
1	Enclosure assembly, brass	1	MIL-E-24142/3	M24142/3-001 for symbol 400.1
2	Identification plate	1	MIL-DTL-24558	Figure 6
3	Information plate	1	MIL-DTL-24558	Figure 6
4	Mounting bracket	1	MIL-DTL-24558	Figure 1[1]
5	Terminal board assembly	1	A-A-59125/20	16TB10
6	RH mach screw #10-24 X 3/4" long	2	COML	Brass
7	Washer for #10 screw	2	COML	Bronze
8	RH mach screw #6-32 X 1/4" long	4	COML	Brass
9	Warning plate	1	MIL-DTL-15024	Brass[2]


[1]Height of mounting brackets shall be modified as shown in figure 1 of MIL-DTL-24558.
[2]A 3-1/2- by 1-3/8-inch plate shall be brazed to cover as shown in figure 1. "WARNING (first line) 1000 VOLTS (second line)" shall be engraved in 3/8-inch lettering. Lettering shall be filled with red enamel.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:44Z
Check the source to verify that this is the current version before use.

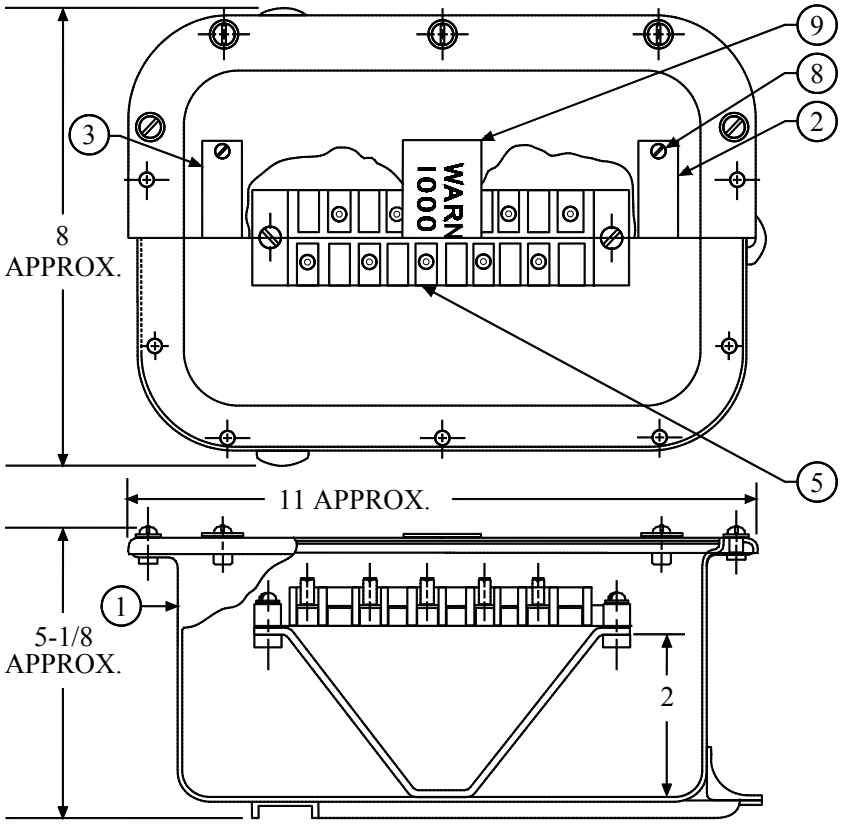

SH 11629


FIGURE 1. Connection box assembly.

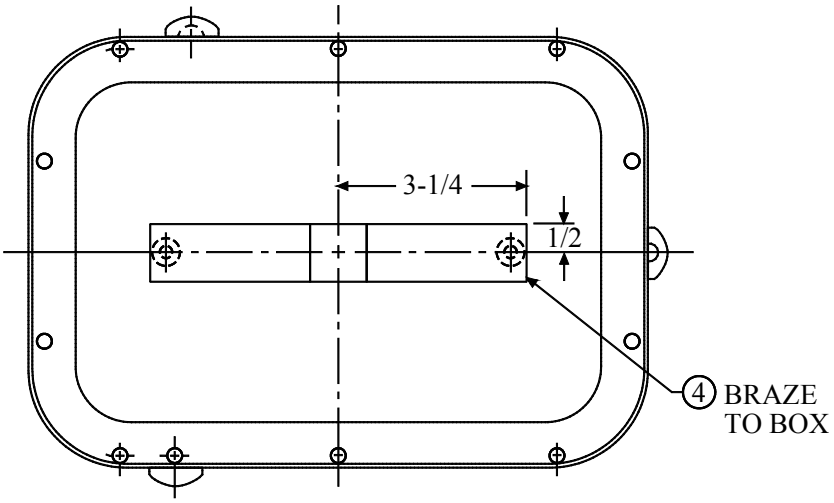

SH 11630

FIGURE 2. Location of terminal board mounting bracket.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:44Z
Check the source to verify that this is the current version before use.

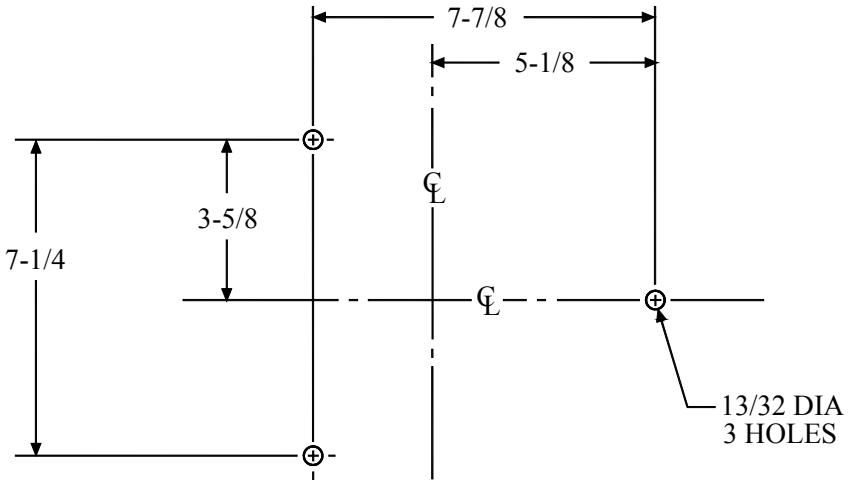

SH 11631

MOUNTING BOLTS SHALL BE 3/8-16

FIGURE 3. Mounting dimensions.

AMENDMENT NOTATIONS. The margins of this specification are marked with vertical lines to indicate modifications generated by this amendment. This was done as a convenience only and the government assumes no liability whatsoever for any inaccuracies in these notations. Bidders and contractors are cautioned to evaluate the requirements of this document based on the entire content irrespective of the marginal notations.

Custodian:
Navy - SH

Preparing Activity:
DLA - GS2

(Project 5940-2005-019)

NOTE: The activities listed above were interested in this document as of the date of this document. Since organizations and responsibilities can change, you should verify the currency of the information above using the ASSIST database at http://assist.daps.dla.mil.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:44Z
Check the source to verify that this is the current version before use.