INCH-POUND

MIL-DTL-24558/20C
31 May 2024
SUPERSEDING
MIL-DTL-24558/20B
3 October 2011

DETAIL SPECIFICATION SHEET

# TERMINAL BOX, CONNECTION, SUBMERSIBLE (15-FOOT), 10-TERMINAL, 20-WIRE, 1000 VOLTS, SYMBOL NO. 529

This specification is approved for use by all Departments and Agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and MIL-DTL-24558, "Terminal Boxes, Connection, for Electrical and Electronic Systems, General Specification for".

REQUIREMENTS: The terminal box shall be as specified herein and in accordance with Table I and Figures 1 through 3.

1. Electrical rating. The terminal box shall have an electrical rating of 1000 volts root mean square, and 1000 volts direct current. The maximum current shall not exceed 40 amperes per stud of terminal board.

2. Dimensions and configuration. For dimensions and configuration see Figures 1 through 3. All dimensions in Figures 1 through 3 are expressed in decimal inches. Overall terminal box dimensions are approximate. Exact dimensions are shown in MIL-E-24142/3, "Enclosure for Electrical Fittings and Fixtures, Submersible, Size 6 by 9 (15-Foot)".

3. Tolerance. All tolerances not specified herein shall be in accordance with MIL-DTL-24558.

4. Standard parts. The standard parts shown in Table I shall be used in the construction of the connection box specified herein. The numbers in circles shown on Figures 1 and 2 are the same as those shown in the "Item" column of Table I.

5. Enclosure. The enclosure shall be a 15-foot submersible type.

6. Finish. The interior of the enclosure may be painted or left unpainted at the contractor's option.



Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:44Z
Check the source to verify that this is the current version before use.

7. Weight. The weight of the connection box shall not exceed 9.0 pounds.

8. Maximum number of wires. The maximum number of wires (including spares) shall not exceed two times the number of terminals. The maximum number of wires to be connected to a single terminal shall not exceed four.

QUALITY ASSURANCE: First article inspection and quality conformance inspection shall be as specified in MIL-DTL-24558.

NOTES:

1. Drawing. The terminal box specified by this specification sheet was formerly covered on NAVSHIPS drawing no. 815-1197015.

2. Part or identifying number (PIN). The PIN to be used for terminal boxes acquired to this specification is created as follows:

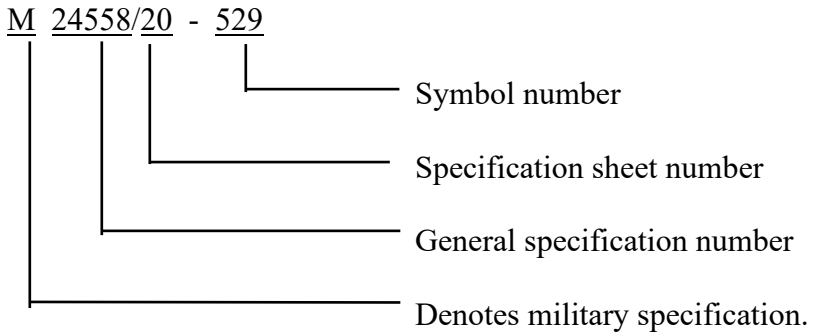



TABLE I. Parts list.

| Item | Description | Qty | Part number or specification | Remarks |
|---|---|---|---|---|
| 1 | Enclosure assembly, brass | 1 | MIL-E-24142/3 | M24142/3-001 |
| 2 | Identification plate | 1 | MIL-DTL-24558 | Figure 6 |
| 3 | Information plate | 1 | MIL-DTL-24558 | Figure 6 |
| 4 | Mounting bracket | 1 | MIL-DTL-24558 | Figure 1 [1] |
| 5 | Terminal board assembly | 1 | A-A-59125/20 | 16TB10 |
| 6 | RDH machine screw 10-24 X 0.750 | 2 | Commercial | Brass |
| 7 | Washer, #10 external tooth | 2 | Commercial | Bronze |
| 8 | RDH machine screw 6-32 X 0.250 | 4 | Commercial | Brass |
| 9 | Warning plate | 1 | MIL-DTL-15024 | Brass [2] |

[1] Height of mounting bracket shall be modified as shown in Figure 1 of MIL-DTL-24558.
[2] A 3.500-inch by 1.375-inch plate shall be brazed to the cover of the connection box as shown in Figure 1. "WARNING" (first line), and "1000 VOLTS" (second line), shall be engraved in 0.375-inch lettering. Lettering shall be filled with red enamel (Chip 21105) in accordance with SAE-AMS-STD-595.



Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:44Z
Check the source to verify that this is the current version before use.

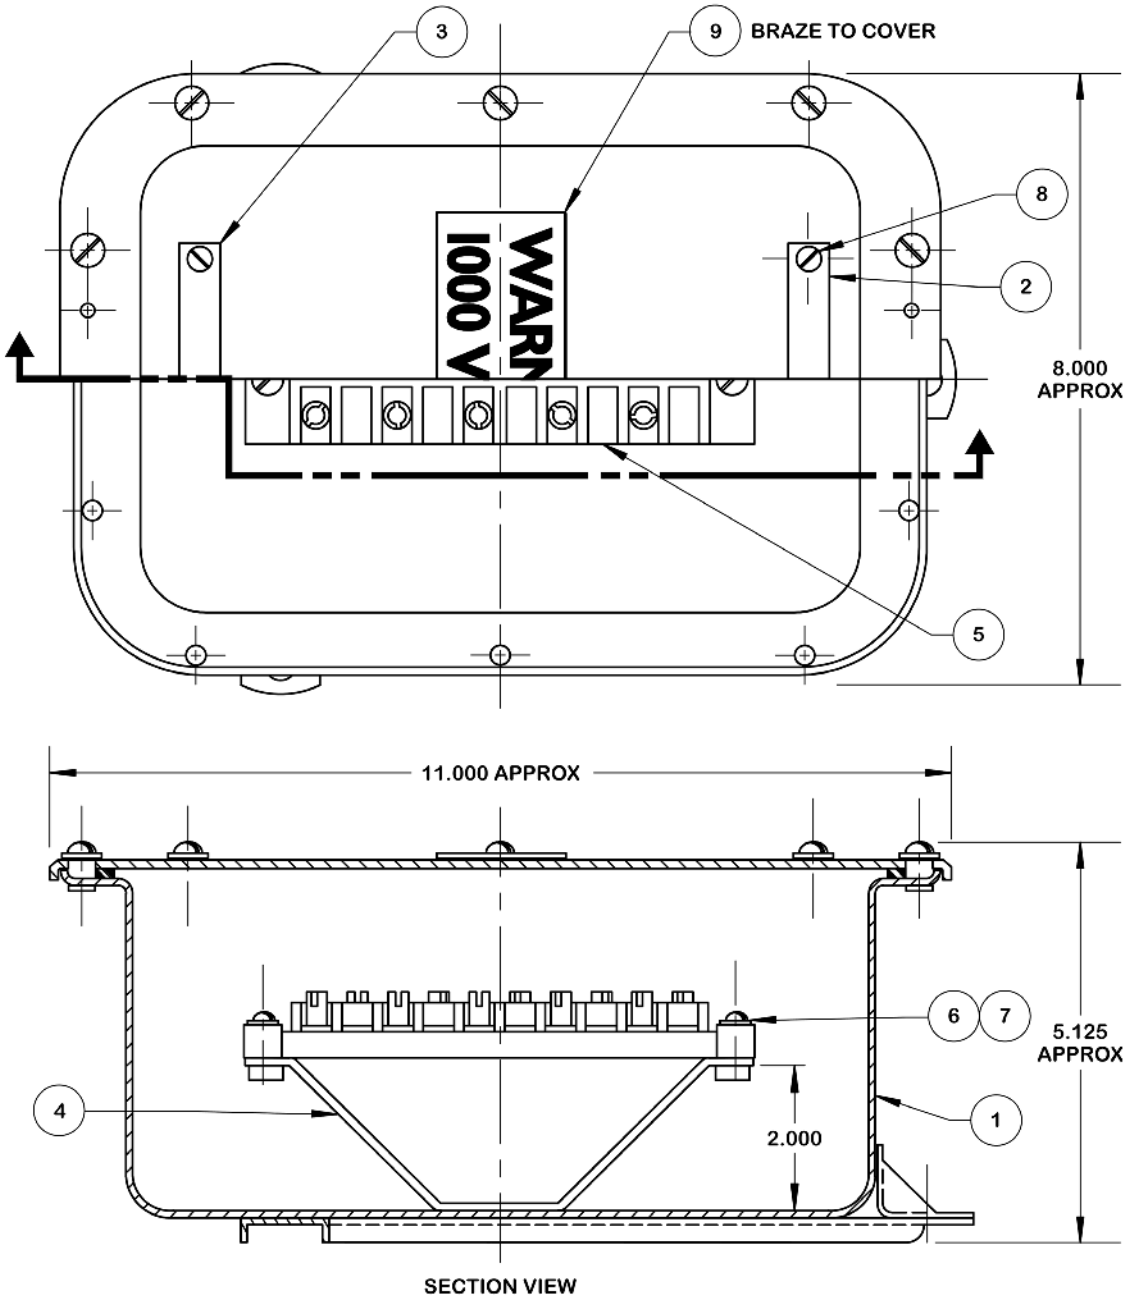



FIGURE 1. Connection box assembly.



Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:44Z
Check the source to verify that this is the current version before use.

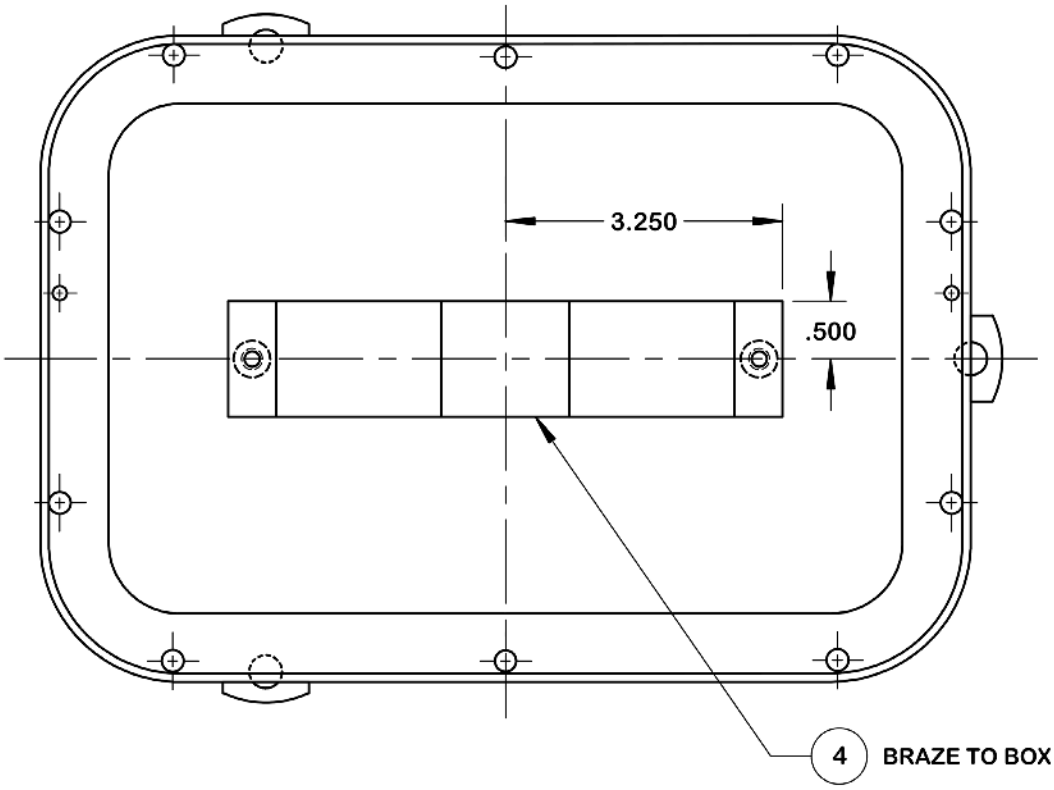



FIGURE 2. Location of terminal board mounting bracket.



Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:44Z
Check the source to verify that this is the current version before use.

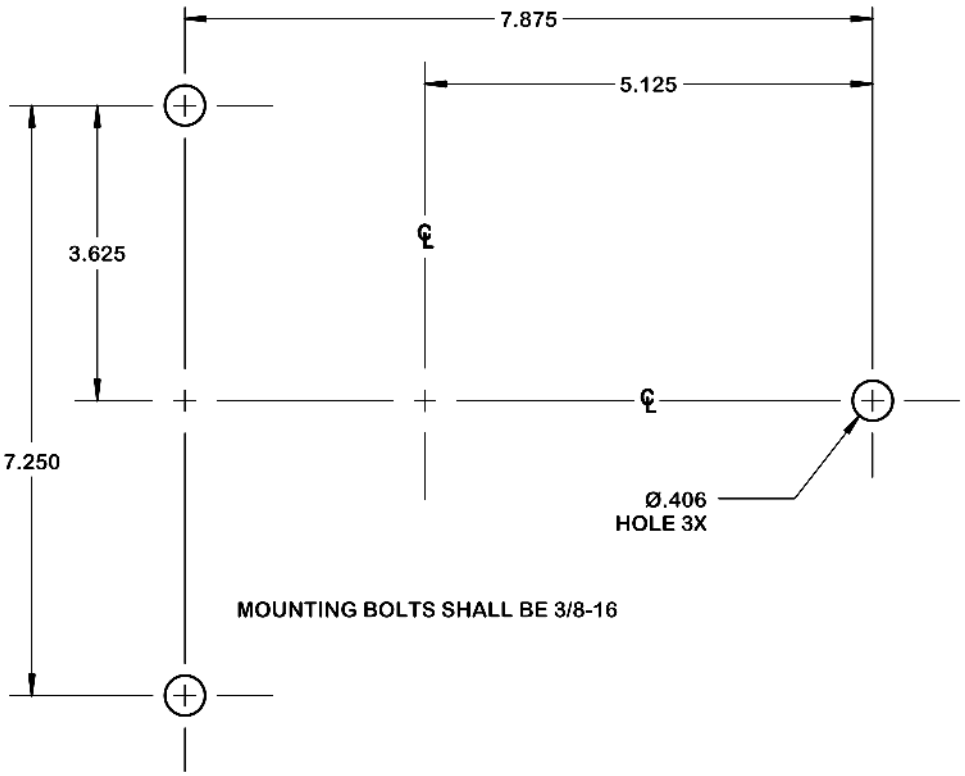



FIGURE 3. Mounting dimensions.



Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:44Z
Check the source to verify that this is the current version before use.

CHANGES FROM PREVIOUS ISSUE. Marginal notations are not used in this revision to identify changes with respect to the previous issue due to the extent of the changes.

Custodians:
Navy - SH
DLA - GS

Preparing Activity:
DLA - GS4
(Project 5940-2024-010)

NOTE: The activities listed above were interested in this document as of the date of this document. Since organizations and responsibilities can change, you should verify the currency of the information above using the ASSIST database at https://assist.dla.mil/.



Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:44Z
Check the source to verify that this is the current version before use.