INCH-POUND

MIL-DTL-24558/22B
3 October 2011
SUPERSEDING
MIL-DTL-24558/22A
w/AMENDMENT 1
17 February 2006

DETAIL SPECIFICATION SHEET

TERMINAL BOXES, CONNECTION, SUBMERSIBLE (15-FOOT), 500 VOLTS, SINGLE-PHASE, SYMBOL NO. 415 - TWO 75 MCM CABLES, SYMBOL NO. 415.1 - TWO 100 MCM CABLES, SYMBOL NO. 415.2 - TWO 125 MCM CABLES, SYMBOL NO. 415.3 - TWO 150 MCM CABLES AND SYMBOL NO. 415.4 - TWO 200 MCM CABLES

This specification is approved for use by all Departments and Agencies of the Department of Defense.

The requirements for acquiring the products described herein shall consist of this specification sheet and MIL-DTL-24558, "Terminal Boxes, Connection, for Electrical and Electronic Systems, General Specification for".

REQUIREMENTS: The terminal boxes shall be as specified herein and in accordance with tables I and II, and figures 1 through 5.

1. Electrical rating. The terminal boxes shall have an electrical rating of 500 volts root mean square, and 500 volts direct current. The maximum current shall not exceed 350 amperes per terminal lug.

2. Dimensions and configuration. For dimensions and configuration see figures 1 through 5. All dimensions in figures 1 through 5 are expressed in decimal inches. Overall terminal box dimensions are approximate. Exact dimensions are shown in MIL-E-24142/6, "Enclosure, Submersible (15-Foot), Sizes 8 by 10 Through 14 by 26".

3. Tolerance. All tolerances not specified herein shall be in accordance with MIL-DTL-24558.

4. Standard parts. The standard parts shown in table I shall be used in the construction of the connection boxes specified herein. The numbers in circles shown on figures 1, 2, 4, and 5 are the same as those shown in the "Item" column of table I.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:45Z
Check the source to verify that this is the current version before use.

5. Enclosure. The enclosures shall be a 15-foot submersible type.

6. Finish. The interior of the enclosures may be painted or left unpainted at the contractor's option.

7. Weight. The weight of the connection boxes shall not exceed 23.0 pounds.

QUALITY ASSURANCE: First article inspection and quality conformance inspection shall be as specified in MIL-DTL-24558.

NOTES:

1. Drawing. The terminal box specified by this specification sheet was formerly covered on NAVSHIPS drawing no. 9000-S6202-74194.

2. Part or identifying number (PIN). The PIN to be used for terminal boxes acquired to this specification is created as follows:

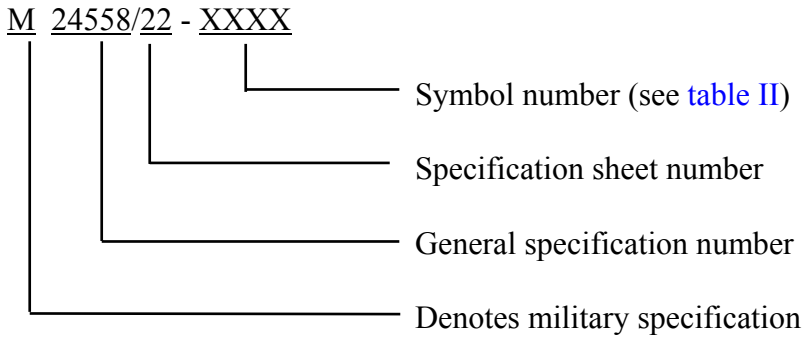


TABLE I. Parts list.

Item	Description	Qty	Part number or specification	Remarks
1	Enclosure assembly, brass with type A cover	1	MIL-E-24142/6	M24142/6-001
2	Identification plate	1	MIL-DTL-24558	Figure 6
3	Information plate	1	MIL-DTL-24558	Figure 6
4	Terminal board base	1	Figure 4	MIL-I-24768/1 type GME
5	Mounting bracket	2	MIL-DTL-24558	Figure 2
6	Terminal lug assembly	2	Figure 5	Copper
7	HEXHD machine screw 5/16-18 X 1.250	4	Commercial	Brass
8	RDH machine screw 5/16-18 X 1.000	4	Commercial	Brass
9	Washer, 5/16 internal tooth	8	Commercial	Bronze
10	RDH machine screw 5/16-18 X 0.875	4	Commercial	Brass
11	RDH machine screw 6-32 X 0.188	4	Commercial	Brass

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:45Z
Check the source to verify that this is the current version before use.

TABLE II. Symbol numbers and general information.

Symbol number	For cable size MCM [1]
415 [2]	75
415.1	100
415.2	125
415.3	150
415.4	200

[1] MCM is defined as thousand circular mils.
[2] Only this connection box will be stocked in the supply system. For other symbol numbers, installing activity should drill terminal lugs for "ØX" and "Y" dimensions shown on figure 5.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:45Z
Check the source to verify that this is the current version before use.

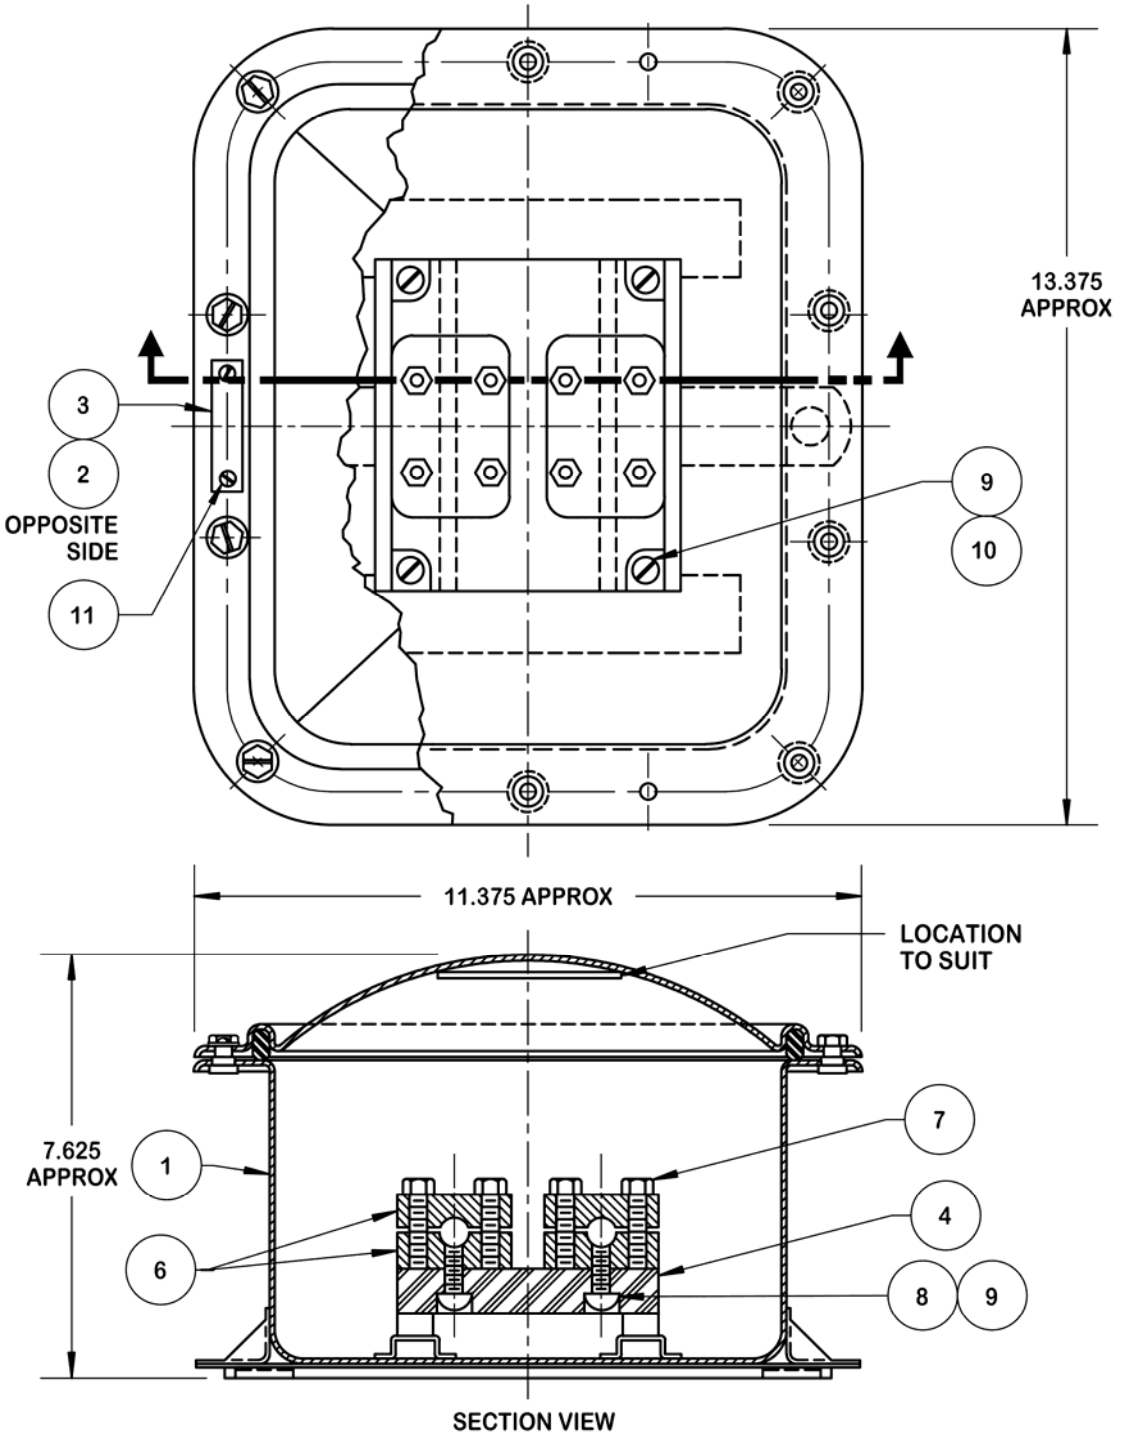


FIGURE 1. Connection box assembly.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:45Z
Check the source to verify that this is the current version before use.

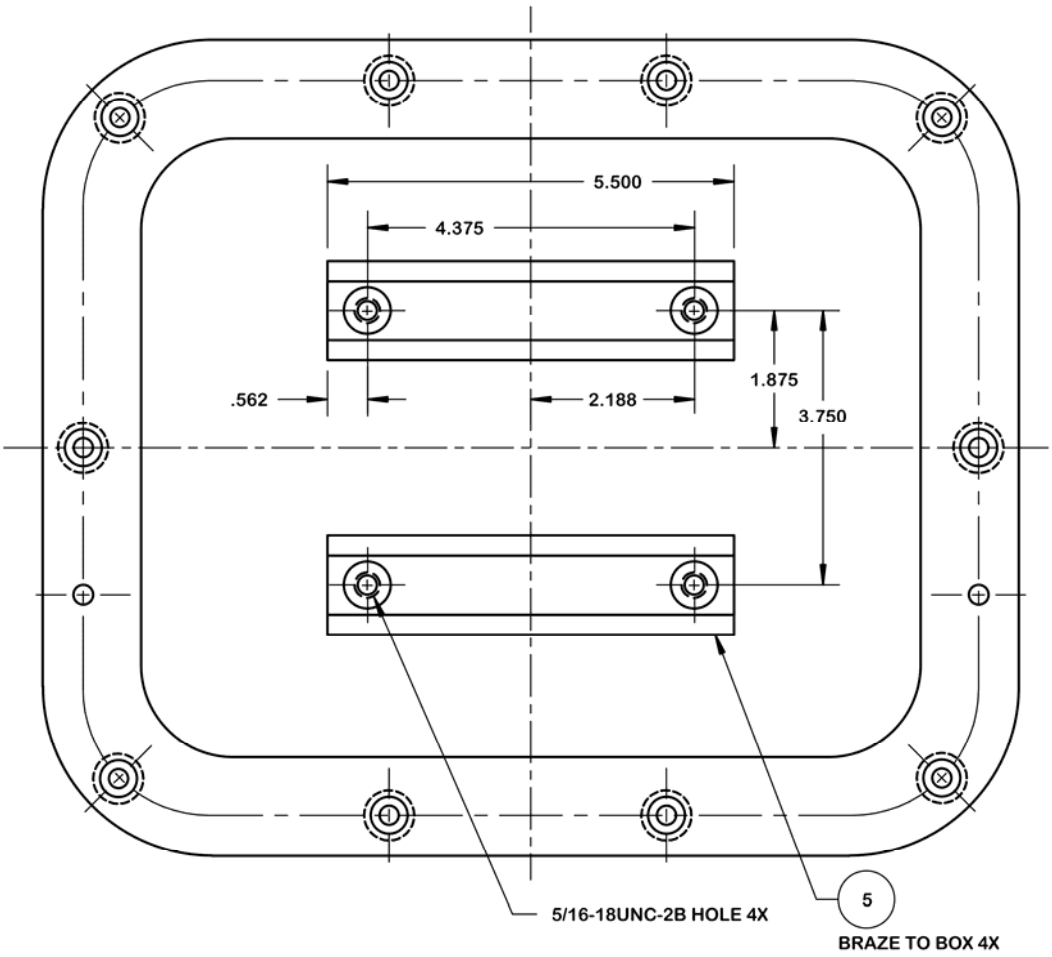


FIGURE 2. Location of terminal board mounting brackets.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:45Z
Check the source to verify that this is the current version before use.

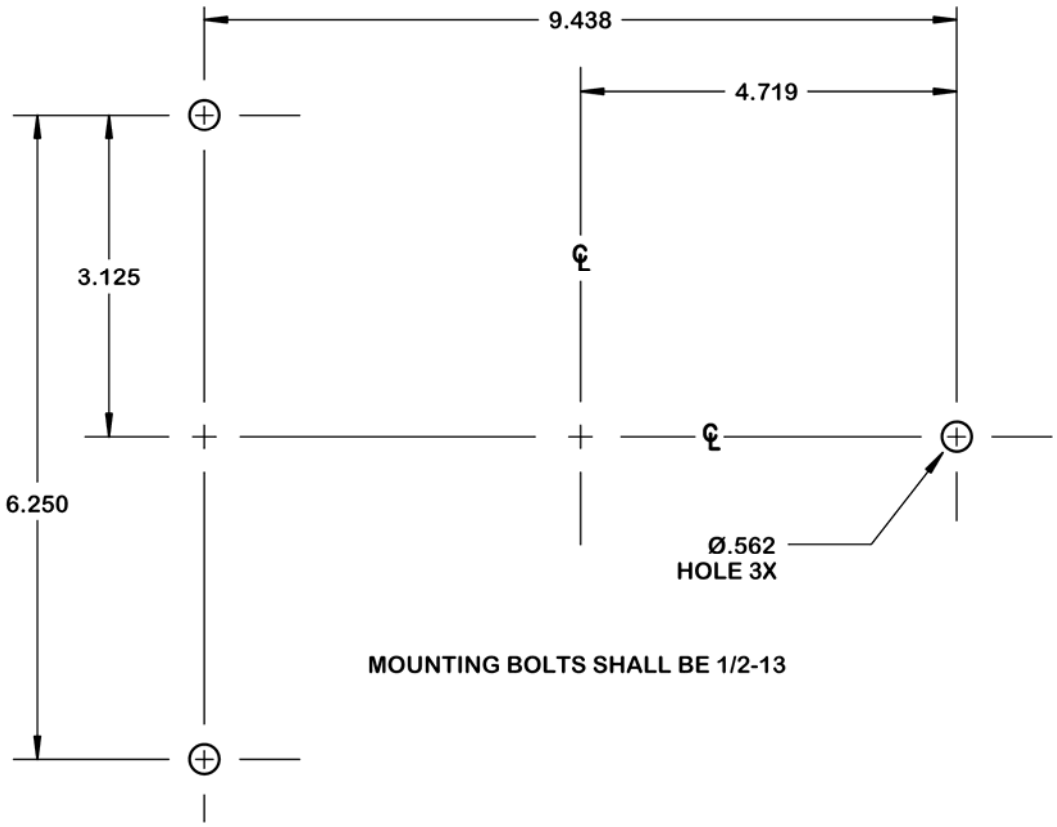


FIGURE 3. Mounting dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:45Z
Check the source to verify that this is the current version before use.

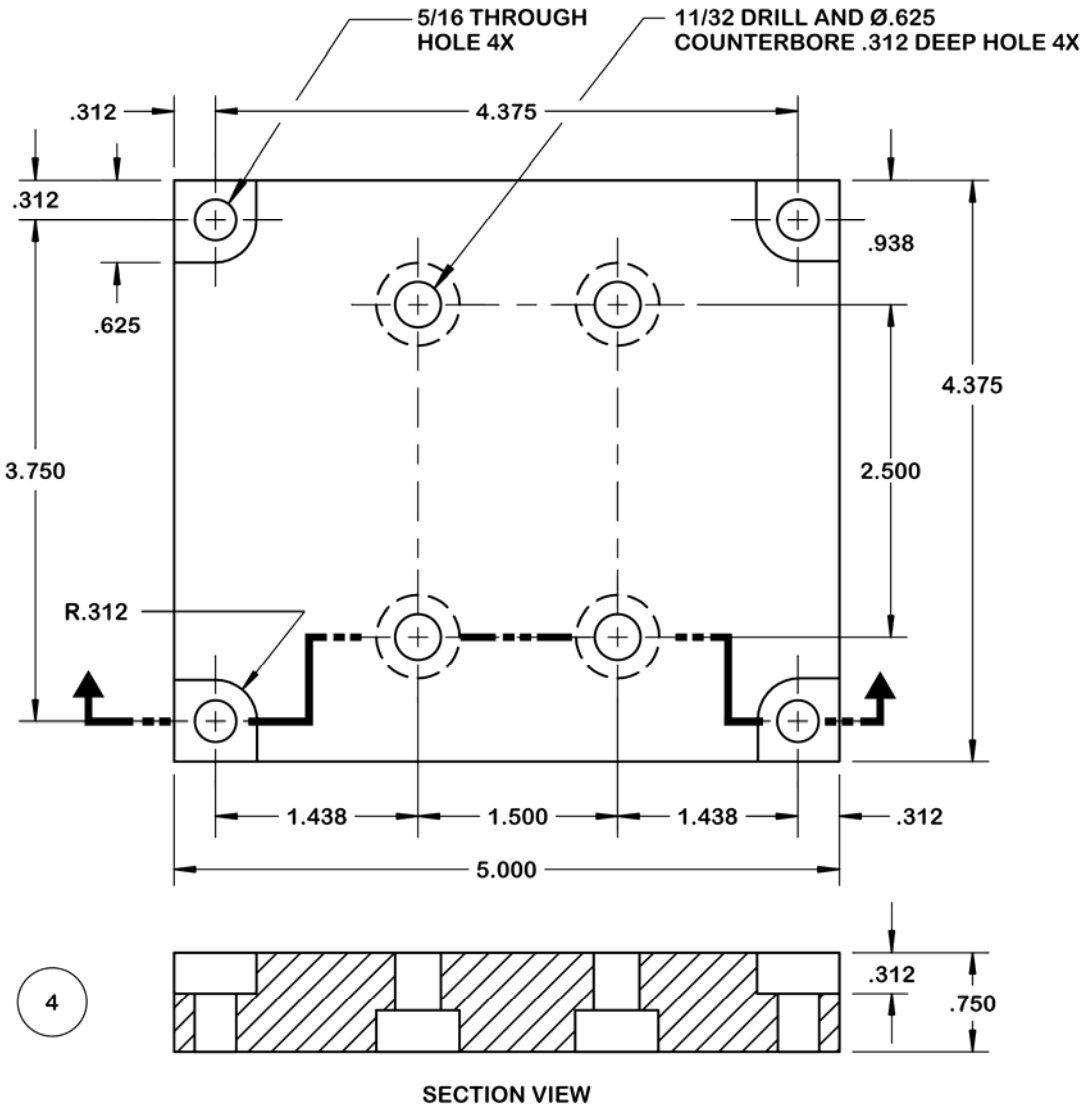


FIGURE 4. Terminal board base.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:45Z
Check the source to verify that this is the current version before use.

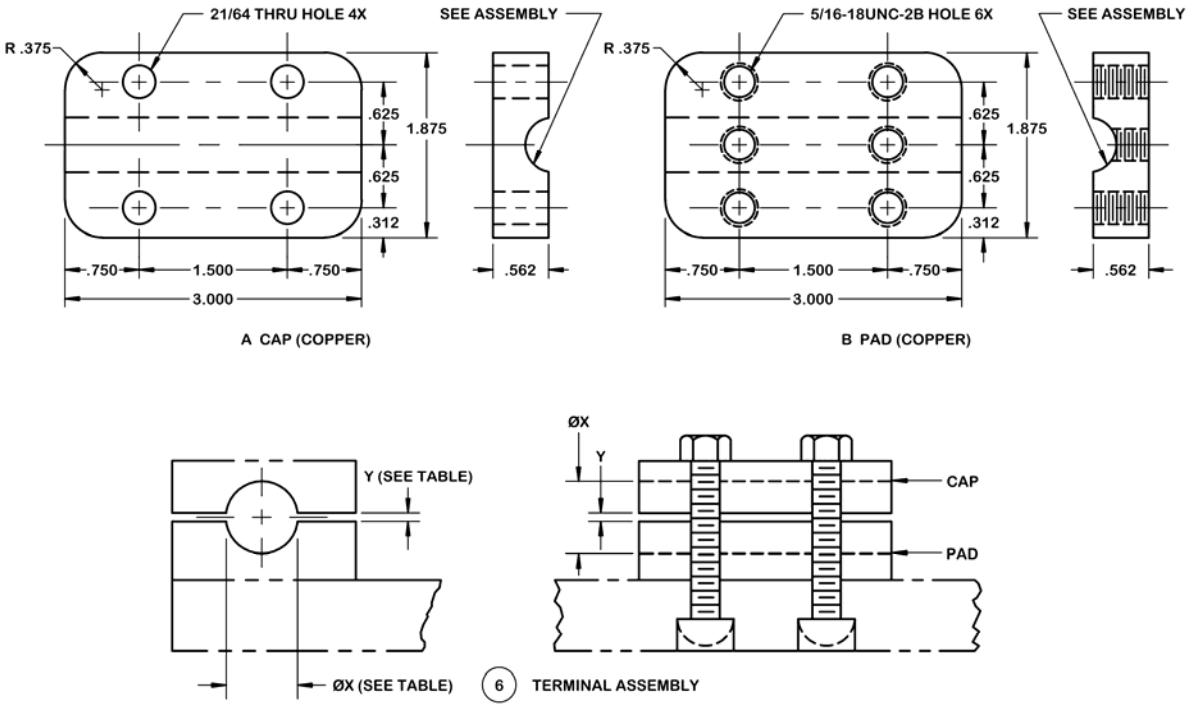


TABLE FOR DRILLING TERMINAL CAP AND PAD

Symbol numbers	Cable size MCM	ØX drill	Y
415	75	3/8	.125
415.1	100	7/16	.188
415.2	125	15/32	.188
415.3	150	17/32	.188
415.4	200	9/16	.188

FIGURE 5. Terminal lug assembly.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:45Z
Check the source to verify that this is the current version before use.

CHANGES FROM PREVIOUS ISSUE. Marginal notations are not used in this revision to identify changes with respect to the previous issue due to the extent of the changes.

Custodians:
Navy - SH
DLA - GS

Preparing Activity:
DLA - GS4

(Project 5940-2011-049)

NOTE: The activities listed above were interested in this document as of the date of this document. Since organizations and responsibilities can change, you should verify the currency of the information above using the ASSIST database at https://assist.daps.dla.mil/.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T22:45Z
Check the source to verify that this is the current version before use.