
NOTICE: When Government drawings, specifications, or other data are used for any purpose other than in connection with a definitely related Government procurement operation, the United States Government thereby incurs no responsibility, nor any obligation whatsoever; and the fact that the Government may have formulated, furnished, or in any way supplied the said drawings, specifications, or other data is not to be regarded by implication or otherwise as in any manner licensing the holder or any other person or corporation, or conveying any rights or permission to manufacture, use, or sell any patented invention that may in any way be related thereto.

FED. SUP CLASS. 6115

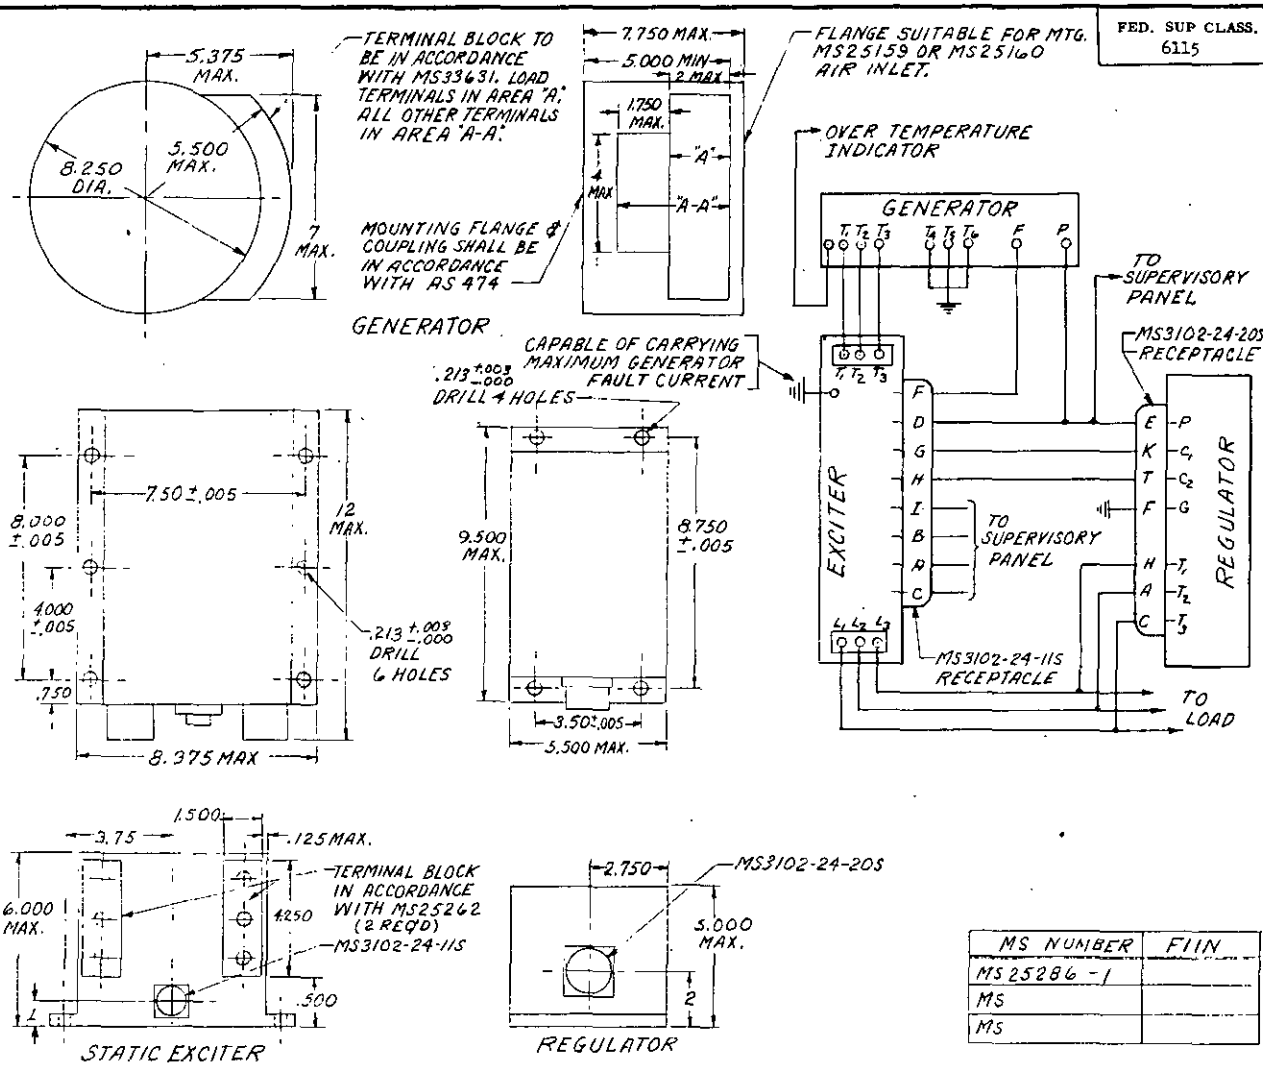

MS NUMBER	FIIN
MS 25286 -1	
MS	
MS	

GENERATOR DATE	
RATED VOLTAGE	120/208 V (see Note a)
Rated Output	20 KVA
Phase	3
Speed Range	7600-8400 RPM
Max Speed For Regulation	9000 RPM
Overspeed	11000 RPM
Rated Power Factor	.75 Lagging to 1.0
Efficiency Min At Rated Load	75%
Max Weight	45 lb.
Overhung Moment, Max	300 In. lb.
Frequency	380-420 CPS
Class	C

REGULATOR DATA	
Regulator Weight Max	8 lb.
Voltage Regulation Limits For All Conditions As Per Figure 8 Of Specification	

STATIC EXCITER DATA	
Static Exciter Weight Max	17 lb.

NOTES:
(a) The rated voltage of the generator shall be that voltage at the output terminals of the exciter.
(b) Prior to delivery the regulator shall be set at 115/200 plus or minus 0.5/0.86 volts.
(c) The aircraft manufacturer shall allow connecting lead length and blast tube length for the limiting generator dimensions shown on this drawing.
(d) The aircraft manufacturer shall provide connecting leads shown.
(e) The aircraft manufacturer shall allow adequate clearance for installing and removing from the aircraft the generator shown on this standard.
(f) The aircraft manufacturer shall provide connecting leads from the static exciter to the generator field which will not exceed 0.15 ohms.
(g) The generating system shall be qualification tested with an external resistance of 0.15 ohms minimum in the generator field circuit.
(h) The generator system shall be so designed that upon removal of any connector plug the generator and regulator shall be deenergized.
(i) Dimensions in inches unless otherwise specified. Tolerances: Decimals ± .062
(j) All outline dimensions are limiting dimentions only.
(k) This standard takes precedance over documents referenced herein.
(l) Referenced documents are of the issue in effect on date of invitations for bid.

(A) CANCELLED AFTER 28 April 1966 NO SUPERSEDING STANDARD

APPROVED 11/6/57 REVISED (A) 28 April 1966

CUSTODIANS	OTHER INT.
Navy - BuAer	A -
	N -
	AF -

MILITARY STANDARD

GENERATOR & REGULATOR AC, AIRCRAFT, STATIC EXCITER, 20KVA, 3 PHASE, 380-420 CPS

MS25286 (AER)

PROCUREMENT SPECIFICATION

SUPERSEDES:

SHEET | OF |

Source: https://assist.dla.mil - Downloaded: 2026-10-23 15:07Z
Check the source to verify that this is the current version before use.