INCH-POUND
A-A-50604
10 August 1993

COMMERCIAL ITEM DESCRIPTION

EXPANSION JOINT, SLEEVED, (NON-FLANGED), FIRE-RETARDANT, WITH RETAINING CLAMPS

The General Services Administration has authorized the use of this commercial item description as a replacement for MIL-E-15330 which is canceled in part.

1. Abstract. This description covers sleeved, fire resistant rubber expansion joints and retaining clamps identified as class B in MIL-E-15330. Each expansion joint shall be defined by size as indicated below.

Size designation	Inside diameter (inches nominal)
A	2
B	2-1/2
C	3
D	4
E	6
F	8
G	10
H	12

2. Salient characteristics.

2.1 Configuration. The body of the expansion joint shall be convoluted and constructed with a minimum of 3 plies of reinforcing fabric. The fabric may be nylon, polyester, or aramid. An outer ply of aluminized glass cloth fabric shall be applied for fire resistance. The retaining clamps shall be fabricated of 316 corrosion resisting steel. The end to end dimension for all sizes shall be 7 inches. The general configuration of the expansion joints and retaining clamps shall be as specified on figure 1 (A) and (B).

Beneficial comments (recommendations, additions, deletions) and any pertinent data which may be of use in improving this document should be addressed to: Commander, Naval Sea Systems Command, SEA 03Q42, 2531 Jefferson Davis Hwy, Arlington, VA 22242-5160 by using the self-addressed Standardization Document Improvement Proposal (DD Form 1426) appearing at the end of this document or by letter.

AMSC N/A FSC 4730

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T08:45Z
Check the source to verify that this is the current version before use.

2.2 Tensile and elongation properties. The minimum tensile properties of the rubber used shall be 1500 pounds per square inch (psi) initial and 1200 psi after aging. Elongation minimums shall be 300 percent initial and 180 percent after aging. Aging shall be accomplished by subjecting the samples to dry circulating air at 212 ± 5°F for a period of 70 hours.

2.3 Workmanship. Expansion joints shall be free of voids, foreign inclusions, soft spots, and blisters. Retaining clamps shall be free of sharp edges.

3. Quality assurance provisions.

3.1 Proof pressure. Each expansion joint submitted for delivery shall pass a proof test to 250 psi for a period of 10 minutes.

3.2 Marking. Each expansion joint shall have a label containing the following:

(a) This specification number.
(b) Manufacturer's name or logo.
(c) Contract number and date.
(d) Expansion joint size.


4. Contractor certification. The contractor shall certify and maintain substantiating evidence that the product offered meets the salient characteristics of this Commercial Item Description, and that the product conforms to the producers own drawings, specifications, standards, and quality assurance practices. The government reserves the right to require proof of such conformance prior to first delivery and thereafter as may be otherwise provided for under the provisions of the contract.

5. Regulatory requirements. The offeror/contractor is encouraged to use recovered materials in accordance with Public Law 94-580 to the maximum extent practicable.


6. Preservation, packaging, packing, labeling, and marking. The preservation, packaging, packing, labeling, and marking shall be as specified in the contract or order.

Preparing activity:
Navy - SH
(Project 4730-N097)

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T08:45Z
Check the source to verify that this is the current version before use.

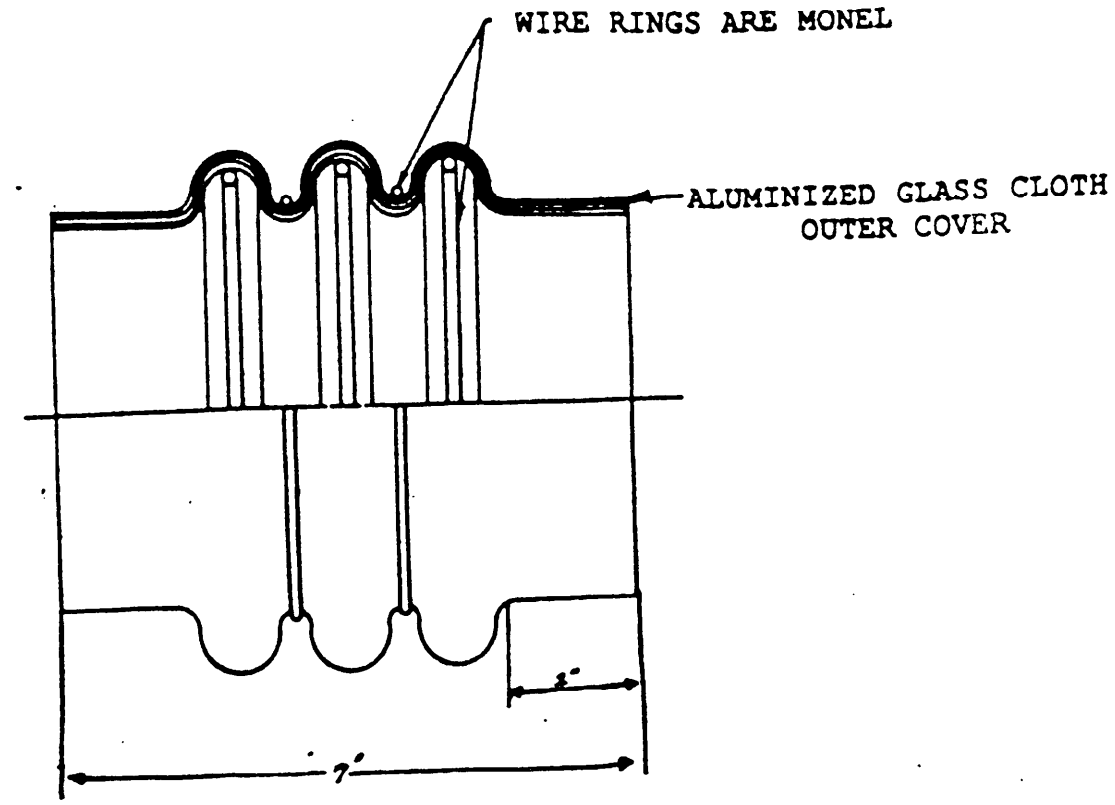

(A) SLEEVED (NON-FLANGED) EXPANSION JOINT

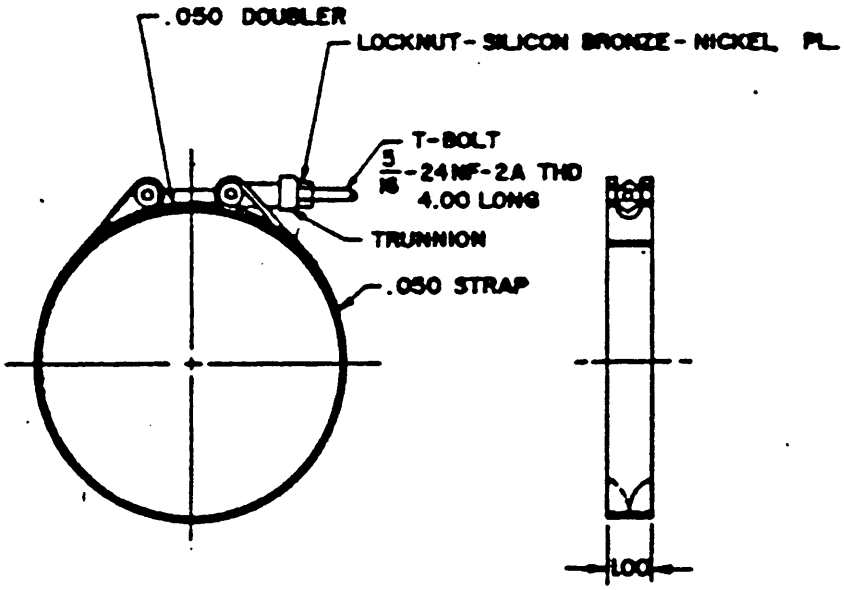

(B) RETAINING CLAMP FOR SLEEVED EXPANSION JOINT

FIGURE 1. General configuration.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T08:45Z
Check the source to verify that this is the current version before use.

STANDARDIZATION DOCUMENT IMPROVEMENT PROPOSAL

INSTRUCTIONS

1. The preparing activity must complete blocks 1, 2, 3, and 8. In block 1, both the comment number and revision letter should be given.
2. The submitter of this form must complete blocks 4, 5, 6, and 7.
3. The preparing activity must provide a reply within 30 days from receipt of this form.

NOTE: This form may not be used to request copies of documents, nor to request waivers, or clarification of requirements on current contracts. Comments submitted on this form do not constitute or imply authorization to waive any portion of the referenced document(s) or to amend contractual requirements.

I RECOMMEND A CHANGE:	1. DOCUMENT NUMBER A-A-50604	2. DOCUMENT DATE (YYMMDD) 93/08/10

3. DOCUMENT TITLE
EXPANSION JOINT, SLEEVED, (NON-FLANGED), FIRE-RETARDANT, WITH RETAINING CLAMPS

4. NATURE OF CHANGE (identity paragraph number and include proposed rewrite, if possible. Attach extra sheets as needed.)

5. REASON FOR RECOMMENDATION

6. SUBMITTER

A. NAME (Last, First, Middle Initial)	b. ORGANIZATION	
c. ADDRESS (include Zip Code)	d. TELEPHONE (Include Area Code) (1) Commercial (2) DSN (if applicable)	7. DATE SUBMITTED (YYMMDD)

8. PREPARING ACTIVITY

A. NAME Technical Point of Contact (TPOC) MR. CARL BANKS, SEA 03Y23 ADDRESS ALL CORRESPONDENCE AS FOLLOWS:	b. TELEPHONE (Include Area Code) (1) Commercial: DSN: TPOC: 703-602-0367 8-332-0367
c. ADDRESS (Include Zip Code) COMMANDER, NAVAL SEA SYSTEMS COMMAND ATTN: SEA 03Q42 2531 JEFFERSON DAVIS HIGHWAY ARLINGTON, VA 22242-5160	IF YOU DO NOT RECEIVE A REPLY WITHIN 45 DAYS, CONTACT: Defense Quality and Standardization Office 5203 Leesburg Pike, Suite 1403 Falls Church, VA 22041-3466 Telephone 703-756-2340 DSN 289-2340

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T08:45Z
Check the source to verify that this is the current version before use.