INCH-POUND
MS18307C(SH)
12 July 2016
SUPERSEDING
MS18307B(SH)
29 July 1982

MILITARY SPECIFICATION SHEET

LATERALS (Y-BRANCH), FORGED STEEL SOCKET WELDING, 3000 PSI AT 1000 °F (MAX.) STEAM SERVICE

This specification is approved for use by the Naval Sea Systems Command and is available for use by all Departments and Agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet.

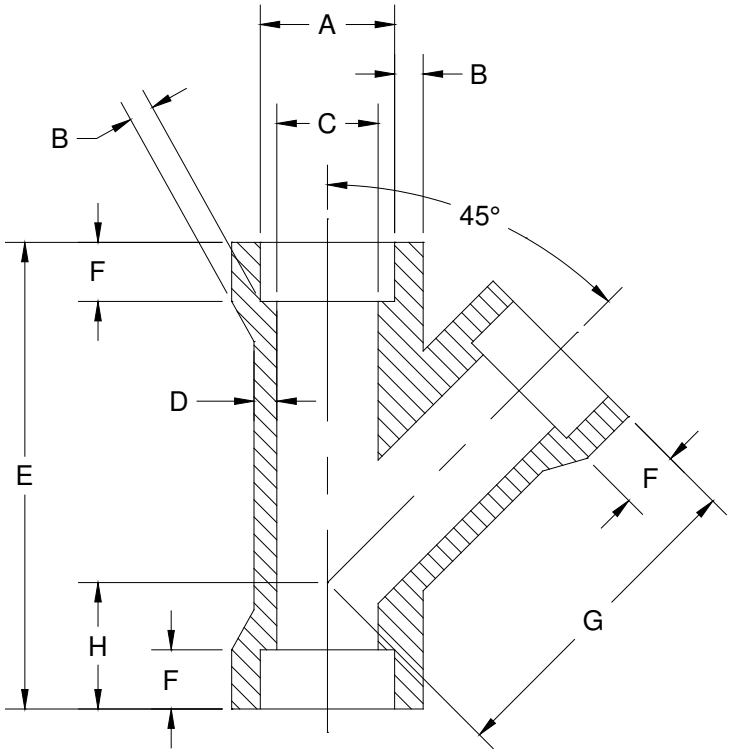


FIGURE 1. Lateral (Y-Branch).

Comments, suggestions, or questions on this document should be addressed to Commander, Naval Sea Systems Command, ATTN: SEA 05S, 1333 Isaac Hull Avenue, SE, Stop 5160, Washington Navy Yard DC 20376-5160 or emailed to CommandStandards@navy.mil, with the subject line "Document Comment". Since contact information can change, you may want to verify the currency of this address information using the ASSIST Online database at https://assist.dla.mil.

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T14:19Z
Check the source to verify that this is the current version before use.

TABLE I. Lateral (Y-Branch) dimensions (inches).

Nominal Pipe Size	Socket Bore Dia. A 1/	Socket Wall Thickness B 2/		Bore Dia. C 1/	Body Wall D Min.	E Min.	Socket Depth F. Min.	G Min.	H Min.
		Avg.	Min.						
¼	0.575 0.555	0.149	0.130	0.394 0.334	0.119	2 5/16	0.380	1 5/8	11/16
3/8	0.710 0.690	0.158	0.138	0.523 0.463	0.126	2 11/16	0.380	1 7/8	11/16
½	0.875 0.855	0.184	0.161	0.652 0.592	0.147	3	0.380	2 1/8	13/16
¾	1.085 1.065	0.193	0.168	0.854 0.794	0.154	3 9/16	0.500	2 9/16	1
1	1.350 1.330	0.224	0.196	1.079 1.019	0.179	4 1/8	0.500	3	1 1/16
1¼	1.695 1.675	0.239	0.208	1.410 1.350	0.191	4 13/16	0.500	3½	1 3/16
1½	1.935 1.915	0.250	0.218	1.640 1.580	0.200	5 7/8	0.500	3 15/16	1 15/16
2	2.426 2.406	0.273	0.238	2.097 2.037	0.218	6 7/16	0.620	4¾	1 5/8

FOOTNOTES:

1/ Upper and lower values for each size are the respective maximum and minimum dimensions.

2/ Average of socket wall thickness around periphery shall be no less than the listed values. The minimum values are permitted in localized areas.

NOTES:

1. All procurement documents shall specify the number and revision of this standard and the size required.
2. Material of fittings made from this standard shall be chromium-molybdenum alloy steel, 1¼ chromium, ½ molybdenum in accordance with ASTM A182/A182M Grade F-11, Class 2.
3. Unless otherwise noted in this standard, fittings shall conform to ASME B16.11.

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T14:19Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Unless otherwise noted herein or in the contract, in the event of a conflict between the text of this document and the following references cited herein, the text of this document takes precedence. Nothing in this document, however, supersedes applicable laws and regulations unless a specific exemption has been obtained.

ASME B16.11, Forged Fittings, Socket-Welding and Threaded

(Copies of ASME documents are available online at www.asme.org.)

ASTM A182/A182M, Standard Specification for Forged or Rolled Alloy and Stainless Steel Pipe Flanges, Forged Fittings, and Valves and Parts for High-Temperature Service

(Copies of ASTM documents are available online at www.astm.org.)

CHANGES FROM PREVIOUS ISSUE. Marginal notations are not used in this revision to identify changes with respect to the previous issue due to the extent of the changes.

Preparing activity:
Navy – SH
(Project 4730-2016-029)

NOTE: The activities listed above were interested in this document as of the date of this document. Since organizations and responsibilities can change, you should verify the currency of the information above using the ASSIST Online database at https://assist.dla.mil.

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T14:19Z
Check the source to verify that this is the current version before use.