MILITARY SPECIFICATION SHEET

PANEL, GROUND DETECTOR, 120-VOLT (SYMBOL 1005.3) AND

240-VOLT (SYMBOL 1005.4) DIRECT CURRENT, DRIPPROOF

The complete requirements for procuring ground detector panel described herein shall consist of this document and the latest issue of specification MIL-P-24395(SHIPS).

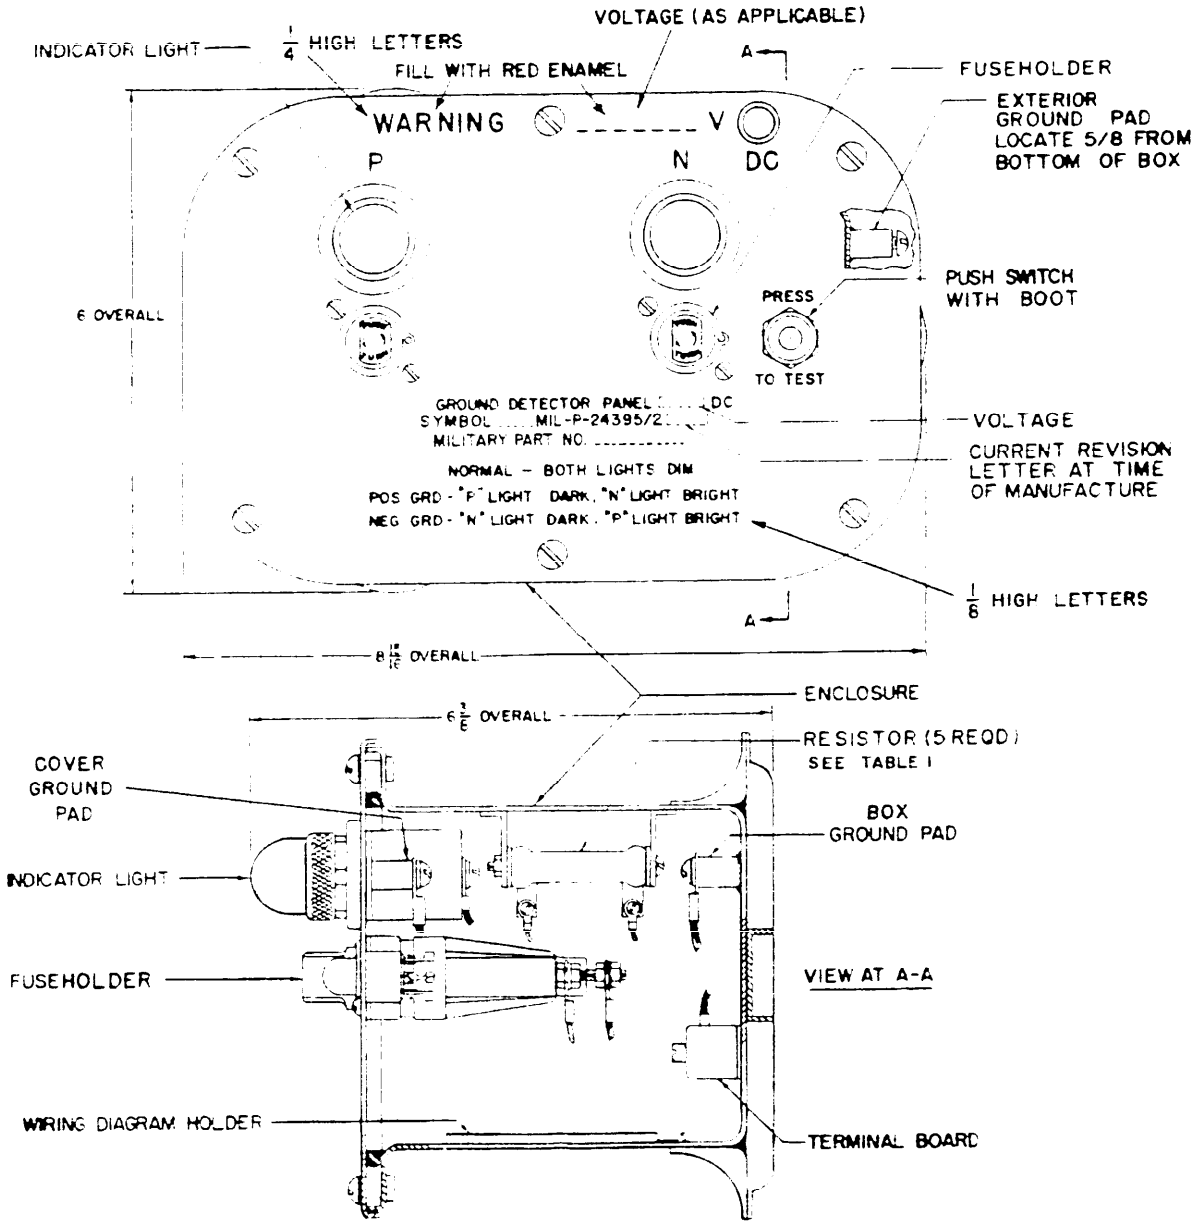



Figure 1 - Ground detector Panel.

NOTES:

1. All dimensions are in inches, unless otherwise specified. Tolerances are ±1/64 for fractions and ±.005 for decimals.
2. Keep face of ground pads free of paint.

FSC 6110

Source: https://assist.dla.mil -- Downloaded: 202610-19T21:46Z
Check the source to verify that this is the current version before use.

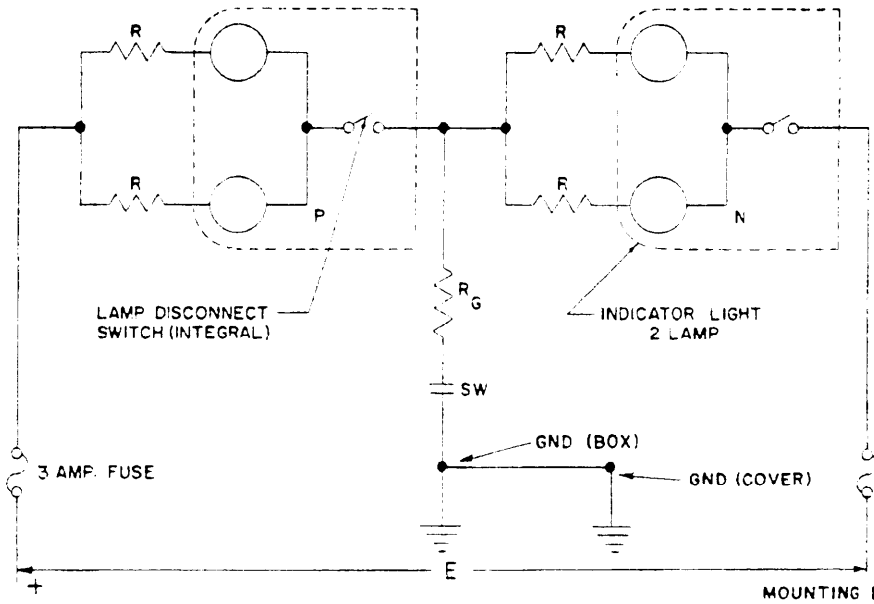

SH 9984

FIGURE-2 WIRING DIAGRAM FOR D.C. GROUND DETECTOR

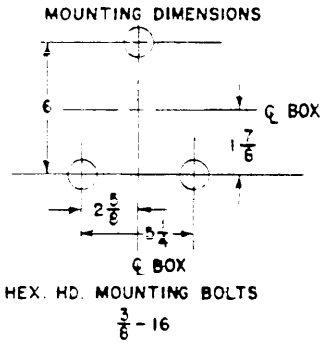


TABLE I

PARTS FOR ONE UNIT					
SYMBOL NO.	MILITARY PART NO.	VOLTAGE APPLICATION (E)	RESISTOR√ (R)	RESISTOR√ (RG)	FUSEHOLDER
1005.3	M24395/2-001	120 D.C.	RW29V112	RW29V631	MIL-F-19207/2 TYPE FHL1IU
1005.4	M24395/2-002	240 D.C.	RW29V282	RW29V142	MIL-F-19207/2 TYPE FHL1IU

√ MIL-R-26/3

Source: https://assist.dla.mil -- Downloaded: 202610-19T21:46Z
Check the source to verify that this is the current version before use.

REQUIREMENTS

Enclosure: Shall conform to MIL-J-24142/4-001.

Push Switch: Type specified in MIL-S-8805/20 with boot specified in MIL-B-5423/7.

Indicator Light:

Housing: Style LH95 of MIL-L-3661/62.

Lenses: Type LC40CN3 of MIL-L-3661/54.

Lamp: Incandescent, T-1-3/4, midget screw base, MS15612-5.

Resistor: Resistors shall be in accordance with MIL-R-26/3, type as specified in table I.

Fuseholders: As specified in table I.

Fuses: Type F03A250V3A for 120 volts and 240 volts in accordance with MIL-F-15160/3.

Terminal Board: Type 9TB4 as shown in MIL-T-55164/15.

Interior Wiring: Type B, size 16 in accordance with MIL-W-16878/1.

Degree of enclosure: Dripproof.

Part number: Consists of the basic number of this specification and a dash number taken from table I.

Example: M24395/2-001.

Preparing activity:
Navy - SH
(Project 6110-N077)

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T21:46Z
Check the source to verify that this is the current version before use.

SPECIFICATION ANALYSIS SHEET

Form Approved
Budget Bureau No. 119-R004

INSTRUCTIONS

This sheet is to be filled out by personnel either Government or contractor, involved in the use of the specification in procurement of products for ultimate use by the Department of Defense. This sheet is provided for obtaining information on the use of this specification which will insure that suitable products can be procured with a minimum amount of delay and at the least cost. Comments and the return of this form will be appreciated. Fold on lines on reverse side, staple in corner, and send to preparing activity *(as indicated on reverse hereof)*.

SPECIFICATION

ORGANIZATION *(Of submitter)* | CITY AND STATE

CONTRACT NO. | QUANTITY OF ITEMS PROCURED | DOLLAR AMOUNT
$

MATERIAL PROCURED UNDER A

☐ DIRECT GOVERNMENT CONTRACT ☐ SUBCONTRACT

1. HAS ANY PART OF THE SPECIFICATION CREATED PROBLEMS OR REQUIRED INTERPRETATION IN PROCUREMENT USE?

A. GIVE PARAGRAPH NUMBER AND WORDING.

B. RECOMMENDATIONS FOR CORRECTING THE DEFICIENCIES.

2. COMMENTS ON ANY SPECIFICATION REQUIREMENT CONSIDERED TOO RIGID

3. IS THE SPECIFICATION RESTRICTIVE?

☐ YES ☐ NO IF "YES", IN WHAT WAY?

4. REMARKS *(Attach any pertinent data which may be of use in improving this specification. If there are additional papers, attach to form and place both in an envelope addressed to preparing activity)*

SUBMITTED BY *(Printed or typed name and activity)* | DATE

DD, FORM 1 APR 63 1426 REPLACES NAVSHIPS FORM 4863, WHICH IS OBSOLETE 0101-807-2000

Source: https://assist.dla.mil -- Downloaded: 202610-19T21:46Z
Check the source to verify that this is the current version before use.

FOLD

DEPARTMENT OF THE NAVY
Naval Ship Engineering Center
Center Building
Prince George's Center
Hyattsville, Maryland 20782

POSTAGE AND FEES PAID
NAVY DEPARTMENT

OFFICIAL BUSINESS

Commander, Naval Ship Engineering Center
DOI Standardization Program & Documents Branch
Center Building
Prince George's Center
Hyattsville, Maryland 20782

FOLD

Source: https://assist.dla.mil -- Downloaded: 202610-19T21:46Z
Check the source to verify that this is the current version before use.