
NOTICE: When Government drawings, specifications, or other data are used for any purpose other than in connection with a definitely related Government procurement operation, the United States Government thereby incurs no responsibility, nor any obligation whatsoever; and the fact that the Government may have formulated, furnished, or in any way supplied the said drawings, specifications, or other data is not to be regarded by implication or otherwise as in any manner licensing the holder or any other person or corporation, or conveying any rights or permission to manufacture, use, or sell any patented invention that may in any way be related thereto.

FED. SUP. CLASS. 6110

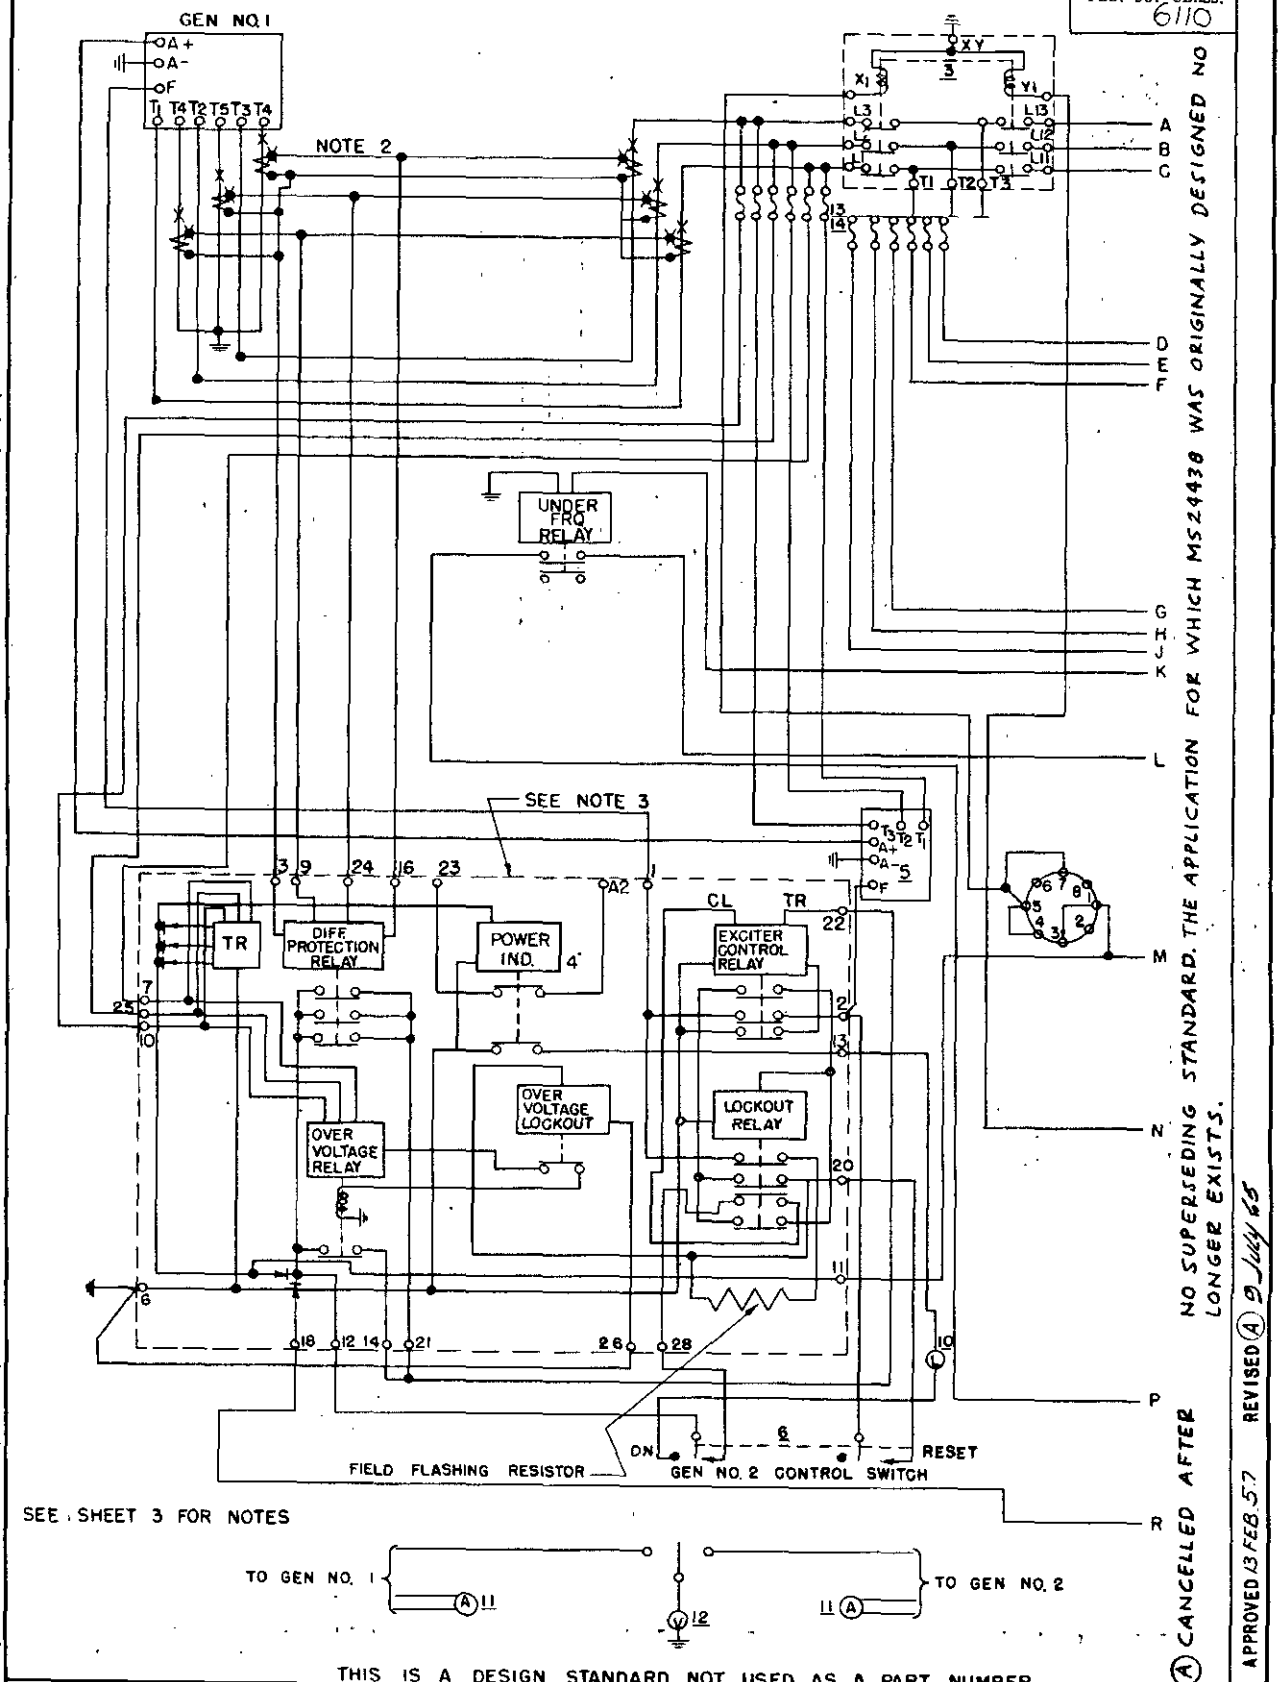

SEE SHEET 3 FOR NOTES

(A) CANCELLED AFTER NO SUPERSEDING STANDARD. THE APPLICATION FOR WHICH MS24438 WAS ORIGINALLY DESIGNED NO LONGER EXISTS.

APPROVED 13 FEB 57 REVISED (A) 9 July 65

THIS IS A DESIGN STANDARD, NOT USED AS A PART NUMBER

CUSTODIANS	OTHER INT.	MILITARY STANDARD	MS24438 (USAF)
Air Force		WIRING DIAGRAM – 115/200V, 3 PHASE VARIABLE FREQUENCY SYSTEM, MANUAL BUS SELECTION, SCHEMATIC	
PROCUREMENT SPECIFICATION NONE		SUPERSEDES:	SHEET 1 OF 3

DD FORM 672-1
1 OCT 52

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T14:54Z
Check the source to verify that this is the current version before use.

MILITARY STANDARD
WIRING DIAGRAM, 115/200V, 3 PHASE VARIABLE FREQUENCY SYSTEM, MANUAL BUS SELECTION, SCHEMATIC
MS24439 (USAF)
SHEET 2 OF 2
SUPERSEDES:
NONE
THIS IS A DESIGN STANDARD NOT USED AS A PART NUMBER
PREPARED IN ACCORDANCE WITH MIL-STD-100

Source: https://assist.dla.mil -- Downloaded: 2026-10-23114:54Z
Check the source to verify that this is the current version before use.

NOTICE: When Government drawings, specifications, or other data are used for any purpose other than in connection with a definitely related Government procurement operation, the United States Government thereby incurs no responsibility, nor any obligation whatsoever; and the fact that the Government may have formulated, furnished, or in any way supplied the said drawings, specifications, or other data is not to be regarded by implication or otherwise as in any manner licensing the holder or any other person or corporation, or conveying any rights or permission to manufacture, use, or sell any patented invention that may in any way be related thereto.

DD FORM 672
1 OCT 52

CUSTODIANS: Air Force
OTHER INT.:
Procurement Specification: NONE

THIS IS A DESIGN STANDARD. NOT USED AS A PART NUMBER.

WIRING DIAGRAM-115/200 V, 3 PHASE VARIABLE FREQUENCY SYSTEM, MANUAL BUS SELECTION -SCHEMATIC-

SUPERSEDES: USAF DRAWING 52D6720

MILITARY STANDARD

MS24438 (USAF)

SHEET 3 OF 3

No.	NAME	IDENTIFICATION			
		30 KVA SYSTEM	60 KVA SYSTEM	90 KVA SYSTEM	120 KVA SYSTEM
1	A.C. GEN.-3 ϕ VAR. FREQ.	MIL-G-6464	MIL-G-6099	MIL-G-6099	NOT AVAILABLE
2	EXTERNAL POWER RECP.	AN3114-18	AN3114-18	AN3114-18	AN3114-18
3	RELAY 3PDT	AN3344-2	NOT AVAILABLE	NOT AVAILABLE	NOT AVAILABLE
4	GENERATOR CONTROL PANEL	EXHIBIT WCEEE-1-22	EXHIBIT WCEEE-1-22	EXHIBIT WCEEE-1-22	EXHIBIT WCEEE-1-22
5	VOLTAGE REGULATOR	MIL-R-6658	MIL-G-6099	MIL-G-6099	NOT AVAILABLE
6	GEN. CONTROL SW.	AN3227-5	AN3227-5	AN3227-5	AN3227-5
7	BUS SELECTOR SW	MS25002-6	MS25002-6	MS25002-6	MS25002-6
8	CIRCUIT BREAKER	MS25017-5	MS25017-5	MS25017-5	MS25017-5
9	PHASE SEQ. INDICATOR	TYPE A-1 32645	TYPE A-1 32645	TYPE A-1 32645	TYPE A-1 32645
10	INDICATOR LIGHT	AN3157-6	AN3157-6	AN3157-6	AN3157-6
11	A.C. AMMETER	H-1	H-1	NOT AVAILABLE	NOT AVAILABLE
12	A.C. VOLTMETER	←	AN3202-1 (MODIFIED	FOR 1000 C.P.S.)	→
13	FUSES	←	MIL-F-5272		→
14	FUSE BLOCKS	←	MIL-F-5273		→
15	RELAY 3PST	←	AN3335, AN3339 OR	AN3341 TO SUIT	→

SELECTOR SWITCH POSITIONS:
2-EXTERNAL POWER
3-OFF
4-GEN. No.1 ON BUS No.1 AND GEN. No.2 ON BUS No.2
5-GEN. No.1 ON BUS No.2 AND GEN. No.2 ON BUS No.1
6-GEN. No.2 ON BUSES No.1 & 2
7-GEN. No.1 ON BUSES No.1 & 2

(A) CANCELLED AFTER 8 JULY 68. No superseding standard. The application for which MS24438 was originally designed no longer exists.

NOTES
1-PHASE "A" ONLY IS SHOWN, PHASES "B" & "C" ARE TO BE CONNECTED IN AN IDENTICAL MANNER.
2-TWO C.T. METHOD OF DIFFERENTIAL PROTECTION WILL BE USED TO PROTECT LONG MAIN LEADS OF GENERATOR. ONE C.T. METHOD OF PROTECTION WILL BE USED WHERE GENERATOR MAIN LEADS ARE SHORT.
3-WIRING OF GENERATOR CONTROL PANEL IS TYPICAL. INTERNAL WIRING OF PANELS FROM VARIOUS MFGRS. MAY DIFFER, BUT OPERATION WILL BE THE SAME.

FED. SUP CLASS. 6110

APPROVED 13FEB57 REVISED (A) SEE SHEETS 1, 2 AND 3

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T14:54Z
Check the source to verify that this is the current version before use.