
INCH-POUND
MIL-DTL-23928/1E
2 February 2013
SUPERSEDING
MIL-DTL-23928/1D
22 October 2010

DETAIL SPECIFICATION SHEET

PANEL, ELECTRICAL, 125 VOLTS, POWER DISTRIBUTION FOR ALB-1 AND NLB-1 CIRCUIT BREAKERS, 4-24 CIRCUITS, DRIPPROOF, THREE PHASE FEED, SINGLE AND THREE PHASE LOADS, TOTALLY ENCLOSED AND WATERTIGHT

This specification is approved for use by all Departments and Agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and MIL-DTL-23928.

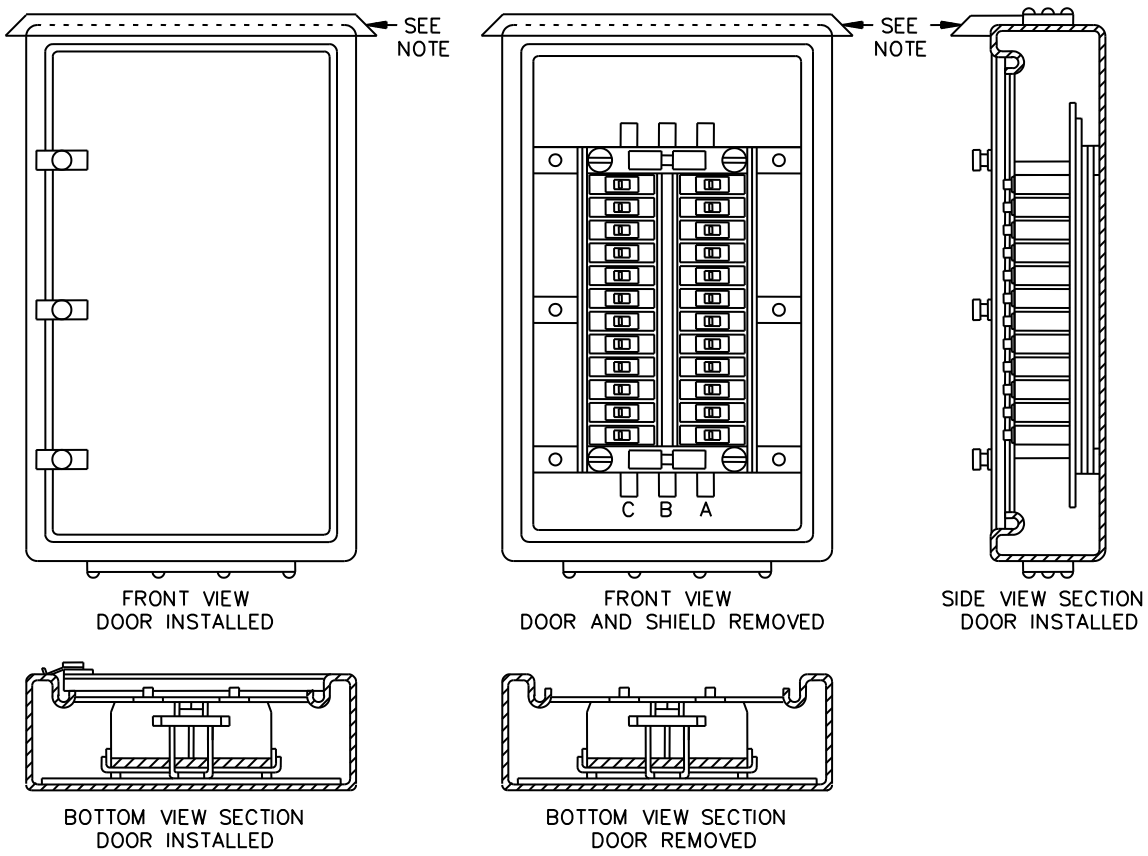

Note: Dripshield required for dripproof enclosure only.

FIGURE 1. Distribution panel for ALB-1 and NLB-1 circuit breakers, totally enclosed and dripproof enclosure (typical).

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T18:18Z
Check the source to verify that this is the current version before use.


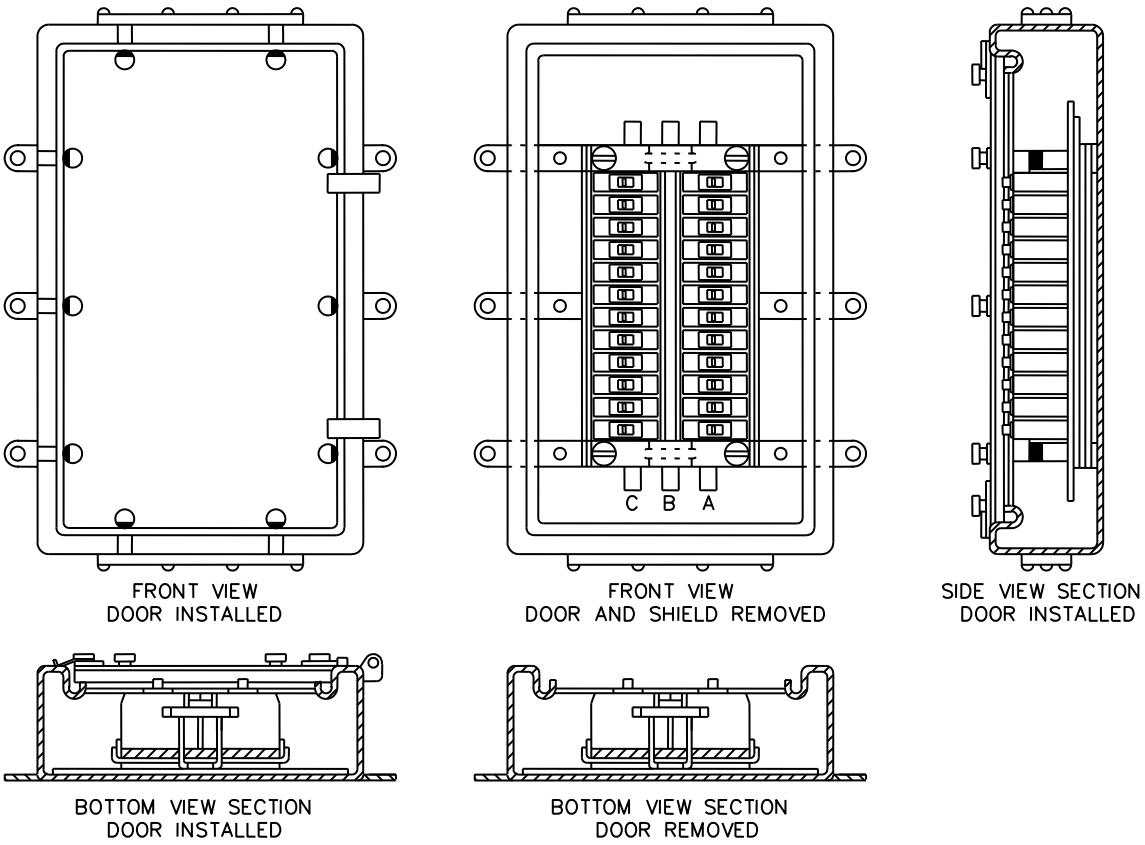


FIGURE 2. Distribution panel for ALB-1 and NLB-1 circuit breakers watertight enclosure (typical).

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T18:18Z
Check the source to verify that this is the current version before use.

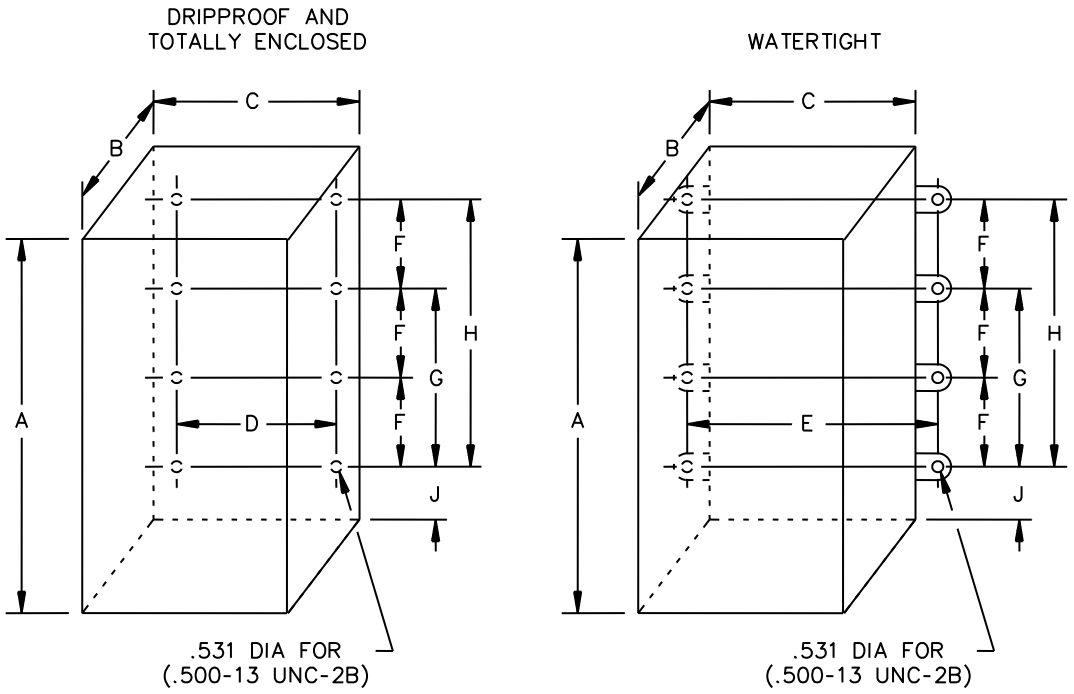

NUMBER OF CIRCUITS	DIMENSIONS (INCHES)									MOUNTING HOLES PER SIDE
	A	B	C	D	E	F	G	H	J	
6-1ϕ or 4-3ϕ	22.50	6.50 Max	15.44 Max	13.44 Max	17.44 Max	4.63	9.25	---	6.63	3
8-1ϕ or 6-3ϕ	25.50					4.63	9.25	---	8.13	
12-1ϕ or 8-3ϕ	28.50					6.00	12.00	---	8.25	
14-1ϕ or 10-3ϕ	31.50					6.50	13.00	19.50	6.00	4
18-1ϕ or 12-3ϕ	34.50					6.50	13.00	19.50	7.50	
20-1ϕ or 14-3ϕ	37.50					6.50	13.00	19.50	9.00	
24-1ϕ or 16-3ϕ	40.50					11.25	22.50	33.75	3.38	

FIGURE 3. Panel and mounting dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T18:18Z
Check the source to verify that this is the current version before use.

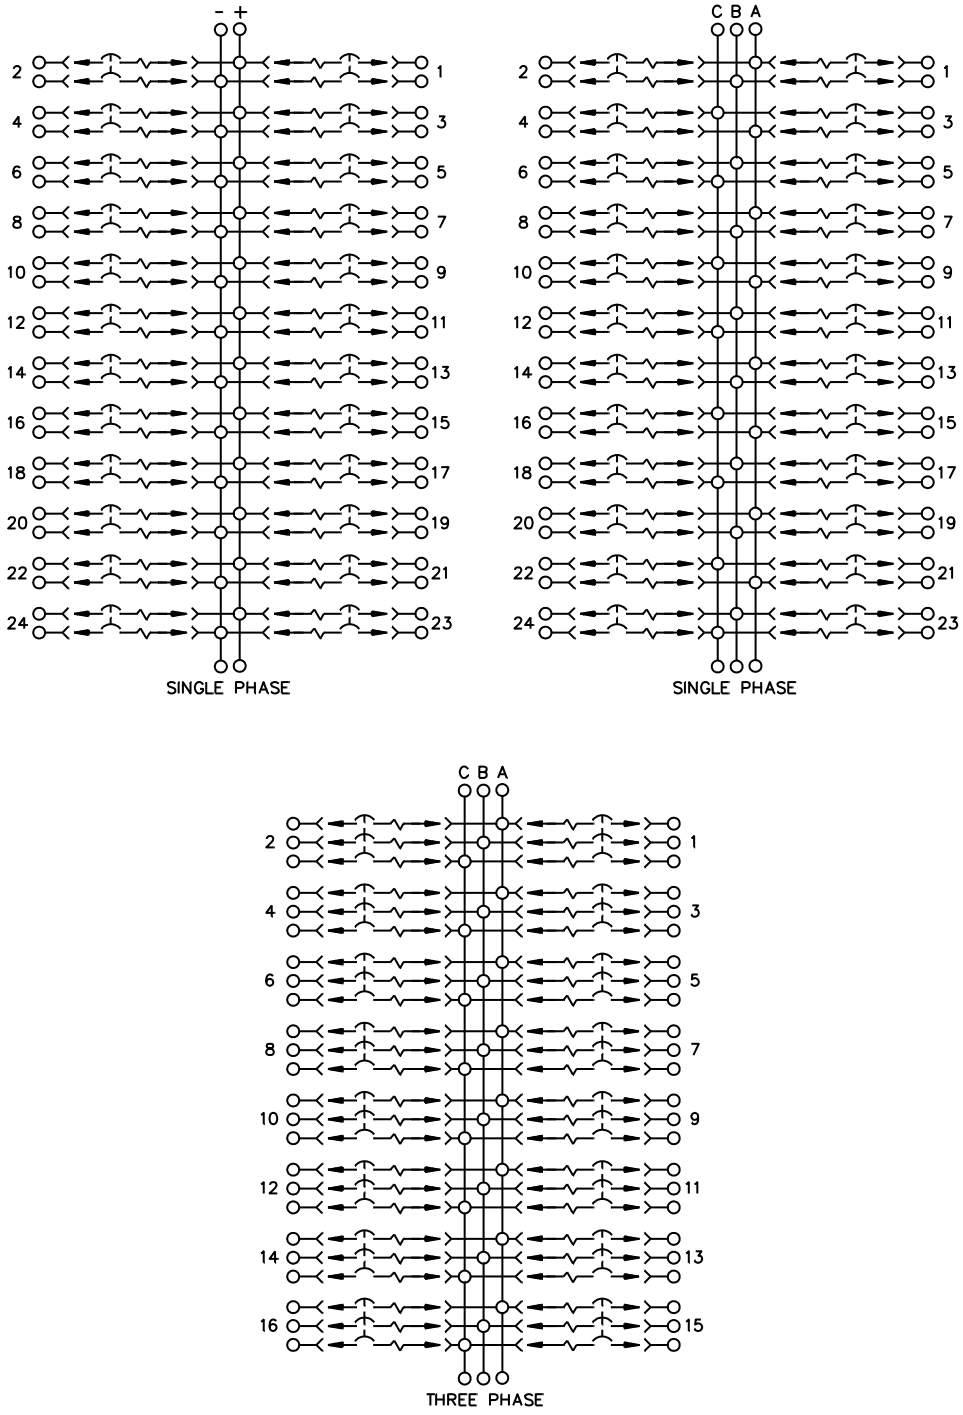


FIGURE 4. Wiring diagrams, front view (typical).


Source: https://assist.dla.mil -- Downloaded: 2026-10-19T18:18Z
Check the source to verify that this is the current version before use.

TABLE I. Part or identifying numbers (PIN's).

Dash number	Number of circuits		Symbol number and enclosure type			Current rating (amperes)
	1ϕ	3ϕ	Dripproof (DP)	Totally enclosed (TE)	Watertight (WT)	
01	6		994.4	994.5	994.6	200
02	8		995.4	995.5	995.6	300
03	12		999.4	999.5	999.6	400
04	14		1006	1006.1	1006.2	400
05	18		1007	1007.1	1007.2	400
06	24		1008	1008.1	1008.2	400
07 1/	20					400
11		4	1009	1009.1	1009.2	200
12		6	1010	1010.1	1010.2	300
13		8	1011	1011.1	1011.2	400
14		10	1012	1012.1	1012.2	400
15		12	1013	1013.1	1013.2	400
16		14	1014	1014.1	1014.2	400
17 1/		16				400

1/ Dash number has no corresponding symbol number established.

Example: The full PIN for a watertight, 8-circuit, single phase panel is:

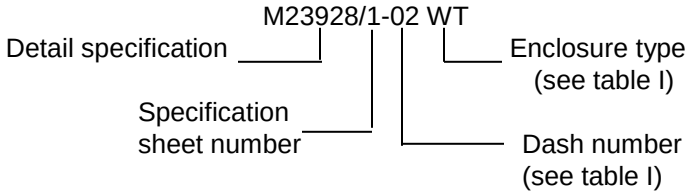

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T18:18Z
Check the source to verify that this is the current version before use.

NOTES:

1. Dimensions are in inches.
2. Unless otherwise specified herein, tolerances shall be as follows:
   Two place decimals: ± 0.02.
   Three place decimals: ± 0.005.
3. Class 1 panels with doors shall meet the 45 degree dripproof requirements, and panels without doors shall meet the 15 degree dripproof requirements in accordance with MIL-STD-108. When used, drip shield dimensions shall be as required to provide the specified degree of enclosure. Panels shall be furnished without doors only when specified in acquisition documents.
4. Class 2 panels shall meet the totally enclosed requirements in accordance with MIL-STD-108. Panels shall be furnished without doors only when specified in acquisition documents.
5. Class 3 panels, with doors, gaskets, and drain opening, shall meet the watertight requirements in accordance with MIL-STD-108.
6. The following types of circuit breaker mounting bases may be installed:
   (a) Single phase (1ø):
   Type A (see MIL-C-17588) four breakers, 2 circuit base, øAB or øBC.
   Type B (see MIL-C-17588) four breakers, 2 circuit base, øAC.
   Type 3ø mounting base-six breakers.
   (b) Three phase (3ø):
   Type (3ø) mounting base-six breakers.
7. When a combination of 1ø and 3ø circuits are required, the number of each type circuit shall be specified in the acquisition document.
8. Panels shall be provided with a retaining device to hold all circuit breakers in place when the shield is removed.
9. Panels shall be of aluminum construction unless steel is specified in the acquisition documents.
10. Panels shall be furnished with mounting blocks.

REQUIREMENTS:

Class: 1 - Dripproof (see note 1).

Class: 2 - Totally enclosed (see note 2).

Class: 3 - Watertight (see note 3).

Dimensions and configuration: See figures 1 through 4.

Composition: See table I.

Current rating: See table I.

Voltage rating: 125 V ac and V dc.

Short circuit capacity: 50,000 amperes.

Bus bar size: 1 x .250 inch.

Bus bar feeder connection: Top and bottom.

Circuit breakers: ALB-1 and NLB-1 (see MIL-C-17588).

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T18:18Z
Check the source to verify that this is the current version before use.

Referenced documents. In addition to MIL-DTL-23928, this document references the following:

MIL-C-17588 MIL-STD-108

The margins of this specification are marked with vertical lines to indicate where changes from the previous issue were made. This was done as a convenience only and the Government assumes no liability whatsoever for any inaccuracies in these notations. Bidders and contractors are cautioned to evaluate the requirements of this document based on the entire content irrespective of the marginal notations and relationship to the last previous issue.

Custodians:
Navy - SH
DLA - CC

Preparing activity:
DLA - CC

(Project 5925-2013-003)

NOTE: The activities listed above were interested in this document as of the date of this document. Since organizations and responsibilities can change, you should verify the currency of the information above using the ASSIST Online data base at https://assist.dla.mil.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T18:18Z
Check the source to verify that this is the current version before use.