INCH-POUND
MIL-P-23928/2B(SH)
5 December 1988
SUPERSEDING
MIL-P-23928/2A(SH)
11 May 1979

MILITARY SPECIFICATION SHEET

PANEL, ELECTRICAL, POWER DISTRIBUTION FOR AQB-A50 AND NQB-A50 CIRCUIT BREAKERS, DRIPPROOF, TOTALLY ENCLOSED AND WATERTIGHT

This specification sheet is approved for use by the Naval Sea Systems Command, Department of the Navy, and is available for use by all Departments and Agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and the issue of the following specification listed in that issue of the Department of Defense Index of Specifications and Standards (DoDISS) specified in the solicitation: MIL-P-23928(SH).

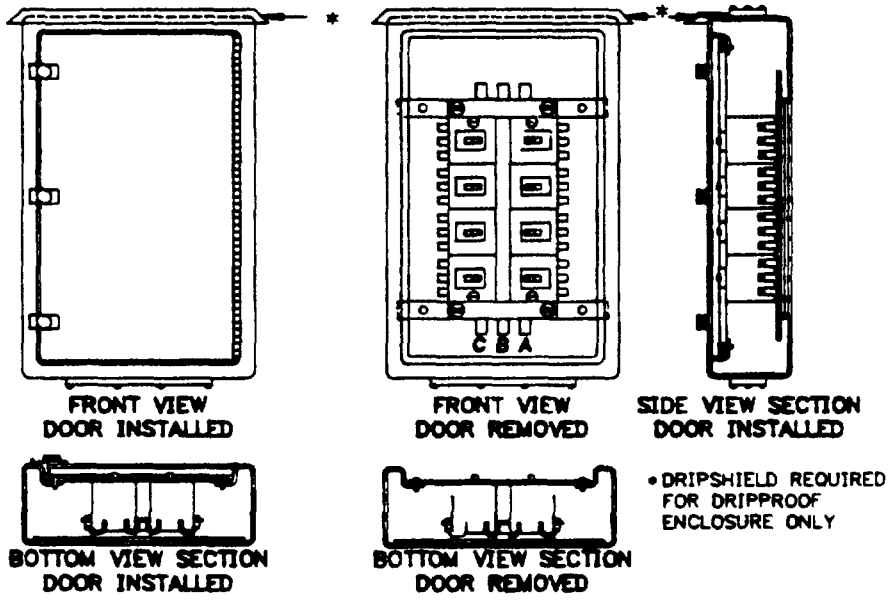


FIGURE 1. Distribution panel for AQB-A50 and NQB-A50 circuit breakers, dripproof and totally enclosed enclosure (typical).

AMSC N/A FSC 5925

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T18:19Z
Check the source to verify that this is the current version before use.


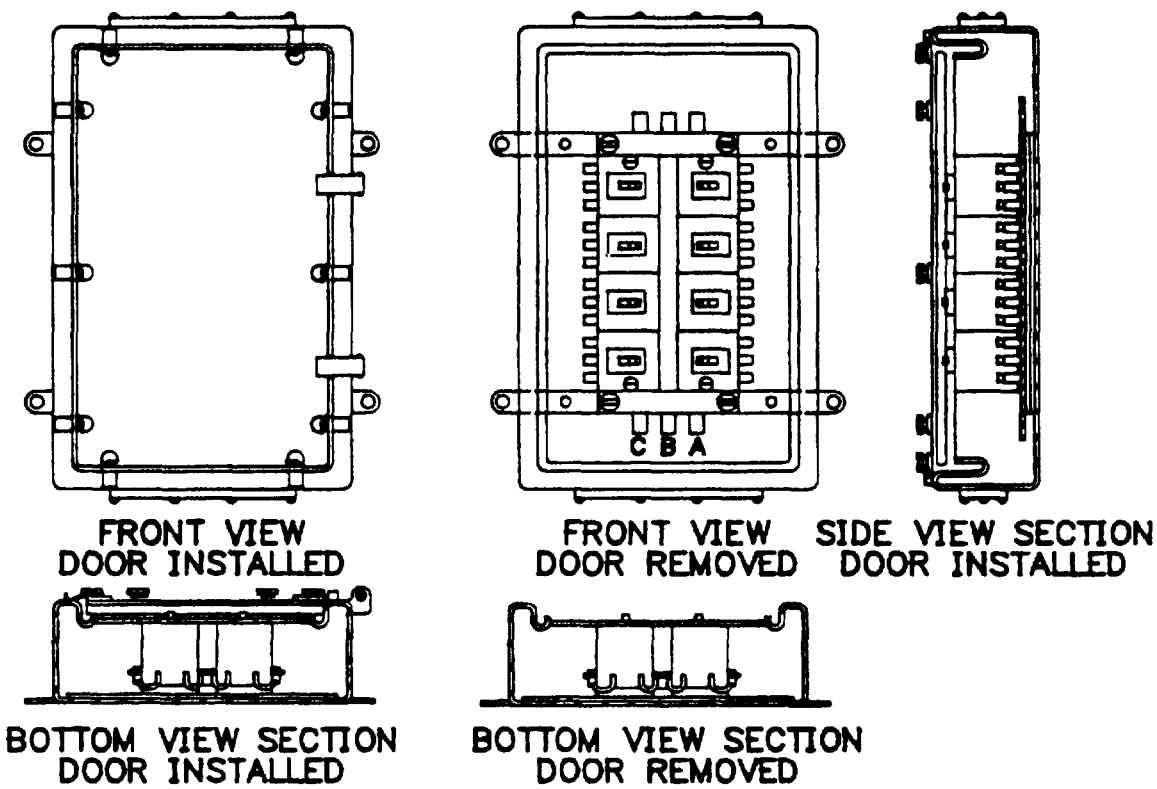


FIGURE 2. Distribution panel for AQB-A50 and NQB-A50 circuit breakers, watertight enclosure (typical).

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T18:19Z
Check the source to verify that this is the current version before use.

MAX. NO. OF CIRCUITS	DIMENSIONS (INCHES)			
	A	B	C	D
2	15.38	–	–	4.37
4	18.75	–	–	7.75
6	22.13	–	–	11 12
8	25.50	–	–	14.50
10	32.13	7.87	11.25	19.12
12	35.50	11.25	11.25	22.50
14	38.88	11.25	14.63	25 88
16	42.25	14.63	14.63	29.25

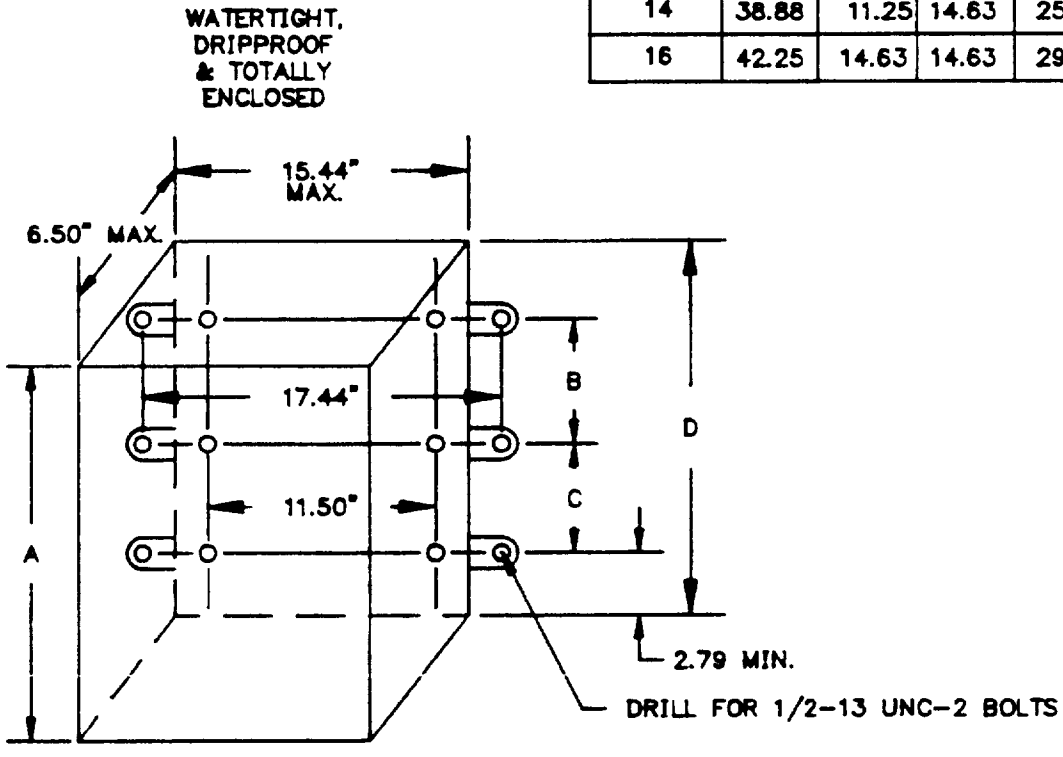

SH13231813

FIGURE 3. Panel and mounting dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T18:19Z
Check the source to verify that this is the current version before use.

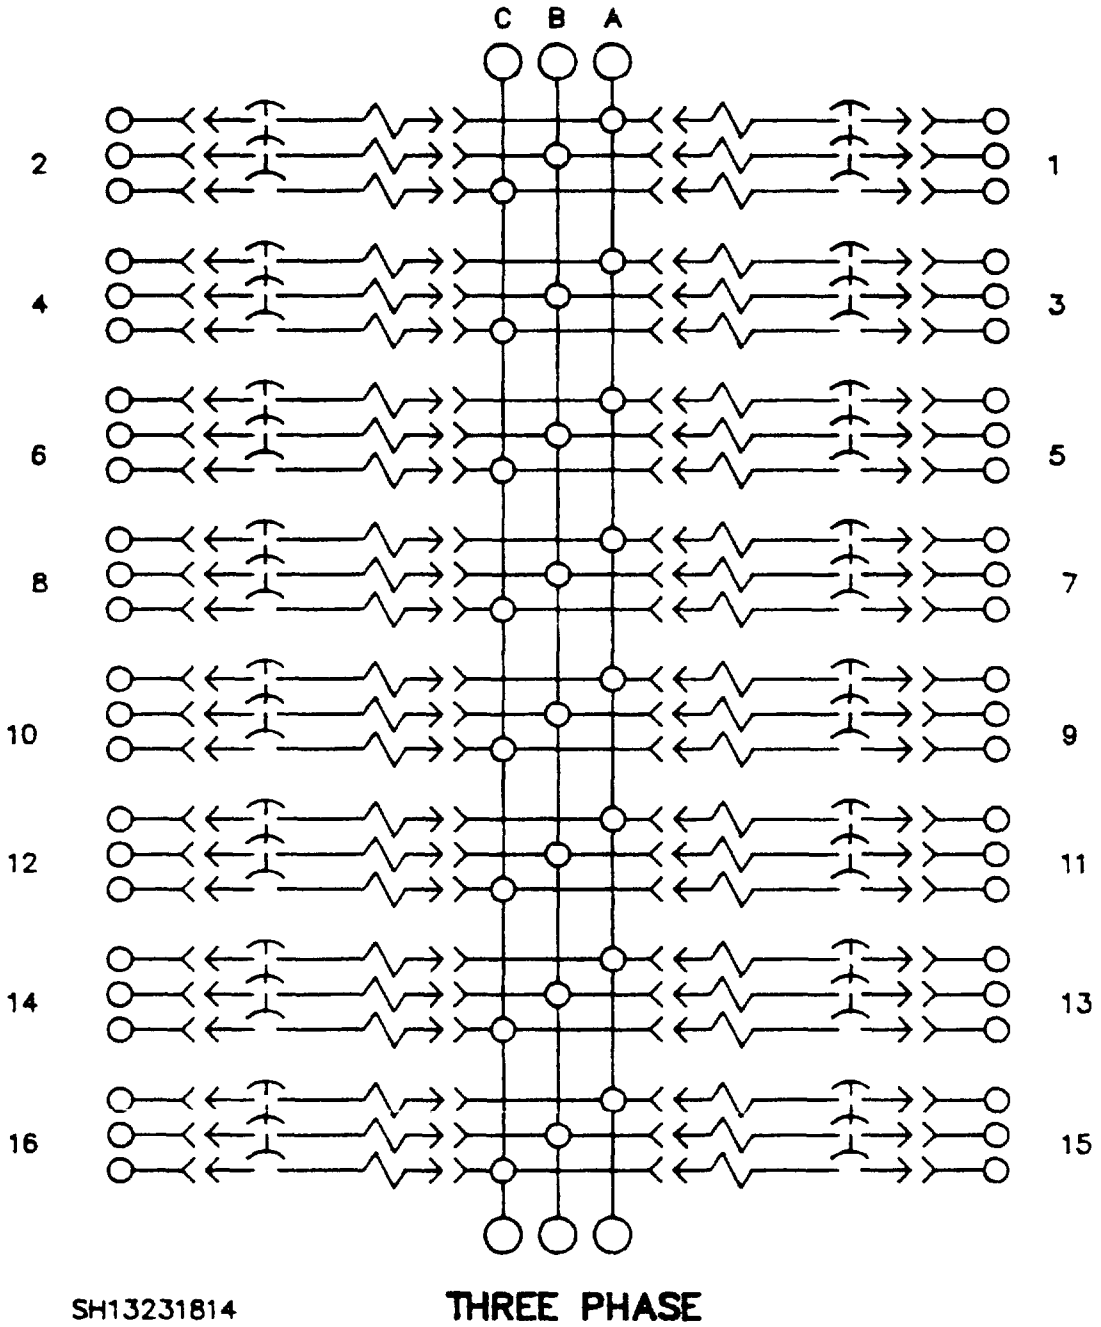



FIGURE 4. Wiring diagram, front view (typical).

Source: https://assist.dla.mil -- Downloaded: 202610-19T18:19Z
Check the source to verify that this is the current version before use.

TABLE I. Part or identifying numbers (PIN's).

Dash number	Number of circuits	Symbol number and enclosure type			Current rating (amperes)
		Dripproof (DP)	Totally enclosed (TE)	Watertight (WT)	
01	2				100
02	4				200
03	6				400
04	8				400
05	10				400
06	12				400
07	14				400
08	16				400

Example: The full PIN for a watertight, 8-circuit panel is:

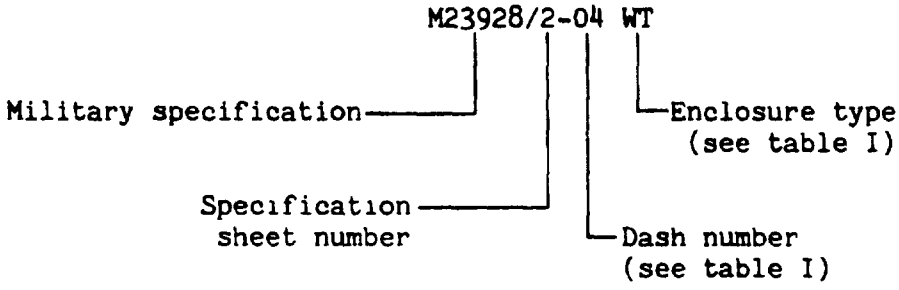

REQUIREMENTS:

Class: 1 - Dripproof (see note 1).
Class: 2 - Totally enclosed (see note 2).
Class: 3 - Watertight (see note 3).
Dimensions and configuration: See figures.
Composition: See table I.
Current rating: See table I.
Voltage rating: See table II.
Short circuit capacity: 100,000 amperes (AQB).
Bus bar sizes (minimum): 1 x 0.250 inch.
Bus bar feeder connection: Top and bottom.
Circuit breakers: See table II.

Source: https://assist.dla.mil -- Downloaded: 2026-10-19T18:19Z
Check the source to verify that this is the current version before use.

Table II. Circuit breakers.

Circuit breaker	Voltage	Specification
AQB-A50 NQB-A50	500 Vac 250 Vdc	MIL-C-17361

NOTES:

1. Class 1 panels with doors shall meet the 45 degree dripproof requirements, and panels without doors shall meet the 15 degree dripproof requirements as specified in MIL-STD-108. When used, drip shield dimensions shall be as required to provide the specified degree of enclosure. Panels shall be furnished without doors only when specified in acquisition documents.
2. Class 2 panels shall meet the totally enclosed requirements as specified in MIL-STD-108. Panels shall be furnished without doors only when specified in acquisition documents.
3. Class 3 panels with doors, gaskets and drain opening shall meet the watertight requirements as specified in MIL-STD-108.
4. A split bus arrangement shall be provided when specified in the acquisition documents. The current rating shown shall apply to each separate bus grouping.
5. Panels shall be of aluminum construction unless steel is specified in the acquisition document.

Revision letters are not used to denote changes due to the extensiveness of the changes.

Preparing activity:
Navy - SH
(Project 5925-N118-02)

Source: https://assist.dla.mil -- Downloaded: 202640-19T18:19Z
Check the source to verify that this is the currentversion before use.