
COMMERCIAL ITEM DESCRIPTION

FUSEHOLDER, BLOCK, CLASS H, 30 AMPERES, 250 V AC, ONE, TWO, AND THREE POLE

The General Services Administration has authorized the use of this commercial item description (CID).

Abstract. This CID covers the general requirements for one, two, and three pole class H type fuseholder blocks. Fuseholders covered by this CID are intended for commercial/industrial applications and shall not be used in military systems needing stringent environmental and electrical requirements.

Part or Identifying Number (PIN). The PIN for the CID shall be as shown in the following example:

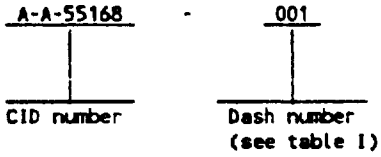

Salient characteristics.

Ampere rating. The ampere rating shall be 30 amperes maximum.

Voltage rating. The voltage rating shall be 250 V ac maximum.

Interrupting rating. This class H fuseholder shall be used with class H fuses which have an interrupting rating of 10,000 amperes maximum.

Design and construction. Fuseholders supplied to this CID shall be as specified herein and shall meet the requirements of UL 512 for class H fuseholders and as specified on figure 1.

Wire termination. Wire termination shall be specified on figure 2 and as follows:

a. Screw connector for use with spade lugs or ring terminals.

b. Screw with pressure plate connector for use with solid or standard wire without terminal. Recommended where vibration will be a factor.

c. Box lug connector the most durable. For use with all types of wire without terminals.

Wire size. The maximum wire size shall be #10 CU for screw connectors and screw with pressure plate connectors and #2 CU-AL for box lug connectors.

Reinforcing spring. Reinforcing springs are used for reinforcement of the fuse clip. Spring reinforced fuse clips are recommended if frequent fuse replacement is expected.

Marking. Fuseholders supplied to this CID shall be marked with the manufacturer's standard commercial PIN and the UL listing mark.

Fuse accommodation. This fuseholder accepts class H fuses with dimensions of 14.28 mm x 50.8 mm (0.562 inch x 2.00 inches).

Regulatory requirements. This section is not applicable to this CID.

AMSC N/A FSC 5920

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:44Z
Check the source to verify that this is the current version before use.

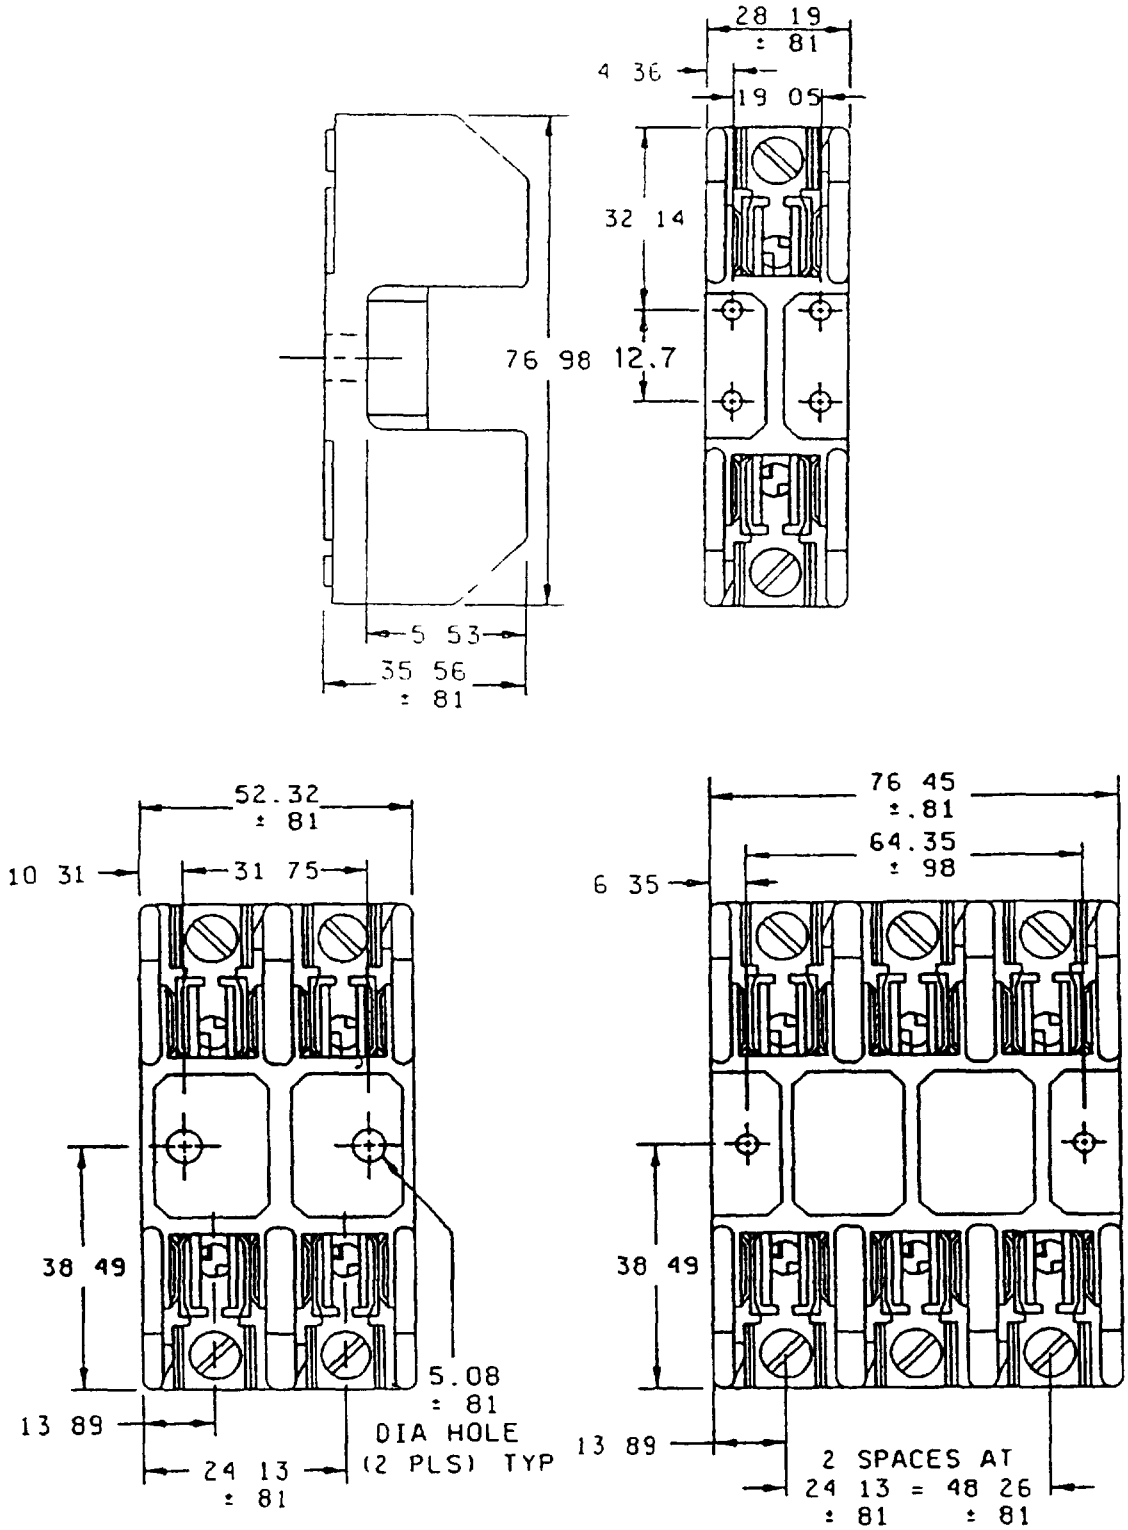


Figure 1. Configuration and dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:44Z
Check the source to verify that this is the current version before use.

mm	Inches	mm	Inches
4.36	.171	31.75	1.25
5.53	.218	32.14	1.265
6.35	.250	35.71	1.406
10.31	.406	38.49	1.515
12.7	.50	48.41	1.906
13.89	.546	51.99	2.046
19.05	.750	63.5	2.50
24.20	.953	76.2	3.00
27.78	1.093	76.98	3.031

NOTES:
1. Dimensions are in millimeters.
2. Tolerance is ± 0.13 mm (0.005 inch), unless otherwise specified.
3. This item was designed using inch-pound units of measurement. In case of problems involving conflicts between the metric and inch-pound units, the inch-pound units shall rule.

Figure 1. Configuration and dimensions - Continued.

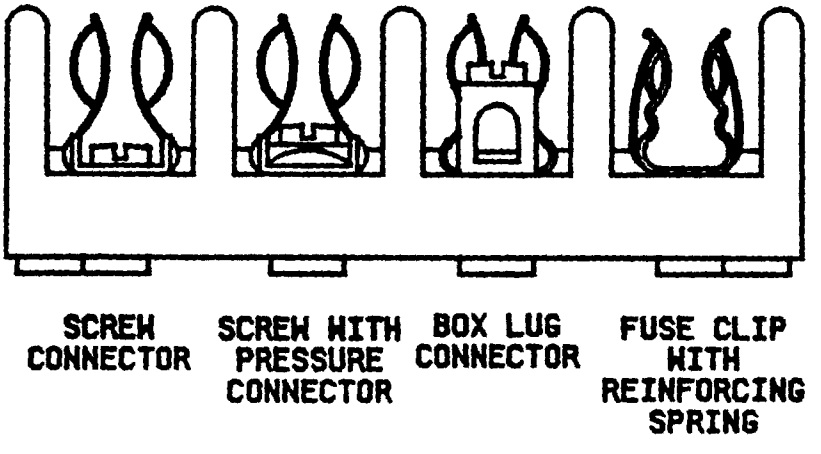


Figure 2. Wire termination configuration.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:44Z
Check the source to verify that this is the current version before use.

TABLE I. Characteristics.

A-A-55168-	Characteristics
001	1 pole, screw connector.
002	1 pole, screw connector. Fuse clip with reinforcing spring.
003	1 pole, screw with pressure plate connector.
004	1 pole, screw with pressure plate connector. Fuse clip with reinforcing spring.
005	1 pole, box lug connector.
006	1 pole, box lug connector. Fuse clip with reinforcing spring.
007	2 pole, screw connector.
008	2 pole, screw connector. Fuse clip with reinforcing spring.
009	2 pole, screw with pressure plate connector.
010	2 pole, screw with pressure plate connector. Fuse clip with reinforcing spring.
011	2 pole, box lug connector.
012	2 pole, box lug connector. Fuse clip with reinforcing spring.
013	3 pole, screw connector.
014	3 pole, screw connector. Fuse clip with reinforcing spring.
015	3 pole, screw with pressure plate connector.
016	3 Pole, screw with pressure plate connector. Fuse clip with reinforcing spring.
017	3 pole, box lug connector.
018	3 pole, box lug connector. Fuse clip with reinforcing spring.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:44Z
Check the source to verify that this is the current version before use.

Quality assurance provisions.

Responsibility for inspection. The contractor is responsible for the performance of all inspection, examination, and test requirements specified in the contract or purchase order. The contractor may use his own or any other facilities suitable for inspection requirements specified in the contract or purchase order, unless otherwise disapproved by the acquiring activity. The acquiring activity reserves the right to perform any of the inspections set forth in the contract or purchase order where such inspections, examinations, and tests are deemed necessary to assure supplies and services conform to prescribed requirements.

Contractor certification statement. The contractor shall certify and maintain objective quality evidence that the product offered meets the requirements of this CID, and that the product conforms to the producer's own drawings, specifications, standards, quality assurances practices, and is the same as the product provided as a bid sample. The acquiring activity reserves the right to require proof of such conformance prior to the first delivery and thereafter as may be otherwise provided for under the provisions of the contract.

Certificate of compliance. A certificate of compliance shall accompany all fuseholders supplied to this CID. The letter of certification shall state that the fuseholder is UL listed to the requirements of UL 512 for class H fuseholders and it shall include the UL file number.

Packaging.

Preservation, packaging, packing, labeling, and marking. Preservation, packaging, packing, labeling, and marking shall be as specified in the contract or purchase order.

Notes. This section contains relevant information which is useful to buyers, users, and suppliers in the process of acquiring the item, but is not mandatory.

Ordering data. The contract or purchase order shall specify the following:

a. CID document number and revision and CID PIN.

b. Quality assurance provisions.

c. Packaging requirements.

Comments. Comments on this CID should be directed to Defense Electronics Supply Center, 1507 Wilmington Pike, ATTN: DESC-EMN, Dayton, OH 45444-5270, or telephone (513) 296-6184, or fax (513) 296-8868.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:44Z
Check the source to verify that this is the current version before use.

Suggested sources of supply. Suggested sources of supply are listed herein. Additional sources will be added as they become available.

CID dash number (see table I) A-A-55168-	Vendor commercial PIN CAGE 71400	Vendor commercial PIN CAGE 71424	Vendor commercial PIN CAGE 75915
001	H25030-1S	20311	LH25030-1S
002	H25030-1SR	20316	LH25030-1SR
003	H25030-1P	20321	LH25030-1P
004	H25030-1PR	20326	LH25030-1PR
005	H25030-1C	20301	LH25030-1C
006	H25030-1CR	20306	LH25030-1CR
007	H25030-2S	20312	LH25030-2S
008	H25030-2SR	20317	LH25030-2SR
009	H25030-2P	20322	LH25030-2P
010	H25030-2PR	20327	LH25030-2PR
011	H25030-2C	20302	LH25030-2C
012	H25030-2CR	20307	LH25030-2CR
013	H25030-3S	20313	LH25030-3S
014	H25030-3SR	20318	LH25030-3SR
015	H25030-3P	20323	LH25030-3P
016	H25030-3PR	20328	LH25030-3PR
017	H25030-3C	20303	LH25030-3C
018	H25030-3CR	20308	LH25030-3CR

Vendor CAGE number	Vendor name and address
71400	Bussmann P.O. Box 14460 St. Louis, MO 63178-4460 (314) 394-2877
71424	Gould Incorporated 374 Merrimac Road Newburyport, MA 01950-1998 (508) 462-6662
75915	Littelfuse, Incorporated 800 E. Northwest Highway Des Plaines, IL 60016-3096 (312) 824-1188

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:44Z
Check the source to verify that this is the current version before use.

CIVIL AGENCY COORDINATING ACTIVITY:

GSA - 7FXE

PREPARING ACTIVITY:

DLA-ES

Project 5920-D199

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:44Z
Check the source to verify that this is the current version before use.