INCH-POUND

MIL-DTL-16377/83
18 December 2008

DETAIL SPECIFICATION SHEET

FIXTURES, LIGHTING; T8 FLUORESCENT, EMERGENCY LIGHTING 34 WATTS, 120 VOLTS, 60 HERTZ, WATERTIGHT, SYMBOLS 77.4T8EM, 77.5T8EM, 344.2T8EM, AND 344.3T8EM

This specification is approved for use by the Naval Sea Systems Command and is available for use by all Departments and Agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and MIL-DTL-16377.

All dimensions in inches. For tolerances, other than specified herein, see 3.5.2 of MIL-DTL-16377.

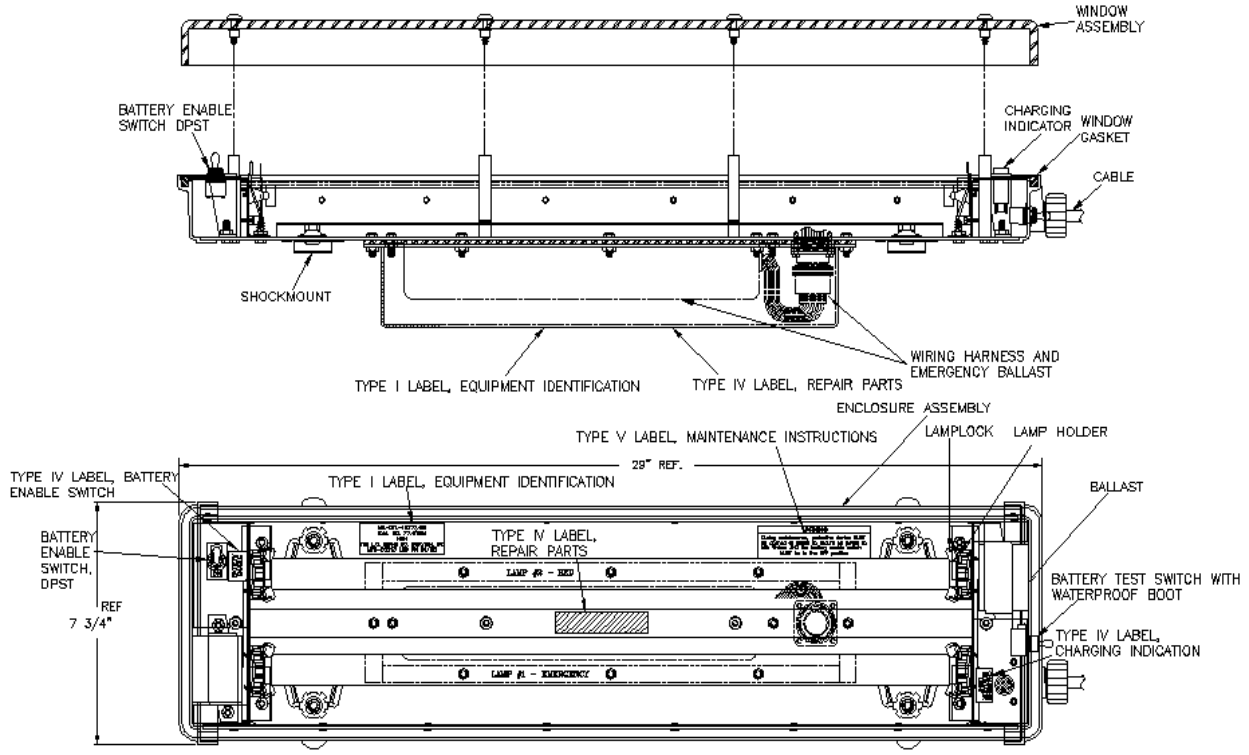


FIGURE 1. Typical view of symbols 77.4T8EM and 344.2T8EM, symbols 77.5T8EM, and 344.3T8EM use identical construction with flush mounting flange not shown.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T08:56Z
Check the source to verify that this is the current version before use.


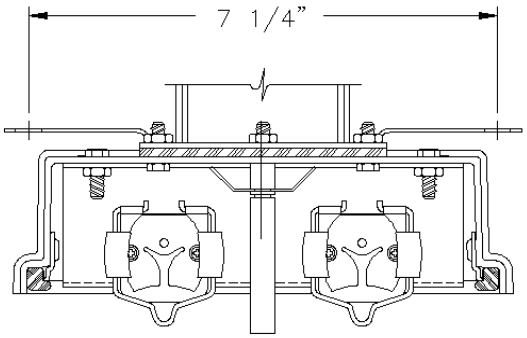


FIGURE 2. Typical section for symbols 77.4T8EM and 344.2T8EM.

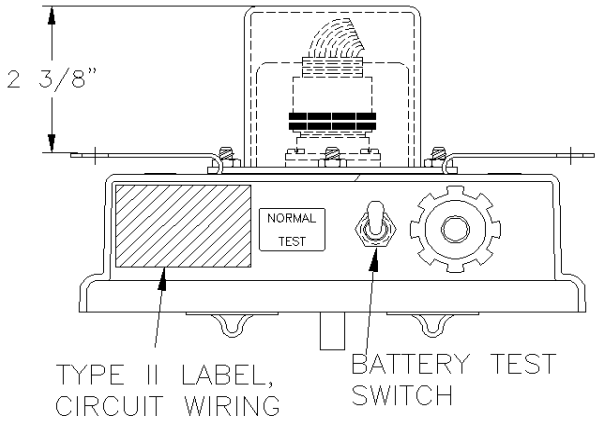

NOTES:

1. Symbols 77.5T8EM and 344.3T8EM use identical battery test switch construction with additional switch hardware (not shown) for switch operation below ceiling.
2. Type II Label required on all fixtures.

FIGURE 3. Typical section for symbols 77.5T8EM and 344.3T8EM.

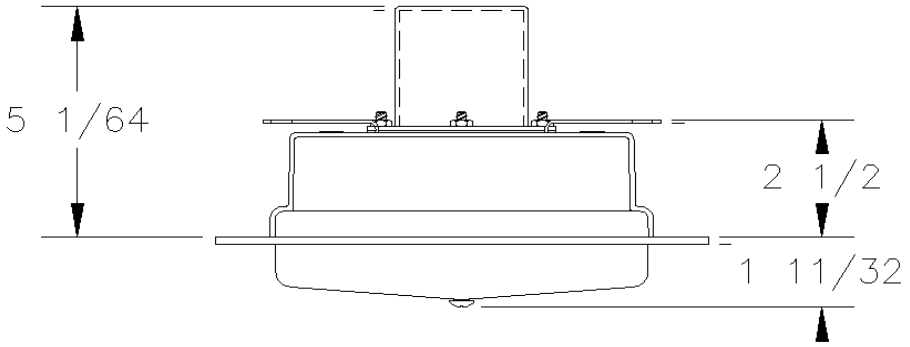


FIGURE 4. Typical section for symbols 77.5T8EM and 344.3T8EM.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T08:56Z
Check the source to verify that this is the current version before use.

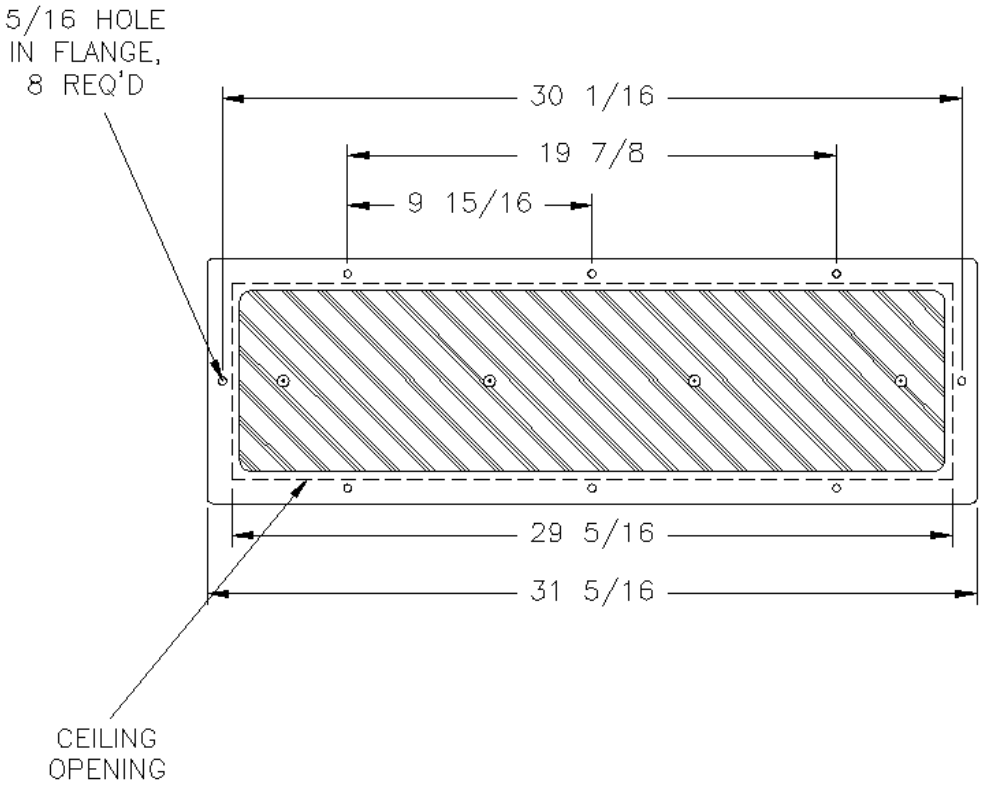


FIGURE 5. Flush mounting dimension for symbols 77.5T8 and 344.3T8.


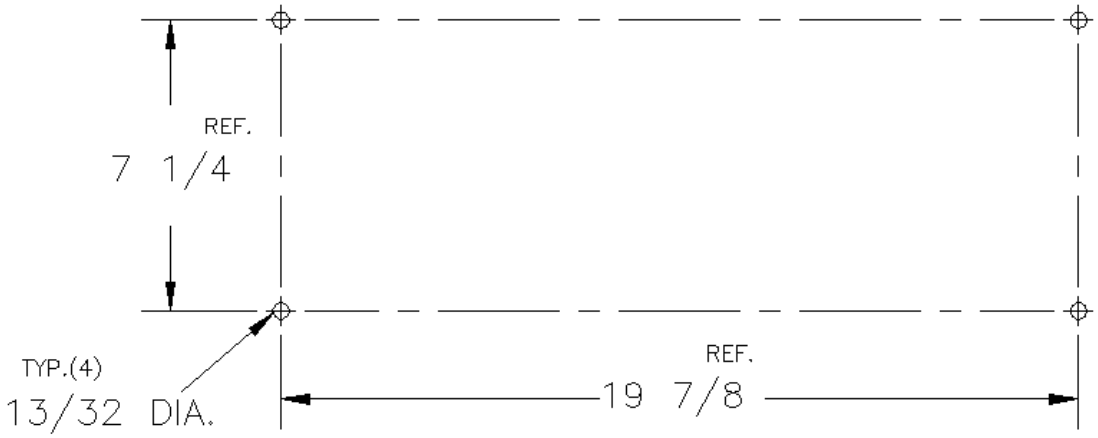


FIGURE 6. Standard mounting dimensions utilizing shock mounts for symbols 77.4T8 and 344.2T8.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T08:56Z
Check the source to verify that this is the current version before use.

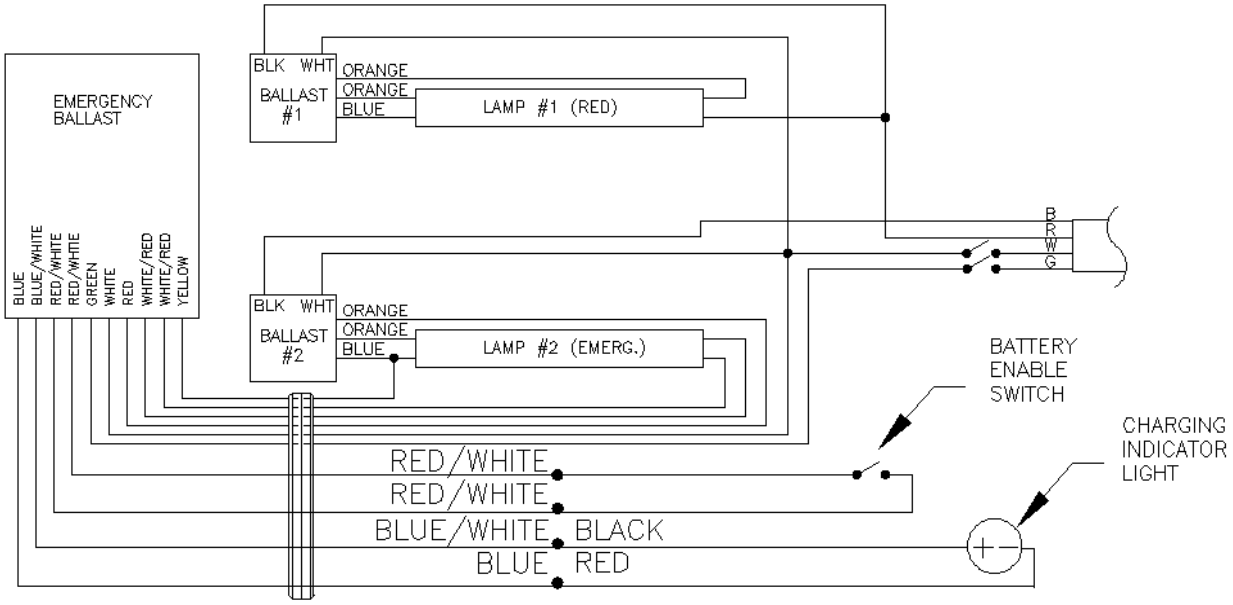

NOTES:

1. The black and red input conductors are the only switched power leads to the fixture, used for normal on/off lamp control.
2. The white and green input conductors shall be connected directly to the power source and remain continuously energized for emergency lamp battery charging. The white and green input conductors shall not have power interrupted by on/off control switches.
3. The white input conductor is shared by the normal lamp circuits (white and red) and by the emergency circuit.

FIGURE 7. Typical wiring diagram.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T08:56Z
Check the source to verify that this is the current version before use.

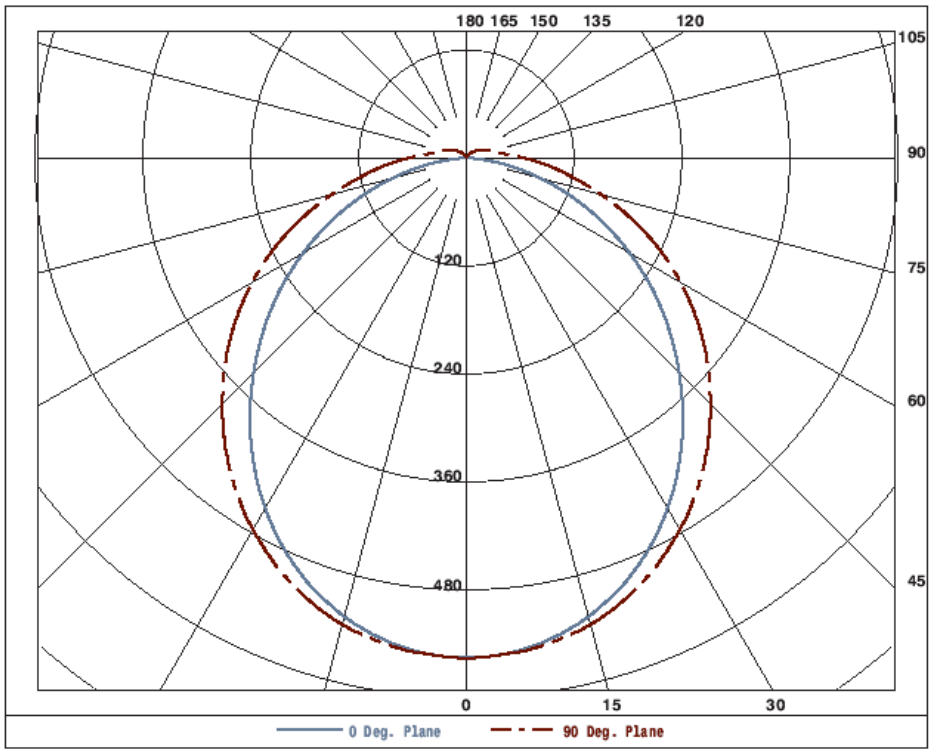


FIGURE 8. Candela distribution curves, white diffusing window, symbols 77.4T8EM and 77.5T8EM.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T08:56Z
Check the source to verify that this is the current version before use.

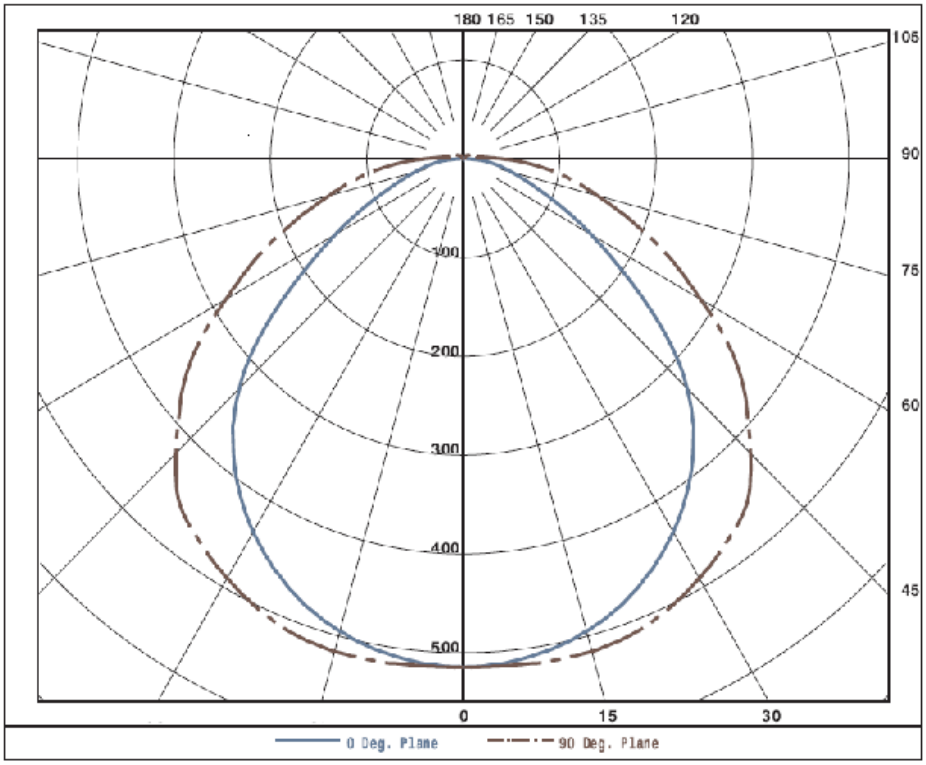


FIGURE 9. Candela distribution curves, prismatic window, symbols 344.2T8EM and 344.3T8EM.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T08:56Z
Check the source to verify that this is the current version before use.

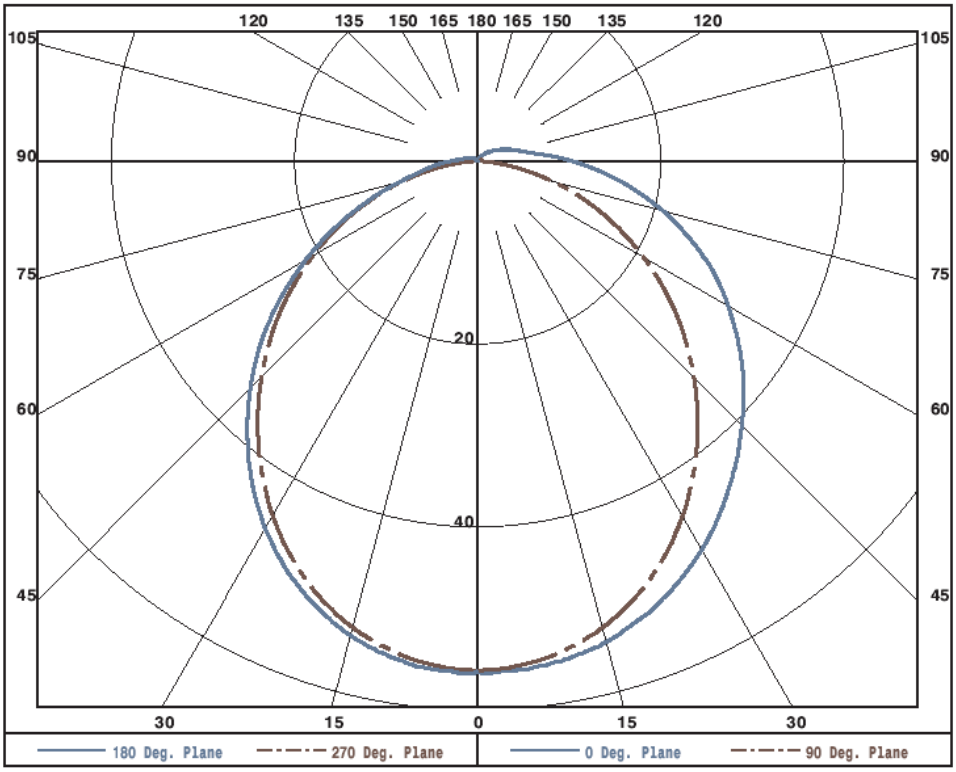


FIGURE 10. Candela distribution curves, emergency mode.

TABLE I. Numerical candela distribution, white diffusing window, symbols 77.4T8EM and 77.5T8EMU.

Vertical angle	Candela distribution	
	0-degree	90-degree
0	556	556
5	552	552
15	528	537
25	480	501
35	413	449
45	335	385
55	253	314
65	167	236
75	85	155
85	18	90
90	4	65

Vertical angle	Candela distribution	
	0-degree	90-degree
95	4	46
105	3	30
115	2	21
125	2	14
135	1	8
145	0	4
155	0	0
165	0	0
175	0	0
180	0	0

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T08:56Z
Check the source to verify that this is the current version before use.

TABLE II. Numerical candela distribution, prismatic window, symbols. 344.2T8EM and 344.3T8EM.

Vertical angle	Candela distribution	
	0-degree	90-degree
0	515	515
5	512	515
15	495	516
25	461	503
35	407	475
45	328	421
55	207	340
65	109	236
75	52	144
85	19	75
90	5	40

Vertical angle	Candela distribution	
	0-degree	90-degree
95	4	20
105	3	13
115	2	11
125	1	6
135	1	3
145	0	2
155	0	0
165	0	0
175	0	0
180	0	0

TABLE III. Numerical candela distribution, emergency mode.

Vertical angle	Candela distribution	
	0-degree	90-degree
0	56	56
5	56	55
15	54	53
25	51	48
35	46	41
45	41	33
55	35	25
65	28	17
75	21	8
85	14	2
90	10	1

Vertical angle	Candela distribution	
	0-degree	90-degree
95	8	0
105	4	0
115	3	0
125	2	0
135	1	0
145	1	0
155	0	0
165	0	0
175	0	0
180	0	0

PHOTOMETRIC DATA:

Photometry reports based on LM-41 and other IESNA procedures.

Plane: zero degrees is parallel to lamps, 90 degrees is perpendicular to lamps.

Electrical values: 120 volts, 60 hertz, 36.1 watts+4.0 watts (battery charging circuit) =40.1 watts total.

Ambient temperature: 25±1 °C.

Lamps: GE F17T8-SP41-ECO (seasoned for at least 100 hours).

Lamps correction: lamp rated at 1325 lumens.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T08:56Z
Check the source to verify that this is the current version before use.

Ballast: Furnished with fixture, see MIL-DTL-16377/81 for 17-watt lamp specification, MIL-DTL-16377/77 for emergency ballast specification.

REQUIREMENTS:

CLASSIFICATION:

Type: I (Fluorescent)

Class: 2 (General)

SYMBOL NUMBERS:

77.4T8EM: Complete lighting fixture assembly, standard mounting, with two 17-watt T8 cool white fluorescent lamps, white diffusing window assembly, includes emergency battery/ballast circuit for emergency lighting.

77.5T8EM: Complete lighting fixture assembly, flush mounting, with two 17-watt T8 cool white fluorescent lamps, white diffusing window assembly, includes emergency battery/ballast circuit for emergency lighting.

344.2T8EM: Complete lighting fixture assembly, standard mounting, with two 17-watt T8 cool white fluorescent lamps, clear and white prismatic window assembly, includes emergency battery/ballast circuit for emergency lighting.

344.3T8EM: Complete lighting fixture assembly, flush mounting, with two 17-watt T8 cool white fluorescent lamps, clear and white prismatic window assembly, includes emergency battery/ballast circuit for emergency lighting.

DESIGN:

Electrical rating:	34 watts, 120 volts, 60 hertz, ungrounded electrical distribution system. Total input power: 36.1 watts+4.0 watts (battery charging circuit) = 40.1 watts total at 120 volts.
Dimension and configurations:	See figures 1, 2, 3, and 4.
Photometric data:	See figures 8, 9, 10, and tables I, II, III.
Wiring diagram:	See figure 7.
Ballast:	See MIL-DTL-16377/81 for 17-watt T8 lamp specification, MIL-DTL-16377/77 for emergency ballast specification.
Window assembly:	
Symbols 77.4T8EM and 77.5T8EM:	White window, see table VI and figure 27 of MIL-DTL-16377.
Symbols 344.2TEM and 344.3T8EM:	Prismatic window, see table VI and figure 27 of MIL-DTL-16377.
Enclosure:	Watertight; see 3.5.11 of MIL-DTL-16377.
Cable:	10 feet (minimum) of type LSFHOF-3 in accordance with MIL-DTL-24643/3.
Weight:	
Symbols 77.4T8EM and 344.2T8EM:	Not to exceed 17 pounds.
Symbols 77.5T8EM and 344.3T8EM:	Not to exceed 19 pounds.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T08:56Z
Check the source to verify that this is the current version before use.

DESIGNATION AND MARKING:

The following labels shall be furnished in accordance with MIL-DTL-16377 applied as shown on figures 1 and 3.

a. Two type I labels, equipment identification, reference MIL-DTL-16377 figure 11, shall include manufacturer and address, one located on back and other located on an inner nonreflecting surface.

b. One type II label, circuit wiring information, reference MIL-DTL-16377 figure 12, located on outside surface adjacent to cable entrance.

c. Two type IV label, repair parts, reference MIL-DTL-16377 figure 14, information to be shown shall include "USE THE FOLLOWING REPAIR PARTS ONLY." List all standard parts shown in table IV, located on an inner nonreflecting surface and back of fixture.

d. One type IV label, reference MIL-DTL-16377 figure 14, information to be shown shall be "CHARGING INDICATOR LIGHT".

e. One type IV label, reference MIL-DTL-16377 figure 14, information to be shown shall be "BATTERY ENABLE".

f. One type V label, reference MIL-DTL-16377 figure 15, information to be shown shall be "DURING MAINTENENCE PROTECTIVE DEVICE MUST BE OPENED OR PULLED TO SECURE AC POWER TO THIS FIXTURE AND THE BATTERY ENABLE SWITCH MUST BE IN THE OFF POSITION."

EXAMINATION AND TESTS:

Examination and tests shall be as specified in MIL-DTL-16377 and the following:

First article testing/inspection:

Complete fixtures:	See table V.
Window assemblies:	See table VI.
Comparison inspection:	See tables V and VI.
Conformance inspection:	See MIL-DTL-16377.

Inspection of product for delivery:

Examination:	See MIL-DTL-16377.
Conformance test:	See MIL-DTL-16377.
Examination for preparation of delivery:	See MIL-DTL-16377.

GENERAL INFORMATION:

Table IV. Fixture standard parts

Table V. Complete fixture first article tests

Table VI. Window assembly first article tests

Table VII. Complete fixture part numbers

NOTES:

1. Installation circuit wiring shall incorporate a minimum ratio of eight 17-watt lamps and one emergency 17-watt lamp. The 8-to-1 ratio is required for meeting MIL-STD-1399-300 harmonic requirements. The 17-watt emergency ballast produces non-linear current that must be offset by the linear current from eight 17-watt lamp ballasts connected to the same circuit.
2. Emergency fixtures may be designated as Navy Emergency Automatic Lighting System or NEALS.
3. The "battery enable" switch shall be placed in the normal position after installation.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T08:56Z
Check the source to verify that this is the current version before use.

TABLE IV. Standard parts.

Name	Military p/n or specification	National Stock Number (NSN)	Remarks
Lamp	Commercial identification F17T8/CW	6240-01-391-6027	---
Lamplock	M16377/40-003	---	---
Lampholder	UL 542	6250-00-284-0481	Commercial
Ballast	M16377/81-001	---	Integrated starter type
Shockmount	M16377/41-008	6210-01-393-4302	0.067 steel, zinc plated
Window assembly, diffusing	M16377/11-001	6210-00-399-7035	1/
Window assembly, prismatic	M16377/11-003	6210-01-169-5997	1/
Emergency ballast, wiring harnesses, and mating connector	M16377/77-001	6250-01-491-7039	Complete assembly: includes wiring harnesses and matting AMP #206043 connectors.
Charging indicator light	---	6220-01-415-7889	LED type
Switch, battery enable	M16377/75-008	5930-01-414-9240	DPST
Switch, battery test	Carling 2167-M-A-NC-73XCA4	---	Momentary toggle
Switch cover, rubber boot	MIL-DTL-5423/2	---	Neoprene
Filter, 17-watt T8 fluorescent lamp (DARK ADAPTATION)	M16377/42-010	---	Red transparent

NOTE:

1/ Window assemblies (diffusing and prismatic) are the same as T12 lamp fixtures (MIL-DTL-16377/11).

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T08:56Z
Check the source to verify that this is the current version before use.

TABLE V. First article tests and comparison inspection for complete fixtures.[1/]

Test	Requirement	Test method	Remarks
Examination	3.13	4.5	---
Operation	3.13	4.8.1	---
Electromagnetic Interference	3.6.14	4.8.16	---
Electrical equipment interface testing requirements: MIL-STD-1399-300	MIL-STD-1399-300	MIL-STD-1399-300	2/ 3/
Dielectric withstanding voltage	3.6.15	4.8.2	4/
Insulation resistance	3.6.16	4.8.3	4/
Enclosure effectiveness	3.5.11	4.8.14.4	4/
Shock	3.5.12	4.8.7	4/
Vibration	3.5.13	4.8.8	4/
Enclosure effectiveness	3.5.11	4.8.14.4	4/
Dielectric withstanding voltage	3.6.15	4.8.2	4/
Insulation resistance	3.6.16	4.8.3	4/
Noise	3.5.14	4.8.9	---
Continuity of grounding	3.6.13.4	4.8.12	---
Light output	3.7.1	4.8.6.1	---
Optical uniformity	3.7.4.1.1	4.8.4	---
Stress relief	3.8.5.3	4.8.5	---
Magnetic permeability	3.4.8	4.8.18	---
Emergency light output: Distribution curves shall be documented during emergency lamp operation	3.7.1	4.8.6.1	5/
Emergency ballast performance: Operating time and discharge test	See MIL-DTL-16377/77, Table II, battery discharge test	See MIL-DTL-16377/77, Table II, battery discharge test	---

NOTES:

1/ Requirements and test methods use MIL-DTL-16377.

2/ Less then 1KVA exception not applicable for input waveform THD.

3/ Solid state components shall be subject to 250 positive spikes and 250 negative spikes (500 total spikes), one spike per minute, using testing method identified in MIL-STD-1399-300.

4/ Tests shall be performed in the order specified.

5/ Shall meet or exceed published distribution curves.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T08:56Z
Check the source to verify that this is the current version before use.

TABLE VI. First article tests and comparison inspection for window assemblies.[1/]

Test	Requirement paragraph	Test paragraph	Remarks
Examination	3.13	4.5	---
Optical uniformity	3.7.4.1.1	4.8.4	---
Stress relief	3.8.5.3	4.8.5	---
Shock	3.5.12	4.8.7	[2/]
Vibration	3.5.13	4.8.8	[2/]
Enclosure effectiveness	3.5.11	4.8.14.4	[2/]
Light output	3.7.1	4.8.6.1	Candela distribution

NOTES:

[1/] Testing requirements and methods use MIL-DTL-16377.

[2/] Tests shall be performed in the order specified.

TABLE VII. Complete fixture part numbers.

Name	Military p/n
Complete fixture, symbol 77.4T8EM	M16377/83-77.4T8EM
Complete fixture, symbol 77.5T8EM	M16377/83-77.5T8EM
Complete fixture, symbol 344.2T8EM	M16377/83-344.2T8EM
Complete fixture, symbol 344.3T8EM	M16377/83-344.3T8EM

Custodians:
Army – CR4
Navy – SH
Air Force – 99

Review Activities
Navy – AS, CG
Air Force – 03
DLA – GS2
GSA – FAS

Preparing Activity:
Navy – SH
(Project 6210-2006-007)

NOTE: The activities listed above were interested in this document as of the date of this document. Since organizations and responsibilities can change, you should verify the currency of the information above using the ASSIST Online database at http://assist.daps.dla.mil.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T08:56Z
Check the source to verify that this is the current version before use.