

FED SUP CLASS
5930

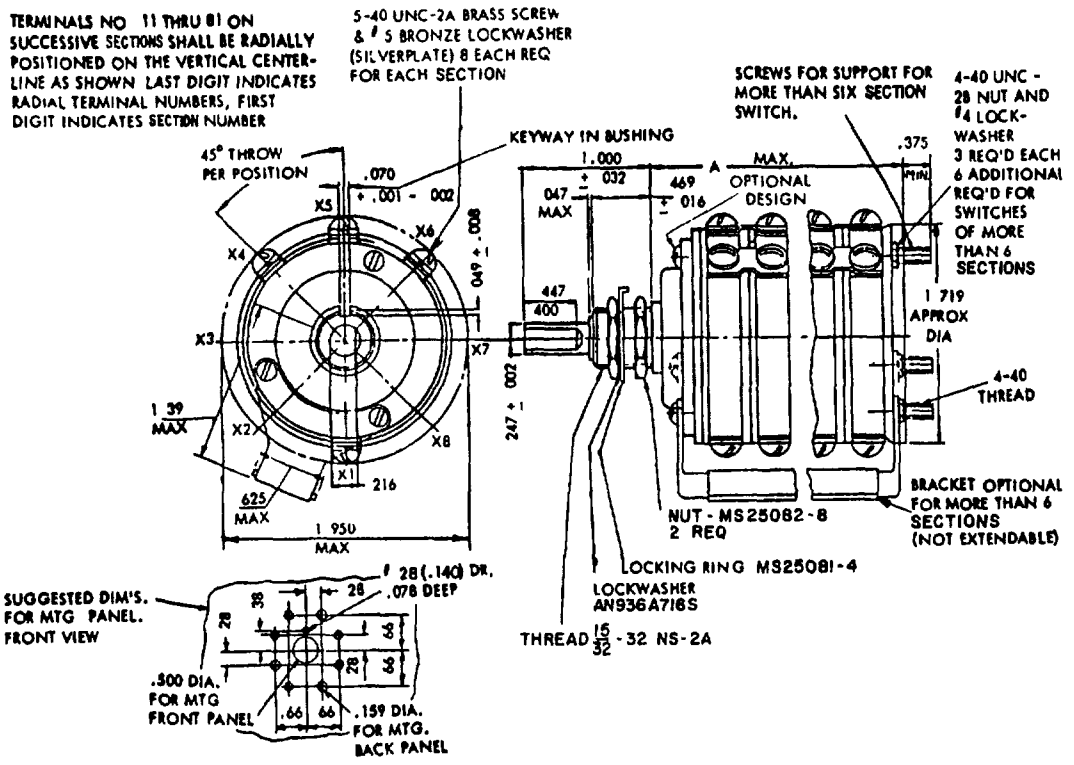

TYPICAL WIRING DIAGRAM FOR ANY 2 SECTION SET

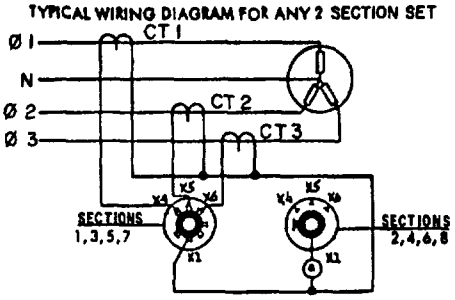

TERMINALS 14-24, 15-25, 16-26, 34-44, 35-45, 36-46, 54-64, 55-65, 56-66, 74-84, 75-85, 76-86 PERMANENTLY JUMPERED.

INCHES	MM	INCHES	MM
.001	03	.216	5.49
.002	.05	.247	6.27
008	.20	.400	10.16
.016	.41	.447	11.35
.032	.81	.469	11.91
.047	1.19	1.000	25.40
.049	1.24	1.151	29.24
.064	1.63	1.250	31.75
.070	1.78	1.719	43.66
.188	4.78	1.950	49.53

NOTES:
1. Dimensions are in inches.
2. Metric equivalents (to the nearest .01 mm) are given for general information only and are based upon 1 inch = 25 4 mm.
3. Unless otherwise specified, tolerances are ±.005(.13 mm) and ± 1/2°

Ⓔ DENOTES CHANGES

APPROVED 31 MARCH 1961 REVISED Ⓐ 25 MAR 1963 Ⓑ 17 SEPT 1963 Ⓒ 19 JUNE 1964 Ⓓ 10 NOV 1969 Ⓔ 11 FEB 80

DSA - ES
Army - AV, MI
Navy - OS, EC
Air Force - 11, 17, 99

User activities: Army - Navy - Air Force -
Review activities

This military standard is approved for use by all Departments and Agencies of the Department of Defense Selection for all new engineering and design applications and for repetitive use shall be made from this document when applicable

P A: USAF - 85 Other Cust: NAVY - AS ARMY - ER Ⓔ	International Interest	TITLE: SWITCH, ROTARY, AMMETER SELECTOR, 115/200 VOLTS FOR 1, 2, 4 GENERATOR SYSTEM	MILITARY STANDARD MS21994
Procurement Specification: MIL-S-6807		SUPERSEDES	SHEET 1 OF 2

DD FORM 1 MAY 73 672 (Coordinated) PREVIOUS EDITIONS OF THIS FORM ARE OBSOLETE

PROJECT NO. 5930-1120

Source: https://assist.dla.mil -- Downloaded: 2026-10-23T14:43Z
Check the source to verify that this is the current version before use.

DETAIL REQUIREMENTS:

1. Shaft is shown in the off position.
2. Off position of knob may be oriented as desired by positioning of mounting panel detent for engagement with locking ring bent tab.
3. (E) Threads in accordance with FED-STD-H28, Screwthreads Standards for Federal Service.
4. Stops shall be provided to limit movement of the pointer knob to positions 3, 4,.5 and 6.
5. Contacts shall be make-before-break.
6. Shock Method II is required for shipboard application.

CURRENT CAPACITY 115/200V, 400 Hertz AC
RESISTIVE 5 AMP
ELECTRICAL END 10,000 CYCLES

(E)

DASH NO. / SHOCK METHOD I & II	NO. OF SECTIONS	WEIGHT (LBS.)	TORQUE (LB.-IN.)	"A" DIM
-1	2	.4 MAX.	6 MAX.	1,525
-2	4	.6 MAX.	8 MAX.	2,275
-3	8	9 MAX.	14 MAX.	4,;50

(E) SUPERSESSION TABLE

SUPERSEDING DASH NO. / SHOCK METHOD I & II	SUPERSEDED DASH NO. / SHOCK METHOD I & II
-1	-12
-2	-22
-3	-32

For design feature purposes, this standard takes precedence over procurement docuemnts referenced herein. Referenced documents shall be of the issue in effect on date of invitation for bid.

QUALIFICATION

1. Single Switch Submission - Qualification will be made in accordance with the Qualification Table of MIL-S-6807.
2. Group Submission - In conjunction with Qualification of MS25002 Switches only specimen numbers 7 and 8 of the Qualification Table are required, at 200V, 400 Hz

☆U.S. GOVERNMENT PRINTING OFFICE 1981 — 505-022/8697

APPROVED 31 MARCH 1961 REVISED E FOR CHANGES SEE SHEETS 1 & 2

This military standard is approved for use by all Departments and Agencies of the Department of Defense Selection for all new engineering and design applications and for repetitive use shall be made from this document when applicable

User activities Army - Navy - Air Force -

Review activities DSA - ES Army - AV, MI Navy - OS, EC Air Force - 11, 17, 99

P A USAF - 85 Other Cust NAVY - AS ARMY - ER (E)	International interest	TITLE SWITCH, ROTARY, AMMETER SELECTOR, 115/200 VOLTS FOR 1, 2, 4 GENERATOR SYSTEM	MILITARY STANDARD MS21994
Procurement Specification MIL - S - 6807		SUPERSEDES	SHEET 2 OF 2

DD FORM 1 MAY 73 672 (Coordinated) PREVIOUS EDITIONS OF THIS FORM ARE OBSOLETE

Source: https://assist.dla.mil — Downloaded: 2026-10-23T14:43Z
Check the source to verify that this is the current version before use.