[INCH-POUND]
A-A-52592
March 15, 1996
SUPERSEDING
MIL-P-10388H
24 September 1990

COMMERCIAL ITEM DESCRIPTION

PIPE FITTINGS: ONE OR MORE ENDS GROOVED

The General Services Administration has authorized the use of this commercial item description (CID) for all federal agencies.

1. SCOPE. This CID covers requirements for grooved and combination type pipe fittings. Grooved-type pipe fittings are intended for use as components of portable pipelines conveying light petroleum products or water.

2. SALIENT CHARACTERISTICS

2.1 Materials. Unless otherwise specified, materials shall be in accordance with the manufacturer's material specifications. The use of recovered material made in compliance with regulatory requirements is acceptable providing that all requirements of this CID are met.

2.1.1 Adapters and flanged reducer fittings.

2.1.1.1 Aluminum flanged fittings. Aluminum flanged fittings shall be fabricated from round aluminum-alloy tubing conforming to UNS A96061-T6, wall thickness to fit the application, and flanges of aluminum-alloy forgings conforming to ASTM B247 alloy UNS A96151, or aluminum-alloy castings conforming to ASTM B26, alloy and temper to fit the application.

Beneficial comments, recommendations, additions, deletions clarifications, etc. and any other data which may improve this document should be sent to: U.S. Army Tank-automotive and Armaments Command, ATTN: AMSTA-TR-E/BLUE, Warren, MI 48397-5000.

AMSC N/A FSC 4730
DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.

2.1.1.2 Steel flanged fittings. Steel flanged fittings shall be fabricated from steel pipe conforming to table I, size and weight as shown in table II, and flanges of steel selected by the contractor subject to all the provisions of this specification.

2.1.1.3 Iron flanged fittings. Iron flanged fittings shall be fabricated from steel pipe conforming to table I, size and weight as shown in table II, and flanges of malleable iron castings conforming to ASTM A47, grade 32510, or ductile iron castings conforming to ASTM A536, grade 65-45-12.

2.1.2 Couplings.

2.1.2.1 Steel couplings. Steel couplings shall be steel pipe conforming to table I, size and weight as shown in table II.

2.1.2.2 Aluminum couplings. Aluminum couplings shall be round aluminum-alloy tube conforming to ASTM B210, alloy UNS A96061-T6, wall thickness to fit the application.

Table I. Pipe requirements.

Nominal pipe size (inches)	Outside diameter (inches)	Wall thickness (inches)	Minimum hydrostatic test pressure (psig)
2	2.375	0.154	1500
3	3.500	0.216	1600
4	4.500	0.219	1250
	4.500	0.237	1500
6	6.625	0.219	900
	6.625	0.280	1250
8	8.625	0.250	800
	8.625	0.322	1200
	8.625	0.375	1400
10	10.75	0.307	900
12	12.75	0.250	500
	12.75	0.281	600
	12.75	0.312	750
	12.75	0.375	1000
14	14.00	0.312	600
16	16.00	0.312	550
18	18.00	0.312	500

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.

2.1.3 Fittings (except adapter, coupling, and flanged reducer).

2.1.3.1 Iron fittings. Fittings shall be malleable iron castings conforming to ASTM A47, grade 32510, or ductile iron castings conforming to ASTM A536, grade 65-45-12.

2.1.3.2 Steel fittings. Steel fittings shall be steel selected by the contractor and subject to all provisions of this specification.

2.1.3.3 Aluminum fittings. Aluminum fittings shall be aluminum-alloy forgings conforming to ASTM B247, alloy UNS A96151, or aluminum-alloy castings conforming to ASTM B26, alloy and temper to fit the application.

2.1.4 Fitting ends.

2.1.4.1 Beveled. Beveled ends shall conform to ASME B16.25.

2.1.5 Flanged ends.

2.1.5.1 Cast iron. Cast iron flanged ends shall conform to ASME B16.1, class 125 or 250.

2.1.5.2 Steel. Steel flanged ends shall conform to ASME B16.5, class 150 or 300.

2.1.5.3 Aluminum. Aluminum-alloy flanged ends shall be faced and drilled and conform to ASME B16.1, class 125, 250, or ASME B16.5, class 150 or 300.

2.1.6 Grooved ends. Grooved ends shall conform to the dimensions shown on figure 1. The land-sealing surface shall be smooth and free from mill marks and shall have a roughness height rating of not more than 500 and conform to ASME B46.1.

2.1.7 Threaded ends. Threaded ends shall be National Pipe Thread (NPT) and conform to ASME B1.20.1.

2.2 Design and construction. Fittings shall be malleable iron, ductile iron, steel, or aluminum alloy, as specified (see 6.1 and 6.3). All fittings shall have one end grooved and the other end beveled, flanged, grooved, or threaded. The groove may be continuous or backstop lug design. As specified (see 6.1 and 6.3), fittings may be drilled, tapped, and a pipe plug inserted for 0.25-inch, 0.50-inch, 0.75-inch, or 2-inch National Pipe Thread (NPT) connection.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.

Table II. Pipe Requirements

Nominal Pipe Size (inches)	Outside Pipe Diameter (inches)	Wall Thickness (inches)	Minimum Weight (lb./ft)	Minimum Hydrostatic Test Pressure (psig)
3/4	1.050	0.154	1.13	2000
1	1.315	0.154	1.68	2000
1-1/4	1.660	0.154	2.27	2000
1-1/2	1.900	0.154	2.72	2000
2	2.375	0.154	3.65	2000
2-1/2	2.875	0.154	5.79	1800
3	3.500	0.216	7.58	1800
3-1/2	4.000	0.216	9.11	1800
4	4.500	0.219	10.79	1600
	4.500	0.237	10.79	1600
5	5.563	0.219	14.62	1600
6	6.625	0.219	18.97	1400
	6.625	0.280	18.97	1400
8	8.625	0.250	24.70	1200
	8.625	0.322	24.70	1200
	8.625	0.375	24.70	1200
10	10.750	0.307	28.04	1000
12	12.750	0.250	33.38	1000
	12.750	0.281	33.38	1000
	12.750	0.312	33.38	1000
	12.750	0.375	33.38	1000
14	14.000	0.312	36.71	800

2.2.1 Adapters and flanged reducers. Cast-iron adapters and flanged reducers shall consist of steel pipe threaded into a cast-iron flange. Steel adapters and flanged reducers shall consist of steel pipe threaded or welded to a steel flange. When pipe and flange are threaded together, the threads shall be coated with a nonhardening, nongalling compound inert to aromatic gasoline. Aluminum adapters and flanged reducers shall consist of aluminum-alloy tubing welded to an aluminum-alloy flange.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.

2.2.2 Tees. When specified (see 6.1) tees shall be furnished with a ½-inch cleaner guide. Material of cleaner guide for aluminum fittings shall be ½-inch aluminum. Material of cleaner guide for steel or ductile iron fittings shall be ½-inch steel. Cleaner guide shall be attached to the fitting by brazing or welding across the inside diameter of the branch outlet, with the inner side in line with the bore of the main outlets. Joining processes shall not reduce the strength of the fitting to the extent that the fitting could not withstand the desired hydrostatic test pressure. Appropriate filler material and flux shall be used to prevent corrosion.

2.2.3 Dimensions.

2.2.3.1 Fitting lengths. Lengths for adapters, couplings, and reducers shall be as specified as part of the specification part number (see 6.1 and 6.3). All other fitting dimensions shall conform to table III.

Table III. Fitting length.

Cap	
Nominal size (inches) 3/4, 1, 1-1/4, 1-1/2, 2, 2-1/2, 3, 3-1/2, 4, 5, 6, 8, 10, 12, and 14.	
Length: Seats flush with outside of coupling.	
Cross	
Nominal size (inches)	Length of cross (inches) measured center to ends, all ends grooved
3/4	2-1/4
1	2-1/4
1-1/4	2-3/4
1-1/2	2-3/4
2	3-1/4
2-1/2	3-3/4
3	4-1/4
3-1/2	4-1/2
4	5
5	5-1/2
6	6-1/2
8	7-3/4
10	9
12	10
14	11

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.

Table III. Fitting length - Continued.

Elbows									
Nominal size (inches)	Length of elbows (inches) Both ends grooved					External threaded one end			
	Center to end			End to end		Center to threaded end		Center to grooved end	
	90°	45°	22-1/2°	11-1/4°	Adjustable	90°	45°	90°	45°
3/4	2-1/4	1-1/2	1-5/8	1-3/8	-	2-1/4	1-1/2	2-1/4	1-1/2
1	2-1/4	1-3/4	1-5/8	1-3/8	3-1/4	2-1/4	1-3/4	2-1/4	1-3/4
1-1/4	2-3/4	1-3/4	1-3/4	1-3/8	-	2-3/4	1-3/4	2-3/4	1-3/4
1-1/2	2-3/4	1-3/4	1-3/4	1-3/8	-	2-3/4	1-3/4	2-3/4	1-3/4
2	3-1/4	2	1-7/8	1-3/8	3-3/4	4-1/4	3	3-1/4	2
2-1/2	3-3/4	2-1/4	2	1-1/2	4	3-3/4	2-1/4	3-3/4	2-1/4
3	4-1/4	2-1/2	2-1/4	1-1/2	4-1/2	6	4-1/4	4-1/4	2-1/2
3-1/2	4-1/2	2-3/4	2-1/2	1-3/4	5	6-1/4	2-3/4	4-1/2	2-3/4
4	5	3	2-5/8	1-3/4	5-1/4	7-1/4	5-1/4	5	3
5	5-1/2	3-1/4	2-7/8	2	-	-	-	-	-
6	6-1/2	3-1/2	3-1/8	2	6-1/4	6-1/2	3-1/2	6-1/2	3-1/2
8	7-3/4	4-1/4	3-7/8	2	7-3/4	-	-	-	-
10	9	4-3/4	4-3/8	2-1/8	-	-	-	-	-
12	10	5-1/4	4-7/8	2-1/4	-	-	-	-	-
14	21	8-3/4	5	3-1/2	-	-	-	-	-

Nominal size (inches)	45° Lateral	
	Length of lateral (inches) All ends grooved	
	Center to long end	Center to short end
3/4	4-1/2	2
1	5	2-1/4
1-1/4	5-3/4	2-1/2
1-1/2	6-1/4	2-3/4
2	7	2-3/4
2-1/2	7-3/4	3
3	8-1/2	3-1/4
3-1/2	10	3-1/2
4	10-1/2	3-3/4
5	12-1/2	4
6	14	4-1/2
8	18	6
10	20-1/2	6-1/2
12	23	7
14	26-1/2	7-1/2

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.

Table III. Fitting length - Continued.

Tees		
Nominal size (inches)	Length of tees (inches) measured center to ends	
	Grooved all ends	Reducing
3/4 x 3/4 x 3/4	2-1/4	-
1 x 1 x 1	2-1/4	-
1-1/4 x 1-1/4 x 1-1/4	2-3/4	-
1-1/2 x 1-1/2 x 1-1/2	2-3/4	-
2 x 2 x 3/4	-	3-1/4
x 1	-	3-1/4
x 1-1/2	-	3-1/4
x 2	3-1/4	-
2-1/2 x 2-1/2 x 2-1/2	3-3/4	-
3 x 3 x 1	-	4-1/4
x 1-1/2	-	4-1/4
x 2	-	4-1/4
x 2-1/2	-	4-1/4
x 3	4-1/4	-
3-1/2 x 3-1/2 x 3-1/2	4-1/2	-
4 x 4 x 1	-	3-3/4
x 2	-	5
x 2-1/2	-	5
x 3	-	5
x 4	5	-
5 x 5 x 2	-	5-1/2
x 3	-	5-1/2
x 4	-	5-1/2
x 5	5-1/2	-
6 x 6 x 2	-	6-1/2
x 2-1/2	-	6-1/2
x 3	-	6-1/2
x 4	-	6-1/2
x 5	-	6-1/2
x 6	6-1/2	-
8 x 8 x 2	-	7-3/4
x 3	-	7-3/4
x 4	-	7-3/4
x 5	-	7-3/4
x 6	-	7-3/4
x 8	7-3/4	-
10 x 10 x 2	-	9
x 3	-	9
x 4	-	9
x 5	-	9
x 6	-	9
x 8	-	9
x 10	9	-
12 x 12 x 3	-	10
x 4	-	10
x 5	-	10
x 6	-	10
x 8	-	10
x 10	-	10
x 12	10	-
14 x 14 x 8	-	11
x 10	-	11
x 12	-	11
x 14	11	-

Union (flexible)	
Nominal size (inches)	Length of union (inches) measured end to end both ends grooved
3/4	4
1	4-1/8
1-1/4	4-5/8
1-1/2	4-5/8
2	5
3	5-1/2
4	6-1/2

Tees

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.

2.2.4 Grooves. Pipe grooves shall be as indicated in figure 2.

2.3 Performance.

2.3.1 Working and test pressures.

2.3.1.1 Adapter and flanged reducers. Adapter and flanged reducers shall withstand the applicable working and hydrostatic pressures shown in table IV without evidence of leakage, rupture, or yielding.

Table IV. Working and hydrostatic test pressure.

Class	Maximum working pressure (WOG) 1/ (psi)	Hydrostatic test pressure (psi)
125	175	250
150	230	500
250	500	900
300	720	1100

1/ Water, oil, or gas.

2.3.1.2 Fittings (except adapter and flanged reducers). All fittings except adapter and flanged reducers shall have a working pressure of not less than 600 pounds per square inch (psi) for water, oil, or gas and shall withstand the hydrostatic pressures specified in table V without evidence of leakage, rupture, or yielding.

Table V. Hydrostatic test pressures.

Nominal pipe size (inches)	Hydrostatic test pressure (psi)
3/4	2000
1	2000
1-1/4	2000
1-1/2	2000
2	2000
2-1/2	1800
3	1800
3-1/2	1800

Nominal pipe size (inches)	Hydrostatic test pressure (psi)
4	1600
5	1600
6	1400
8	1200
10	1000
12	1000
14	800

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.

2.4 Treatment and painting. The portions of the pipe and fittings normally painted shall have corrosion resistance equal to or exceed that provided by hot dip galvanized 1020 steel, with coating thickness in accordance with ASTM A123, with zinc phosphate pre-treatment. An alternative coating shall be compared to a galvanized sample (as described above) using the Accelerated Corrosion Test GM 9540P Method B 120 cycles, or until failure of one of the items.

2.5 Identification and markings. Identification and marking of the pipe fittings shall be permanent and legible and shall include, as a minimum, the manufacturer's identification code (CAGE), the contract number, the part identification number (PIN) (see 6.1), and the national stock number (NSN).

3. REGULATORY REQUIREMENTS

3.1 Recovered materials. The offeror/contractor is encouraged to use recovered materials to the maximum extent practicable, in accordance with paragraph 23.403 of the Federal Acquisition Regulation (FAR).

4. QUALITY ASSURANCE PROVISIONS

4.1 Responsibility for inspection. The contractor is responsible for the performance of all inspections and tests.

4.2 Contractor certification. The contractor shall certify and maintain substantiating evidence that the product offered meets the salient characteristics of this CID and that the product conforms to the producer's own drawings, specifications, workmanship standards, and quality assurance practices. Items with known defects shall not be submitted for Government acceptance. The Government reserves the right to require proof of such conformance prior to the first delivery and thereafter as may be otherwise provided for under the provisions of the contract.


5. PACKING. Preservation, packing, and marking shall be as specified in the contract or purchase order (see 6.1).

6. NOTES

(This section contains information of a general or explanatory nature that may be helpful, but is not mandatory.)

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.

6.1 Part or identification number (PIN). The PINs to be used for pipe fittings acquired to this CID are created as follows:

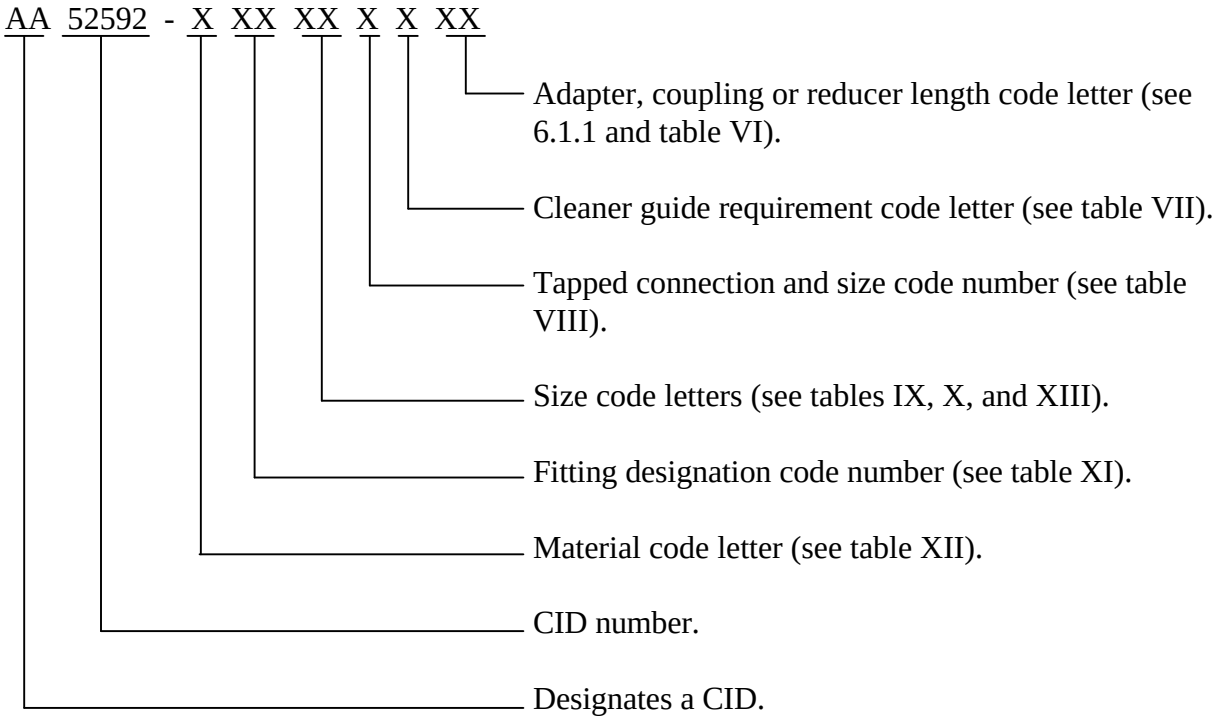

6.1.1 Adapter, coupling and reducer length. The length of the adapter, coupling, or reducer will be identified by a number and letter combination. The number is the number of whole inches in required length, and the letter code indicates the fractional part of an inch of the required length (example: a length of 8.0 inches is 8A, 5.50 inches is 5C, 0.75 inch is 0D, and 10.25 inches is 10B) (see table VI).

Table VI. Fractional inch code letter.

Code Letter	Fractional Inch
A	0
B	1/4
C	1/2
D	3/4

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.

Table VII. Cleaner guide code letter.

Code Letter	Cleaner guide requirement
A	Without cleaner guide (for tees).
B	With cleaner guide (for tees).
C	Without cleaner guide (for fittings other than tee).

Table VIII. Tapped connection and size code number.

Code number	Size of drilled and tapped connection (inches)
1	None
2	1/4
3	1/2
4	3/4
5	1
6	2

Table IX. Size code letters (except reducers and tees).

Size code letters	Nominal pipe size (inches)
AA	3/4
AB	1
AC	1-1/4
AD	1-1/2
AE	2
AF	2-1/2
AG	3
AH	3-1/2
AI	4
AJ	5
AK	6
AL	8
AM	10
AN	12
AO	14

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.

Table X. Reducer size code letters.

Size code letters	Nominal pipe size (inches)	Size code letters	Nominal pipe size (inches)
BA	1-1/2 x 1	AG	3 x 1
BB	2 x 3/4	BH	x 2
BC	x 1	BI	x 2-1/2
BD	x 1-1/4	BJ	3-1/2 x 3
BE	x 1-1/2	BK	4 x 1
BF	2-1/2 x 2	BL	x 2
BM	x 2-1/2	BV	8 x 3
BN	x 3	BW	x 4
BO	x 3-1/2	BX	x 5
BP	5 x 4	BY	x 6
BQ	6 x 1	BZ	10 x 4
BR	x 2	CA	x 6
BS	x 3	CB	x 8
BT	x 4	CC	12 x 6
BU	x 5	CD	x 8
		CE	x 10

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.

Table XI. Fitting designation code number.

Fitting code number	Fitting kind
	ADAPTERS
01	Flanged (class 125) one end.
02	Flanged (class 150) one end.
03	Flanged (class 250) one end.
04	Flanged (class 300) one end.
05	CAP
	COUPLINGS
06	Beveled one end.
07	External threaded one end.
08	Grooved both ends.
09	Internal threaded one end.
10	CROSS
	ELBOWS
11	90 degree both ends grooved.
12	90 degree external threaded one end.
13	45 degree both ends grooved.
14	45 degree external threaded one end.
15	22-1/2 degree both ends grooved.
16	11-1/4 degree both ends grooved.
17	Adjustable both ends grooved.
	LATERALS
18	45 degree all ends grooved.
	REDUCERS
19	Grooved both ends.
20	Flanged (class 125) large end.
21	Flanged (class 150) large end.
22	Flanged (class 250) large end.
23	Flanged (class 300) large end.
24	Flanged (class 125) small end.
25	Flanged (class 150) small end.
26	Flanged (class 250) small end.
27	Flanged (class 300) small end.
28	Threaded small end.
	TEES
29	Grooved all ends.
30	Reduced grooved all ends.
31	Reducing run ends grooved, branch end external threaded.
32	Reducing run ends grooved, branch end internal threaded.
33	Union flexible both ends grooved.

Table XII. Type material code letter.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.

Code Letter	Material
A	Aluminum alloy.
B	Malleable iron, ductile iron or steel.

Table XIII. Tee size code letters.

Size letter	Nominal pipe size (inches)	Size letter	Nominal pipe size (inches)
DA	3/4 x 3/4 x 3/4	DO	3-1/2 x 3-1/2 x 3-1/2
DB	1 x 1 x 1	DP	4 x 4 x 1
DC	1-1/4 x 1-1/4 x 1-1/4	DQ	x 2
DD	1-1/2 x 1-1/2 x 1-1/2	DR	x 2-1/2
DE	2 x 2 x 3/4	DS	4 x 4 x 3
DF	x 1	DT	x 4
DG	x 1-1/2	DU	5 x 5 x 2
DH	x 2	DV	x 3
DI	2-1/2 x 2-1/2 x 2-1/2	DW	x 4
DJ	3 x 3 x 1	DX	x 5
DK	x 1-1/2	DY	6 x 6 x 2
DL	x 2	DZ	x 2-1/2
DM	x 2-1/2	EA	x 3
DN	x 3	EP	x 8
EB	x 4	EQ	x 10
EC	x 5	ER	12 x 12 x 3
ED	x 6	ES	x 4
EE	8 x 8 x 2	ET	x 5
EF	x 3	EU	x 6
EG	x 4	EV	x 8
EH	x 5	EW	x 10
EI	x 6	EX	x 12
EJ	x 8	EY	14 x 14 x 8
EK	10 x 10 x 2	EZ	x 10
EL	x 3	FA	x 12
EM	x 4	FB	x 14
EN	x 5		
EO	x 6		

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.

6.2 Source of documents.

6.2.1 Government documents. Copies of the Code of Federal Regulations (FAR) may be obtained from the Superintendent of Documents, U.S. Government Printing Office, Washington, DC 20402.

6.2.2 DoD adopted documents. Copies of ASTM Standards are available from the American Society for Testing and Materials, 100 Barr Harbor Drive, West Conshohocken, PA 19428-2959. Copies of ASME Standards are available from the American Society of Mechanical Engineers, 345 East 47th Street, New York, NY 10017.

6.3 Ordering data. Acquisition documents must specify the following:

a. Title, number, and date of this CID.
b. Issue of DoDISS to be cited in the solicitation.
c. Type, PIN and quantity of fittings required.
d. Selection of applicable level and packaging requirements.

6.4 Cross-reference data. Pipe fittings conforming to this CID are interchangeable/substitutable with pipe fittings conforming to MIL-P-10388H.


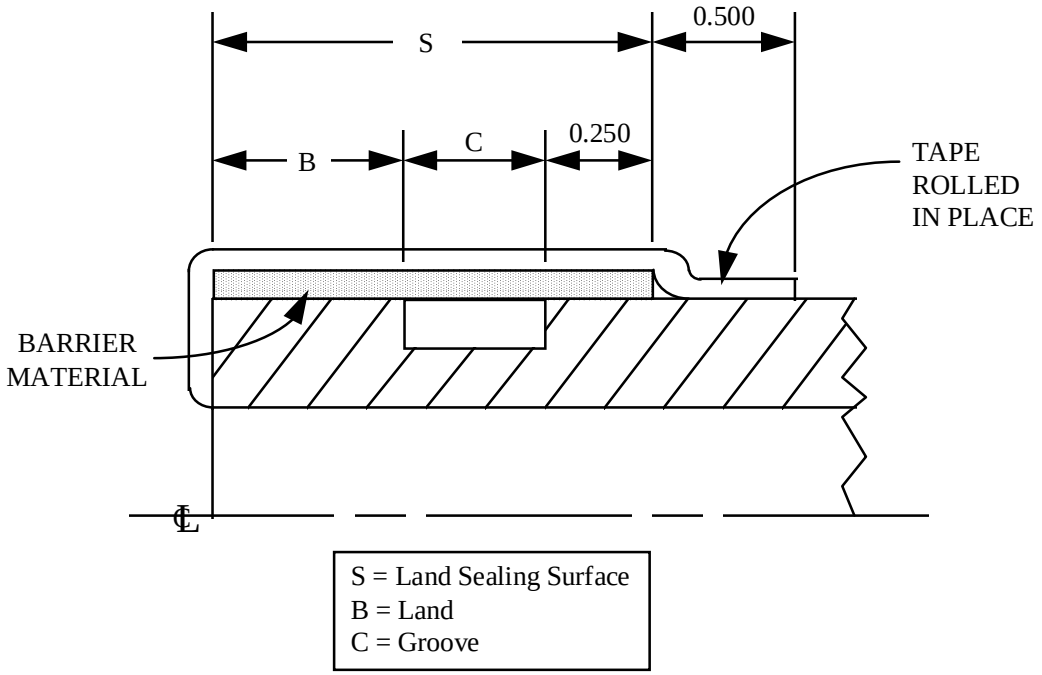


Figure 1. Land sealing surface for grooved end pipe, tube end fittings.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.

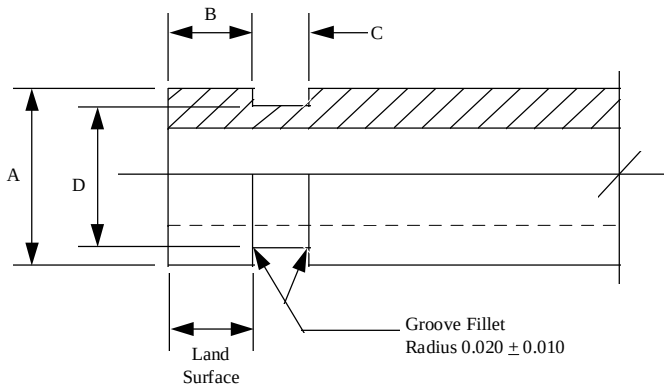

Nominal Pipe Size	A		B	C	D
	Aluminum	Iron 1/			
3/4	1.065 +0.000 -0.016	1.050 +0.031 -0.016	0.625 ±0.031	0.313 ±0.031	0.938 +0.000 -0.015
1	1.330 +0.000 -0.016	1.315 +0.031 -0.016	0.625 ±0.031	0.313 ±0.031	1.190 +0.000 -0.015
1-1/4	1.675 +0.000 -0.016	1.660 +0.031 -0.016	0.625 ±0.031	0.313 ±0.031	1.535 +0.000 -0.015
1-1/2	1.915 +0.000 -0.016	1.900 +0.031 -0.016	0.625 ±0.031	0.313 ±0.031	1.775 +0.000 -0.015
2	2.407 +0.000 -0.016	2.375 +0.031 -0.016	0.625 ±0.031	0.313 ±0.031	2.250 +0.000 -0.015
2-1/2	2.905 +0.000 -0.016	2.875 +0.031 -0.016	0.625 ±0.031	0.313 ±0.031	2.720 +0.000 -0.015
3	3.532 +0.000 -0.016	3.500 +0.031 -0.016	0.625 ±0.031	0.313 ±0.031	3.344 +0.000 -0.018
3-1/2	4.040 +0.000 -0.016	4.000 +0.031 -0.016	0.625 ±0.031	0.313 ±0.031	3.834 +0.000 -0.020
4	4.532 +0.000 -0.016	4.500 +0.031 -0.016	0.625 ±0.031	0.375 ±0.031	4.334 +0.000 -0.020
5	5.620 +0.000 -0.016	5.563 +0.031 -0.016	0.625 ±0.031	0.375 ±0.031	5.395 +0.000 -0.022
6	6.657 +0.000 -0.016	6.625 +0.031 -0.016	0.625 ±0.031	0.375 ±0.031	6.455 +0.000 -0.022
8	8.657 +0.000 -0.016	8.625 +0.031 -0.016	0.750 ±0.031	0.437 ±0.031	8.441 +0.000 -0.025
10	10.850 +0.000 -0.032	10.750 +0.047 -0.031	0.750 ±0.031	0.500 ±0.031	10.562 +0.000 -0.027
12	12.797 +0.000 -0.032	12.750 +0.047 -0.031	0.750 ±0.031	0.500 ±0.031	12.531 +0.000 -0.030
14	14.870 +0.000 -0.032	14.000 +0.047 -0.031	0.936 ±0.031	0.500 ±0.031	13.781 +0.000 -0.030

1/ Steel, Maleable Iron, or Ductile Iron

FIGURE 2. Pipe Groove.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.

MILITARY INTERESTS:

Custodians:
Army - AT
Navy - MC

Review Activities:
DLA - CS

CIVIL AGENCY COORDINATING ACTIVITY:
GSA - FSS

Preparing Activity:
Army - AT

(Project 4730-0459)

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:13Z
Check the source to verify that this is the current version before use.