TT–C–598b
MARCH 12, 1965

SUPERSEDING
Int. Fed. Spec. TT–C–00598a
April 15, 1964 and
Fed. Spec. TT–C–598
April 25, 1942

FEDERAL SPECIFICATION

CALKING COMPOUND, OIL AND RESIN BASE TYPE (FOR MASONRY AND OTHER STRUCTURES)

This specification was approved by the Commissioner, Federal Supply Service, General Services Administration, for the use of all Federal agencies.

1. SCOPE AND CLASSIFICATION

1.1 Scope. This specification covers the properties of a one-component oil and/or resin base calking compound for use in masonry and other types of structures.

1.2 Classification.

1.2.1 *Types.* The calking compound shall be available in two types:

Type I—For gun application. This type shall be suitable for use in calking guns at temperatures above 40° F.

Type II—For knife application. This type shall be suitable for application with a putty knife at temperatures above 40° F.

2. APPLICABLE SPECIFICATIONS AND STANDARDS

2.1 The following specifications and standards, of the issues in effect on date of invitation for bids or request for proposal, form a part of this specification to the extent specified herein:

Federal Specifications:

PPP–C–96—Cans, Metal, 28 Gage and Lighter.
PPP–B–585—Boxes, Wood, Wirebound.
PPP–B–591—Boxes, Fiberboard, Wood-Cleated.
PPP–B–601—Boxes, Wood, Cleated-Plywood.
PPP–B–621—Boxes, Wood, Nailed and Lock-Corner.
PPP–B–636—Box, Fiberboard.
PPP–B–640—Boxes, Fiberboard, Corrugated, Triple-Wall.
PPP–P–704—Pails: Shipping, Steel (1 Through 12 Gallon).

Federal Standards:

Fed. Std. No. 102—Preservation, Packaging, and Packing Levels.
Fed. Std. No. 123—Marking for Domestic Shipment (Civilian Agencies).
Fed. Test Method Std. No. 141—Paint, Varnish, Lacquer, and Related Materials; Methods of Inspection, Sampling, and Testing.

(Activities outside the Federal Government may obtain copies of Federal Specifications, Standards, and Handbooks as outlined under General Information in the Index of Federal Specifications and Standards and at the prices indicated in the Index. The Index, which includes cumulative monthly supplements as issued, is for sale on a subscription basis by the Superintendent of Documents, U.S. Government Printing Office, Washington, D.C., 20402.

(Single copies of this specification and other product specifications required by activities outside the Federal Government for bidding purposes are available without charge at the General Services Administration Regional Offices in Boston, New York, Washington, D.C., Atlanta, Chicago, Kansas City, Mo., Dallas, Denver, San Francisco, Los Angeles, and Seattle, Wash.

(Federal Government activities may obtain copies of Federal Specifications, Standards, and Handbooks and the Index of Federal Specifications and Standards from established distribution points in their agencies.)

Military Standards:

MIL–STD–105—Sampling Procedures and Tables for Inspection by Attributes.
MIL–STD–129—Marking for Shipment and Storage.

(Copies of Military Specifications and Standards required by contractors in connection with specific procurement functions should be obtained from the procuring activity or as directed by the contracting officer.)

3. REQUIREMENTS

3.1 Material. The compound shall be composed of pigments and fillers, either with or without fibers, uniformly mixed in a liquid ve-

☆U.S. GOVERNMENT PRINTING OFFICE: 1981—703-023/4474

FSC 8030

102–691—65

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T12:17Z
Check the source to verify that this is the current version before use.

hicle to a consistency suitable for calking joints in metal, glass, wood, or masonry surfaces. The producer is allowed a wide latitude in the choice of raw materials for making the product.

3.2 Stability. The compound in the original cartridge or can shall be stable for at least 12 months from the time of delivery when stored at a temperature not exceeding 80° F.

3.3 Color. Unless otherwise specified, the color shall be in the range of the commercial shades of calking compounds such as white, gray, and natural. When a specific color is specified it shall substantially match that of a reference sample mutually agreed upon by purchaser and producer.

3.4 Shrinkage. The compound, when tested on limestone as prescribed in 4.3.4, shall not shrink more than 20.0 percent.

3.5 Tenacity. A ¼-inch layer of compound, when tested on limestone as prescribed in 4.3.5, shall not show any crack or separation after being folded over, 180 degrees, six times.

3.6 Bond. The compound, when tested between limestone and glass as prescribed in 4.3.6, shall not separate from the glass over an area greater than 10 percent of the original area of contact.

3.7 Slump. The compound shall not slump more than 0.15 inch when tested as prescribed in 4.3.7.

3.8 Stain. The compound shall not show a stain index greater than 6 when tested as prescribed in 4.3.8.1. In the alternative method, the maximum stain value shall not be greater than 1.5 mm.

3.9 Tack-free time. When tested as prescribed in 4.3.9, no calking material shall adhere to the polyethylene strip when the latter is pulled from the layer of compound.

3.10 Extrudability (for type I compound only). The compound shall have an extrudability value of not more than 9 seconds per ml. when tested as prescribed in 4.3.10.

4. SAMPLING, INSPECTION, AND TEST PROCEDURES

4.1 The supplier is responsible for the performance of all inspection requirements as specified herein. Except as otherwise specified, the supplier may utilize his own or any other inspection facilities and services acceptable to the Government. Inspection records of the examination and tests shall be complete and available to the Government as specified in the contract or order. The Government reserves the right to perform any of the inspections set forth in the specification where such inspections are deemed necessary to assure that supplies and services conform to prescribed requirements.

4.2 Sampling and inspection should be made in accordance with methods 1011, 1021 and/or 1031 of Fed. Test Method Standard No. 141, as applicable.

4.2.1 *Inspection of preparation for delivery requirements.* An inspection shall be made to determine that the packaging, packing, and marking requirements comply with the requirements of section 5 of this specification. Defects shall be scored in accordance with table I. For examination of interior packaging, the sample unit shall be one shipping container fully prepared for delivery selected at random just prior to the closing operations. Sampling shall be in accordance with MIL–STD–105. Defects of closure listed shall be examined on shipping containers fully prepared for delivery. The lot size shall be the number of shipping containers in the end item inspection lot. The inspection level shall be S–2 and the AQL shall be not more than 4.0 defects per hundred units.

TABLE I.—*Classification of preparation for delivery defects*

Examine	Defects
Markings (exterior and interior).	Omitted; incorrect; illegible; improper size, location, sequence, or method of application.
Materials	Any component missing or damaged.
Workmanship	Inadequate application of components such as incomplete closure of container flaps; loose strapping, inadequate stapling. Bulging or distortion of container.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T12:17Z
Check the source to verify that this is the current version before use.

4.3 Laboratory tests.

4.3.1 *Standard conditions for laboratory tests.* All tests described in the following paragraphs shall be performed in a laboratory controlled at 75°±3° F. and 50±10 percent relative humidity. The calking sample shall be conditioned for at least 24 hours at standard temperature and relative humidity before any laboratory tests are made.

4.3.2 *Standard limestone blocks.* Standard blocks to be used in the shrinkage, tenacity, and bond tests shall be "Rockwood veinless gray" produced by the Alabama Limestone Co., Division of the Georgia Marble Co., Russellville, Ala. The test blocks shall be 3½ inches square by ⅝- to ¾-inch thick and shall be finished by grinding with No. 80 grit (aluminum oxide, silicon carbide, or sand). The finished blocks may be ordered from the producer mentioned above, or any other convenient source of supply.

4.3.3 *Color.* If a color match is required, spread a layer about ⅛-inch thick on glass or metal alongside a similar layer of the reference sample. Compare the colors of the two compounds after 5 days exposure in the laboratory, and report observations. If the color is not specified, the test specimen shall be examined to determine if its color is within the range stated in 3.3.

4.3.4 *Shrinkage.* Apparatus and accessory materials required are: (1) Convection type oven controlled at 149°±3° F.; (2) oven (convection or blower type), controlled at 220°±5° F.; (3) titrating buret marked in 0.1 ml.; (4) brass ring (metal about 1/16-inch thick) exactly $2^{41}/_{64}$ inches in inside diameter and ½-inch wide, with ends ground flat; (5) two ground glass cover plates 3 to 3½ inches in diameter; (6) a standard limestone block, 3½ inches square by ⅝- to ¾-inch thick; (7) leveling tool for spreading compound; (8) distilled water; and (9) steel spatula.

Procedure. Adhere the brass ring to one of the groud glass plates. Determine the volume of the ring by filling it with distilled water at standard temperature from a titrating buret. The water from the buret shall be slowly added so that there are no air bubbles when the glass cover plate is centered on the ring. Record the amount of water required to fill the ring, to the nearest 0.03 ml., as V_r.

Center the ring on the limestone block which had been previously dried in an oven at 220° ±5° F. for 24 hours and cooled to room temperature. Spread a ¼-inch layer of compound in the ring using the leveling tool to form good contact with ring and stone (fig. 1). Pour distilled water from buret into ring until it is exactly filled (without air bubbles), as determined by covering with a ground glass plate (fig. 2). Record how much water is needed to fill the ring (reading the buret to an accuracy of 0.03 ml.) and designate the amount as V_i.

Pour out the water from the ring and place the specimen at the same level as the temperature measuring device in an oven set at 149° ±3° F. for 120 hours. At the end of this exposure period and after the specimen has cooled for 2 hours at room temperature, repeat the filling of the ring using the buret and record the volume of water used as V_f. Calculate the shrinkage of the sample as follows:

$$\text{Percent shrinkage} = \frac{V_f - V_i}{V_r - V_i} \times 100$$

where:

V_r = volume of ring.

V_f = volume of water required to fill ring after 120 hours exposure.

V_i = volume of water required to fill ring before oven exposure.

4.3.5 *Tenacity.* This test is made on the specimen used for determining shrinkage. Accessory materials required are: (1) Thin knife blade; (2) wide stiff putty knife. After the shrinkage test has been completed, run the point of a thin knife blade along the inside edge of the ring and lift ring from the compound and block. With a stiff putty knife, loosen one-half of the calking pat from the block. Place the putty knife under the loosened portion of the compound and fold over 180 degrees, on to the remaining part, return to original position and repeat operation until six folds have been made along the same line. Embrittlement or lack of tenacity is indicated by breaking or cracking of the calking layer at the crease.

4.3.6 *Bond.* Apparatus and materials required are: (1) Convection type oven, controlled

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T12:17Z
Check the source to verify that this is the current version before use.

at 122°±2° F.; (2) glass plate, 3½ inches square, about ⅛-inch thick; (3) standard limestone block, 3½ inches square and ⅝- to ¾-inch thick; (4) two brass rods, 4 inches long and 5/16-inch in diameter which have been planed off on two opposite sides to give a thickness of ¼ inch; (5) steel spatula; (6) wrench; and (7) glass plate ruled into ½-inch squares.

The rods are temporarily sealed to the stone block with flattened sides in contact with the stone, each parallel to and about ¼ inch away from opposite edges of the block. A layer of the compound is spread over the surface of the stone between the rods and built up to a thickness slightly greater than ¼ inch. A thin layer of the compound is then applied to one surface of the glass plate in a strip about 2½ inches wide so there are no bubbles between the glass and the compound. This plate is then placed on top of the rods with the strip of compound in contact with the layer between the rods and forced down (fig. 3). The excess compound forced out of the joint is then cleaned off and the specimen stored for 120 hours in an oven controlled at 122°±2° F. At the end of the exposure period and after the specimen is allowed to cool 2 hours at room temperature, the test is made by turning the rods, one at a time, 90 degrees with a wrench, so they will roll away from the compound thus increasing the thickness of the joint by 25 percent. The area of separation from the glass may be estimated by super-imposing on the specimen a glass or clear plastic plate ruled into ½-inch squares.

4.3.7 *Slump.* Apparatus and materials required are: (1) Flow test jig, constructed in accordance with fig. 4; (2) convection type oven controlled at 122°±2° F.; (3) steel spatula; (4) plastic scraper; and (5) solvent such as methyl ethyl ketone.

Procedure. Place the flow test jig, after cleaning it thoroughly with solvent, on a level table with front face upward and with the plunger depressed to the limit of its travel.

After jig has been conditioned in the laboratory for at least 5 hours at 75°±3° F., place a portion of the compound in the cavity and level off the compound carefully with a plastic straightedge, flush with the surface of the block. The leveling shall be accomplished by one gentle upward stroke, while holding the straightedge at a 45-degree angle. Precautions should be taken to avoid air pockets in the compound especially near the surface of the plunger.

Carefully clean the area around the cavity with a plastic scraper and cloth. After cleaning, immediately place the instrument on its end and advance the plunger gently to one half its maximum travel, or 3/16 inch. This leaves a solid cylinder of calking compound, 1½ inches in diameter and 3/16-inch thick, ready to flow down the face of the instrument.

Note: The washer, 3/16-inch thick, placed on the shaft of the plunger in back of the instrument and in front of the large nut prevents the plunger from being moved more than 3/16 inch.

Immediately place the instrument in a vertical position on a level shelf in an oven held at 122°±2° F. Precautions should be taken to eliminate any vibrations in the table supporting the oven during the test. Take a reading of the maximum point of flow after 30 minutes. Estimate the reading to the nearest 0.01 inch on the engraved scale which is graduated to 0.1 inch.

4.3.8 *Stain.*

4.3.8.1 *Procedure with filter paper.* Apparatus and materials required are: (1) Convection or blower type oven having a temperature controlled at 220°±5° F.; (2) brass ring, 19 mm. (¾ inch) inside diameter, 19 mm. high, walls at one end beveled to a minimum diameter; (3) filter paper Whatman, No. 1, or equivalent grade of domestic paper, 10 sheets, high grade, rapid, 9 cm. in diameter; (4) aluminum foil, household type, 1-inch square; (5) weight, 300 g.; (6) small thin steel spatula; and (7) glass plate, approximately 4 by 4 inches, ⅛-inch thick.

Dry, for 5 to 8 hours, a sufficient number of filter papers in an oven maintained at 220° ±5° F. At the end of the drying period remove from the oven and store in a desiccator until cool. Remove 10 filter papers from the desiccator, staple them together, and place them on a glass plate. Set the brass ring with beveled edge down centrally on top of the filter papers. Fill the ring flush with compound taking care to incorporate as little air as possible with compound. Place a 1-inch-square piece of alumi-

Source: https://assist.dla.mil -- Downloaded: 202610-26T12:17Z
Check the source to verify that this is the current version before use.

num foil on top of ring, and the 300 g. weight on top of the foil (fig. 5). Allow to stand for 72 hours at 75° ± 3° F. After 72 hours, slide a spatula under the brass ring and remove the ring and compound. Hold the top filter paper up to the light with a glass plate under it and with a sharp pencil point mark the maximum and minimum diameters of the stain. Measure these diameters to the nearest 0.2 mm. Subtract 19 (diameter of ring in mm.), from the average of the two diameters and divide by 2. Record the result as "width of stain."

Examine the 10 individual papers for oil stain by holding them up to the light. Record the number of papers, including the first one, showing any evidence of oil staining as "number of papers stained."

The sum of the "width of stain" and "number of papers" stained shall be reported as "stain index."

4.3.8.2 *Alternative stain test.* If the sample of calking compound to be tested is accompanied by a sample block of masonry (brick, marble, limestone, etc.) which is to be used on the job in question, the standard stain test shall be waived and the following alternative test used in its place:

Apparatus and accessory materials required are: (1) Convection or blower type oven controlled at 220° ± 5° F.; (2) putty knife. Dry duplicate specimens of the masonry sample (cut into approximately 3½- by 3½- by ¾-inch blocks) in an oven controlled at 220° ± 5° F. for 24 hours and cool to room temperature. Place a round pat of the calking sample 1½ inches in diameter and about ¼-inch high on the surface of each block. Expose the blocks in air for 5 days at 75° ± 3° F. At the end of this period measure and record the width of the stain (if present) to the nearest 0.2 mm. Take four readings at 90 degree points around each pat. Record the average of the eight readings and designate this value as S.

Remove calking pat with a putty knife and break the blocks in two, approximately through the middle of the calked area, by a sharp blow with a hammer. Measure and record the depth of penetration of the stain into the block, taking three readings on each broken piece, two on the ends and one in the middle of the stained surface. Record the average of the 12 readings, and designate this value as T. The final stain value is the average of S and T.

4.3.9 *Tack-free-time.* Accessory materials required are: (1) Brass weight, 40 g., approximately 1½ by ¾ by ¼ inches; (2) template, steel or brass, ⅛-inch high, 3¾ inches by 1 inch inside, and approximately 4¾ by 2 inches outside; (3) two clear, low density polyethylene strips, approximately 5 by 1 by 0.004 inches ±0.002 inch; (4) one tin plate, 3 by 5 inches; and (5) steel spatula and thin knife blade.

Test procedure. Center template on tin plate and completely fill the space within the template with a portion of the sample. Strike the surface of the compound flat to a uniform ⅛ inch throughout the template and lift template straight up. For type 1 compound expose the test specimen in the laboratory for 72 hours at 75° ± 3° F. For type 2 compound expose for 120 hours under same conditions as for type 1. At the end of the exposure period center the polyethylene strip lengthwise along the top surface of the compound and set the brass weight in the center of the top of the strip for 30 seconds. Remove weight, and then progressively withdraw plastic film (with thumb and forefinger) at right angles to the compound. Note if any compound adheres to the film (fig. 6).

4.3.10 *Extrudability.* Equipment and accessory materials required are: (1) Press-flow extrusion rheometer; (2) air supply and pressure gauge accurate to 1 p.s.i.; (3) stand and clamps to hold rheometer; (4) shrinkage ring of known volume as used for shrinkage test, and 2 ground glass plates; (5) 50-ml. titrating buret and stand; (6) triple beam balance accurate to 1 g.; (7) chemical balance; (8) Stopwatch. After conditioning rheometer at 75° ± 3° F. for at least 4 hours, remove both ends from rheometers and stand the rheometer tube on a vertical surface, bottom up. Insert follower plate and fill with calking, avoiding air pockets. Strike off filled tube, flat, with spatula. Replace top and orifice caps and connect to air supply (fig. 7).

Adjustment of air pressure. Adjust air pressure to 30 p.s.i. and open air valve. If pressure drops, readjust to 30 p.s.i. while extrusion is in progress. Close air valve and discard extruded

Source: https://assist.dla.mil -- Downloaded: 202640-26T12:17Z
Check the source to verify that this is the current version before use.

compound. The equipment is now ready for testing.

Place assembly in a stand so that the calking compound is extruded on a triple beam balance. Open air valve and start stopwatch simultaneously. After extruding approximately 50 g. of compound, close air valve and click stopwatch simultaneously. Weigh to the nearest 0.01 g., the exact amount of compound extruded. Calculate the seconds per gram by dividing the number of seconds elapsed by the number of grams extruded and designate this value as S. This value shall be converted to seconds per ml. after determining the density of the sample as follows:

Weigh a glass plate and shrinkage ring of known volume (designate V_1) to the nearest 0.01 g. and record combined weight as W_1 (see shrinkage test procedure for description of materials). Center the ring on the glass plate and spread about 20 g. of the sample on the plate inside the ring, free of air bubbles. Weigh assembly and record as W_2.

With a titrating buret determine the ml. of distilled water required to fill the ring as determined by placing a ground glass cover plate over the ring. The filled ring shall be free of air bubbles. Record this amount of water as V_2. Grams per ml. of calking compound are expressed as:

$$D=\frac{W_2-W_1}{V_1-V_2}$$

Extrudability, expressed in seconds per ml. of calk is determined by the formula:

$$E=S\times D$$

where:

S=seconds per gram of calk
D=grams per ml. of calk

5. PREPARATION FOR DELIVERY

(For civil agency procurement, the definitions and application of levels of packaging and packing shall be in accordance with Fed. Std. No. 102.)

5.1 Packaging. Packaging shall be level A, B, or C, as specified (see 6.2).

5.1.1 *Unit of issue.* One filled cartridge, ½ pint, 1 pint, 1 gallon or 5 gallons of the product constitutes a unit of issue.

5.1.1.1 *Level A.*

5.1.1.1.1 *Unit packaging.*

5.1.1.1.1.1 *Type I.* The compound shall be unit packaged in a cartridge, 1-pint or 1-gallon round can conforming to PPP-C-96, type V, class 2 or in a 5-gallon pail conforming to PPP-P-704, type II, classes 3, 4, or 5 as specified (see 6.2).

5.1.1.1.1.2 *Type II.* The compound shall be unit packaged in a ½-pint or 1-gallon round can conforming to PPP-C-96, type V, class 2 as specified (see 6.2).

5.1.1.1.1.3 *Intermediate packaging.* Ten unit packages of cartridge shall be packaged in a close-fitting box conforming to PPP-B-636, W5c. The box shall be closed and waterproofed sealed in accordance with the appendix to the box specification.

5.1.1.2 *Level B.* The compound shall be unit packaged as specified in 5.1.1 and 5.1.1.1 except the intermediate package box shall be class-domestic.

5.1.1.3 *Level C.* The compound shall be packaged in accordance with the suppliers commercial practice.

5.2 Packaging. Packing shall be level A, B, or C, as specified (see 6.2).

5.2.1 *Level A.* The intermediate packages of cartridges or cans of compound shall be packed in close-fitting boxes conforming to PPP-B-585, class 3; PPP-B-591, class II; PPP-B-601, type III; PPP-B-621, class 2; PPP-B-636, class weather-resistant; or PPP-B-640, class 2, grade A. The boxes shall be closed and strapped in accordance with the applicable specification or appendix thereto. The gross weight of the triple wall fiberboard box and the wood boxes shall not exceed 200 pounds. The gross weight of the PPP-B-636 fiberboard box shall not exceed the weight limitations of the box specification.

5.2.2 *Level B.*

5.2.2.1 *Type I.* Five intermediate packages of cartridges or 24-pints or 4-gallon cans of compound shall be packed in a close-fitting box conforming to PPP-B-636, class-domestic. The box shall be closed in accordance with the appendix to the box specification.

5.2.2.2 *Type II.* Twenty-four ½-pint or four 1-gallon cans of compound shall be packed

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T12:17Z
Check the source to verify that this is the current version before use.

in a close-fitting box conforming to PPP–B–636, class-domestic. The box shall be closed in accordance with the appendix to the box specification.

5.2.3 *Level C.* The compound shall be packed to insure carrier acceptance and safe delivery to destination in containers complying with the rules and regulations applicable to the mode of transportation.

5.3 Standard pack (civil agency procurements). The standard pack for civil agency procurements shall be as specified in paragraphs 5.1.1.2 and 5.2.2 (see 6.2).

5.4 Marking.

5.4.1 *Civil agencies.* In addition to markings required by the contract or order, the packages and shipping containers shall be marked in accordance with Fed. Std. No. 123.

5.4.2 *Military activities.* In addition to markings required by the contract or order, the packages and shipping containers shall be marked in accordance with MIL–STD–129.

6. NOTES

6.1 Intended use.

6.1.1 The compound covered by this specification is intended for sealing joints in wood, glass, metal, and masonry structures or joints between various combinations, such as masonry and metal, metal and glass, etc. Type 1 is of a soft consistency that can be applied with a calking gun at the usual temperatures at which construction work is done.

Type 2 is about the same consistency as glazing putty and is generally applied with a calking tool. A compound should not be applied at temperatures below 40° F.

6.1.2 *Calking compound for gun application* is available in bulk or in standard size cartridges which fit into standard size metal calking guns. Guns are also available for bulk compounds.

6.1.3 When a shipment includes calking compound from more than one batch, each batch should be sampled for test because two batches made by the same formula and by the same manufacturer often differ in quality.

6.1.4 Calking materials should be applied to clean, dry surfaces. Joints may be freed from dust by swabbing with a cloth moistened with a solvent such as mineral spirits. Priming of porous materials where contact is made with the calking compound is often done, but primers that thoroughly seal the pores may interfere with the bond. Many primers produce discolorations on masonry if allowed to flow over the exposed parts. A properly compounded calking material does not stain masonry and in general may be expected to give better service without the use of primers.

6.1.5 The plasticity of calking compounds is affected by temperature and hence cold weather application is difficult. Modification of the compound on the job by addition of thinners or dry powders should not be permitted. For cold weather application the material may be softened by warming it in the container.

6.1.6 Calking compound often undergoes changes in consistency in the containers and should not be kept in storage for a long period before use.

6.2 Ordering data. Purchasers should exercise any desired options offered herein and procurement documents should specify the following:

(*a*) Title, number, and date of this specification.
(*b*) Type required (see 1.2.1).
(*c*) Specify color if required (see 3.3).
(*d*) Quantity and sizes of containers required.
(*e*) Level of packaging and packing required (see 5.1 and 5.2).
(*f*) Special marking if required (see 5.4).

6.3 Standard pack for civil agencies. The standard pack requirements in 5.3 are intended for use in procurements of stores stock replenishments. Procuring officers should use the standard pack requirements when it is known that the material will be shipped from a supplier to a domestic warehouse, supply depot, or intermediate storage point for temporary storage, subsequent issue, or shipment to eventual user.

The following represents freight classification description and minimum weights under which the benefit of lowest carload and truckload rates

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T12:17Z
Check the source to verify that this is the current version before use.

for the commodity covered by this specification will be protected, provided shipments are described accordingly in covering bills of lading:

6.4 Transportation description. Transportation descriptions and minimum weights applicable to this commodity are:

Rail:

Calking compounds, not otherwise indexed by name.

Carload minimum weight 36,000 pounds.

Motor:

Calking compound, not otherwise indexed.

Truckload minimum weight 36,000 pounds, subject to Rule 115, National Motor Freight Classification.

MILITARY CUSTODIANS:

Army—MR
Navy—YD
Air Force—69

Review Activities:

Army—MR
Navy—YD
Air Force—69

User Activities:

Army—MO

Source: https://assist.dla.mil -- Downloaded: 202640-26T12:17Z
Check the source to verify that this is the current version before use.

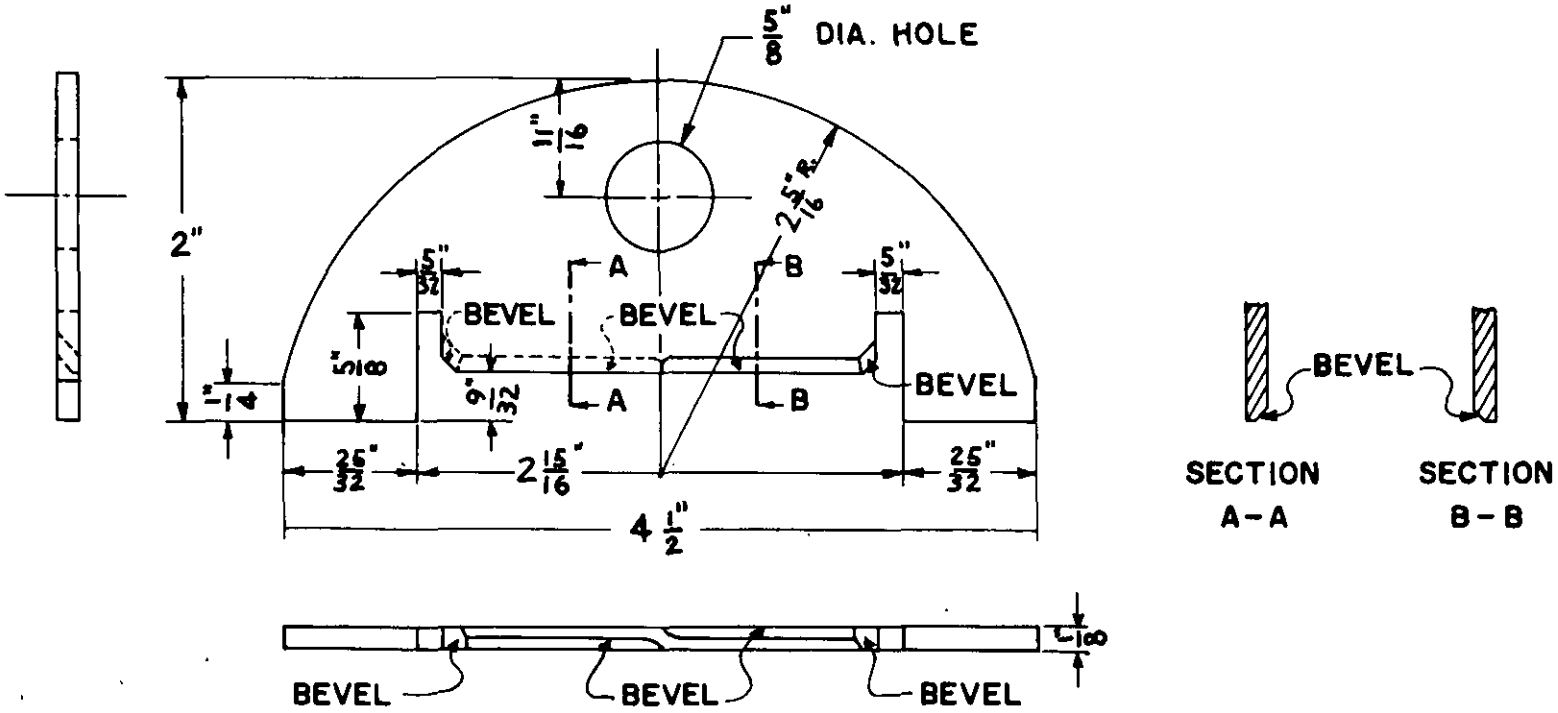


FIG. 1. TOOL FOR LEVELING CAULKING COMPOUND IN THE SHRINKAGE TEST SPECIMEN.

Source: https://assist.dla.mil -- Downloaded: 202610-26T12:17Z
Check the source to verify that this is the current version before use.

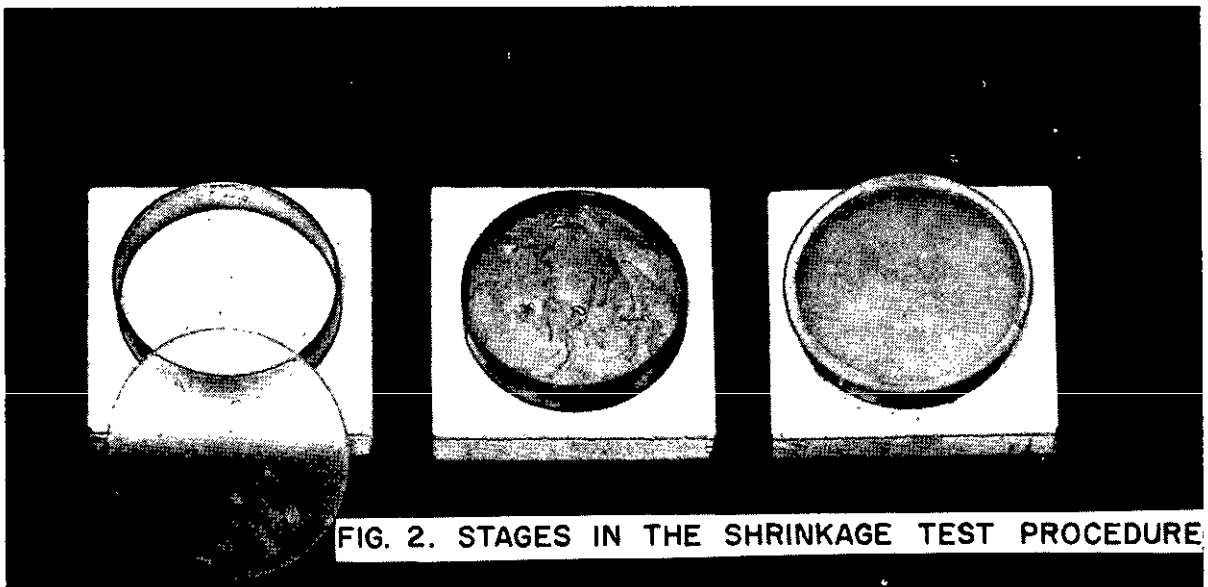


FIG. 2. STAGES IN THE SHRINKAGE TEST PROCEDURE.



FIG. 3. STAGES IN THE BOND TEST PROCEDURE.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T12:17Z
Check the source to verify that this is the current version before use.


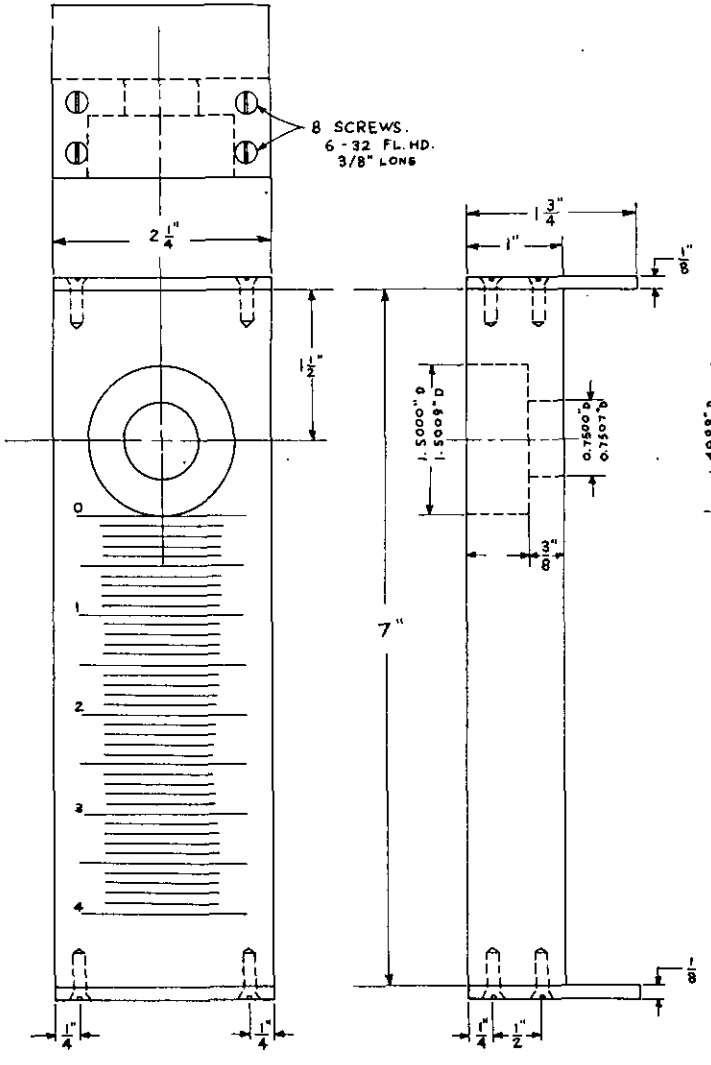


FIG. 4. FLOW TEST JIG

1 REQ'D.

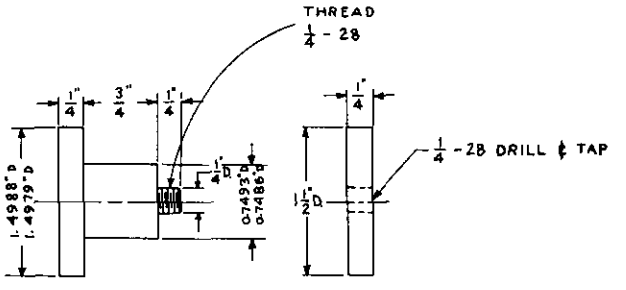


PLUNGER

1 REQ'D.

NUT

1 REQ'D.

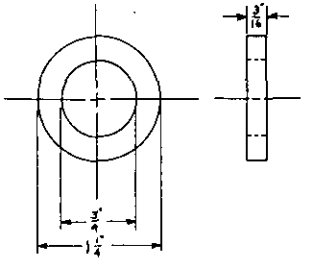

WASHER

1 REQ'D.

(ALUMINUM OR BRASS)

MATERIAL - ALUMINUM ALLOY

LIQUID-HONE FINISH

TOLERANCES ± 0.002" UNLESS OTHERWISE INDICATED.

SCALE: FULL SIZE

Source: https://assist.dla.mil -- Downloaded: 202640-26T12:17Z
Check the source to verify that this is the current version before use.

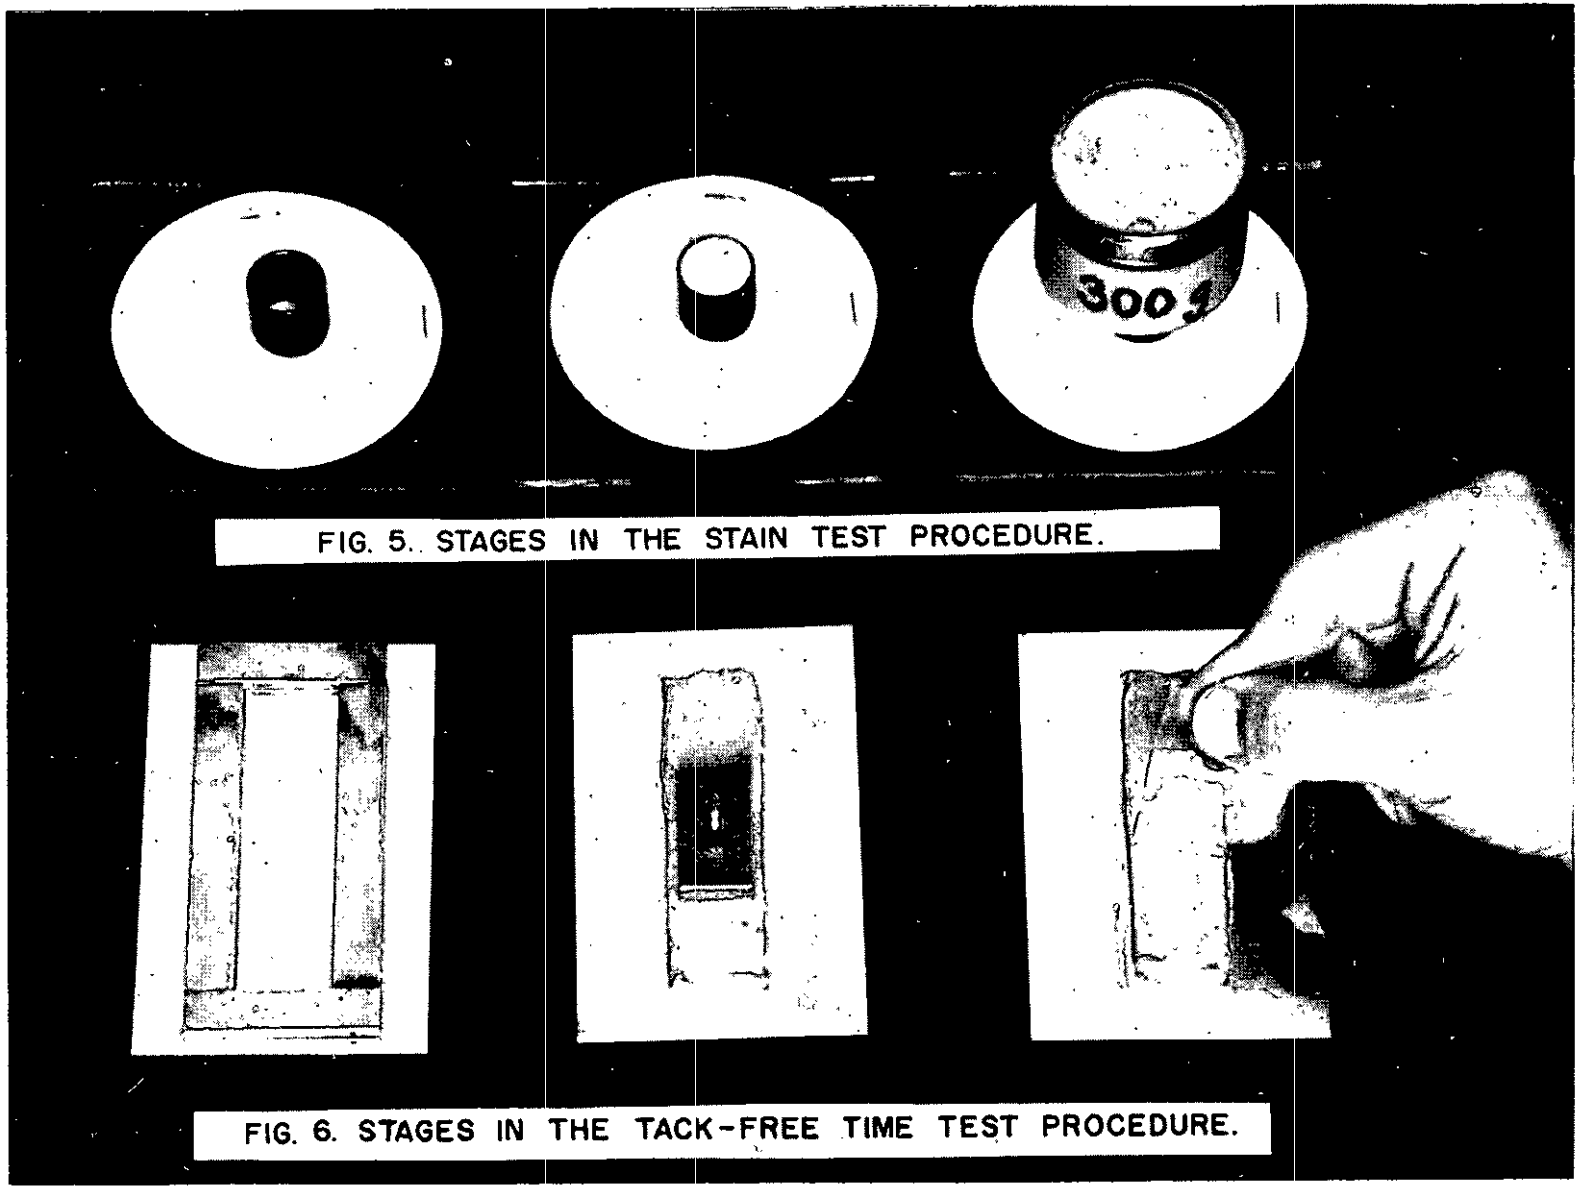


FIG. 5. STAGES IN THE STAIN TEST PROCEDURE.

FIG. 6. STAGES IN THE TACK-FREE TIME TEST PROCEDURE.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T12:17Z
Check the source to verify that this is the current version before use.

Copies of this specification may be purchased for 10 cents each.

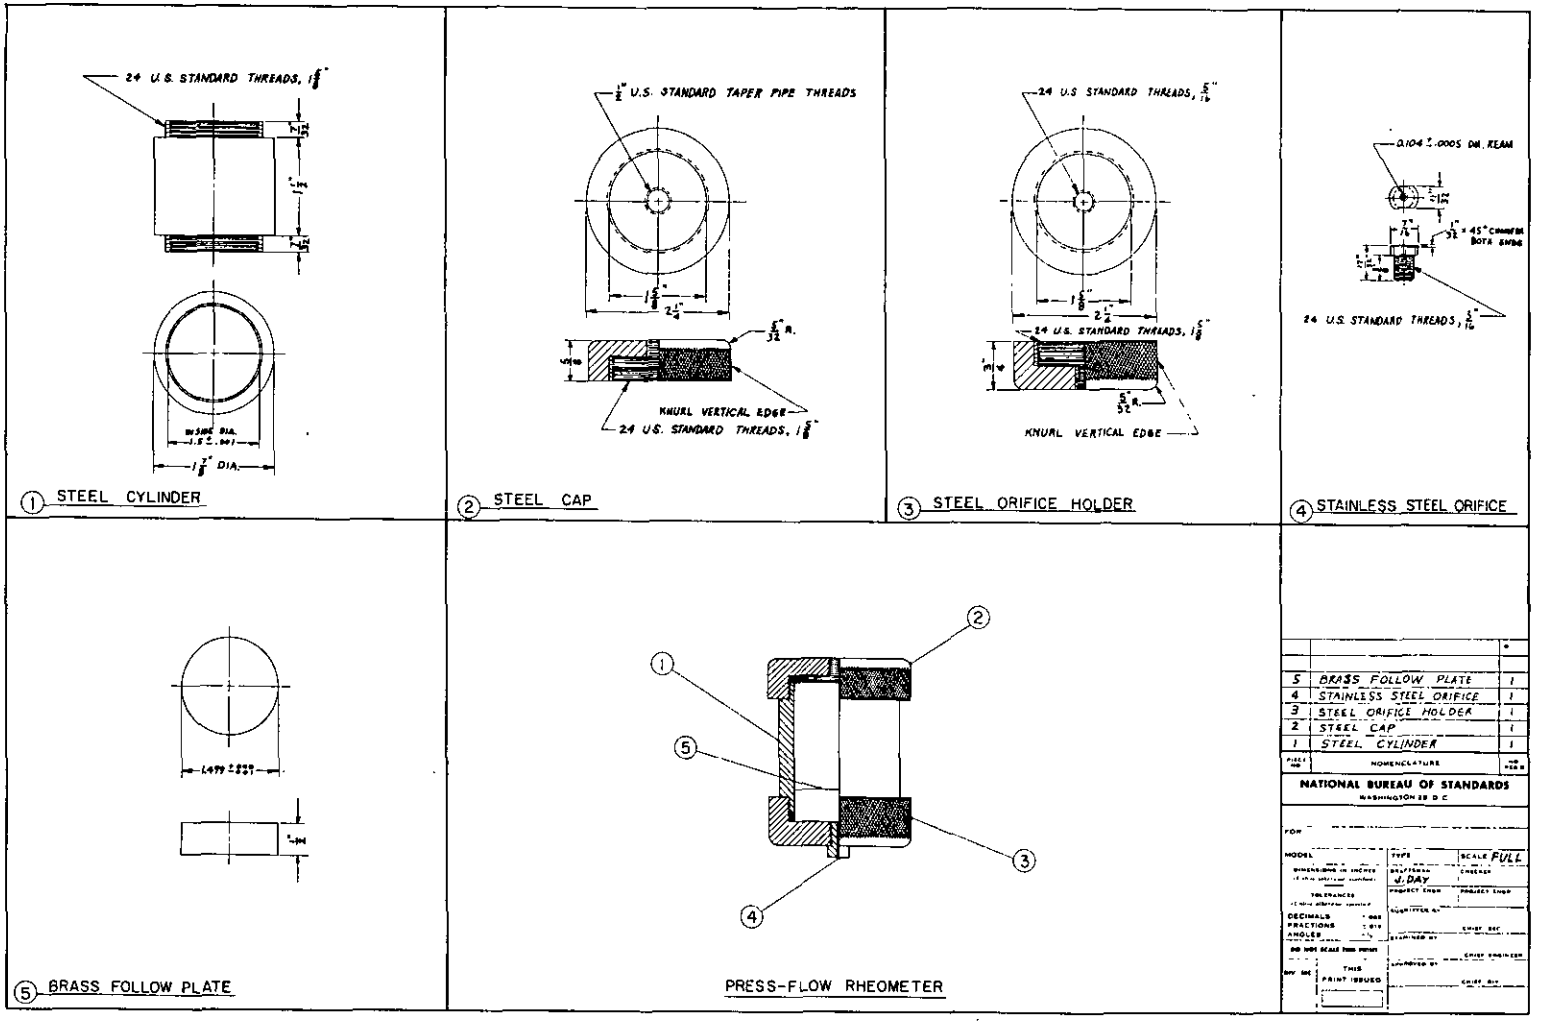


FIG. 7 DRAWING OF PRESS-FLOW EXTRUSION RHEOMETER FOR EXTRUDABILITY TEST.

Source: https://assist.dla.mil -- Downloaded: 202640-26T12:17Z
Check the source to verify that this is the current version before use.