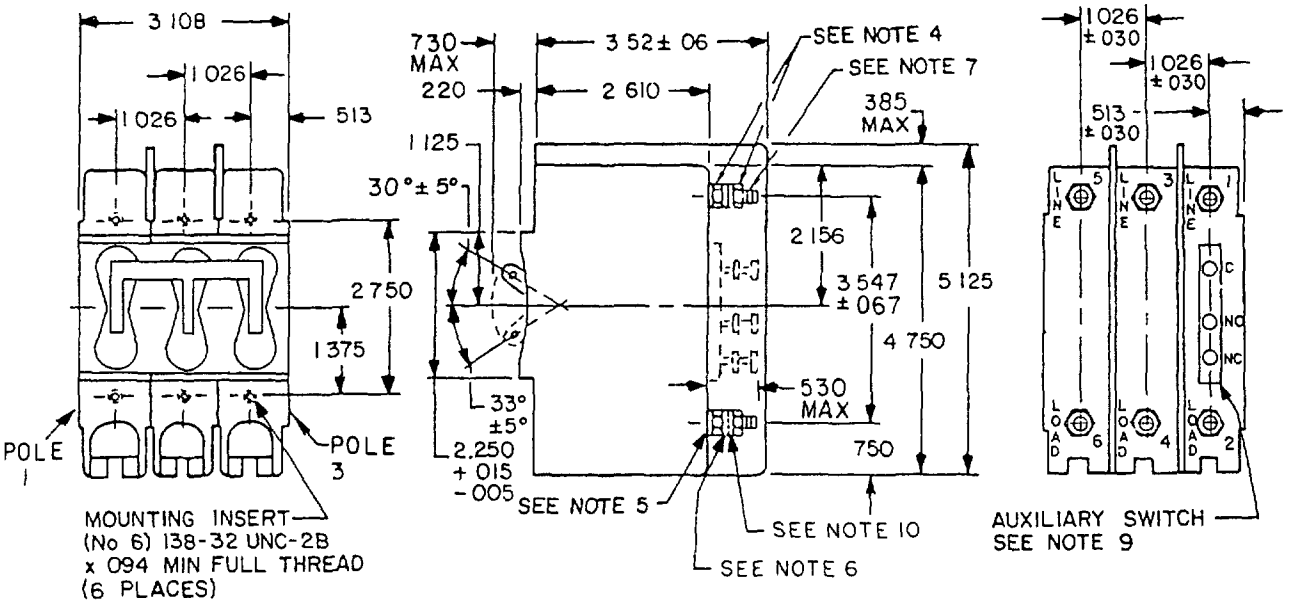
MILITARY SPECIFICATION SHEET

CIRCUIT BREAKERS, MAGNETIC, UNSEALED, TRIP-FREE, THREE POLE, FRONT MOUNTED AUXILIARY CONTACTS (1 to 100 AMPERES)

This specification is approved for use by all Departments and Agencies of the Department of Defense

The complete requirements for acquiring the circuit breakers described herein shall consist of this specification and the latest issue of MIL-C-55629



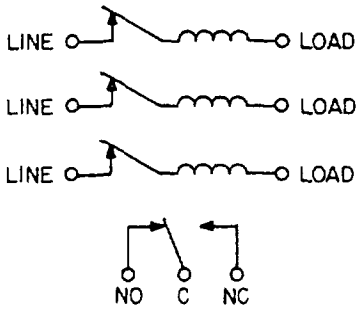


FIGURE 1 Dimensions and configurations

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T23:45Z
Check the source to verify that this is the current version before use.

Inches	mm	Inches	mm	Inches	mm	Inches	mm
002	0 05	093	2 36	370	9 40	1 375	34 93
005	0 13	094	2 39	385	9 78	2 156	54 76
010	0 25	109	2 77	438	11 13	2 250	57 15
.015	0 38	138	3 51	500	12 70	2 286	58 06
.016	0 41	156	3 96	.513	13 03	2 610	66.29
020	0 51	190	4 83	530	13 46	2 750	69 85
030	0 76	197	5 00	625	15.88	3 108	78.94
.032	0 81	220	5 59	730	18 54	3 52	89 4
035	0 89	250	6 35	750	19 05	3 547	90.09
06	1 5	281	7 14	1 026	26 06	4 750	120 65
062	1.57	308	7 82	1 125	28 58	5 125	130 18

NOTES

1 Dimensions are in inches
2. Metric equivalents are given for general information only
3. Unless otherwise specified, tolerance is ± 010
4 NUT-HEX (0 - 50 amperes) 190 - 32 UNF-2B, 308 ± 005 across flats, 109 ± 010 thick
(51 - 100 amperes) 250 - 20 UNC-2B, 438 or 375 ± 016 across flats, 156 ± 016 thick
Material - Brass (QQ-B-626), Tin Plated (MIL-T-10727 type I) or Stainless Steel
5 Lockwasher, internal or external tooth, for 0 - 50 amperes, MS35333-107 or MS35335-88 and for 51 - 100 amperes, MS35333-108 or MS35335-89, or equivalent
6 Washer, Flat (0 - 50 amperes) 370 ± 002 OD, 197 ID, 032 ± 005 thick
(51 - 100 amperes) 500 ± 016 OD, .281 ± 016 ID, 035 ± 005 thick
Material - Brass (QQ-B-626), Tin Plated (MIL-T-10727 type I) or Stainless Steel
7 Stud (0 - 50 amperes) 190 - 32 UNF-2A, 625 ± 062 long
(51 - 100 amperes) .250 - 20 UNC-2A, .750 ± 062 long
8 Configuration optional providing overall dimensions are not exceeded.
9. Auxiliary contact terminals shall provide for soldered connections, shall be located on the back side of the circuit breaker (same surface as shown) and shall be of the double turret stop type and capable of accepting two No 18 AWG wires
10 Locker, Split (0 - 50 amperes) MS35338-138 or equivalent
(51 - 100 amperes) MS35338-139 or equivalent

FIGURE 1 Dimensions and configurations - Continued

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T23:45Z
Check the source to verify that this is the current version before use.

REQUIREMENTS.

Dimensions and configuration: See figure 1.

Current ratings: See table I.

Voltage ratings: See table II.

Tripping time delays: See table II.

Terminal and mounting hardware: See figure 1.

Terminals. See figure 1.

Auxiliary contact terminals. Contact capacity shall be 5 amperes to 250 volts 60/400 Hz resistive and inductive, 1 amp resistive and .25 amp inductive at 50 V dc and 5 amp resistive and 3 amp inductive at 30 V dc.

Actuator strength: 40 pounds.

Actuator operating force: 12 pounds, maximum.

Shock:
a. MIL-STD-202, method 213, test condition I.
b. 60 G's for 21 ms.

Interrupting capacities. 5,000 amperes at 125 V dc, and 240 V ac, 60 Hz and 400 Hz in accordance with the applicable requirements of UL489. Interrupt test is not performed at 400 Hz.

High inrush: Applicable to time delay characteristics K, L, N, P, R, and S.

Vibration: Energized current shall be 80 percent of rated current and the frequency range shall be 10 to 55 Hz.

QUALITY ASSURANCE PROVISIONS.

Qualification inspection Not applicable.

Quality conformance inspection. Group A tests of MIL-C-55629.

Part number The military part number consists of the prefix M55629/17 and six code letters selected from tables I and II as shown in the following example.

	For pole identification, see figure 1					
	Pole 1		Pole 2		Pole 3	
M55629/17	A	R	E	K	E	L
Three pole circuit breaker with auxiliary contacts.						
Current rating code, see table I. 1/						
Voltage, frequency, and time delay curve code, see tables I.and II. 1/						

1/ Poles 1, 2, and 3, respectively, shall be coded in ascending order of current rating code letter. If two or more poles have identical current ratings, those poles shall be coded in ascending order of voltage, frequency, and time delay code letter.

On-off marking shall be visible with the trim or cover in place.

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T23:45Z
Check the source to verify that this is the current version before use.

TABLE I. Part numbering code letters and parameters

Current rating		Voltage frequency and tripping time delay code letter from table II	Resistance or impedance ohms (max)	Current rating		Voltage frequency and tripping time delay code letter from table II	Resistance or impedance ohms (max)
(amperes)	Code letter			(amperes)	Code letter		
1	A	K, L, or M	2.0 at dc	30	I	K, L, or M	.005 at dc
1	A	N, P, or Q	2.20 at 60 Hz	30	I	N, P, or Q	.005 at 60 Hz
1	A	R, S, or T	6.4 at 400 Hz	30	I	R, S, or T	.010 at 400 Hz
2	B	K, L, or M	.5 at dc	35	J	K, L, or M	.004 at dc
2	B	N, P, or Q	.52 at 60 Hz	35	J	N, P, or Q	.004 at 60 Hz
2	B	R, S, or T	2.0 at 400 Hz	35	J	R, S, or T	.008 at 400 Hz
5	C	K, L, or M	.08 at dc	40	K	K, L, or M	.0035 at dc
5	C	N, P, or Q	.102 at 60 Hz	40	K	N, P, or Q	.0035 at 60 Hz
5	C	R, S, or T	.372 at 400 Hz	40	K	R, S, or T	.006 at 400 Hz
7	D	K, L, or M	.04 at dc	50	L	K, L, or M	.003 at dc
7	D	N, P, or Q	.048 at 60 Hz	50	L	N, P, or Q	.003 at 60 Hz
7	D	R, S, or T	.216 at 400 Hz	50	L	R, S, or T	.005 at 400 Hz
10	E	K, L, or M	.018 at dc	60	M	K, L, or M	.0027 at dc
10	E	N, P, or Q	.02 at 60 Hz	60	M	N, P, or Q	.0027 at 60 Hz
10	E	R, S, or T	.1 at 400 Hz	60	M	R, S, or T	.004 at 400 Hz
15	F	K, L, or M	.01 at dc	70	N	K, L, or M	.0024 at dc
15	F	N, P, or Q	.011 at 60 Hz	70	N	N, P, or Q	.0024 at 60 Hz
15	F	R, S, or T	.045 at 400 Hz	70	N	R, S, or T	.0035 at 400 Hz
20	G	K, L, or M	.007 at dc	80	P	K, L, or M	.0022 at dc
20	G	N, P, or Q	.007 at 60 Hz	80	P	N, P, or Q	.0022 at 60 Hz
20	G	R, S, or T	.022 at 400 Hz	80	P	R, S, or T	.003 at 400 Hz
25	H	K, L, or M	.006 at dc	100	Q	K, L, or M	.002 at dc
25	H	N, P, or Q	.006 at 60 Hz	100	Q	N, P, or Q	.002 at 60 Hz
25	H	R, S, or T	.015 at 400 Hz	100	Q	R, S, or T	.0025 at 400 Hz

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T23:45Z
Check the source to verify that this is the current version before use.

TABLE II. Tripping-time delay. 1/

Time delay percent rated current	Tripping-time delay at 25°C ±2°C (tripping time in seconds)																	
	125 V dc						240 V 2/ 60 Hz						240 V 400 Hz					
	K		L		M		N		P		Q		R		S		T	
	Max	Min	Max	Min	Max	Min	Max	Min	Max	Min	Max	Min	Max	Min	Max	Min	Max	Min
100	no trip one hour		no trip one hour		no trip one hour		no trip one hour		no trip one hour		no trip one hour		no trip one hour		no trip one hour		no trip one hour	
125	1000	120	120	8	10	.44	880	100	90	13	7.0	.80	---	---	---	---	---	---
150	360	60	60	5.9	4.0	.25	500	48	37	6	3.0	.40	450	80	40.0	9.5	4.0	.6
200	110	22	21	2.5	1.5	.13	200	20	10.5	2.1	1.0	.15	195	35	17.0	3.8	1.5	.23
400	16	4	4.0	0.5	.35	.03	30	4	1.84	.46	.25	.032	22	4.3	2.2	.35	.16	.03
600	7	0.7	1.7	.19	.2	Inst	9	.9	.9	.03	15	.019	7	.025	1.3	.02	.07	Inst
800	4	Inst	.65	Inst	.16	Inst	5	.025	.6	Inst	.11	Inst	.09	Inst	.50	Inst	.06	Inst
1,000	2.75	Inst	.35	Inst	.12	Inst	2.75	.020	.51	Inst	.095	Inst	.05	Inst	.055	Inst	.06	Inst
1,800 3/	no trip		no trip		N/A		no trip		no trip		N/A		no trip		no trip		N/A	

Time delay percent rated current	Tripping-time delay at high and low temperature (tripping time in seconds) 4/																	
	125 V dc						240 V 2/ 60 Hz						240 V 400 Hz					
	K		L		M		N		P		Q		R		S		T	
	-40° Max	+85° Min	-40° Max	+85° Min	-40° Max	+85° Min	-40° Max	+85° Min	-40° Max	+85° Min	-40° Max	+85° Min	-40° Max	+85° Min	-40° Max	+85° Min	-40° Max	+85° Min
200	1000	5	100	.5	5	.03	1000	5	100	.3	5	.03	1000	5	100	.3	20	.03

1/ Circuit breakers shall not trip at 100 percent of rated current but must trip at 125 percent or 150 percent of rated current as applicable. Between 100 percent and 125 or 150 percent, they may trip. Instantaneous is defined as less than 15 milliseconds.

2/ May be used to a maximum of 480 volts with adequate back-up protection with a maximum of four times the current rating, but not to exceed 225 amperes

3/ High inrush test shall be performed using one alternation which has a peak value of 2,000 percent of rated current. 400 Hz and dc delays are subjected to a 400 Hz waveform, 60 Hz delays shall be subjected to a 60 Hz waveform.

4/ High and low test temperature tolerances are ±2°C

Source: https://assist.dla.mil -- Downloaded: 202610-22T23:45Z
Check the source to verify that this is the current version before use.

TABLE III. Supersession and substitution data.

Circuit breakers covered by this specification sheet are substitutable for the manufacturer's part numbers as shown below. This information in no way implies that the manufacturer's part number is substitutable for the military part number.

Superseding military part number	Superseded manufacturers part number	
	FSCM 81541	FSCM 74193
	Type 209-3	Type CD3
M55629/17XXXXXX	The complete part number consists of the type (above) plus identification codes for comparable mounting, terminal configuration, internal connections, voltage, frequency, time delay, and current rating, with or without auxiliary switch, high-inrush feature, or UL listing, or recognition.	

NOTE: Revision letters are not used to denote changes due to the extensiveness of the changes.

Custodians:
Army - ER
Navy - EC
Air Force - 85

Review activities:
Army - ME, MI,
Navy - AS, OS
Air Force - 17, 99
DLA - ES

User activities:
Army - AV
Navy - MC
Air Force - 19

Preparing activity:
Army - ER

Agent:
DLA - ES

(Project 5925-0169-5)

Source: https://assist.dla.mil -- Downloaded: 2026-10-22T23:45Z
Check the source to verify that this is the current version before use.