[INCH-POUND]
A-A-2852
May 24, 1994
SUPERSEDING
WW-T-001914 (GSA-FSS)
November 17, 1975

COMMERCIAL ITEM DESCRIPTION

TRAPS, DRAIN, PLUMBING FIXTURE (P-TRAP) (LAND USE)

The General Services Administration has authorized the use of this commercial item description for all Federal agencies.

1. SCOPE

1.1 Scope. This commercial item description covers plumbing fixture drain traps (P-traps), for general purpose waste systems.

2. CLASSIFICATION

2.1 Classification. The drain traps shall be of the following type and size, as specified (see 7.3).

Type - 106
Size - 1-1/2 inch (38.1 mm) diameter.

Type - 114
Size - 1-1/2 inch (38.1 mm) diameter.

Type - 115
Size - 1-1/4 inch (31.7 mm) diameter.

3. SALIENT CHARACTERISTICS

3.1 Standard product. Except as otherwise specified herein, drain traps (P-traps) covered by this commercial item description shall be the manufacturer's standard commercial product, and one of the types illustrated in Figure 1, as specified (see 7.3).

3.2 Materials. Materials not specifically specified shall be the quality used in commercial practice.

3.2.1 Cast copper alloy P-trap. Except as otherwise specified herein, cast copper alloy P-traps shall conform to the requirements of ASME/ANSI B16.23.

Beneficial comments, recommendations, additions, deletions, clarifications, etc. and any data which may improve this document should be sent to: General Services Administration, Engineering Group (7FXEE), 819 Taylor St., Fort Worth, TX 76102

DISTRIBUTION STATEMENT A: Approved for public release; distribution is unlimited.

FSC 4510

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T08:26Z
Check the source to verify that this is the current version before use.

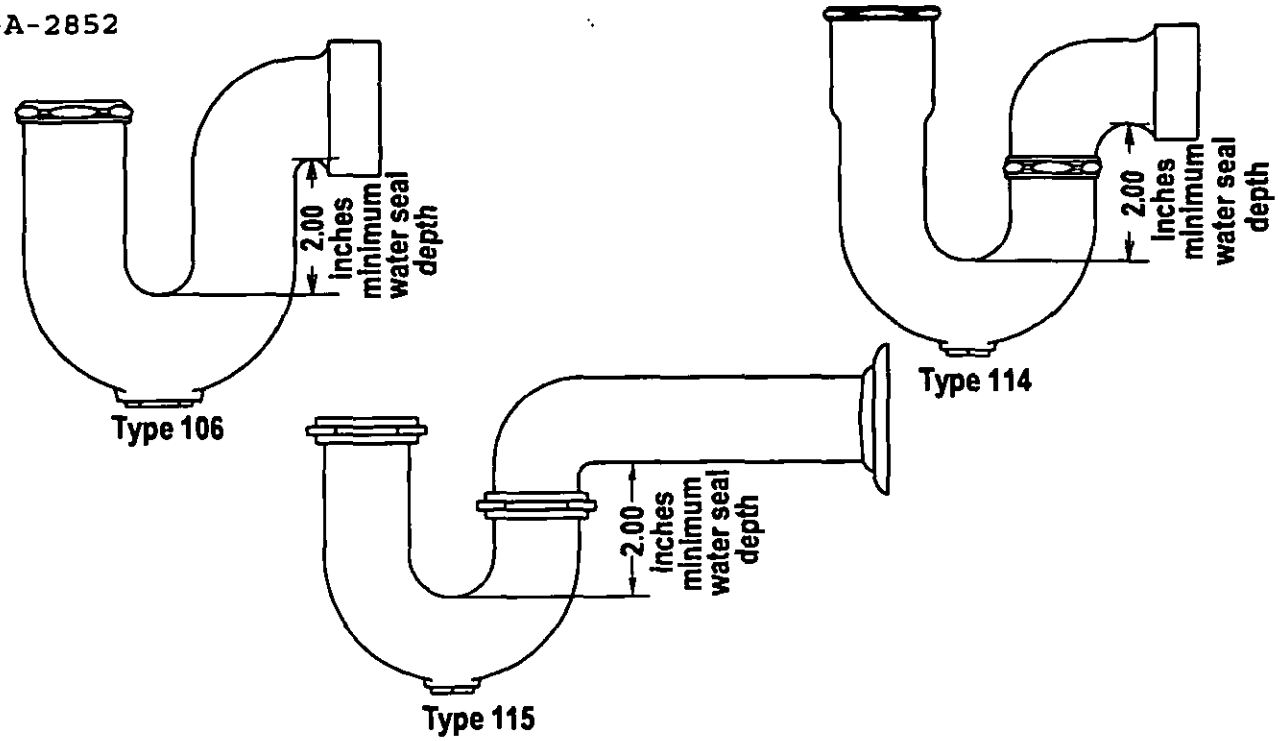


Figure 1

3.2.2 Wrought copper alloy P-trap. Thickness of wrought copper alloy P-traps shall be 0.032 ± 0.003 inch (0.81 ± 0.076 mm) prior to bending. Except for thickness, wrought copper alloy P-traps shall conform to ASME/ANSI B16.29 for material and end dimensions, and to ASME/ANSI B16.23 for other dimensions.

3.3 Type 106. Type 106 P-traps shall be a one-piece cast copper alloy with slip joint (SJ) inlet to female threaded outlet (F) connection. The outside diameter of the P-trap shall be 1-1/2 inches (38.1 mm).

3.4 Type 114. Type 114 P-traps shall be a two-piece metal to metal swivel joint, wrought metal with cast elbow, slip joint (SJ) inlet to female threaded outlet (F) connection. The outside diameter of the P-trap shall be 1-1/2 inches (38.1 mm). The overall length shall be 5-1/2 inches (139.7 mm).

3.5 Type 115. Type 115 P-traps shall be a two-piece metal to metal swivel joint, wrought copper alloy with elbow extension tube and escutcheon. The length of the extension tube shall be not less than 10-1/4 inches (260.3 mm) measured from the centerline of the trap inlet to the tube outlet. The trap inlet connection shall be slip joint (SJ). The tube connection to waste pipe shall be a straight tube for use with an adapter. The outside diameter of the tube and trap shall be 1-1/4 inches (31.7 mm).

3.6 Inlet connection (SJ) (washer and nut). The inlet connection shall have an elastomeric washer and a copper alloy or die-cast zinc nut with wrench flats and compatible with the size of the P-trap.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T08:26Z
Check the source to verify that this is the current version before use.

3.6.1 Cleanout plug. P-traps shall be equipped with a copper alloy cleanout plug with wrench flats, and furnished with a washer to seal the joint. The cleanout shall not form a pocket in the trap or obstruct the outlet flow of waste.

3.6.2 Water seal depth. The depth of the water seal shall be not less than 2 inches (50.8 mm). The term *water seal* refers to the vertical distance in a pipe trap between water level at the point of overflow and the lowest level that prevents the passage of any gas or air through the trap.

3.7 Finish.

3.7.1 Internal surfaces. Internal surfaces shall have an as-cast surface for cast parts and a smooth mill finish for wrought parts.

3.7.2 Exterior surfaces. Exposed surfaces of traps, plugs, and other hardware shall have a bright or satin chromium finish at the manufacturer's option, plated in accordance with service condition (SC 1) specified in ASTM B456.

3.8 Performance.

3.8.1 P-Trap joints. P-trap joints shall withstand a torque of 30 ft·lb$_f$ (40 J) without failure (see 5.6.1).

3.9 Workmanship. All parts shall be free of defects that affect appearance, function, or serviceability. Chromium plating shall be uniform in appearance and free of blisters and void areas.

3.10 Measurement system. The values stated in inch-pound units are to be regarded as the standard. The metric values stated in parentheses are for information purposes only.

3.10.1 Metric products. Products manufactured to metric dimensions will be considered on an equal basis with those manufactured using inch-pound units, provided they fall within the tolerances specified and all other requirements of this document are met. If a product is manufactured to metric dimensions and those dimensions exceed the tolerances specified in the inch-pound units, a request should be made to the contracting officer to determine if the product is acceptable.

3.11 Commercial item. The use of the term "commercial item description" in this document does not imply that any item or items offered are not required to conform with all requirements specified herein.

4. REGULATORY REQUIREMENTS

4.1 Regulatory requirements. The offeror/contractor is encouraged to use recovered materials to the maximum extent practicable, in accordance with paragraph 23.403 of the Federal Acquisition Regulation (FAR).

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T08:26Z
Check the source to verify that this is the current version before use.

5. QUALITY ASSURANCE PROVISIONS

5.1 Contractor Certification. The contractor shall certify and maintain substantiating evidence that the product offered meets the salient characteristics of this commercial item description, and that the product conforms to the producer's own drawings, specifications, standards, and quality assurance practices. The government reserves the right to require proof of such conformance prior to first delivery and thereafter as may be otherwise provided for under the provisions of the contract.

5.2 Sampling. The levels of inspection and acceptable quality levels (AQL) shall be in accordance with MIL-STD-105.

5.3 Lot formation. All P-traps of the same type and size from the same manufacturer offered for delivery at one time shall be considered a lot for purposes of inspection.

5.4 Sampling for visual and dimensional examination. A random sample of P-traps shall be selected from each lot in accordance with inspection level S-2, AQL 6.5, expressed in terms of percent defective. The sample unit shall be one P-trap. The sample P-traps shall be visually and dimensionally examined to verify compliance with this commercial item description.

5.5 Sampling for tests. A random sample of P-traps shall be selected from each lot in accordance with inspection level S-1, AQL 2.5, expressed in terms of percent defective. The sample unit shall be one P-trap.

5.6 Testing.

5.6.1 P-trap joints. Apply a torque of 30 ft·lb$_f$ (40 J) at the joints of P-traps and determine compliance to 3.8.1.

6. PACKAGING


6.1 Packaging. Preservation, packing, and marking shall be as specified in the contract or order.

7. NOTES

7.1 Part Identification Number (PIN). P-traps conforming to this commercial item description shall be identified by a part number configuration consisting of identification of a portion of the CID number, type and size. An example of the part number configuration is shown below. This part numbering system is intended for identification and cross-indexing of the item within the Federal cataloging system. The following part identification numbering procedure is for government purposes and does not constitute a requirement for the contractor.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T08:26Z
Check the source to verify that this is the current version before use.

AA2852-106-A Example: AA2852-106-A = Type 106, Size 1-1/2

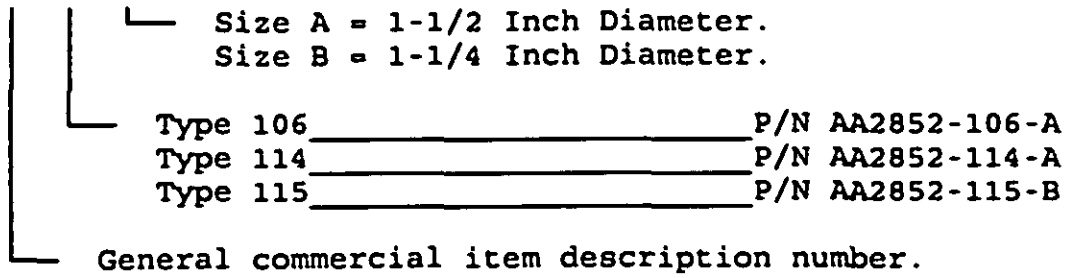

7.2. Referenced Documents. The documents referenced in this commercial item description shall be the issues in effect on the date of issuance of the invitation for bids or request for proposals unless otherwise specified. These documents form a part of this commercial item description to the extent specified. In the event of a conflict between this commercial item description and a document referenced herein, this commercial item description shall take precedence.

Copies of commercial item descriptions are available from the General Services Administration Business Service Centers in Boston, MA; New York, NY; Philadelphia, PA; Atlanta, GA; Kansas City, MO; Fort Worth, TX; and GSA Federal Supply Bureau Specification Section (3FBP-W), 470 East L'Enfant Plaza, SW, Suite 8100, Washington, DC 20407.

Military Standard:

MIL-STD-105 - Sampling Procedures and Tables for Inspection by Attributes

Copies of military standards may be obtained from Standardization Documents Order Desk, Bldg. 4D, 700 Robbins Avenue, Philadelphia, PA 19111-5094.

ASTM Standard:

B456 - Standard Specification for Electrodeposited Coatings of Copper Plus Nickel Plus Chromium and Nickel Plus Chromium

Application for copies of ASTM standards should be addressed to ASTM, 1916 Race Street, Philadelphia, PA 19103.

ASME/ANSI Standards:

B16.23 - Cast Copper Alloy Solder Joint Drainage Fittings

B16.29 - Wrought Copper and Wrought Copper Alloy Solder Joint Drainage Fittings

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T08:26Z
Check the source to verify that this is the current version before use.

Application for copies of ASME/ANSI standards should be addressed to the American Society of Mechanical Engineers, 345 East 47th Street, New York, NY 10017.

7.3 Ordering data. Purchasers should select the preferred options permitted herein and include the following information in procurement documents (if applicable).

a. Title, number and date of this commercial item description.
b. Type and size (see 2.1).
c. The preservation, packing, and marking desired.

7.4 National Stock Numbers (NSNs): The following is a list of NSNs which reference this CID. The list may not be indicative of all possible NSNs associated with this CID.

4510-00-061-4454	Trap, Drain (P-trap)	AA2852-106-A
4510-00-595-0922	Trap, Drain (P-trap)	AA2852-114-A
4510-00-756-1145	Trap, Drain (P-trap)	AA2852-115-B

MILITARY INTERESTS:

Custodian:

Navy - YD1

Review Activity:

DLA - CS

CIVIL AGENCY COORDINATING ACTIVITY:

GSA-FSS

PREPARING ACTIVITY:

GSA-FSS

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T08:26Z
Check the source to verify that this is the current version before use.