
COMMERCIAL ITEM DESCRIPTION

FUSE, INCLOSED LINK, AUTOMOTIVE BLADE TYPE

The General Services Administration has authorized the use of this commercial item description.

Abstract. This commercial item description (CID) covers the general requirements for inclosed link, automotive blade type fuses. Fuses covered by this CID are intended for commercial/industrial applications and shall not be used in military systems needing stringent environmental and electrical requirements.

Part or Identifying Number (PIN). The PIN for the CID shall be as shown in the following example:

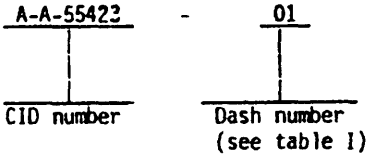

Salient characteristics.

Ampere rating. The ampere rating shall be as specified in table I.

Voltage rating. The voltage rating shall be 32 V dc.

Blow time. The blow time shall be as specified in table II.


Design and construction. Fuses supplied to this CID shall be as specified herein (see figure 1).

Marking. Fuses supplied to this CID shall be marked with the manufacturer's standard commercial PIN.

Regulatory requirements. Not applicable.

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 202610-26T09:46Z
Check the source to verify that this is the currentversion before use.

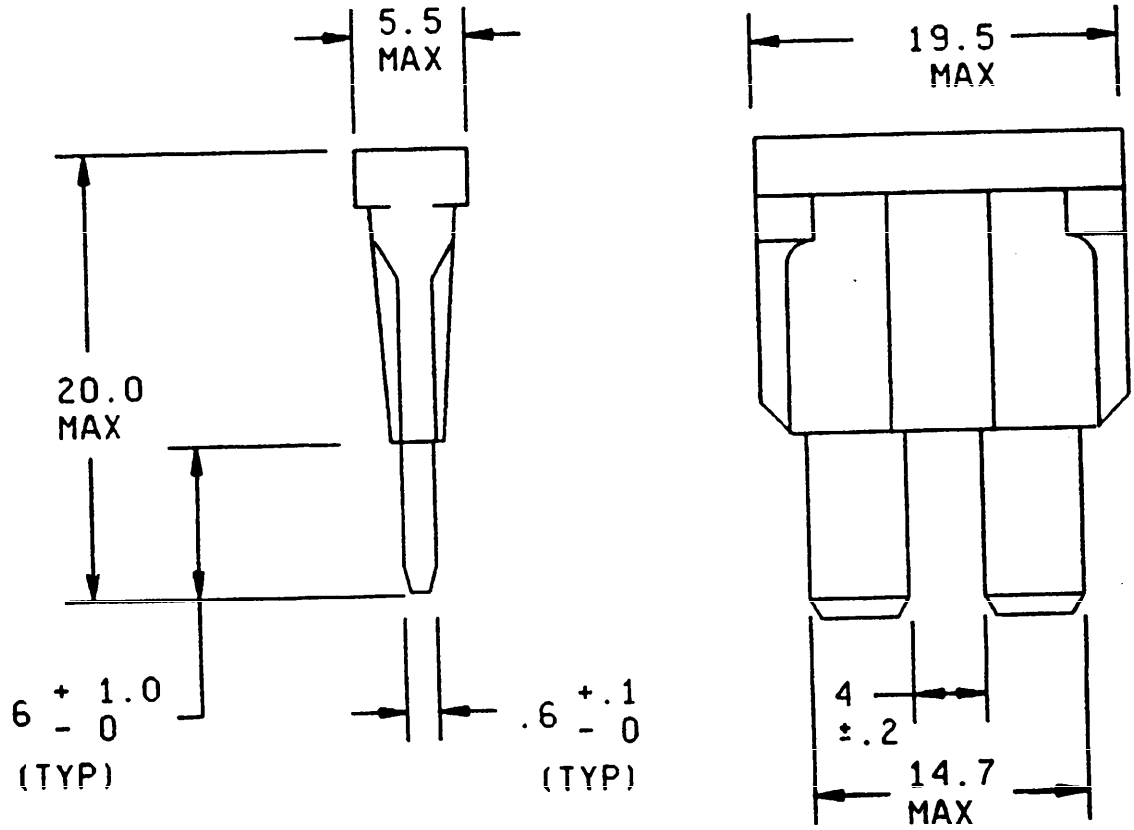

mm	Inches
.1	.004
.2	.008
.6	.023
1.0	.039
4	.16
5.5	.22
6	.24
14.7	.58
19.5	.77
20.0	.79

NOTES:
1. Dimensions are in millimeters.
2. Unless otherwise specified, tolerance is ±0.13 mm (0.005).
3. This item was designed using inch-pound units of measurement. In case of problems involving conflicts between the metric and inch-pound units, the inch-pound units shall rule.

Figure 1. Configuration and dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:46Z
Check the source to verify that this is the current version before use.

TABLE I. Electrical characteristics.

A-A-55423-	Ampere rating	Color code 1/
01	3	Violet
02	4	Pink
03	5	Tan
04	7.5	Brown
05	10	Red
06	15	Blue
07	20	Yellow
08	25	Natural
09	30	Green

1/ Fuses are color-coded for easy amperage identification.

TABLE II. Rating versus blow time.

Rating	Blow time
200 percent	5 seconds, maximum
350 percent	0.08 seconds, minimum

Quality assurance provisions.

Responsibility for inspection. The contractor is responsible for the performance of all inspection, examination, and test requirements specified in the contract or purchase order. The contractor may use his own or any other facilities suitable for inspection requirements specified in the contract or purchase order, unless otherwise disapproved by the acquiring activity. The acquiring activity reserves the right to perform any of the inspections set forth in the contract or purchase order where such inspections, examinations, and tests are deemed necessary to assure supplies and services conform to prescribed requirements.

Contractor certification statement. The contractor shall certify and maintain objective quality evidence that the product offered meets the requirements of this CID, and that the product conforms to the producer's own drawings, specifications, standards, quality assurances practices, and is the same as the product provided as a bid sample. The acquiring activity reserves the right to require proof of such conformance prior to the first delivery and thereafter as may be otherwise provided for under the provisions of the contract.

Certificate of compliance. A certificate of compliance shall accompany all fuses supplied to this CID.

Packaging.

Preservation, packaging, packing, labeling, and marking. Preservation, packaging, labeling, and marking shall be as specified in the contract or purchase order.

Notes. This section contains relevant information which is useful to buyers, users, and suppliers in the process of acquiring the item, but is not mandatory.

Source: https://assist.dla.mil -- Downloaded: 202610-26T09:46Z
Check the source to verify that this is the currentversion before use.

Ordering data. Acquisition documents should specify the following:

a. CID document number and revision and CID PIN.

b. Quality assurance provisions.

c. Packaging requirements.

Comments. Comments on this CID should be directed to Defense Electronics Supply Center, 1507 Wilmington Pike, ATTN: DESC-EMM, Dayton, OH 45444-5270, or telephone (513) 296-6189.

Suggested sources of supply. Suggested sources of supply are listed herein. Additional sources will be added as they become available.

CID dash number (see table I) A-A-55423-	Vendor commercial PIN CAGE 75915	Vendor commercial PIN CAGE 71400
01	257003	ATC3
02	257004	---
03	257005	ATC5
04	25707.5	ATC7.5
05	257010	ATC10
06	257015	ATC15
07	257020	ATC20
08	257025	ATC25
09	257030	ATC30

Vendor CAGE number	Vendor name and address
71400	Bussman P.O. Box 14460 St. Louis, MO 63178
75915	Littelfuse, Incorporated 800 E. Northwest Highway Des Plaines, IL 60016

CIVIL AGENCY COORDINATING ACTIVITY:

GSA - 7FXE

PREPARING ACTIVITY:

DLA-ES

Source: https://assist.dla.mil -- Downloaded: 202640-26T09:46Z
Check the source to verify that this is the current version before use.