
MILITARY SPECIFICATION SHEET

RELAYS, HYBRID, SENSORS, ESTABLISHED RELIABILITY, TYPE I, CLASS B, (HYBRID AC POWER MONITORING SENSOR), 3PDT, LOW LEVEL TO 10 AMPERES, HERMETICALLY SEALED (POTTED), HORIZONTAL MOUNT

This amendment forms a part of MIL-R-28894/6, dated 10 April 1986, and is approved for use by all Departments and Agencies of the Department of Defense.

PAGE 2

Figure 1, delete circuit diagram in its entirety and substitute new circuit diagram below.

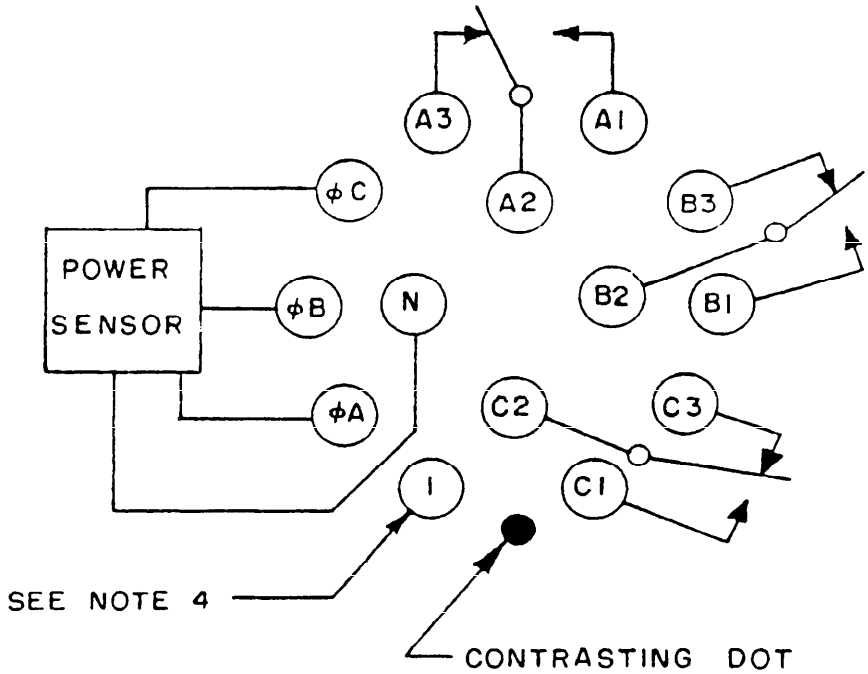

CIRCUIT DIAGRAM TERMINAL VIEW

Delete note 4 and substitute:

"4. Terminal 1 is a non-functional lead."

Custodians:
Army - ER
Navy - EC
Air Force - 85

Review activities:
Army - AV
Navy - OS, SH

Preparing activity:
Navy - EC

Agent:
DLA - ES

(Project 5945-0741-6)

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.
Source: https://assist.dla.mil -- Downloaded: 2026-10-20T20:47Z
Check the source to verify that this is the current version before use.