MILITARY SPECIFICATION SHEET

~~RELAYS, HYBRID, SENSORS, ESTABLISHED RELIABILITY, TYPE I,~~
CLASS B, (HYBRID AC POWER MONITORING SENSOR), 3PDT, LOW LEVEL
TO 10 AMPERES, HERMETICALLY SEALED (POTTED), INVERTED MOUNT

This amendment forms a part of MIL-R-28894/7, dated 10 April 1986, and is approved for use by all Departments and Agencies of the Department of Defense.

PAGE 2

Figure 1, delete circuit diagram in its entirety and substitute new circuit diagram below.

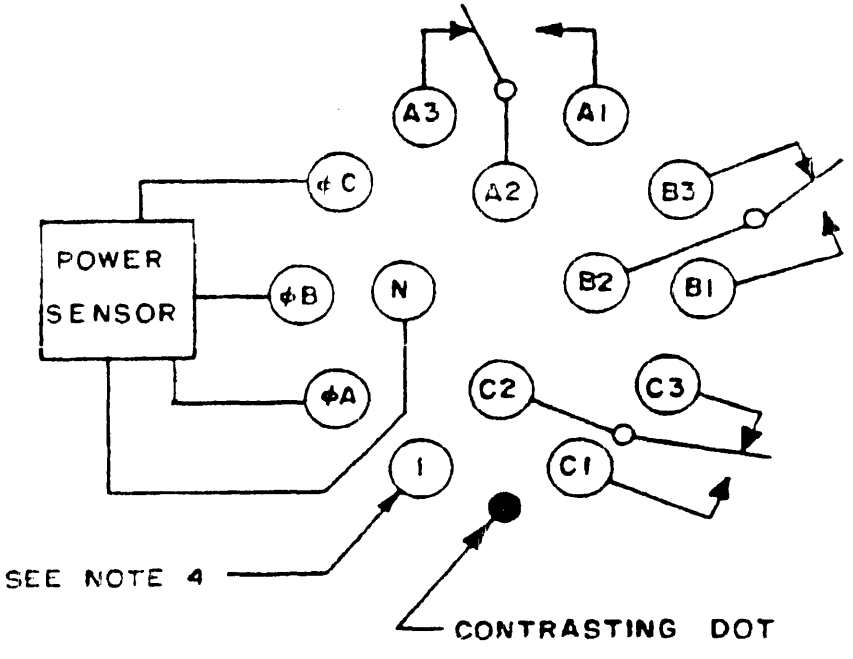

CIRCUIT DIAGRAM TERMINAL VIEW

Custodians:
Army - ER
Navy - EC
Air Force - 85

Review activities:
Army - AY
Navy - OS, SH

Preparing activity:
Navy - EC

Agent:
DLA - ES

(Project 5945-0741-7)

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T20:48Z
Check the source to verify that this is the current version before use.