INCH-POUND
A-A-59159B
28 December 2020
SUPERSEDING
A-A-59159A
03 January 2003


COMMERCIAL ITEM DESCRIPTION

HOSE AND HOSE ASSEMBLIES, RUBBER, STEAM

The General Services Administration has authorized the use of this commercial item description (CID) for all federal agencies.

1. SCOPE. This CID covers the general requirements for reinforced rubber steam hose and hose assemblies for conveyance of saturated steam. Rubber steam hose and hose assemblies covered by this CID are intended for commercial/industrial steam applications but not to convey steam into food service equipment.

2. CLASSIFICATION/PART OR IDENTIFICATIN NUMBER (PIN). This CID uses a classification system which is included in the PIN as shown in the following example (see 7.1).

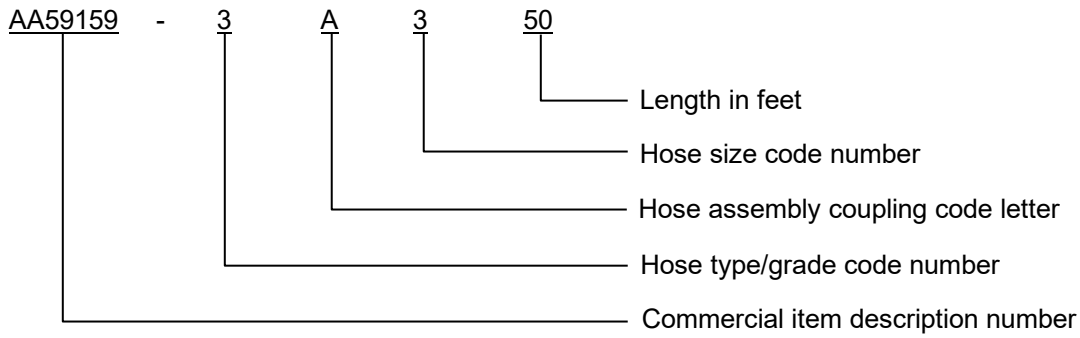

Comments, suggestions, or questions on this document should be addressed to: DLA Land and Maritime, Attn: VAI, P.O. Box 3990, Columbus, OH 43218-3990, or emailed to FluidFlow@dla.mil. Since contact information can change, you may want to verify the currency of this address information using the ASSIST Online database at https://assist.dla.mil

AMSC N/A

FSC 4720

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T10:04Z
Check the source to verify that this is the current version before use.

TABLE I. Type/grade, coupling, size and, length to PIN code cross reference.

Type/grade	PIN code
I/A	1
I/B	2
II	3
Coupling assembly	PIN code
Male one end/female other end	A
Male on both ends	B
Hose size	PIN code
0.5	1
0.75	2
1.0	3
1.25	4
1.5	5
2.0	6
2.5	7

2.1 Types. The hoses shall be of the following types and grades, as specified (see 7.4).

Type I – Braided wire reinforced construction.

Grade A – multiple braid reinforcement: for working pressure up to 200 pounds per square inch gage (psig) and temperatures up to 388 ºF.

Grade B – Single braid reinforcement: for working pressures up to 100 psig and temperatures up to 320 ºF.

Type II – Wrapped fabric construction; for working pressures up to 75 psig and temperatures up to 320 ºF

3. SALIENT CHARACTERISTICS.

3.1 Interface and physical dimensions. Rubber steam hose and hose assemblies supplied to this CID shall be as specified herein.

3.2 Description.

3.2.1 Type I. Type I hose shall be suitable for heavy-duty, high-pressure, shock-resistant, flexible steam applications.

Grade A hose shall be available in the following nominal sizes (ID in inches): 0.5, 0.75, 1.0, 1.25, 1.5, 2.0, and 2.5, and be suitable for working pressure and temperatures up to 200 psig and 388 ºF.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T10:04Z
Check the source to verify that this is the current version before use.

Grade B hose shall be available in the following nominal sizes (ID in inches): 0.5, 0.75, and 1.0, and be suitable for working pressure and temperatures up to 100 psig and 320 ºF.

3.2.2 Type II. Type II hose shall be suitable for general service as a steam hose for working pressures up to 75 psig and 320º F. Type II shall be available in the following nominal sizes (ID in inches): 0.5, 0.75, 1.0, 1.25, 1.5, and 2.0.

3.2.3 Inside diameter. The inside diameter and tolerances shall be as specified in table II.

TABLE II. Inside diameter and tolerance, inch(es).

Type of hose	Inside diameter						
	0.500	0.750	1.000	1.250	1.500	2.000	2.500
Type I, grade A	+.039 -.016	+.039 -.016	+.047 -.016	+.063 -.016	+.063 -.016	+.063 -.016	+.078 -.016
Type I, grade B	+.039 -.016	+.039 -.016	+.047 -.016	-	-	-	-
Type II	±.031	±.031	±.031	±.031	±.031	±.063	-

3.2.4 Length. Hose length shall be 50 feet (+ 6 inches, - 0 inches) excluding couplings, unless otherwise specified in the contract or order (see 7.4.d).

3.3 Construction. The hose shall be constructed of a heat and ozone resistant cover. Type I hose shall have reinforcement to withstand shock, vibration, and flexing. Treatment may be applied to the reinforcement to increase the adhesion to the heat resistant tube. The construction specified represents minimum requirements and is not intended to bar hose having improved properties that exceed the requirements of this specification.

3.4 Couplings. When specified, the hose shall be fitted with couplings. Couplings shall be of the long shank, interlocking clamp type, having fingers or lugs on each half of the clamp to grip a collar on the stem. The coupling shall consist of a stem with a serrated or grooved shank end, a raised continuous collar, and a two-part interlocking-type clamp with clamping bolts. Hose smaller than I.00 inch ID shall be provided with not less than two clamping bolts; all other couplings shall have four clamping bolts. Two male couplings or one female and one male coupling shall be provided, as specified in the contract or order. Components, except washers and soft metal contact surface inserts, shall be protected with a corrosion-resisting coating (see 7.4c).

3.5 Physical requirements. The hose shall meet the minimum requirements specified in table III when tested in accordance with ASTM D380, Standard Test Methods for Rubber Hose.

TABLE III. Physical properties.

Property	Inside diameter, nominal (inches)						
Hydrostatic proof pressure, minimum, psig	0.5	0.75	1.0	1.25	1.5	2.0	2.5
Type I, grade A	1250	1250	1250	1250	1250	1250	1250
Type I, grade B	900	900	900	-1/	-1/	-1/	-1/
Type II	400	400	400	350	350	300	-
Hydrostatic burst pressure, minimum, psig							
Type I, grade A	2000	2000	2000	2000	2000	2000	2000
Type I, grade B	1800	1800	1800	-1/	-1/	-1/	-1/
Type II	875	875	875	800	800	750	-

Note 1: Sizes larger than 1 inch inside diameter for Type I, grade B hose are not considered structurally sound.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T10:04Z
Check the source to verify that this is the current version before use.

3.5.1 Type I. When pressurized to burst pressure, Type I hose shall have no more than one rotation or twist of 360º within 50 feet or exceed ± 4% change in length.

3.6 Identification marking. Each length of hose shall be marked in a color that contrasts with the color of the hose cover. Marking shall be accomplished either by in-laying a rubber or suitable material brand or by applying a suitable composition ink, bonding the marking onto the cover so that the marking cannot be removed except by mechanical means. The marking shall consist of the manufacturer's name or trademark, the quarter and year of manufacture, the working pressure, and the word "steam". An alternative method of marking may be by the application of a continuous embossed strip along the entire length, vulcanizing the hose and by the subsequent removal of the strip, leaving a continuous relief identification area. Identification shall be the manufacturer's name or trademark, the working pressure, and the word "steam" repeated at maximum intervals of 36 inches. When the marking is accomplished by this alternative method, no color contrast is required. Letters shall be a least 0.25 inches high.

3.6.1 Marking tag. A marking tag shall be secured to the hose near each end fitting (two tags per length of hose), advising users of all safety precautions to be followed in the use of the hose.

The following shall be included on the tag:

a. Hose clamps shall be checked for proper application and shall be re-tightened, as necessary, prior to being placed into service. Be sure that clamps are interlocked over the collar on the nipple and that each clamp half interlocks with the other.
b. Hose clamps shall be tightened after the first several hours of steaming of the hose and periodically thereafter.
c. The importance of taking up evenly on all bolts to prevent cocking of the hose clamp shall be emphasized.
d. Other operational and maintenance suggestions considered necessary by the hose and end-fitting manufacturers.

3.7 Materials. Materials used shall be free from defects that would adversely affect the performance or maintainability of individual components or of the overall assembly. Materials not specified herein shall be of the same quality used for the intended purpose in commercial practice. The term "recovered materials" (see 4.1) means materials that have been collected or recovered from solid waste and reprocessed to become a source of raw materials, as opposed to virgin raw materials. None of the above shall be interpreted to mean that that the use of used or rebuilt products is allowed under this specification unless otherwise specified (see 7.4).

3.8 Workmanship. The quality of workmanship shall be such as to produce hose and hose assemblies that are in accordance with the requirements of this CID.

4. REGULATORY REQUIREMENTS. The offeror/contractor is encouraged to use recovered material to the maximum extent practicable, in accordance with paragraph 23.403 of the Federal Acquisition Regulation (FAR) (see 3.7).

4.1 Metric products. Products manufactured to metric dimensions will be considered on an equal basis with those manufactured using inch-pound units, provided: they fall within the tolerances specified using conversion tables contained in the latest revision of ASTM SI-10; and all other requirements of this CID including form, fit and function are met. If a product is manufactured to metric dimensions and those dimensions exceed the tolerances specified in the inch/pound units, a request should be made to the contracting officer to determine if the product is acceptable. The contracting officer has the option of accepting or rejecting the product.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T10:04Z
Check the source to verify that this is the current version before use.

5. PRODUCT CONFORMANCE PROVISIONS.

5.1 Product conformance. The products provided shall meet the salient characteristics of this CID; conform to the producer's own drawings, specifications, standards, and quality assurance practices; and be the same product offered for sale in the commercial marketplace. No product subjected to pressures greater than its proof pressure shall be supplied to fulfill contract or order requirements for this specification. The Government reserves the right to require proof of such conformance.

6. PACKAGING. Preservation, packing, and marking shall be as specified in the contract or purchase order (see 3.5 and 7.4).

7. NOTES.

7.1 PIN. The PIN should be used for Government purposes to buy commercial products to this CID. See section 2 for PIN format example.

7.2 Commercial and Government Entity (CAGE) code. For ordering purposes, inventory control, and submission of these hoses and hose assemblies to DSCC under the Military Parts Control Advisory Group (MPCAG) evaluation program, CAGE code 58536 should be used.

7.3 Source of documents.

FEDERAL ACQUISITION REGULATIONS

FAR 23.403	-	Environment, Conservation, Occupational Safety, And Drug-Free Workplace; Use Of Recovered Materials; Policy

(The Federal Acquisitions Regulations may be obtained from the Superintendent of Documents, U. S. Government Printing Office, Washington, DC 20402 or from the internet at https://www.acquisition.gov/browse/index/far.)

Non-Government publications

AMERICAN SOCIETY for TESTING and MATERIALS (ASTM)

ASTM D380	-	Standard Test Methods for Rubber Hose
ASTM SI-10	-	International System of Units (SI): The Modern Metric System

(Copies of ASTM standards are available online at http://www.astm.org and from the American Society for Testing and Materials, 100 Barr Harbor Drive, West Conshohocken, PA 19428-2959.)

7.4 Ordering Data. Acquisition documents should specify the following:

a. CID document number, revision, and CID PIN.
b. Type, grade, and size of hose required (see 2.1).
c. When couplings are required, type of couplings, and material (see 3.4).
d. Length of hose required if other than 50 feet as specified in 3.2.4.
e. Level of preservation-packaging and level of packing required (see 6.1).
f. Use of recovered materials, or of used or rebuilt products, if other than specified (see 3.7 and 4.1).

7.5 Possible Sources of Supply. As part of the market analysis and research effort, this CID was coordinated with the sources listed in table IV. At the time of CID preparation and coordination, these sources were known to have products that would meet the requirements of this CID. (NOTE: This information should not be considered as a list of approved sources to be used to restrict procurement to only the companies.)

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T10:04Z
Check the source to verify that this is the current version before use.

TABLE IV. Sources' contact information.

CAGE	contact information
4S282	Reliable Industrial Products Inc 2611 Thunderhawk Ct Dayton, OH 45414-3461 Telephone: (937) 454-2080
61125	J G B Enterprises 115 Metropolitan Dr Liverpool, NY 13088 Telephone: (315) 451-2770
33YL7	Production Components, Inc. 115 Eagle Way Clinton, TN 37716-4026 Telephone: (865) 356-3636
4VMB2	Hose & Rubber Supply Inc 3450 S 300 W Salt Lake City, UT 84115-4308 Telephone: (801) 910-5872
1A737	Adirondack Elrctronics Inc 2084 RTE 9 Round Lake, NY 12151-1710 Telephone: (518) 456-0203

7.6 Government users. To acquire information on obtaining these rubber steam hoses or hose assemblies from the Government inventory system, contact DLA Customer Interaction Center (CIC), email dlacontactcenter@dla.mil, or toll free 1-877-DLA-CALL (1-877-352-2255), DSN CONUS/OCONUS: 877-352-2255, Commercial: 269-704-7921, or Fax: 269-704-7930.

7.7 Subject term (key word) listing.

Clamps
Collar
Nipple
Reinforced hose
Saturated
Steaming

7.8 Changes from previous issue. The margins of this specification are marked with vertical lines to indicate where changes from the previous issue were made. This was done as a convenience only and the Government assumes no liability whatsoever for any inaccuracies in these notations. Bidders and contractors are cautioned to evaluate the requirements of this document based on the entire content irrespective of the marginal notations and relationship to the previous issue.

MILITARY INTERESTS:

Custodians:
Army – AT
Navy – SH
Air Force –03
DLA – CC

Review activities:
Navy – SA
Air Force –71

CIVIL AGENCY COORDINATING ACTIVITIES:

GSA – FSS

Preparing activity:
DLA - CC

(Project 4720-2021-002)

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T10:04Z
Check the source to verify that this is the current version before use.