SS-S-118B
June 13, 1980
SUPERSEDING
SS-S-118A
September, 15, 1967

FEDERAL SPECIFICATION

SOUND CONTROLLING (ACOUSTICAL) TILES AND PANELS

This specification was approved by the Commissioner, Federal Supply Service, General Service Administration, for use of all Federal agencies.

1. SCOPE AND CLASSIFICATION

1.1 Scope. This specification covers prefabricated acoustical tiles and panels which provide acoustical treatments and interior finish.

1.2 Classification. Acoustical tiles and panels furnished under this specification shall be of one or more of the following types, forms, patterns, classes, grades, and LR values, as specified (see 6.1):

1.2.1 Types.

Type I	Cellulose composition with standard washable painted finish.
Type II	Cellulose composition with plastic membrane-faced overlay.
Type III	Mineral composition with standard washable painted finish.
	Form 1 - modulated, cast or molded. Form 2 - water felted. Form 3 - dry felted.
Type IV	Mineral composition with plastic membrane-faced overlay.
	Form 1 - modulated, cast or molded. Form 2 - water felted. Form 3 - dry felted.
Type V	Steel facings with mineral composition absorbent backing.
Type VI	Stainless steel facings with mineral composition absorbent backing.
Type VII	Aluminum facings with mineral composition absorbent backing.
TypeVIII	Cellulose composition with scrubbable pigmented or clear finish.
Type IX	Mineral composition with scrubbable pigmented or clear finish.
	Form 1 - modulated, cast or molded. Form 2 - waterfelted. Form 3 - dry felted.
Type X	Mineral composition with plastic/aluminum membrane.
Type XI	Other (specify)

Source: https://assist.dla.mil -- Downloaded: 202610-26T12:12Z
Check the source to verify that this is the currentversion before use.

1.2.2 Patterns. Acoustical units shall be one of or a combination of two or more of the following:

Pattern	
	a. Regularly large hole perforated.
	b. Randomly large hole perforated.
	c. Finely perforated.
	d. Fissured.
	e. Textured light to medium.
	f. Textured heavy.
	g. Smooth.
	h. Printed.
	i. Embossed.
	j. Embossed-in-register.
	k. Other (Specify).

1.2.3 Classes.

Class	Flame Spread Index
A	0-25
B	26-75
C	76-200

1.2.4 Grades. Acoustical units shall be one of the following grades. Do not specify the NIC' designation except for systems which are acoustically designed to accommodate open planned areas where background sound masking and speech privacy screens are integral parts of the design. If NIC' designations are specified, do not specify NRC designations.

NRC grade designation	Acceptable minimum NRC 1/
NRC 95	0.95
NRC 90	.90
NRC 85	.85
NRC 80	.80
NRC 75	.75
NRC 70	.70
NRC 65	.65
NRC 60	.60
NRC 55	.55
NRC 50	.50
NRC 45	.45
NRC 40	.40

1/ Noise Reduction Coefficient (NRC) is defined as the average expressed to the nearest integral multiple of 0.05, of the coefficients at 250, 500, 1,000, and 2,000 Hz.

NIC' grade designation	Acceptable minimum NIC'
NIC' 20	20
NIC' 17	17

1.2.5 Light reflectance coefficients (LR)

LR designation	Acceptable minimum LR
LR 1	0.75
2	.70
3	.65
4	.60

2. APPLICABLE DOCUMENTS

2.1 The following documents, of the issues in effect on date of invitation for bids or request for proposal, form a part of this specification to the extent specified herein:

Federal Specification:

PPP-B-636 - Boxes, Shipping, Fiberboard

Source: https://assist.dla.mil -- Downloaded: 202610-26T12:12Z
Check the source to verify that this is the current version before use.

PACKAGING NOT AS SPECIFIED.

(Activities outside the Federal Government may obtain copies of Federal specifications, standards, and commercial item descriptions as outlined under General Information in the Index of Federal Specifications, Standards and Commercial Item Descriptions. The Index, which includes cumulative bimonthly supplements as issued, is for sale on a subscription basis by the Superintendent of Documents, U.S. Government Printing Office, Washington, DC 20402.

(Single copies of this specification, other Federal specifications, and commercial item descriptions required by activities outside the Federal Government for bidding purposes are available without charge from General Services Administration Business Service Centers in Boston; New York; Washington, DC; Philadelphia; Atlanta; Chicago; Kansas City, MO; Fort Worth; Houston; Denver; San Francisco; Los Angeles; and Seattle, WA.

(Federal Government activities may obtain copies of Federal specifications, standards, and commercial item descriptions, and the Index of Federal Specifications, Standards and Commercial Item Descriptions from established distribution points in their agencies.)

Military Standard:

MIL-STD-105 - Sampling Procedure and Tables for Inspection by Attributes.

(Copies of Military specifications and standards required by contractors in connection with standards required by contractors in connection with specific procurement functions should be obtained from the procuring activity or as directed by the contracting officer.)

Public Buildings Service Standard Methods of Tests:

Test Method PBS-C.1 - Method for the Direct Measurement of Speech Privacy Potential (SPP) based on Subjective Judgements.

Test Method PBS-C.2 - Method for the Sufficient Verification of Speech Privacy Potential (SPP) based on Objective Measurements including Methods for the Rating of Functional Interzone Attenuation and NC Background.

(Application for copies required by contractors in connection with specific procurement functions should be obtained from the procuring activity or as directed by the contracting officer.

(Activities outside the Federal Government may obtain copies through the appropriate GSA Business Service Centers.

(Federal Government activities may obtain copies by completing and submitting GSA Form 1725, Issuance Request ad Transmittal to: General Services Administration (3FNDD), Washington, DC 20407).

2.2 Other publications. The following documents form a part of this specification to the extent specified herein. Unless a specific issue is identified, the issue in effect on date of invitation for bids or request for proposal shall apply.

American Society for Testing and Materials (ASTM) Publications:

C 423 Method of Test for Sound Absorption of Acoustical Materials in Reverberation Rooms.
C 523 Methods of Test for Light Reflectance of Acoustical Materials by the Integrating Sphere Reflectometer.
E 84 Method of Test for Surface Burning Characteristics of Building Materials.

(Application for copies should be addressed to the American Society for Testing and Materials, 1916 Race Street, Philadelphia, PA 19103.)

Steel Products Manual - AISI 302 and 430 Stainless and Heat Resisting Steels.

(Application for copies should be addressed to the American Iron and Steel Institute (AISI), 1000 16th Street NW., Washington, DC 20036.)

National Motor Freight Traffic Association, Inc., Agent:

National Motor Freight Classification.

(Application for copies should be addressed to the American Trucking Associations, Inc., Traffic Department, 1616 P Street, NW., Washington, DC 20036.)

Source: https://assist.dla.mil -- Downloaded: 2026-04-26T12:12Z
Check the source to verify that this is the current version before use.

Uniform Classification Committee, Agent:

Uniform Freight Classification.

(Application for copies should be addressed to the Uniform Classification Committee, Room 1106, 222 South Riverside Plaza, Chicago, IL 60606.)

3. REQUIREMENTS.

3.1 Types I through XI.

3.1.1 Design. Tiles and panels shall be designed for proper installation and use as an architectural finish.

3.1.2 Size. Widths and lengths shall be as specified and shall be within commercially accepted tolerances for the intended application. Thicknesses shall be as required to achieve the specified grade for the material used.

3.1.3 Edge. Edge and joint details shall be as specified (see 6.2 and 6.9).

3.1.4 Flame spread. The degree of surface flame spread of tiles and panels shall be as follows when tested in accordance with 4.4.1.

3.1.4.1 Class A. The flame spread index of class A tiles and panels shall not exceed 25, nor shall the material show evidence of continued progressive combustion after the test flame has been extinguished. All surfaces, including those which would be exposed by cutting through the material in any way, shall meet these requirements. In addition, class A tiles and panels shall have a smoke developed rating not to exceed 50.

3.1.4.2 Class B. The flame spread index of class B tiles and panels shall not exceed 75 on the face side.

3.1.4.3 Class C. The flame spread index of class C tiles and panels shall not exceed 200 on the face side.

3.1.5 Grades.

3.1.5.1 NRC Grades. Noise reduction coefficients (NRC) for noise reduction treatment grade designations prefixed "NRC" are specified. Tiles and panels mounted according to figure 1 shall be graded in regard to their sound absorption coefficients at the four frequencies 250, 500, 1000 and 2000 Hz. The average of the sound absorption coefficients at the four frequencies taken to the nearest multiple of 0.05 will be the NRC (see 4.4.2).

3.1.5.2 NIC' Grades. The Speech Privacy Noise Isolation Class (NIC') scheme of rating the acoustical performance of ceilings designed to accommodate open-plan areas is applicable for any ceiling material used as a part of an acoustically designed system incorporating background sound masking and speech privacy screens. When so used in flat configuration, the degree of correlation between NIC' and subjective judgements of speech privacy is well defined. (See test method PBS-C.1.). The NIC' rating scheme can also be used to rate other than flat ceiling configurations such as as vaulted and baffled ceiling systems, but in this case the degree of correlation with subjective judgments of speech privacy is less well defined. NIC' is a better rating scheme for selecting ceiling tile or lay-in panels for open-plan use than the NRC rating scheme; therefore, do not specify NRC when NIC' is specified. The addition of hard surfaced elements in the ceiling such as recessed or surface mounted light fixtures will impair the acoustical performance of the ceiling to greater or lesser degrees depending upon their surface area and location in the ceiling.

3.1.6 Light reflectance coefficients (LR). Reflectance, white only, shall meet the values for the specified LR when tested in accordance with 4.4.3.

3.2 Types II and IV, plastic membrance facing. In types II and IV, plastic membrane facings are meant to be separate film facings and not coatings similar to paint.

3.3 Type V, steel pans.

3.3.1 Base metal. Pans shall be formed from manufacturers standard gage No. 26 (0.0179 inch), minimum thickness 0.016 inch, cold rolled, low-carbon steel (see 4.4.4.1.2), for pans up to 48 inches long. For pans over 48 inches, the minimum thickness shall be increased in direct proportion to the additional length of the pan, or in lieu thereof, stiffeners or ribs may be provided to insure rigidity.

3.3.2 Zinc coat. Pans shall be zinc coated on all surfaces. Thickness or weight of the zinc shall be at the manufacturer's option. Galvanized surfaces shall be phosphate coated to provide a base for subsequent painting.

3.3.3 Painted surfaces. Pans shall be coated with a baked-on enamel. The dry film thickness (see 4.4.4.1.1) excluding the zinc coat shall be at least 1.5 mils (0.0015 inch).

Source: https://assist.dla.mil -- Downloaded: 202610-26T12:12Z
Check the source to verify that this is the current version before use.

3.4 Type VI, perforated stainless steel pans. Pans shall be AISI 302 or AISI 430 stainless steel, as specified (see 6.2).

3.4.1 Austenitic stainless steel pans. Pans shall be formed from AISI 302 stainless steel. The face, bevels, and flanges shall have a dull finish.

3.4.2 Ferritic stainless steel pans. Pans shall be formed from AISI 430 stainless steel. The face, bevels, and flanges shall have a bright finish.

3.4.3 Length and thickness, styles 302 and 430. Thickness of pans shall not be less than .0179 inch for pans up to 48 inches (see 4.4.4.2). For pans over 48 inches the minimum thickness shall be increased in direct proportion to the additional length of the pan, or in lieu thereof, stiffeners or ribs may be provided to insure rigidity.

3.5 Type VII, perforated aluminum pans.

3.5.1 Base metal. Aluminum pans may be formed from any alloy and temper at the manufacturer's option. Thickness shall be 25 mils (0.025 inches) or greater (see 4.4.4.1.2 and 4.4.4.2) for pans up to 48 inches long. For pans over 48 inches long the minimum thickness shall be increased in direct proportion to the additional length of the pan, or in lieu thereof, stiffeners or ribs may be provided to insure rigidity.

3.5.2 Surface finish. Aluminum pans shall be surfaced by one of the following finishes, as specified (see 6.2):

(a) Anodized satin finish, all surfaces.
(b) Baked white enamel, face and flanges.
(c) Acrylic white, face and flanges.

Chemically treated pans (a) shall be anodized after pans are formed. Thickness of paint (see 4.4.4.1.1) on the face side of painted pan (b) shall be least 1.5 mils (0.0015 inches).

3.6 Pads for types, V, VI, and VII. Acoustical pads or blankets, including the facings or enclosing envelopes, shall meet the requirements for class A in 3.1.4.1. Glass fiber pads shall be completely enclosed or exposed as specified (see 6.2). Other mineral fiber pads, as specified (see 6.2), shall be completely enclosed. A pad and spacer shall be furnished with each pan.

3.7 Workmanship. Acoustical tiles and panels shall be free from imperfections and blemishes that affect their appearance or serviceability. Exposed plain surfaces shall be straight and true to form. Corners and edges shall be full and without marred or broken edges.

4. QUALITY ASSURANCE PROVISIONS

4.1 Responsibility for inspection. Unless otherwise specified in the contract or purchase order, the supplier is responsible for the performance of all inspection requirements as specified herein. Except as otherwise specified, the supplier may utilize his own facilities or any commercial laboratory acceptable to the Government. The Government reserves the right to perform any of the inspections set forth in the specification where such inspections are deemed necessary to assure that supplies and services conform to prescribed requirements.

4.2 Sampling.

4.2.1 Dimensional and visual examination of end item. Sampling of tiles and panels for these characteristics shall be in accordance with MIL-STD-105, using inspection level S-3. The sample unit shall be a single tile or panel.

4.2.2 Sampling for tests. Samples for tests shall be 80 square feet for sound absorption and 60 square feet for flame spread. For Speech Privacy Noise Isolation Class, a laboratory mock-up is required as specified by the test procedure. Sampling of metal pans for thickness measurement shall be in accordance with level S-1.

4.3 Examination.

4.3.1 End item. Tiles and panels selected in accordance with 4.2.1 shall be examined for defects listed in table I. The acceptable quality levels (AQL's) for defects shall be 2.5 percent defective for major defects, and 4.0 percent for minor defects in accordance with MIL-STD-105.

Source: https://assist.dla.mil -- Downloaded: 202610-26T12:12Z
Check the source to verify that this is the current version before use.

TABLE I. Classification of defects, end item

Defects	Major	Minor
Fractures	X	
Warps	X	
Corner chips (tile only)		X
Paint color variation	X	
Tile or metal pans out of square	X	
Metal pans concaved or convexed	X	
Lay-in, or metal lay-in panels out of square		X
Damage or defects not affecting function or serviceability		X

4.3.2 Examination of preparation for delivery. An examination shall be made to determine compliance with the requirements of section 5. The sample unit shall be one shipping container fully prepared for delivery. Sampling shall be in accordance with MIL-STD-105. The inspection level shall be S-2 with an AQL of 4.0 expressed in terms of percent defective.

4.4 Test methods. The AQL for tests conducted in 4.4.4, shall be 4.0 percent defective.

4.4.1 Flame spread index and smoke. Determine burning characteristics in accordance with ASTM E-84 (see 3.1.4).

4.4.2 Sound control.

4.4.2.1 Sound absorption. Determine NRC in accordance with ASTM C 423 using tiles and panels mounted according to figure 1 (see 3.1.5.1).

4.4.2.2 Speech privacy noise isolation class (NIC'). The test shall be procedure II of test method PBS-C.2 in laboratory mock-up, subject to the following:

(a) The interzone distance between speaker and listener shall vary typically between 9 and 12 feet, with the standardized screen located midway between speaker and listener.

(b) The surface of the finished floor along the typical interzone path shall be carpeted.

(c) The ceiling to be tested shall be installed as normally used in its recommended suspension system, no less than 8 feet and no more than 9 feet above the floor.

(d) The plenum depth measured from the specimen surface to the underside of the finished floor above shall be 2 feet 6 inches. The extended surface of the underside of the floor above shall be accoustically hard. Since an NC background distribution system is not a part of this offering, none need be provided during the test, and consequently, no measurements need be made of its level.

4.4.3 Light reflectance. Determine LR in accordance with ASTM C 523 (see 3.1.6).

4.4.4 Thickness of metal pans and film coat.

4.4.4.1 Painted pans.

4.4.4.1.1 Thickness of paint. Determine thickness by one of the following methods (see 3.3.3 and 3.5.2):

(a) Determine thickness using a micrometer. The difference between the measurement before the face paint is removed and the measurement after the paint is removed is the thickness of the face paint. Remove paint, using methylene chloride or other organic solvent such as benzene, dry and measure thickness.

(b) Measure thickness of face paint on type V steel pans using a magnetic or scratch gauge. Measure thickness of face paint on type VII aluminum pans using an electrical or scratch gauge.

4.4.4.1.2 Thickness of base metal.

(a) Steel pans, type V. Dip a specimen, with the paint removed, into sulfuric acid, sp.gr. 1.84 (add 40 ml of c.p. H_2SO_4, to 950 ml of distilled water). Keep immersed until rapid evolution of hydrogen has ceased. Remove specimen and scrub or wipe off the black deposit, then wash with water and dry. Measure thickness of base metal with a micrometer (see 3.3.1).

Source: https://assist.dla.mil -- Downloaded: 202610-26T12:12Z
Check the source to verify that this is the currentversion before use.

(b) Aluminum pans, type VII. Measure thickness of the base metal with a micrometer after paint has been removed and the specimen dried (see 3.5.1).

4.4.4.2 Stainless steel and anodized aluminum pans. Measure thickness of type VI stainless steel pans, and type VII aluminum pans having an anodized surface using a micrometer (see 3.4.3 and 3.5.1).

4.4.5 Certification. A certificate of compliance shall be acceptable as proof that the product being offered meets the requirements of paragraphs 3.1.4, 3.1.5, and 3.1.6, provided the contractor furnishes actual test results, acceptable to the contracting officer, which indicate that tests have been performed to substantiate the certification. Supportive test data shall be not more than 5 years old at the date of invitation for bids. The certificate shall state that the tests on which the data is furnished have been performed on products manufactured from the same materials and using the same manufacturing processes as the items being offered. It shall also state that any changes in materials or processes that affect the performance of the product will be reported to the contracting officer. The Government reserves the right to require additional testing and certification by the contractor when such changes are made or when otherwise deemed necessary.

5. PREPARATION FOR DELIVERY

5.1 Packaging. Packaging shall be level A or commercial, as specified (see 6.2).

5.1.1 Level A. The tiles, (or panels) of like description, shall be packaged in quantities as specified in the contract or purchase order, in a close-fitting box conforming to PPP-B-636, class weather resistant, style optional. The box shall be closed and waterproof sealed in accordance with the appendix to PPP-B-636.

5.1.2 Commercial. The tiles, (or panels) of like description, shall be packaged in accordance with normal commercial practice. The complete package shall be designed to protect the tiles (or panels) against damage during multiple shipments, handling, and storage.

5.2 Packing. Packing shall be level A or commercial, as specified (see 6.2).

5.2.1 Level A. Tiles, (or panels) of like description, packaged as specified in 5.1, shall be packed in quantities as specified in the contract or purchase order in close-fitting boxes conforming to PPP-B-636, class weather resistant style optional. Closure, waterproof sealing, and reinforcing of the boxes shall be in accordance with the appendix to PPP-B-636.

5.2.2 Commercial. The tiles, (or panels) of like description, packaged as specified in 5.1.2, shall be packed in fiberboard boxes to insure delivery at destination; provide for redistribution by the initial receiving activity; and be acceptable by common carrier under National Motor Freight Classification Uniform Freight Classification.

5.3 Marking. Marking shall be as specified in the contract or order.

6. NOTES

6.1 Intended use.

6.1.1 Square trimmed edge. Acoustical lay-in panels with square trimmed edges are intended for use in direct hung exposed suspension systems. Panels are laid in place and can easily be pushed upward for removal or access to the plenum above.

6.1.2 Butt edge. Acoustical tile, butt bevel or butt square edge, without kerfing of the edges are intended for adhesive applications, to solid backing.

6.1.3 Tongue and groove edge. Acoustical tile with tongue and groove edges are intended for stapling, concealed suspension system, or adhesive bonding.

6.1.4 Kerfed and rabbeted edge. Acoustical tile with kerfed and rabbeted edges are intended for concealed suspension system, or adhesive bonding.

6.1.5 Kerfed and rabbeted long edges, ends trimmed. Accoustical tile, 2 feet or longer, is intended or installation in semi-exposed, or semi-exposed direct hung suspension systems.

6.1.6 Reveal edge. Acoustical lay-in panels are intended for use in direct hung exposed suspension systems.

Source: https://assist.dla.mil -- Downloaded: 202610-26T12:12Z
Check the source to verify that this is the current version before use.

6.1.7 Metal pans. Metal pans ceiling systems are intended for use where good sound absorptive values are needed and where durable and easy maintenance surfaces are a necessity.

6.2 Ordering data. Purchasers should select the preferred options permitted herein and include the following information in procurement documents:

(a) Title, number, and date of this specification.
(b) Type, pattern, class and grade (see 1.2 and 6.7).
(c) LR for white tiles and panels (see 1.2).
(d) Length and width of panels (see 3.1.2 and 6.8).
(e) Edge and joint details desired (see 3.1.3 and 6.9).
(f) Alloy designation for stainless steel pans, type VI (see 3.4).
(g) Surface finish for aluminum pans, type VII (see 3.5.2).
(h) Whether glass fiber pads are to be exposed or completely enclosed (see 3.6).
(i) Mineral pads other than gloss fiber required (see 3.6).
(j) Levels of packaging and packing required (see 5.1 and 5.2).

6.3 Samples. If, for any particular purpose, samples are necessary, they should be specifically asked for in the invitation for bids and the particular purpose to be served by the bid sample definitely stated, the specification to apply in all other respects.

6.4 System assembly. It is beyond the scope of this specification to cover those aspects of acoustical tiles and panels when related to their use as a component of a system or assembly tested either for fire endurance in accordance with ASTM E 119, Method of Fire Tests of Building Construction and Materials, or tested for ceiling sound transmission in accordance with Acoustical Materials Association Tentative Method of Test AMA-1-II, as amended, Ceiling Sound Transmission Test by the Two-Room method, or both. The performance of these units should meet the performance requirements specified in the contract or purchase order.

6.5 Plenum. The depth of air space has considerable effect on NRC using mechanically mounted acoustical tiles and panels. Because of the unlimited variations which are possible it has been established that mounting no. 7 in figure 1 with a 16 inch mounting depth is most consistent with normal usage and existing technology of testing. Some manufacturers publish data for depths of mountings other than 16 inch, designating them with an X, followed by numbers which indicate the mounting depth in inches. For selecting grade ranges for mechanically mounted acoustical tiles and panels, mounting no. 7 in figure 1 is preferred.

6.6 Physical properties. Physical properties, such as structural hardness, friability, sag, linear expansion and contraction, and transverse strength, which affect the handling, installation, and use of acoustical tiles and panels are not a part of this specification, but should be considered in selecting products for a specified end use. Test methods for determining these properties are included in ASTM C 367, Standard Test Method for Strength of Properties of Prefabricated Architectrual Acoustical Materials.

6.7 Definitions for patterns d, e, and f.

6.7.1 Fissured patterns. Fissured describes a surface with irregular depressions of varying lengths, widths, and depths extending below the basic product face.

6.7.2 Textured patterns. Textured describes a granular or raised (fine, coarse, or a blend), felted or melted surface as an integral part of the basic product or superimposed on the product surface.

6.8 Size and pattern. For dimension and pattern details on acoustical tiles and panels, refer to Sweet's Catalog File, Architectural - Products for General Building, Division 9.1, Acoustical Treatment.

Copies may be obtained from: Sweet's Division, McGraw-Hill Information Systems Company, 1221 Avenue of the Americas, New York, NY 10020 or from individual manufacturers.


6.9 Edge details. Various edge and joint details are available in accordance with table II for acoustical tiles and panels.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T12:12Z
Check the source to verify that this is the current version before use.


TABLE II. Edge and joint detail, types I, II, III, IV, VIII, and IX.

Acoustical unit	Edge detail	Joint detail
Tile	Beveled	Kerfed and rabbeted. Tongue and groove.
	Square	Kerfed and rabbeted. Tongue and groove.
	Beveled long edges, square edge trimmed on ends.	Kerfed and rabbeted long edges only, semi-concealed system.
	Butt	
Panels: Lay-in square. Reveal.	Square trimmed. Reveal.	


JOINT DETAILS

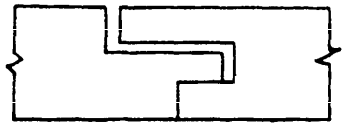

Tongue and Groove



Kerfed and Rabbeted

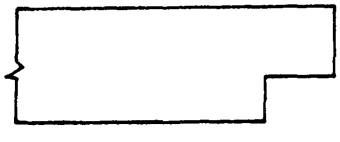

Reveal

These drawings are intended to be representative but not restrictive. Other designs are available and may be furnished.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T12:12Z
Check the source to verify that this is the current version before use.

6.10 Type VIII. When ordering special tiles or panels, consideration should be given to material, size, thickness, edge or joint detail and pattern.

6.11 Tiles and panels, definition. Acoustical tile are units used with concealed suspension systems. Acoustical panels are units used with exposed or semi-exposed suspension units.

Military Custodians:

Army - ME
Navy - YD
Air Force - 85

Review activity:

Navy - YD

Preparing activity:


GSA-FSS

Orders for this publication are to be placed with the General Services Administration, acting as an agent for the Superintendent of Documents. See section 2 of this specification to obtain extra copies and other documents referenced herein.

Source: https://assist.dla.mil -- Downloaded: 202640-26T12:12Z
Check the source to verify that this is the currentversion before use.


Mountings used in measuring sound absorption coefficients. Mounting No. 7 is the mounting generally used

(1)

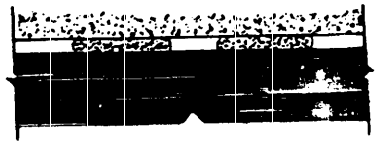


Cemented to plaster board with 1/8" air space. Considered equivalent to cementing to plaster or concrete ceiling.

(2)

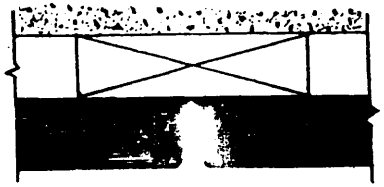

Nailed to nominal 1" x 3" (3/4" x 2 5/8" actual) wood furring 12" o.c.


(5)

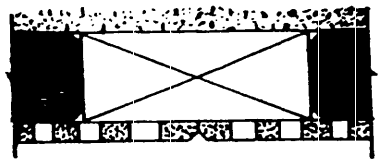

Wood furring 1" x 3" (3/4" x 2 5/8" actual) 24" o.c. 1" mineral wool between furring unless otherwise indicated. Perforated facing fastened to furring.


11

(7)

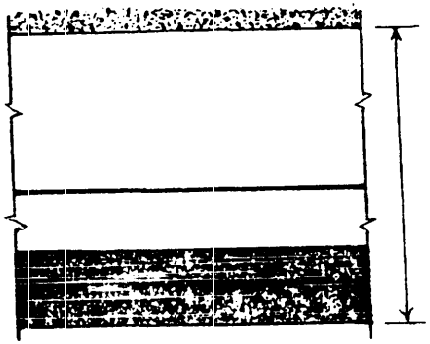

Mechanically mounted on special metal supports.

(8)

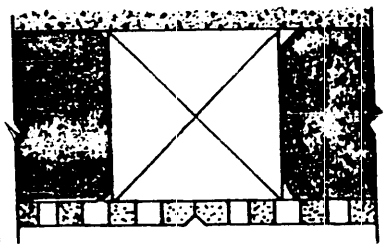

Wood furring 2" x 2" (1 5/8" x 1 5/8" actual) 24" o.c. 2" mineral wool between furring. Perforated facing fastened to furring

FIGURE 1

Source: https://assist.dla.mil -- Downloaded: 2026/10-26T12:12Z
Check the source to verify that this is the current version before use.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T12:12Z
Check the source to verify that this is the current version before use.