INCH-POUND

MIL-DTL-29183/2B
13 March 2003
SUPERSEDING
MIL-P-29183/2A
24 May 1985

DETAIL SPECIFICATION SHEET

PANELBOARD, POWER DISTRIBUTION, PORTABLE, WEATHERPROOF, TYPE I, CLASS 1, CONFIGURATION 2: 208Y/120 VOLT, 15 KILOWATT

Inactive for new design after 13 March 2003

This specification is approved for use by all departments and agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and the issue of MIL-DTL-29183 listed in that issue of the Department of Defense Index of Specifications and Standards (DoDISS) specified in the solicitation.

REQUIREMENTS: The distribution panel shall be as specified herein and in accordance with figures 1 and 2, and tables I and II. Government furnished equipment shall be as specified in table III.

Physical:

Special design features: See figure 2.

Weight: The weight shall not exceed 80 pounds (36 kilograms).

Dimensions (maximum):
Length: 24.5 inches (622 millimeters (mm))
Width: 18.5 inches (470 mm)
Height: 16.5 inches (419 mm)

Hinged access panel: Not required (see MIL-DTL-29183).

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T21:56Z
Check the source to verify that this is the current version before use.

Stability: The vertical center of gravity shall be not more than 11.0 inches (280 mm) above level ground. Additional stability requirements shall apply in accordance with MIL-DTL-29183.

Lifting attachments: Crane lifting attachments are not required (see MIL-DTL-29183). A carrying handle is required.

Electrical:


Input: The input to the distribution panel shall be 208Y/120 volt (V), 3-phase (ø), 4-pole (P), 5-wire (W), 60 Hertz (Hz).

Bus capacity: The bus bar capacity shall be 100 amperes (A).

Provision for modification: Design provisions shall be made to accommodate the future installation of an additional 3P-60A main breaker and an additional MS90558C32412P connector for dual input capability.

Circuit breaker: The number of poles and current rating shall be as indicated in table I herein and the voltage rating shall be sufficient for the intended circuit.

PIN: The government part identification number (PIN) is as follows:

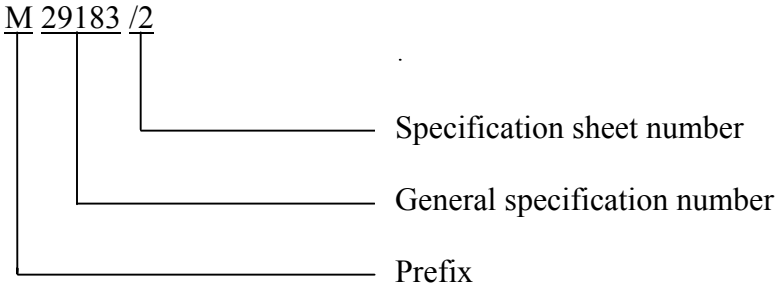

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T21:56Z
Check the source to verify that this is the current version before use.



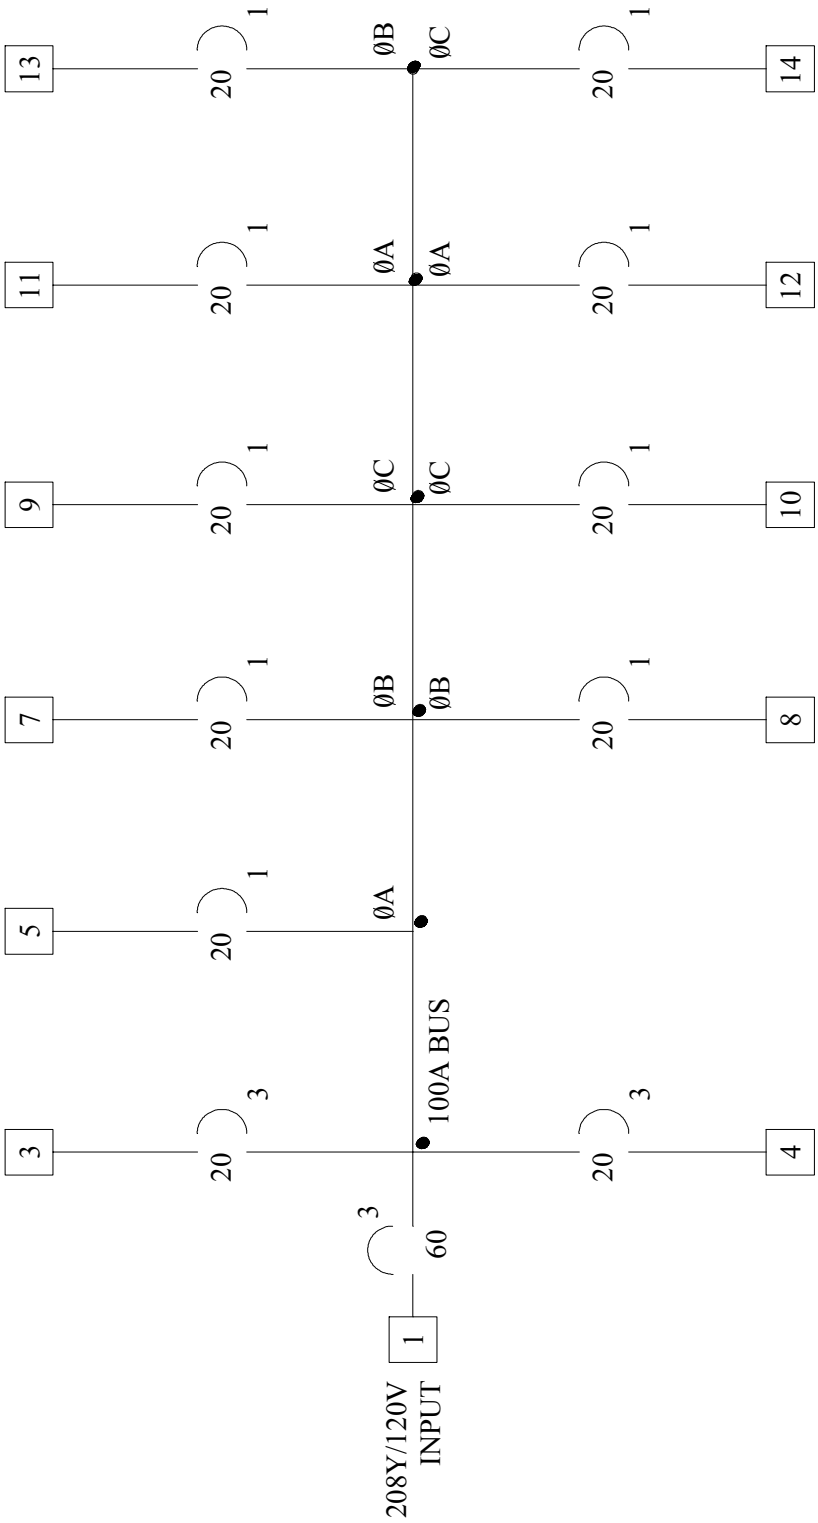


FIGURE 1. Single-line wiring diagram.


Source: https://assist.dla.mil -- Downloaded: 2026-10-20T21:56Z
Check the source to verify that this is the current version before use.

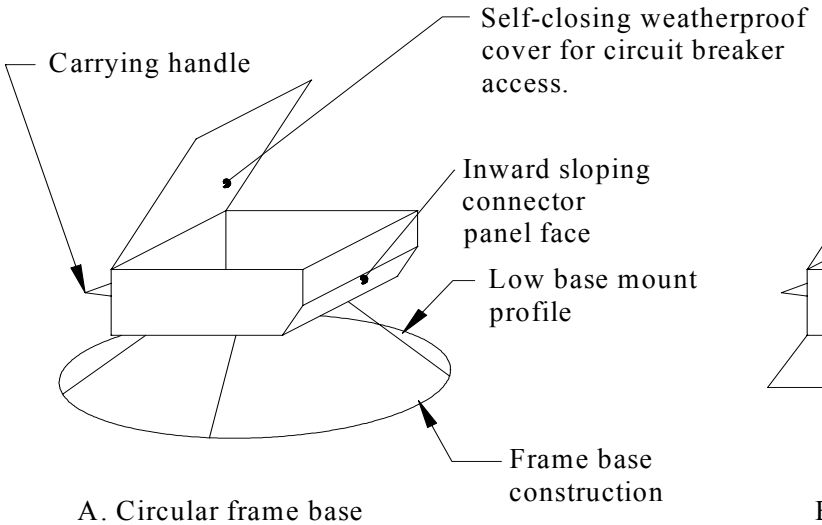


A. Circular frame base

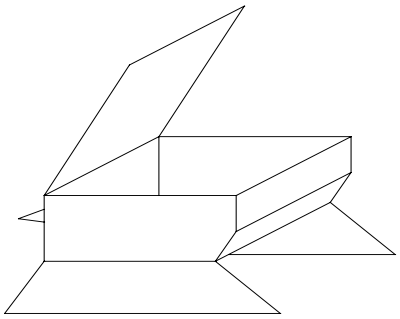

B. Trapezoid frame base

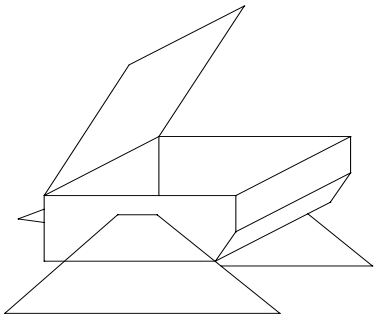

C. "A" frame base

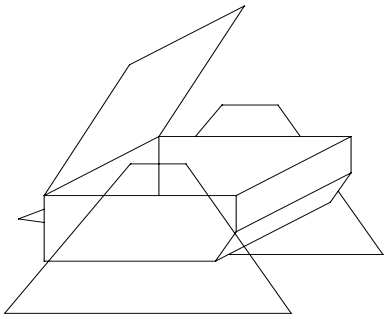

D. Extended "A" frame base

NOTES:

1. These drawings are for reference only and illustrate some of the features required by the specification of which it is a part. It is not intended that these drawings limit the design except for the requirements specified herein.

2. Base mount type shall be similar to figure 2A, or 2B, or 2C, or 2D.

3. Carrying handle, inward sloping connector panel face(s), self-closing cover, frame base construction, and low base mount profile are required.

FIGURE 2. Distribution panel design features.

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T21:56Z
Check the source to verify that this is the current version before use.

TABLE I. Circuit characteristics.

Quantity	Circuit kind	Circuit breaker Pole (P) - Ampere (A)	Interface connector[1]
1	208Y/120V, 3-phase, 4P, 5W	3P-60A	MS90558C32412P
2	208Y/120V, 3-phase, 4P, 5W	3P-20A	MS17346R24N10S
9	120V, 1-phase, 2P, 3W	1P-20A	MS17346R22N2S

[1] Connector designations are military type connectors conforming to MIL-C-22992. See MIL-DTL-29183.

TABLE II. Connector assignment and connector terminal wiring.

Circuit	Function	Interface connector[1]	Phase A, black wire	Phase B, red wire	Phase C, blue wire	Neutral, white wire	Ground, green (bare) wire
1	Input	MS90558C32412P	A	B	C	N	G
3, 4	Branch	MS17346R24N10S	F	B	E	A	C
5, 11, 12	Branch	MS17346R22N2S	B	-	-	C	A
7, 8, 13	Branch	MS17346R22N2S	-	B	-	C	A
9, 10, 14	Branch	MS17346R22N2S	-	-	B	C	A

[1] Connector designations are military type connectors conforming to MIL-C-22992. See MIL-DTL-29183.

TABLE III. Government furnished equipment.

Item	Quantity	Description	Military part number[1]
1	1	MIL-C-22992, class L, 60A wall mount, plug, with coupling ring, connector	MS90558C32412P
2	1	Protective cover (plug) for item 1	MS90564-3C
3	9	MIL-C-22992, class R, size 22, box mount socket receptacle	MS17346R22N2S
4	9	Protective cover (cap) for item 3	MS17349N22B
5	2	MIL-C-22992, class R, size 24, box mount socket receptacle	MS17346R24N10S
6	2	Protective cover (cap) for item 5	MS17349N24B

[1] Connector designations are military type connectors conforming to MIL-C-22992. See MIL-DTL-29183.

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T21:56Z
Check the source to verify that this is the current version before use.

Custodian:
Navy - YD

Preparing Activity:
DLA - GS2

(Project 6110-0443-002)

Review Activity:
Navy - MC

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T21:56Z
Check the source to verify that this is the current version before use.

STANDARDIZATION DOCUMENT IMPROVEMENT PROPOSAL

INSTRUCTIONS

1. The preparing activity must complete blocks 1, 2, 3, and 8. In block 1, both the document number and revision letter should be given.

2. The submitter of this form must complete blocks 4, 5, 6, and 7.

3. The preparing activity must provide a reply within 30 days from receipt of the form.

NOTE: This form may not be used to request copies of documents, nor to request waivers, or clarification of requirements on current contracts. Comments submitted on this form do not constitute or imply authorization to waive any portion of the referenced document(s) or to amend contractual requirements.

I RECOMMEND A CHANGE:	**1. DOCUMENT NUMBER** MIL-DTL-29183/2B	**2. DOCUMENT DATE** (YYYYMMDD) 20030313

3. DOCUMENT TITLE
PANELBOARD, POWER DISTRIBUTION, PORTABLE, WEATHERPROOF, TYPE I, CLASS 1, CONFIGURATION 2: 208Y/120 VOLT, 15 KILOWATT

4. NATURE OF CHANGE *(Identify paragraph number and include proposed rewrite, if possible. Attach extra sheets as needed.)*

5. REASON FOR RECOMMENDATION

6. SUBMITTER

a. NAME *(Last, First, Middle Initial)*	b. ORGANIZATION	
c. ADDRESS *(Include Zip Code)*	d. TELEPHONE (Include Area Code) (1) Commercial (2) DSN *(if applicable)*	**7. DATE SUBMITTED** (YYYYMMDD)

8. PREPARING ACTIVITY

a. NAME Defense Supply Center Richmond	b. TELEPHONE (*Include Area Code*) Commercial: (804) 279-5019 DSN: 695-5019
c. ADDRESS *(Include Zip Code)* ATTN: DSCR-VBD (C. Hammond) 8000 Jefferson Davis Highway Richmond, VA 23297-5610	**IF YOU DO NOT RECEIVE A REPLY WITHIN 45 DAYS, CONTACT:** DEFENSE STANDARDIZATION PROGRAM OFFICE (DLSC-LM) 8725 John J. Kingman Road, Suite 2533 Fort Belvoir, VA 22060-6221 Commercial: (703) 767-6888 DSN: 427-6888

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T21:56Z
Check the source to verify that this is the current version before use.