INCH-POUND

MIL-DTL-29183/4C
13 March 2003
SUPERSEDING
MIL-P-29183/4B
18 JUNE 1990

DETAIL SPECIFICATION SHEET

PANELBOARD, POWER DISTRIBUTION, PORTABLE, WEATHERPROOF, TYPE II, CLASS 1, CONFIGURATION 1: 150 KILOWATT, 15 KVA TRANSFORMER

Inactive for new design after 13 March 2003

This specification is approved for use by all departments and agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and the issue of MIL-DTL-29183 listed in that issue of the Department of Defense Index of Specifications and Standards (DoDISS) specified in the solicitation.

REQUIREMENTS: The distribution panel shall be as specified herein and in accordance with figure 1, and tables I and II.

Physical:

Weight: The weight shall not exceed 675 pounds (306 kilograms).

Dimensions (maximum):
Length: 57.5 inches (1461 millimeters (mm))
Width: 32.5 inches (826 mm)
Height: 36.5 inches (927 mm)

Paralleling cable access panel: Required (see MIL-DTL-29183).

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T21:56Z
Check the source to verify that this is the current version before use.

Stability: The vertical center of gravity shall be not more than 17.0 inches (432 mm) above level ground. Additional stability requirements shall apply in accordance with MIL-DTL-29183.

Electrical:


Input: The input to the distribution panel shall be 480 volt (V) or 208 V, 3-phase (ø), 4-pole (P), 5-wire (W), 60 Hertz (Hz).

Bus capacity: The bus bar capacities shall be 400 amperes (A) and 200 A (see figure 1).

Transformer: The transformer shall be 3-phase, 15 kilovolt-ampere (kva), dry type with a primary to secondary voltage of 480 to 208 V. Three 5 kva 1-phase transformers may be used in place of a single 3-phase transformer. The transformer(s) shall use a delta to wye (primary to secondary) configuration. The neutral of the transformer secondary shall be connected to the neutral bus bar as indicated in figure 1.

Circuit breaker: The number of poles and current rating shall be as indicated in table I herein and the voltage rating shall be sufficient for the intended circuit.

PIN: The government part identification number (PIN) is as follows:

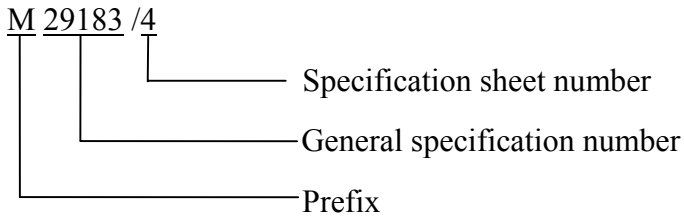

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T21:56Z
Check the source to verify that this is the current version before use.

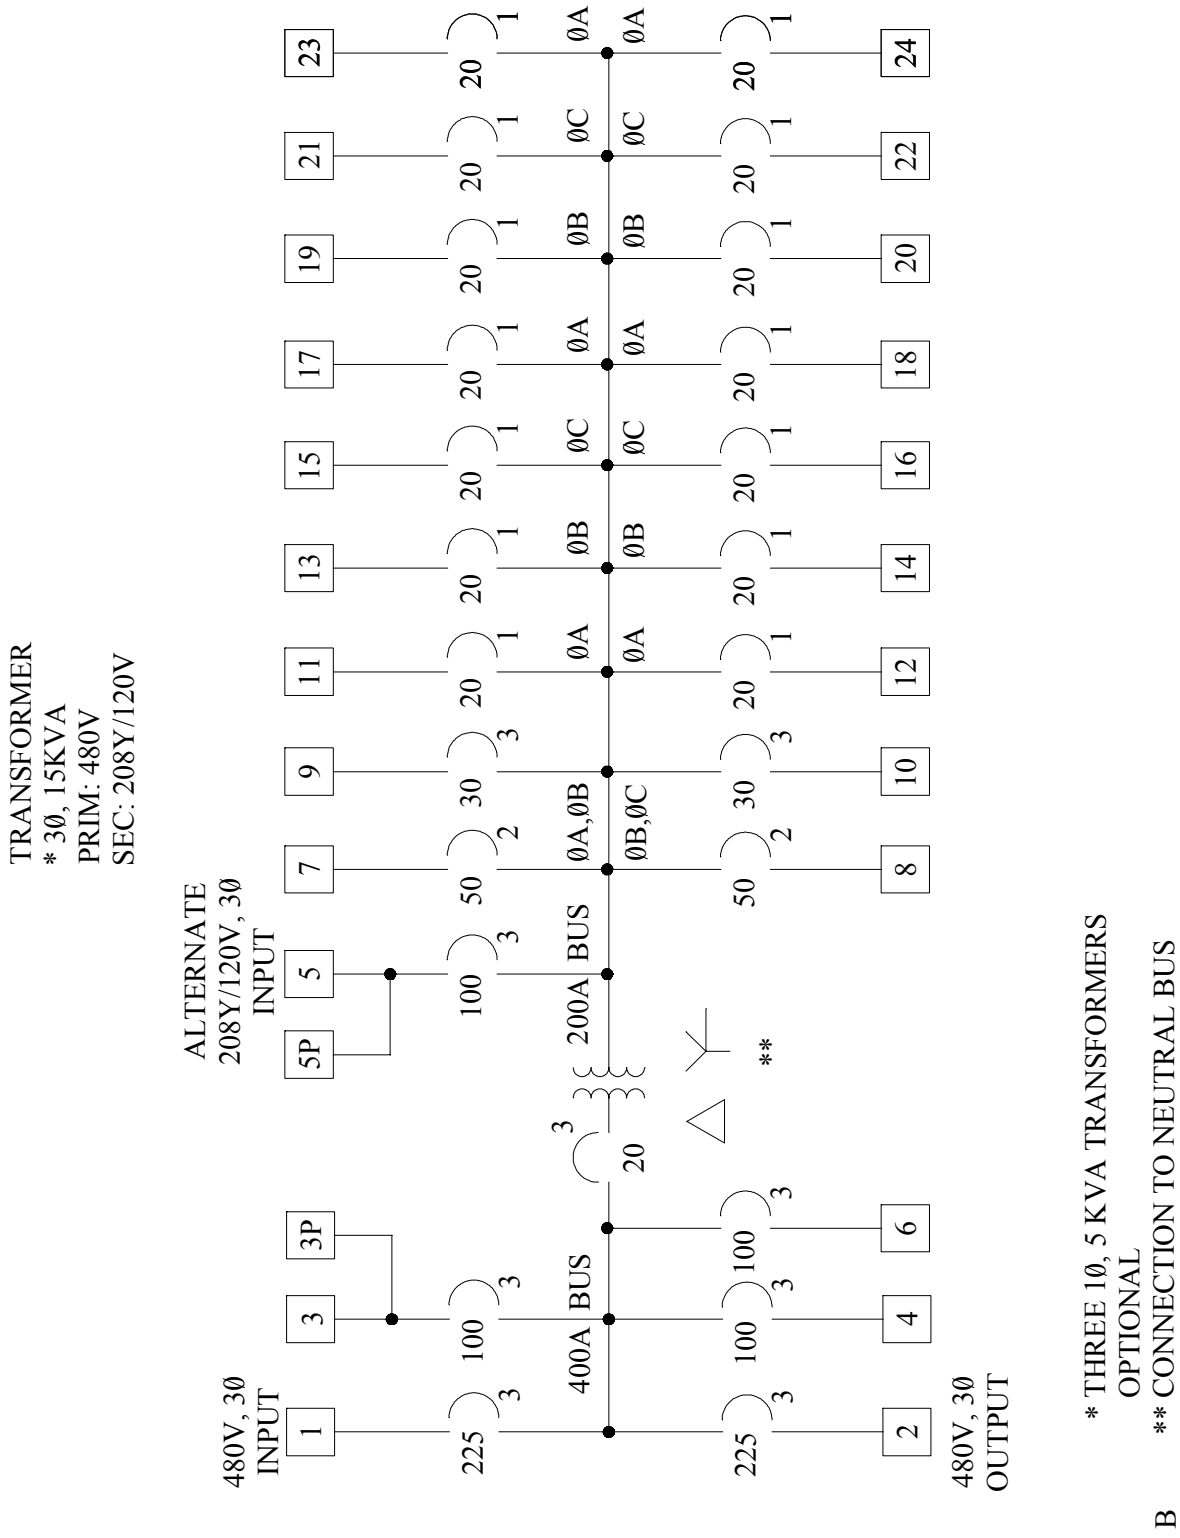


FIGURE 1. Single-line wiring diagram.

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T21:56Z
Check the source to verify that this is the current version before use.

TABLE I. Circuit characteristics.

Quantity	Circuit kind	Circuit breaker Pole (P) - Ampere (A)	Interface connector[1]
1	480V, 3-phase, 5W	3P-225A	Terminals
1	480V, 3-phase, 4W	3P-225A	Terminals
3	480V, 3-phase, 4W	3P-100A	Terminals
1	480V, 3-phase, 3W	3P-20A	Terminals
1	208Y/120V, 3-phase, 5W	3P-100A	Terminals
2	208Y/120V, 3-phase, 4W	2P-50A	Terminals
2	208Y/120V, 3-phase, 5W	3P-30A	NEMA L21-30R[1]
14	120V, 1-phase, 3W	1P-20A	NEMA L5-20R[1]

[1] Connector designations are National Electrical Manufacturers Association (NEMA) type numbers. See MIL-DTL-29183.

TABLE II. Connector assignment and connector terminal wiring.

Circuit	Function	Interface connector	Phase A, black wire	Phase B, red wire	Phase C, blue wire	Neutral, white wire	Ground, green (bare) wire
1	Input, 480V, 3-phase	Pressure type, terminal block, minimum 250 kcmil[1] wire size capacity	T1	T2	T3	T0	G
2	Output, 480V, 3-phase		L1	L2	L3	-	G
3, 4, 6	Branch, 480V, 3-phase	Pressure type, terminal block, minimum No. 1 AWG[2] wire size capacity	A	B	C	-	G
3P	Paralleling, 480V, 3-phase		P1	P2	P3	P0	G
5	Branch or alternate input, 208V, 3-phase	Pressure type, terminal block, minimum No. 1 AWG[2] wire size capacity	X	Y	Z	W	G

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T21:56Z
Check the source to verify that this is the current version before use.

TABLE II. Connector assignment and connector terminal wiring - Continued.

Circuit	Function	Interface connector	Phase A, black wire	Phase B, red wire	Phase C, blue wire	Neutral, white wire	Ground, green (bare) wire
5P	Paralleling, 208V, 3-phase		P1	P2	P3	P0	G
7	Branch, 208V, 1-phase	Pressure type, terminal block	X	Y	-	W	G
8	Branch, 208V, 1-phase		-	X	Y	W	G
9, 10	Branch, 208V, 3-phase	NEMA L21-30R[3]	X	Y	Z	W	G
11, 12 17, 18 23, 24	Branch, 120V, 1-phase	NEMA L5-20R[3]	X	-	-	W	G
13, 14 19, 20	Branch, 120V, 1-phase	NEMA L5-20R[3]	-	X	-	W	G
15, 16 21, 22	Branch, 120V, 1-phase	NEMA 15-20R[3]	-	-	X	W	G

[1] 1000 (k) circular (c) mils (mil)

[2] American wire gauge

[3] Connector designations are National Electrical Manufacturers Association (NEMA) type numbers. See MIL-DTL-29183.

Custodians:
Army - CR4
Navy - YD

Preparing Activity:
DLA - GS2

(Project 6110-0443-004)

Review Activities:
Navy - MC, MS

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T21:56Z
Check the source to verify that this is the current version before use.

STANDARDIZATION DOCUMENT IMPROVEMENT PROPOSAL

INSTRUCTIONS

1. The preparing activity must complete blocks 1, 2, 3, and 8. In block 1, both the document number and revision letter should be given.

2. The submitter of this form must complete blocks 4, 5, 6, and 7.

3. The preparing activity must provide a reply within 30 days from receipt of the form.

NOTE: This form may not be used to request copies of documents, nor to request waivers, or clarification of requirements on current contracts. Comments submitted on this form do not constitute or imply authorization to waive any portion of the referenced document(s) or to amend contractual requirements.

I RECOMMEND A CHANGE:	**1. DOCUMENT NUMBER** MIL-DTL-29183/4C	**2. DOCUMENT DATE** (YYYYMMDD) 20030313

3. DOCUMENT TITLE
PANELBOARD, POWER DISTRIBUTION, PORTABLE, WEATHERPROOF, TYPE II, CLASS 1, CONFIGURATION 1: 150 KILOWATT, 15 KVA TRANSFORMER

4. NATURE OF CHANGE *(Identify paragraph number and include proposed rewrite, if possible. Attach extra sheets as needed.)*

5. REASON FOR RECOMMENDATION

6. SUBMITTER

a. NAME *(Last, First, Middle Initial)*	b. ORGANIZATION	
c. ADDRESS *(Include Zip Code)*	d. TELEPHONE (Include Area Code) (1) Commercial (2) DSN *(if applicable)*	**7. DATE SUBMITTED** (YYYYMMDD)

8. PREPARING ACTIVITY

a. NAME Defense Supply Center Richmond	b. TELEPHONE (*Include Area Code*) Commercial: (804) 279-5019 DSN: 695-5019
c. ADDRESS *(Include Zip Code)* ATTN: DSCR-VBD (C. Hammond) 8000 Jefferson Davis Highway Richmond, VA 23297-5610	**IF YOU DO NOT RECEIVE A REPLY WITHIN 45 DAYS, CONTACT:** DEFENSE STANDARDIZATION PROGRAM OFFICE (DLSC-LM) 8725 John J. Kingman Road, Suite 2533 Fort Belvoir, VA 22060-6221 Commercial: (703) 767-6888 DSN: 427-6888

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T21:56Z
Check the source to verify that this is the current version before use.