| INCH-POUND |

MIL-P-29183/5B
18 June 1990
SUPERSEDING
MIL-P-29183/5A(NAVY)
24 May 1985

MILITARY SPECIFICATION SHEET

PANELBOARD, POWER DISTRIBUTION, PORTABLE, WEATHERPROOF, TYPE 2, CLASS 1, CONFIGURATION 2: 150 KILOWATT, 30 KVA TRANSFORMER

This specification is approved for use by all departments and agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and the issue of the following specification listed in that issue of the Department of Index of Specifications and Standards (DODISS) specified in the solicitation: MIL-P-29183B

REQUIREMENTS:

The distribution panel shall be as specified herein and in accordance with tables I and II, and figure 1.

Physical:

Weight (nominal): 880 pounds (400 kilograms).
Dimensions (maximum):
Length: 57.5 inches (1461 millimeters (mm)).
Width: 32.5 inches (826 mm).
Height: 36.5 inches (927 mm).
Vertical center of gravity: 17 inches (432 mm) above level ground.
Paralleling access panel: Required (see MIL-P-29183).

Electrical:

Input: 480 volt (V) or 208 V, 3 phase, 4 pole (P), 5 wire (W), 60 Hertz.
Transformer: Three phase, 30 kilovolt-ampere (kVA), dry type transformer with rated primary-secondary voltage of 480-208Y/120 V.
Bus capacity: 400 amperes (A) and 200A (see figure 1).

Government part number - M29183/5

B denotes changes

AMSC N/A FSC 6110

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T21:57Z
Check the source to verify that this is the current version before use.

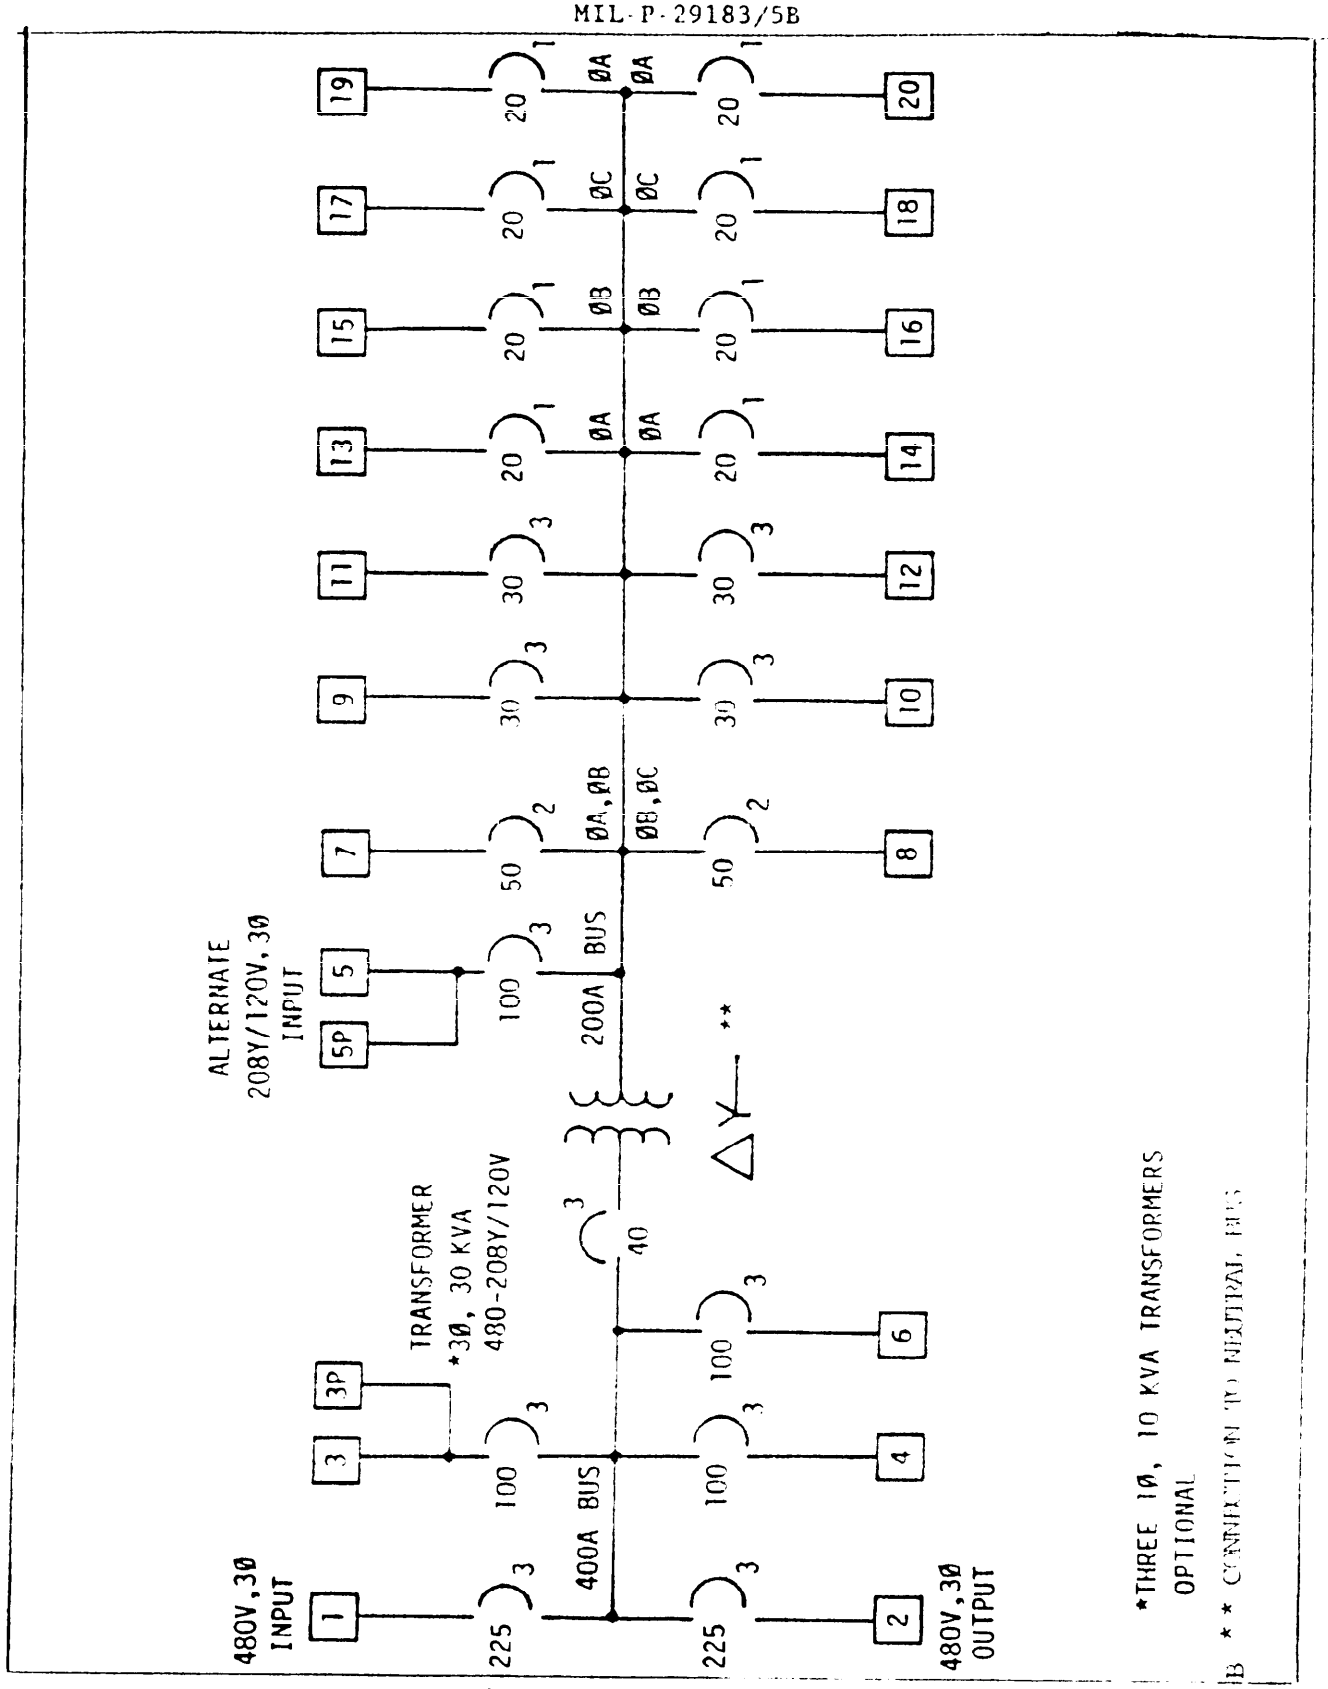


FIGURE 1. Single-line wiring diagram.

Source: https://assist.dla.mil -- Downloaded: 202610-20T21:57Z
Check the source to verify that this is the currentversion before use.

TABLE I. Circuits' characteristics.

B

Quantity	Circuit kind	Circuit breaker Pole (P)-Ampere(A)	Interface connector
1	480V, 3 phase 5W	3P-225A (Main)	Input terminals
1	480V, 3 phase 4W	3P-225A	Output terminal
3	480V, 3 phase 4W	3P-100A	Branch terminals
1	480V, 3 phase 3W	3P-40A	Transformer
1	208Y/120V, 3 phase, 5W	3P-100A	Terminals
2	208Y/120V, 1 phase, 4W	2P-50A	Terminals
4	208Y/120V, 3 phase, 5W	3P-30A	NEMA L21-30R
8	120V, 1 phase, 3W	1P-20A, GFCI type	NEMA L5-20R

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T21:57Z
Check the source to verify that this is the current version before use.

TABLE II. Connector assignment and connector terminal wiring.

Circuit	Function	1/ Connector type	Connector terminal wiring				
			Phase A, black wire	Phase B, red wire	Phase C, blue wire	Neutral, white wire	Ground, green (bare) wire
1	Input, 480V, 3 phase	Pressure type, terminal block, minimum 250 MCM wire size capacity	T1	T2	T3	T0	G
2	Output, 480V, 3 phase		L1	L2	L3	-	G
3, 4, 6	Branch 480V, 3 phase	Pressure type, terminal block, minimum No. 1 AWG wire size capacity	A	B	C	-	G
3P	Paralleling 480V, 3 phase		P1	P2	P3	P0	G
5	Branch alternate input, 208V, 3 phase	Pressure type, terminal block, minimum No. 1 AWG wire size capacity	X	Y	Z	W	G
5P	Paralleling 208V 3 phase		P1	P2	P3	P0	G
7	Branch, 208V	Pressure type, terminal block	X	Y	-	W	G
8			-	X	Y	W	G
9, 10, 11, 12	Branch 208V, 3 phase	NEMA L21-30R	X	Y	Z	W	G

Source: https://assist.dla.mil -- Downloaded: 20260-20T21:57Z
Check the source to verify that this is the current version before use.

TABLE II. Connector assignment and connector terminal wiring. - Continued

Circuit	Function	Connector type 1/	Connector terminal wiring				
			Phase A, black wire	Phase B, red wire	Phase C, blue wire	Neutral, white wire	Ground, green (bare) wire
13,14, 19,20	Branch, 120V, 1 phase	NEMA L5-20R	X	-	-	W	G
15,16,	Branch, 120V, 1 phase	NEMA L5-20R	-	X	-	W	G
17,18,	Branch, 120V, 1 phase	NEMA L5-20R	-	-	X	W	G

1/ Connector designations are National Electrical Manufacturers Association (NEMA) type numbers unless indicated otherwise.

Custodian:
Army - ME
Navy - YD
Air Force - 99

Review Activity:
Navy - MC, MS
Air Force - 80
DLA- GS

Preparing Activity:
Navy - YD

(Project 6110-0335-02)

Source: https://assist.dla.mil -- Downloaded: 202610-20T21:57Z
Check the source to verify that this is the current version before use.