
MILITARY SPECIFICATION SHEET

FIXTURES, LIGHTING; INCANDESCENT, GENERAL LIGHTING


50 WATTS, 120 VOLTS, DRIPPROOF 15 DEGREES, SYMBOLS 64.1 AND 65

This specification sheet is approved for use by the Naval Sea Systems Command and is available for use by all Departments and Agencies of the Department of Defense.

The complete requirements for acquiring the fixtures described herein shall consist of this document and the latest issue of MIL-F-16377(SHIPS).

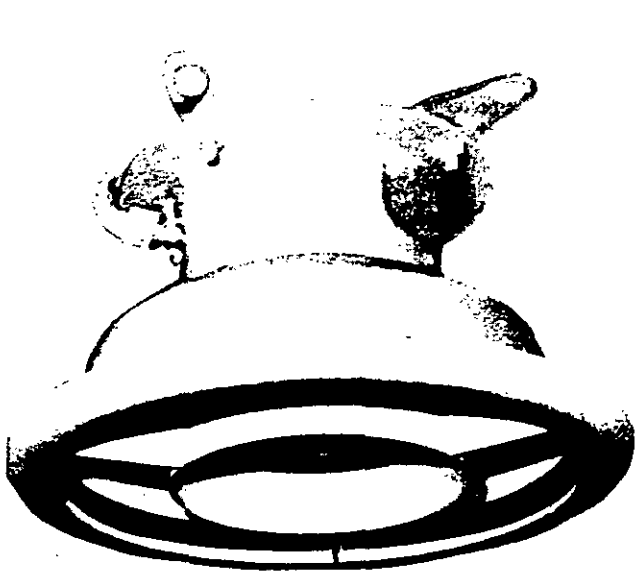

SYMBOL 64.1

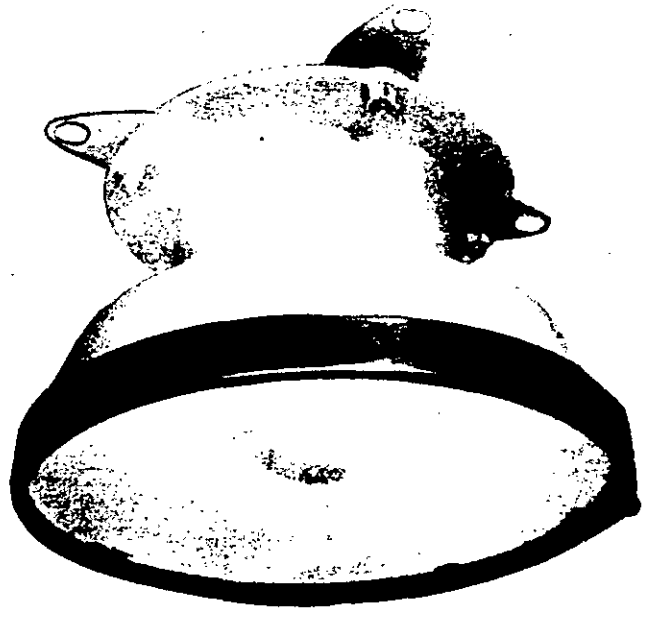


SYMBOL 65

FIGURE 1. Fixtures, incandescent, Symbols 64.1 and 65.

All dimensions in inches.
For tolerances, other than specified herein, see paragraph 3.5.2 of MIL-F-16377.


FSC 6210

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T08:43Z
Check the source to verify that this is the current version before use.

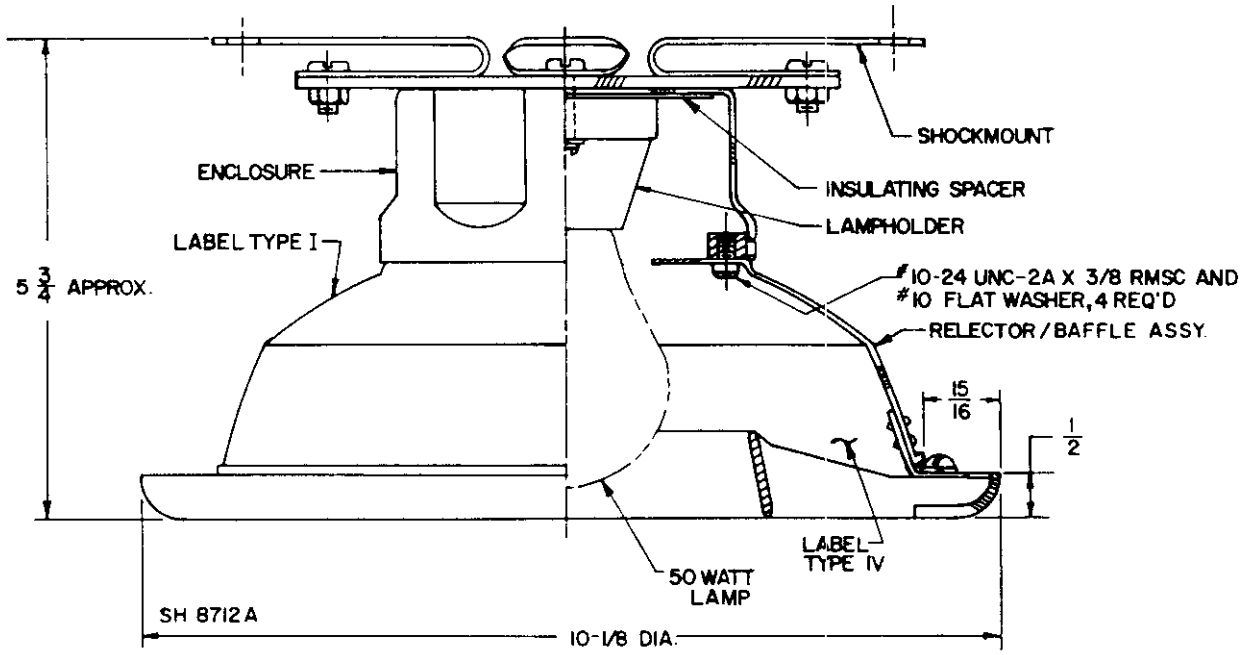

SH 8712 A

FIGURE 2. Fixture assembly, Symbol 64.1.

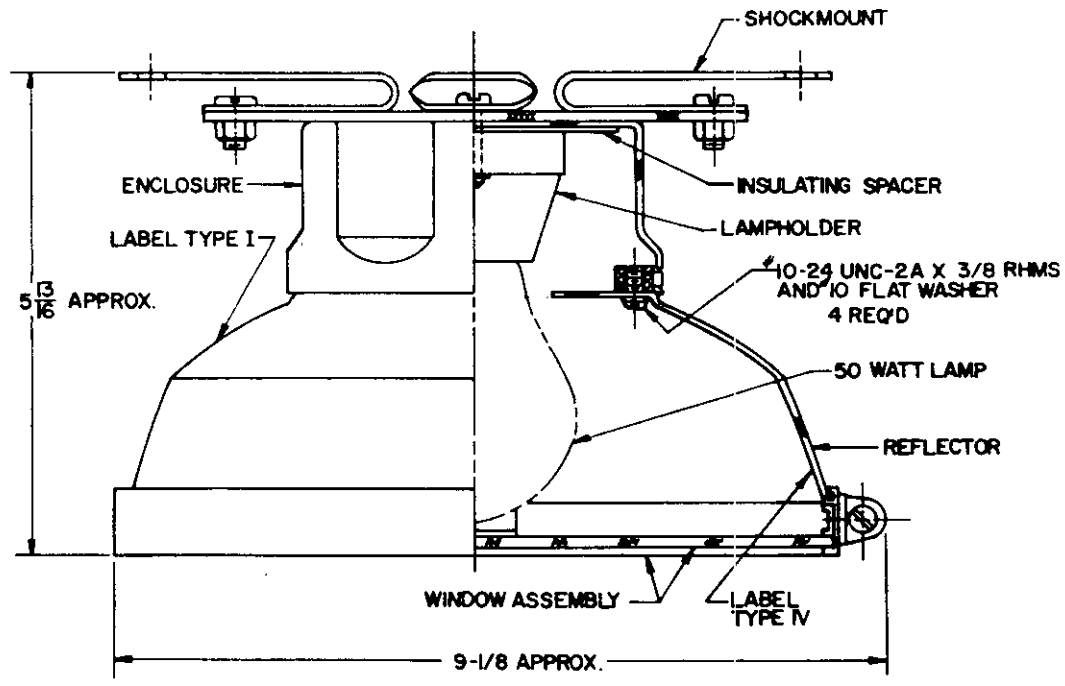

SH 8713 A

FIGURE 3. Fixture assembly, Symbol 65.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T08:43Z
Check the source to verify that this is the current version before use.


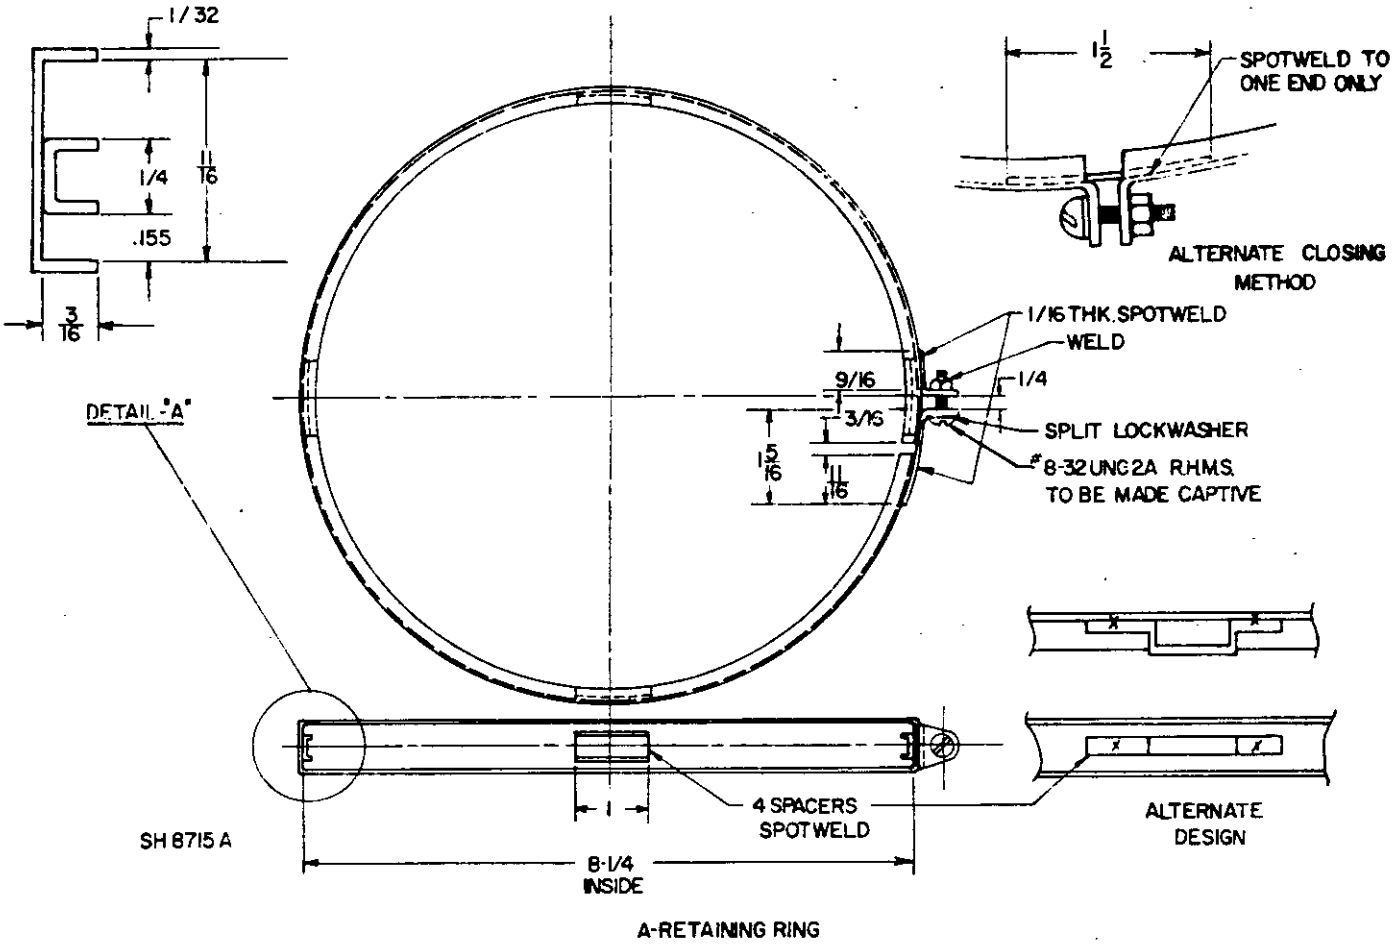



FIGURE 4. Window assembly.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T08:43Z
Check the source to verify that this is the current version before use.

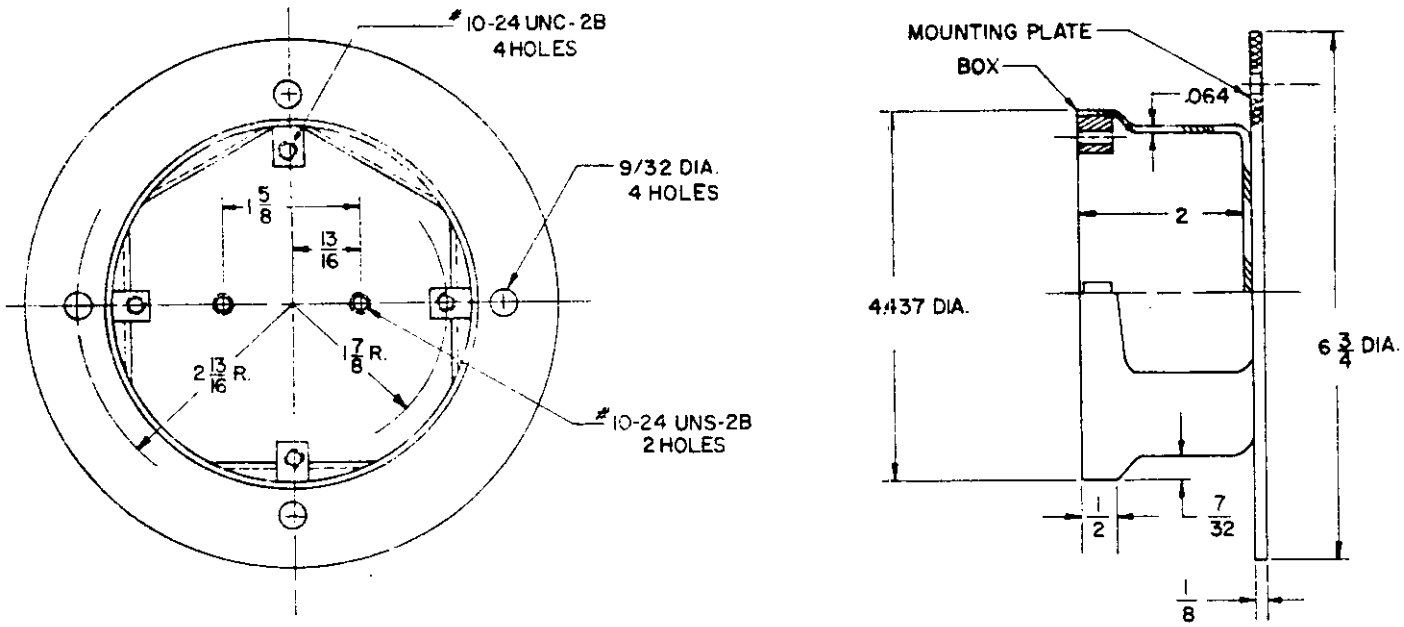

SH12026

FIGURE 5. Enclosure.

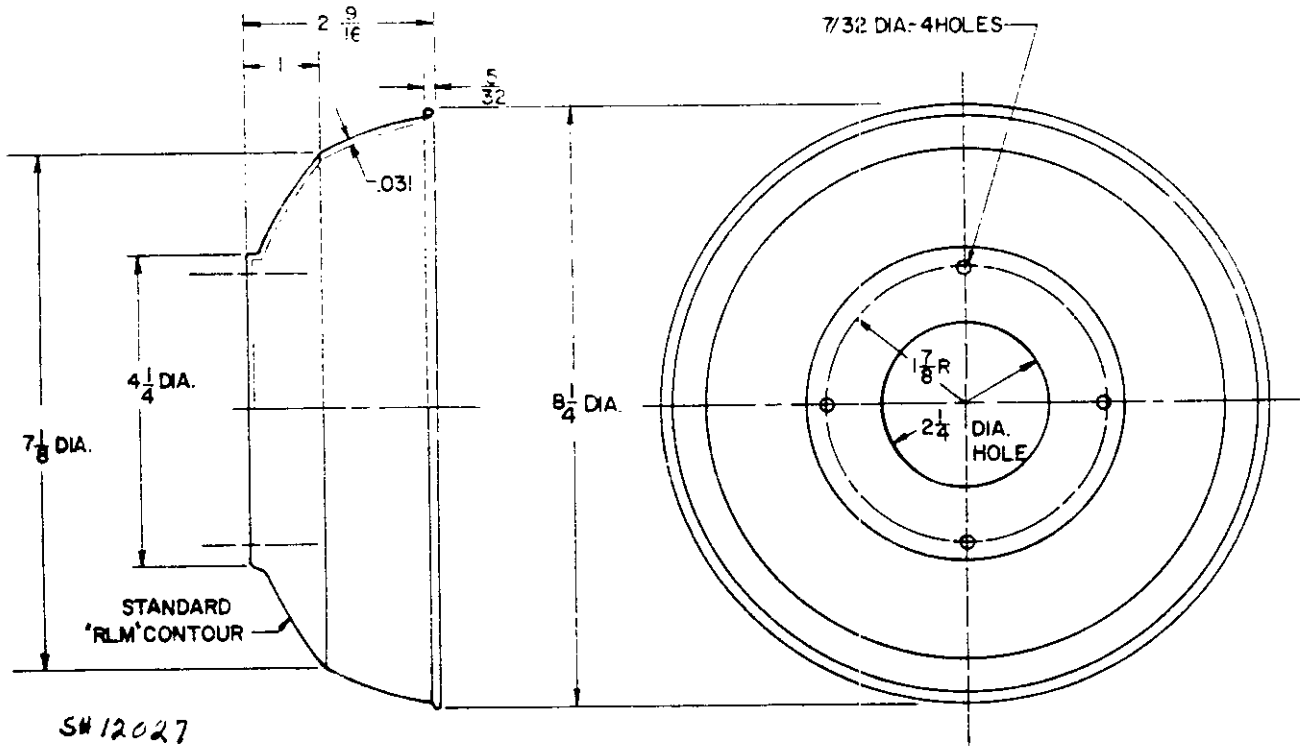

SH 12027

FIGURE 6. Reflector.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T08:43Z
Check the source to verify that this is the current version before use.


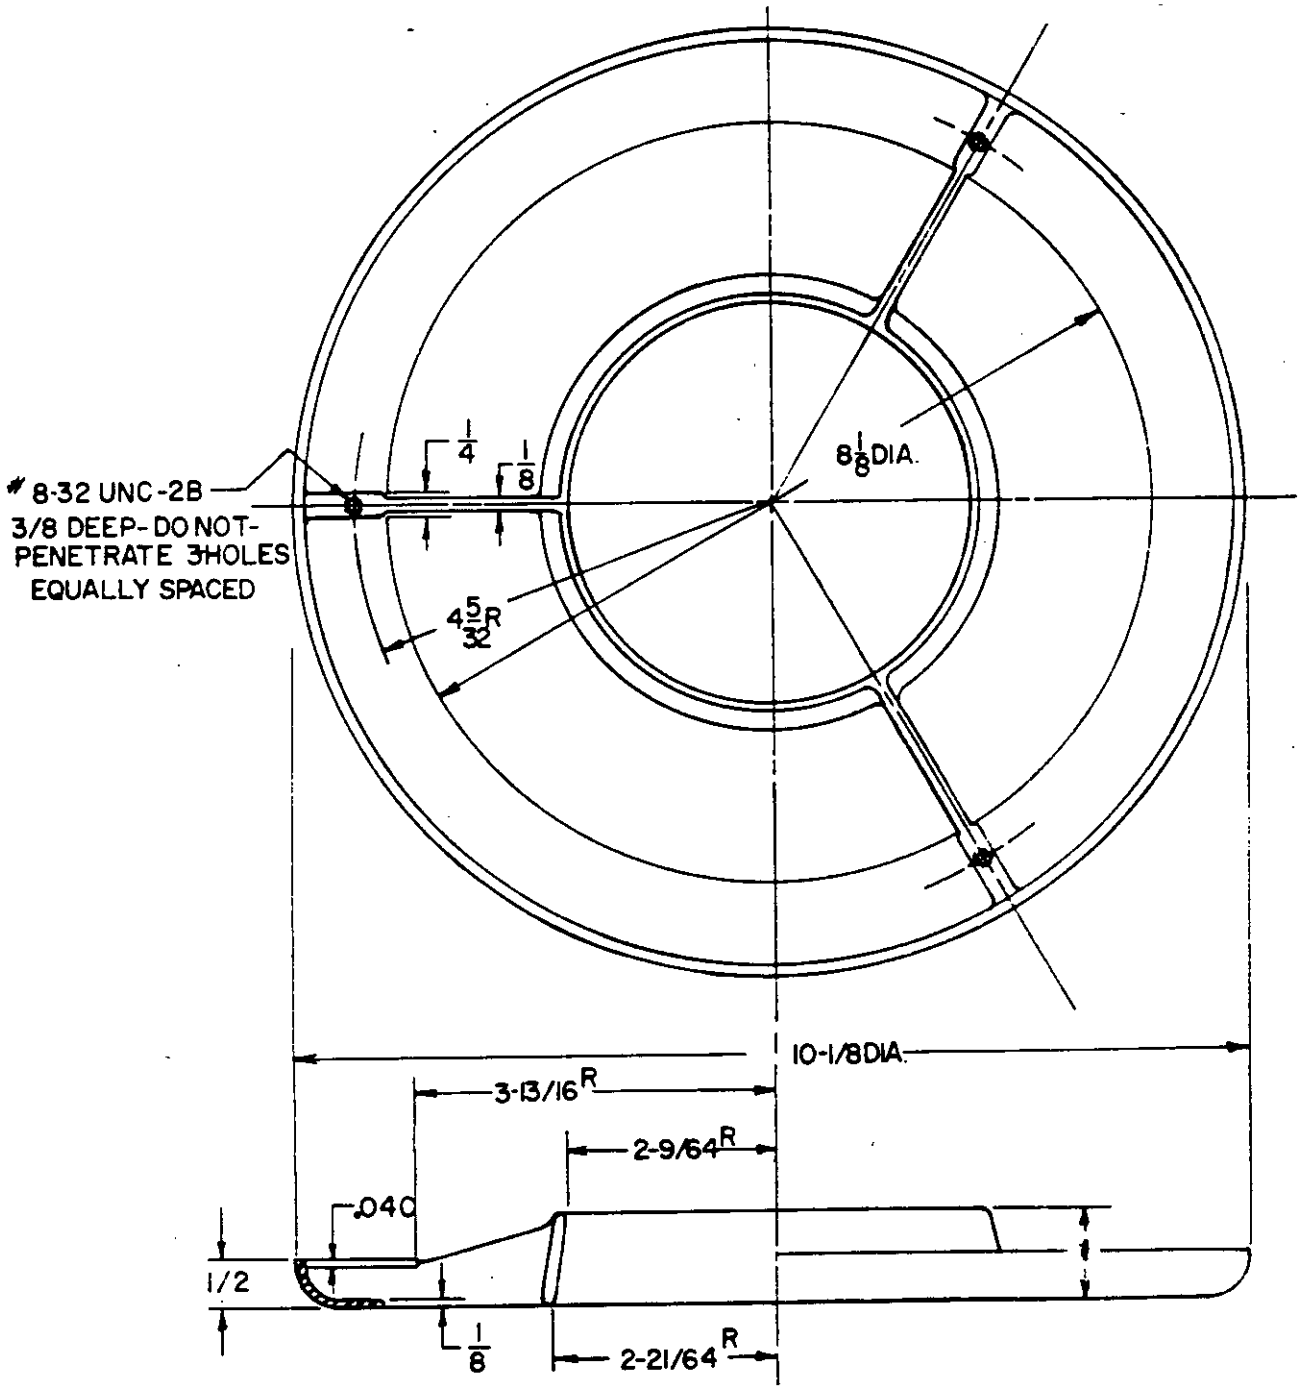


FIGURE 7. Baffle.


Source: https://assist.dla.mil -- Downloaded: 2026-10-18T08:43Z
Check the source to verify that this is the current version before use.

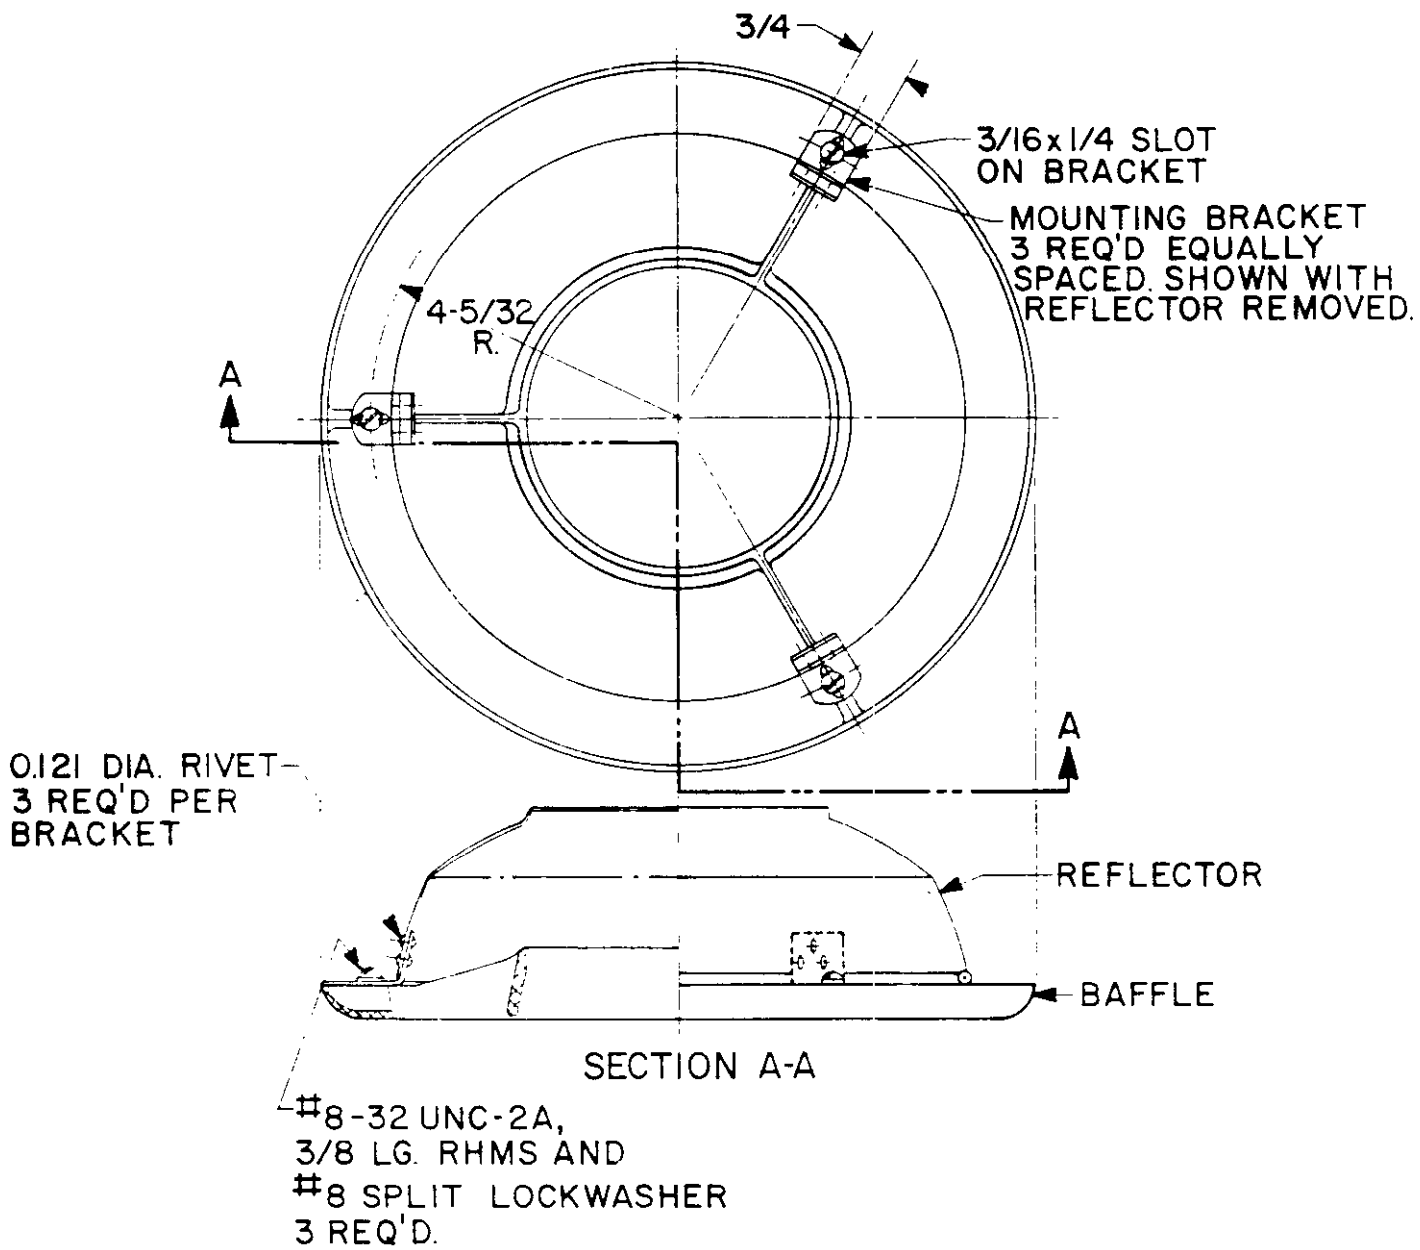

SH12029

FIGURE Reflector/baffle assembly.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T08:43Z
Check the source to verify that this is the current version before use.

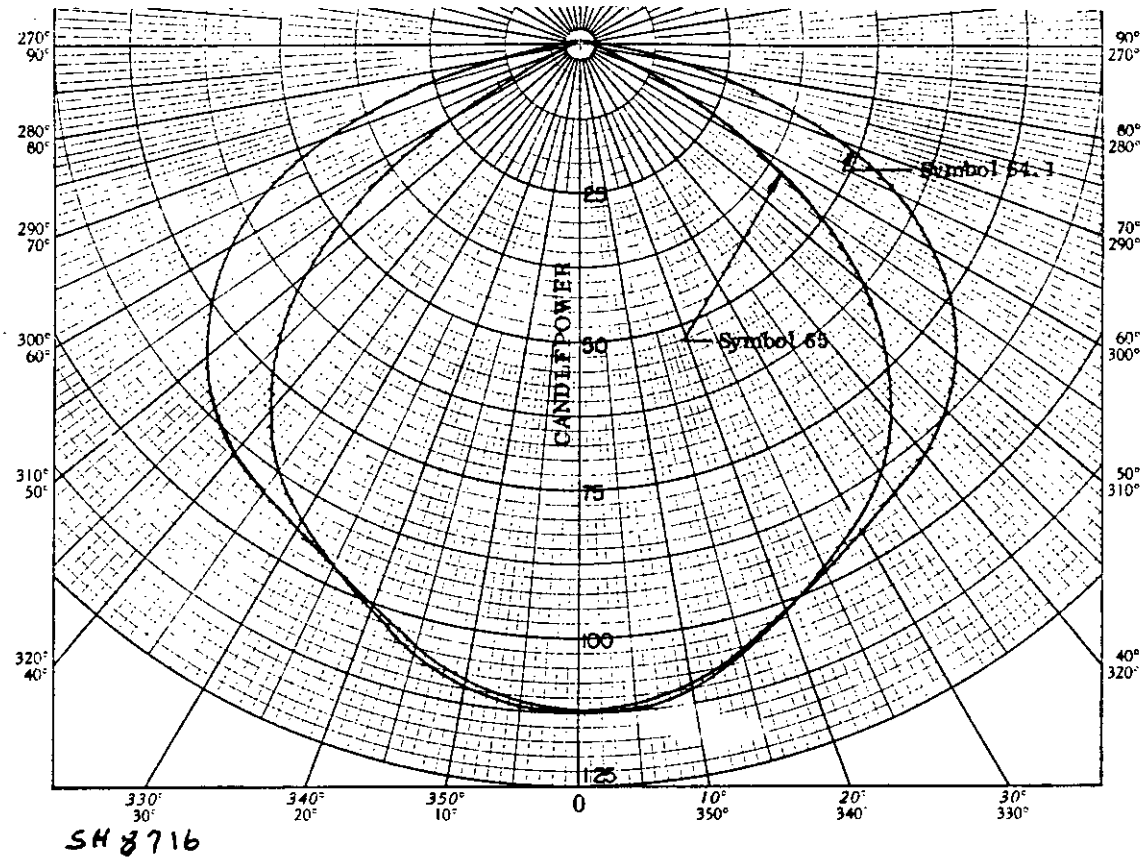

ANGLE	CANDLEPOWER	
	SYM 64.1	SYM 65
0	110	110
5	110	110
10	108	107
15	106	103
20	101	99
25	96	95
30	93	92
35	90	90
40	82	89
45	72	87

ANGLE	CANDLEPOWER	
	SYM 64.1	SYM 65
50	57	82
55	43	77
60	25	68
65	16	61
70	10	35
75	6	24
80	0	5
85	0	2
90	0	0
95	0	0

Photometric test data:

Distance: 10 feet.
Voltage: 120 volts.
Ambient temperature: 76°F.
Lamp: 50 watts, rough service conforming to MS15586-2, furnished by laboratory for test, shall be used.

FIGURE 9. Candlepower distribution curves.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T08:43Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

CLASSIFICATION:
Type: II
Class: 2

SYMBOL NUMBERS:
64.1: Complete lighting fixture assembly with reflector and baffle assembly.
65: Complete lighting fixture assembly with reflector and window assembly

DESIGN:
Electrical rating: 50 watts, 120 volts.
Dimensions and configurations: See figures 1 through 9.
Mounting dimensions: See figure 8 of MIL-F-16377.
Photometric data: See figure 9.
Enclosure assembly: Material for enclosure and reflector shall be aluminum.
Window assembly for Symbol 65 only: See figure 4. Material for lens shall be polycarbonate, clear with light transmittance exceeding 80 percent, and shall conform to the property values of L-P-393. A retainer ring as shown on figure 4 shall be provided for attaching the window to the reflector rim. All metal parts of the retainer ring shall be steel, zinc plated.
Lampholder: MIL-L-970/6, two contact.
Baffle assembly for Symbol 64.1 only: Aluminum, cast or fabricated.
Shockmounts: MIL-F-16377/41, Part Number M16377/41-003.
Enclosure: Dripproof.
Finish: All surfaces, except shockmounts and window assembly, shall receive a baked white enamel finish.
Weight:
Symbol 64.1: 2 pounds, 4 ounces max.
Symbol 65: 2 pounds, 0 ounces max.
Lamp: These fixures shall be designed to accommodate a 50-watt, 120-volt, A-19 bulb, inside frosted, medium screw base, rough service lamp conforming to W-L-101/80. (Lamp not furnished).
Designation and marking: The following labels shall be furnished in accordance with MIL-F-16377 applied as shown in figures 2 and 3:

a. One type I.
b. One type IV. Apply one type IV label (as shown on figures 2 and 3), with the following information in 3/16 inch letters: "USE LAMP - NSN6240-00-143-3070 ONLY."

QUALITY ASSURANCE: Quality assurance shall be as specified in MIL-F-17377 and as follows:

First article inspection	
Complete fixtures	See table I
Repair parts	See table II
Quality conformance:	
Conformance:	Same as the first article inspection
Inspection of product for delivery:	
Examination:	See MIL-F-16377
Examination for preparation of delivery:	See MIL-F-16377
Quality conformance tests:	See MIL-F-16377

GENERAL INFORMATION:

Assignment of Military part numbers and general information is shown in table III.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T08:43Z
Check the source to verify that this is the current version before use.

TABLE I. First article and comparison inspection for complete fixtures.

Tests	Requirement paragraph	Test paragraph	Remarks
Examination	3.13	4.5	
Shock	3.5.12	4.8.7	
Vibration	3.5.13	4.8.8	
Enclosure effectiveness	3.5.11	4.8.14.2	Dripproof
Continuity of grounding	3.6.13.4	4.8.12	
Optical uniformity	3.7.4.11	4.8.4	Sym 65 only
Light output	3.7.1	4.8.6.1	Candlepower
Magnetic permeability	3.4.8	4.8.18	

TABLE II. First article and comparison inspection for repair parts.

Tests	Requirement paragraph	Test paragraph	Remarks
Examination	3.13	4.5	
Optical uniformity	3.7.4.1.1	4.8.4	1/
Light output	3.7.3.7	4.8.6.3	1/ Luminous Transmittance

1/ For lens of window assembly only.

TABLE III. Part numbers and general information.

Military Part Number 1/ M16377/21-	Item Name	National Stock Number (NSN)	Remarks
64.1	Complete fixture, Symbol 64.1	6210-00-295-2881	Figure 2
65	Complete fixture, Symbol 65	6210-00-505-0115	Figure 3
001	Window assembly	6210-00-897-6976	Figure 4
002	Reflector	6210-00-295-2681	Figure 6
003	Reflector/baffle assembly	6210-00-399-6163	Figure 8

1/ Formerly covered on NAVSHIPS Drawing 9000-S6401-73971 and Military Standard MS17222.

Revision letters are not used to denote changes due to the extensiveness of the changes.

Preparing activity:
Navy - SH
(Project 6210-N366)

☆U.S. GOVERNMENT PRINTING OFFICE: 1982-505-022/1670

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T08:43Z
Check the source to verify that this is the current version before use.

TABLE I. First article and comparison inspection for complete fixtures.

Tests	Requirement paragraph	Test paragraph	Remarks
Examination	3.13	4.5	
Shock	3.5.12	4.8.7	
Vibration	3.5.13	4.8.8	
Enclosure effectiveness	3.5.11	4.8.14.2	Dripproof
Continuity of grounding	3.6.13.4	4.8.12	
Optical uniformity	3.7.4.11	4.8.4	Sym 65 only
Light output	3.7.1	4.8.6.1	Candlepower
Magnetic permeability	3.4.8	4.8.18	

TABLE II. First article and comparison inspection for repair parts.

Tests	Requirement paragraph	Test paragraph	Remarks
Examination	3.13	4.5	
Optical uniformity	3.7.4.1.1	4.8.4	1/
Light output	3.7.3.7	4.8.6.3	1/ Luminous Transmittance

1/ For lens of window assembly only.

TABLE III. Part numbers and general information.

Military Part Number 1/ M16377/21-	Item Name	National Stock Number (NSN)	Remarks
64.1	Complete fixture, Symbol 64.1	6210-00-295-2881	Figure 2
65	Complete fixture, Symbol 65	6210-00-505-0115	Figure 3
001	Window assembly	6210-00-897-6976	Figure 4
002	Reflector	6210-00-295-2681	Figure 6
003	Reflector/baffle assembly	6210-00-399-6163	Figure 8

1/ Formerly covered on NAVSHIPS Drawing 9000-S6401-73971 and Military Standard MS17222.

Revision letters are not used to denote changes due to the extensiveness of the changes.

Preparing activity:
Navy - SH
(Project 6210-N366)

☆U.S. GOVERNMENT PRINTING OFFICE: 1982-505-022/1670

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T08:43Z
Check the source to verify that this is the current version before use.