
INCH-POUND
MIL-PRF-19207/25F
17 July 2007
SUPERSEDING
MIL-PRF-19207/25E
22 June 1999

PERFORMANCE SPECIFICATION SHEET

FUSEHOLDERS, EXTRACTOR POST TYPE, NONINDICATING, NON-EMI/RFI SHIELDED AND EMI/RFI SHIELDED, TYPES FHN41W, FHN41WS, FHN41WB AND FHN41WBS

This specification is approved for use by all departments and agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and MIL-PRF-19207.

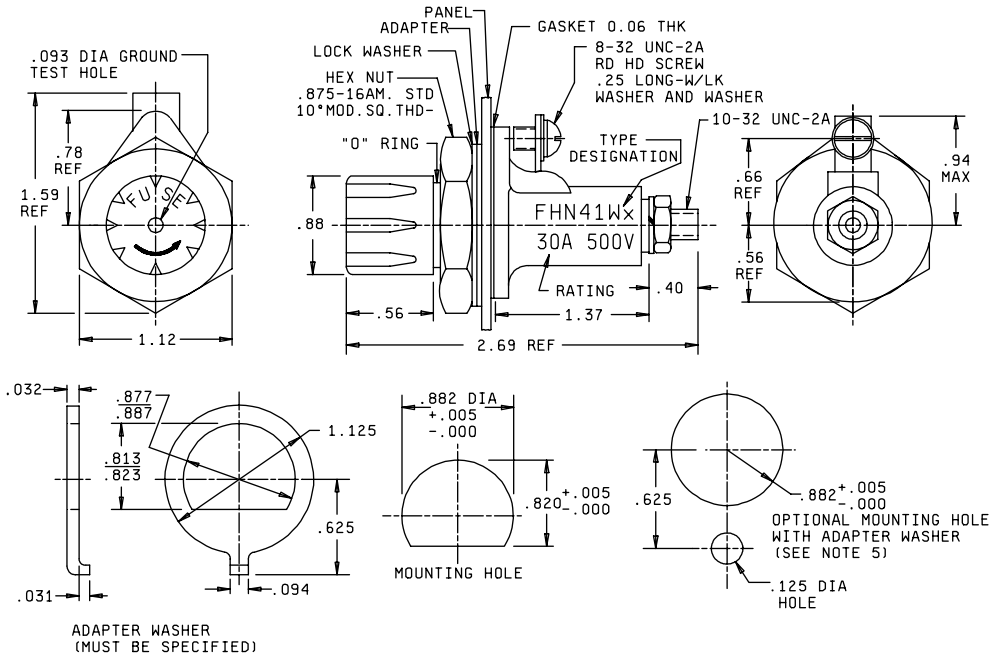

See notes on next page.

FIGURE 1. Type FHN41W and FHN41WB fuseholder.


Source: https://assist.dla.mil -- Downloaded: 2026-10-18T12:33Z
Check the source to verify that this is the current version before use.

Inches	mm	Inches	mm	Inches	mm	Inches	mm	Inches	mm
.005	0.13	.4	10.16	.820	20.83	.887	22.53	1.59	40.39
.031	0.79	.56	14.22	.823	20.90	.93	22.62	2.69	68.33
.032	0.81	.625	15.88	.875	22.23	.94	23.88		
.06	1.52	.66	16.76	.877	22.28	1.12	28.45		
.125	3.18	.78	19.81	.88	22.35	1.125	28.58		
.25	6.35	.813	20.65	.882	22.40	1.37	34.80		

NOTES:

1. Dimensions are in inches.
2. Metric equivalents are given for general information only.
3. Unless otherwise specified, tolerances are ±0.02. (0.51 mm) for two place decimals and ±0.005 (0.13 mm) for three place decimals.
4. Cap thread shall be 9/16-27 NEF2 thread with full provisions for cap interchangeability.
5. Round hole mounting for replacement only. Use adapter washer for non-watertight applications.
6. The location (on the fuseholder body) of the manufacturer's identification and electrical rating is optional.

FIGURE 1. Type FHN41W and FHN41WB fuseholder. - Continued.

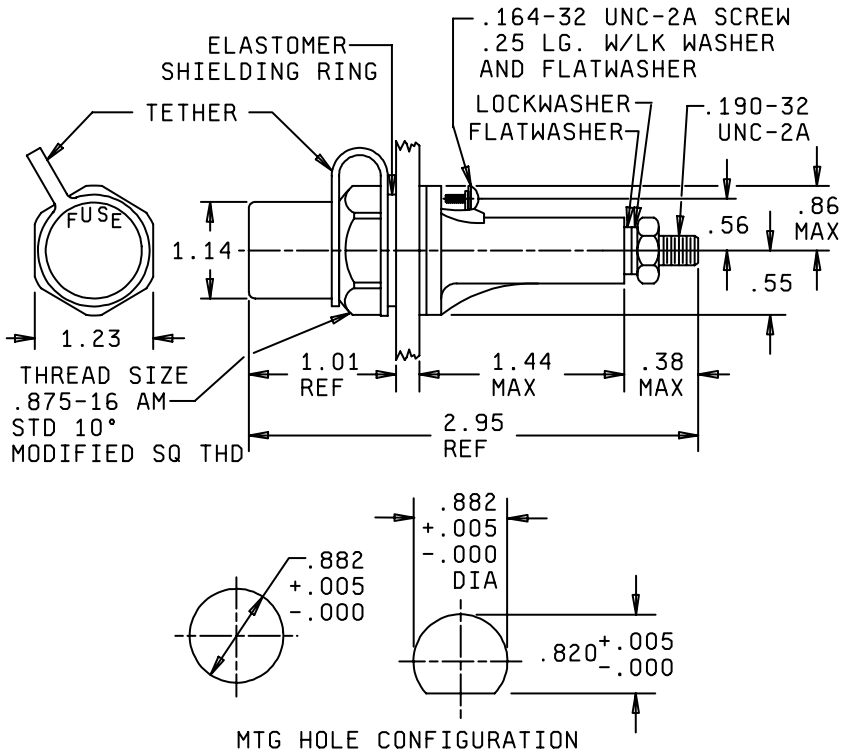

See notes on next page.

Inches	mm	Inches	mm	Inches	mm
.005	0.13	.56	14.22	1.14	28.96
.164	4.17	.820	20.83	1.23	31.24
.190	4.83	.86	21.84	1.44	36.58
.25	6.35	.875	22.23	1.64	41.66
.38	9.65	.882	22.40	2.95	74.93
.55	13.97	1.01	25.65		

FIGURE 2. Type FHN41WS and FHN41WBS fuseholder.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T12:33Z
Check the source to verify that this is the current version before use.

NOTES:

1. Dimensions are in inches.
2. Metric equivalents are given for general information only.
3. Unless otherwise specified, tolerances are ±0.02. (0.51 mm) for two place decimals and ±0.005 for three place decimals.
4. Cap thread shall be 9/16-27 NEF2 thread with full provisions for cap interchangeability.
5. Round hole mounting for replacement only. Use adapter washer for non-watertight applications.
6. The location (on the fuseholder body) of the manufacturer's identification and electrical rating is optional.

FIGURE 2. Type FHN41WS and FHN41WBS fuseholder. - Continued.

REQUIREMENTS:

Interface and physical dimensions: See figure 1

Body material: Body material shall be selected to enable the fuseholder to meet the performance requirements of this specification. Additional information and guidance on body molding material is specified in the notes.

Fuse accommodation:

Ferrule type:

Size: 0.406 inch (10.31 mm) diameter, 1.500 inches (38.10 mm) length

Styles: F07: MIL-PRF-15160/7, F09: MIL-PRF-15160/9, F60: MIL-PRF-15160/60.

Poles: One

Rating: 30 amperes, 500 volts maximum

Panel thickness: 0.125 inch (3.18 mm) maximum

Nonindicating:

Lamp series indicator: None

Terminals: Threaded stud and screw type.

Enclosure: Watertight (FHN41W), watertight with EMI/RFI shielding (FHN41WS), watertight and body sealed (FHN41WB) (for submarine applications use FHN41WB) or watertight and body sealed with EMI/RFI shielding (FHN41WBS).

Test fuses:

Temperature rise: F60C500V30A of MIL-PRF-15160/60.

Voltage drop: F60C500V30A of MIL-PRF-15160/60.

Short circuit: F60C500V30A of MIL-PRF-15160/60.

Mechanical shock: Method I of MIL-PRF-19207.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T12:33Z
Check the source to verify that this is the current version before use.

Terminal strength: 20 pounds.

Torque: Terminal - 25 inch- pounds.

Mounting - 15-20 inch- pounds.

Cap insert - 30 inch-pounds.

Salt spray (corrosion): Test condition B.

Dielectric:

Sea level: 2,000 volts

Reduced pressure: 750 volts

EMI/RFI shielding: Paragraph 3.5.18 of MIL-PRF-19207.

Type designation: Watertight (FHN41W), watertight with EMI/RFI shielding (FHN41WS), watertight and body sealed (FHN41WB) or watertight and body sealed with EMI/RFI shielding (FHN41WBS).

TABLE I Supersession information.

Superseding type designation number	Superseded MIL dash number
FHN41W	M19207/25-001
FHN41WS	N/A
FHN41WB	M19207/25-002
FHN41WBS	N/A

NOTES:

1. Body molding material: It is recommended that type MAI-60 or GDI-30F of American Society For Testing and Materials ASTM-D5948 be considered for meeting the body molding material requirements of this specification.

2. For submarine applications use FHN41WB or FHN41WBS.

3. EMI/RFI shielded type fuseholders are equivalent to the non-shielded type fuseholders with the addition of EMI/RFI shielding cap and mounting nut assembly.

4. To assure maximum shielding effectiveness mounting nut must be torqued to 15-20 inch-pounds over an electrically conductive panel surface, 1.26 inch minimum diameter.

Referenced documents. In addition to MIL-PRF-19207, this document references the following:

MIL-PRF-15160/7 MIL-PRF-15160/9 MIL-PRF-15160/60 ASTM-D5948

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T12:33Z
Check the source to verify that this is the current version before use.

The margins of this specification are marked with vertical lines to indicate where changes from the previous issue were made. This was done as a convenience only and the Government assumes no liability whatsoever for any inaccuracies in these notations. Bidders and contractors are cautioned to evaluate the requirements of this document based on the entire content irrespective of the marginal notations and relationship to the last previous issue.

Custodians:
Army - CR
Navy - SH
Air Force - 11
DLA - CC

Preparing activity:
DLA - CC

(Project 5920-2006-045)

Review activities:
Army - AT, CR4, MI
Navy - EC, OS
Air Force - 70, 71, 99

NOTE: the activities listed above were interested in this document as of the date of this document. Since organizations and responsibilities can change, you should verify the currency of the information above using the ASSIST Online database at http://assist.daps.dla.mil.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T12:33Z
Check the source to verify that this is the current version before use.