COMMERCIAL ITEM DESCRIPTION

FUSE CARTRIDGE, SEMICONDUCTOR TYPE, 500 VOLTS

The General Services Administration has authorized the use of this commercial item description (CID) for all federal agencies

1. SCOPE. This CID covers the general requirements for 500 volt semiconductor fuse cartridges. Fuse cartridges covered by this CID are intended for commercial/industrial applications.

2 CLASSIFICATION. This CID uses a classification system which is included in the Part or Identification Number (PIN) as shown in the following example (see 6.1).

AA55495 - 012

AA55495: CID number
012: Dash number (see table I)

3 SALIENT CHARACTERISTICS

3 1 Design and construction. Fuse cartridges supplied to this CID shall be as specified herein (see figure 1).

3.2 Ampere rating. The ampere rating shall be as specified in table I.

3.3 Voltage rating The voltage rating shall be 500 V ac maximum

3 4 Short circuit interrupt rating The short circuit interrupt rating shall be 200,000 amperes RMS at symmetrical.


3.5 Maximum current clearing I^2t. The maximum current clearing I^2t shall be as specified in table I.

3.6 Marking. Fuse cartridges supplied to this CID shall be marked with the manufacturer's standard commercial PIN.

Beneficial comments, recommendations, additions, deletions, clarifications, etc., and any data which may improve this document should be sent to: Defense Electronics Supply Center, ATTN DESC-ELDM, 1507 Wilmington Pike, Dayton, OH 45444-5765, or telephone (513) 296-6189, or facsimile (FAX) (513) 296-8868

DISTRIBUTION STATEMENT A Approved for public release, distribution is unlimited

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.

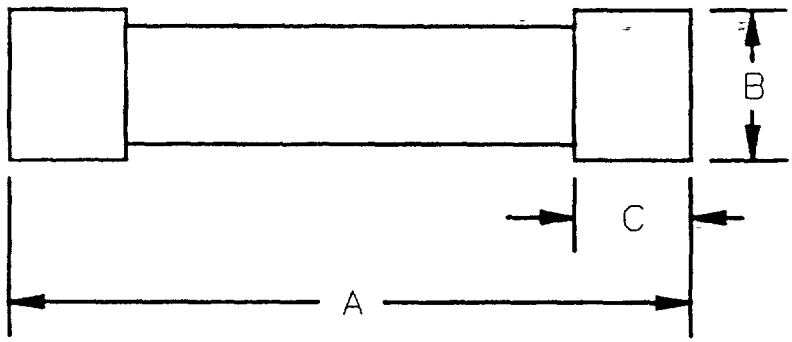


AA55495-	Dimensions		
	A	B	C
001 through 006	50.80 (2.0)	14.29 (.563)	12 70 (.500)

Configuration I

NOTES
1. Dimensions are in millimeters.
2. Tolerance is ± 0.13 mm (0 005 inch), unless otherwise specified.
3 The US government preferred system of measurement is the metric SI system. However, this item was originally designed using inch-pound units of measurement. In the event of conflict between the metric and inch-pound units, the inch-pound units shall take precedence.

Figure 1. Configuration and dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.

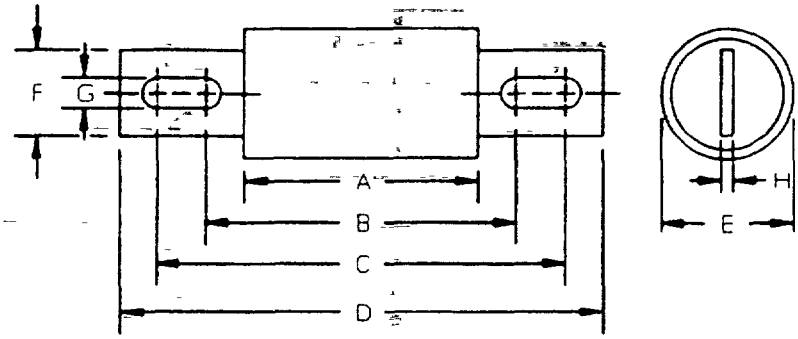

AA55495-	Dimensions							
	A	B	C	D	E	F	G	H
007 through 011	41.41 (1.630) 39.55 (1.557)	57 18 (2.251)	66.03 (2.600) 63 37 (2.495)	80.98 (3.188)	20.65 (.813)	19.18 (.755) 15 77 (621)	8 72 (.343)	3.19 (.126)
012 through 014	53.95 (2.124)	71.96 (2.833) 68.17 (2.684)	77.13 (3 037) 74.48 (2 932)	92.09 (3.626)	25.40 (1.0)	19 08 (.751)	8 83 (.348) 7.81 (.307)	3.19 (.126)
015 through 017	54.13 (2.131) 53.07 (2.089)	71.96 (2.833) 69.72 (2.745)	74.52 (2.934)	92.09 (3.626)	30.98 (1.220)	25.53 (1.005) 18.92 (.745)	8.83 (.348) 7.77 (.306)	4.78 (.188)
018 through 021	53.19 (2.094)	70.77 (2.786) 70.47 (2.774)	87.43 (3.442)	110.32 (4.343)	38.10 (1.5)	25.40 (1.0)	10.31 (.406)	6 38 (.251)
022 through 023	56.53 (2.226) 53.07 (2.089)	77.12 (3.036) 70 47 (2.774)	89.70 (3.531)	113.64 (4.474) 110.17 (4.337)	50.80 (2.0)	38 10 (1.5)	10.31 (.406)	6.38 (.251)
024	56 53 (2.226) 53.07 (2.089)	109.73 (4.320) 87.17 (3.432)	126.33 (4.974) 117.35 (4.620)	164.44 (6.474) 160.97 (6 337)	63.50 (2.5)	50.80 (2.0)	13.50 (.531)	9.52 (.375)

Configuration II

NOTES.
1. Dimensions are in millimeters.
2. Tolerance is ± 0.13 mm (0.005 inch), unless otherwise specified.
3. The US government preferred system of measurement is the metric SI system. However, this item was originally designed using inch-pound units of measurement. In the event of conflict between the metric and inch-pound units, the inch-pound units shall take precedence.

Figure 2 Configuration and dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.

TABLE I Electrical characteristics

AA55495-	Ampere rating	I^2t (A^2s)	AA55495-	Ampere rating	I^2t (A^2s)
001	5	100	013	80	5,000
002	10	200	014	100	7,500
003	15	250	015	125	10,600
004	20	300	016	150	16,000
005	25	350	017	200	28,000
006	30	400	018	250	50,000
007	35	2,000	019	300	60,000
008	40	2,250	020	350	80,000
009	45	2,500	021	400	120,000
010	50	2,750	022	500	190,000
011	60	3,000	023	600	300,000
012	70	4,000	024	800	600,000

4 QUALITY ASSURANCE PROVISIONS

4 1 Contractor certification. The contractor shall certify and maintain substantiating evidence that the product offered meets the salient characteristics of this CID, and that the product conforms to the producer's own drawings, specifications, standards, and quality assurance practices, and is the same product offered for sale in the commercial marketplace. The Government reserves the right to require proof of such conformance prior to first delivery and thereafter as may be otherwise provided for under the provisions of the contract.

4.2 Certificate of compliance. Each contractor desiring to be listed as a suggested source of supply shall submit a DESC certificate of compliance to DESC-ELDM. This certificate shall state that the contractor's product meets all the requirements of this CID. In addition, a certificate of compliance shall accompany all fuse cartridges supplied to this CID.

4.3 Market acceptability The following market acceptability criteria are necessary to document the quality of the product to be provided under this CID.

a The company producing the item must have been producing a product meeting the requirements of this CID for at least 2 years.

b The company must have sold 1,000 units meeting this CID in the commercial market place over the past 2 years.

5. PACKAGING

5 1 Preservation, packing, and marking. Preservation, packing, and marking shall be as specified in the contract or order.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.

6 NOTES

6.1 PIN The PIN should be used for Government purposes to buy commercial products to this CID See section 2 for PIN format example.

6 2 Government users. To acquire information on obtaining these semiconductor fuses from the Government inventory system, please contact Defense Electronics Supply Center, ATTN DESC-EOM, 1507 Wilmington Pike, Dayton, OH 45444-5270, or telephone (513) 296-5106.

6.3 Ordering data The contract or order should specify the following.

a CID document number, revision, and CID PIN.

b Quality assurance provisions.

c. If a bid sample is required.

d Packaging requirements

6 4 Suggested sources of supply. Suggested sources of supply are listed below Additional sources will be added as they become available. The vendors listed have submitted a certificate of compliance to DESC-ELDM and meet the market acceptability requirements of this CID.

CID dash number (see table I) AA55495-	Vendor commercial PIN CAGE 12092	Vendor commercial PIN CAGE 71424	Vendor commercial PIN CAGE 71400	Vendor commercial PIN CAGE 75915
001	A050F005	---	FWH 5A	---
002	A050F010	A50P10-1	FWH 10A	L50S10
003	A050F015	A50P15-1	FWH 15A	L50S15
004	A050F020	A50P20-1	FWH 20A	L50S20
005	A050F025	A50P25-1	FWH 25A	L50S25
006	A050F030	A50P30-1	FWH 30A	L50S30
007	A050F035	A50P35-4	FWH 35A	L50S35
008	A050F040	A50P40-4	FWH 40A	L50S40
009	A050F045	A50P45-4	FWH 45A	L50S45
010	A050F050	A50P50-4	FWH 50A	L50S50
011	A050F060	A50P60-4	FWH 60A	L50S60
012	A050F070	A50P70-4	FWH 70A	L50S70
013	A050F080	A50P80-4	FWH 80A	L50S80
014	A050F100	A50P100-4	FWH 100A	L50S100
015	A050F125	A50P125-4	FWH 125A	L50S125
016	A050F150	A50P150-4	FWH 150A	L50S150
017	A050F200	A50P200-4	FWH 200A	L50S200
018	A050F250	A50P250-4	FWH 250A	L50S250
019	A050F300	A50P300-4	FWH 300A	L50S300
020	A050F350	A50P350-4	FWH 350A	L50S350
021	A050F400	A50P400-4	FWH 400A	L50S400
022	A050F500	A50P500-4	FWH 500A	L50S500
023	A050F600	A50P600-4	FWH 600A	L50S600
024	A050F800	A50P800-4	FWH 800A	L50S800

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.

Vendor CAGE number	Vendor name and address
12092	Carbone Lorraine, Incorporated 14 Eastmans Road Parsippany, NJ 07054-3703 (201) 428-8400
71424	Gould Shawmut , Incorporated 374 Merrimac Road Newburyport, MA 01950-1930 (508) 462-6662
71400	Bussmann P.O. Box 14460 St Louis, MO 63178-4460 (314) 394-2877
75915	Littelfuse, Incorporated 800 E. Northwest Highway Des Plaines, IL 60016-3096 (312) 824-1188

CIVIL AGENCY COORDINATING ACTIVITY.

GSA - 7FXE

PREPARING ACTIVITY

DLA-ES

Project 5920-D217

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.