
COMMERCIAL ITEM DESCRIPTION

FUSE LINK, ELECTRICAL, TYPE K (FAST)

The General Services Administration has authorized the use of this commercial item description (CID).

Abstract. This CID covers the general requirements for a type K (fast) fuse link. Fuse links covered by this CID are intended for commercial/industrial applications.

Part or Identifying Number (PIN). The PIN for the CID shall be as shown in the following example:

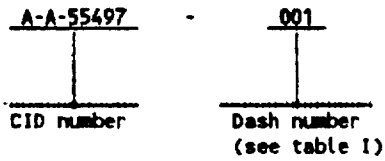

Salient characteristics.

Design and construction. Fuse links supplied to this CID shall be as specified herein and shall meet the requirements of ANSI C37.42 for type K (fast) fuse links and as specified on figure 1.

Ampere rating. The ampere rating shall be as specified in table I.

Voltage rating. The voltage rating shall be 27 kilovolts ac maximum.

Melting-time-current characteristics. The melting-time-current characteristics shall be in accordance with ANSI C37.42 for type K fuse links.


Minimum overall length. The minimum overall length shall be as specified in table I.

Marking. Fuse links supplied to this CID shall be marked with the manufacturer's standard commercial PIN.

Regulatory requirements. This section is not applicable to this CID.

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.

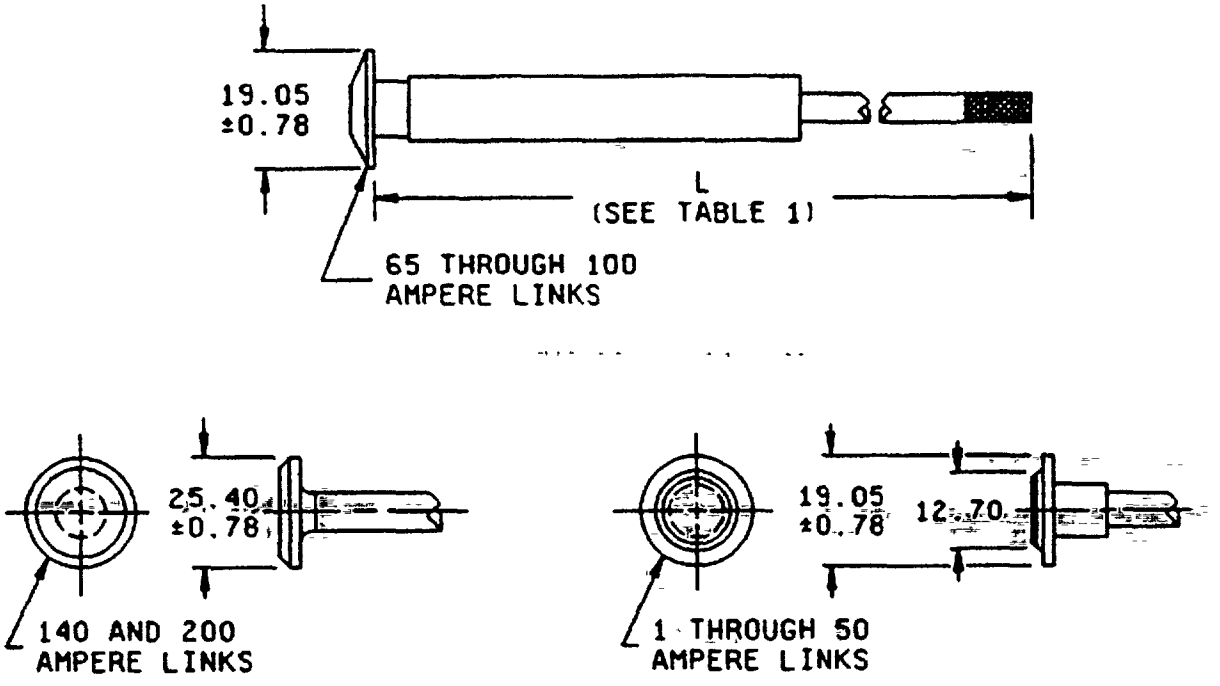

mm	Inches
0.78	.030
12.70	.500
19.05	.750
25.40	1.000

NOTES:
1. Dimensions are in millimeters.
2. Tolerance is ± 0.13 mm (.005 inch).
3. The US government preferred system of measurement is the metric SI system. However, this item was originally designed using inch-pound units of measurement. In the event of conflict between the metric and inch-pound units, the inch-pound units shall take precedence.

Figure 1 Configuration and dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.

TABLE I. Characteristics.

A-A-55497-	Ampere rating	Minimum overall length L mm (inches)	A-A-55497-	Ampere rating	Minimum overall length L mm (inches)
001	1	584.20 (23)	019	1	660.40 (26)
002	2	584.20 (23)	020	2	660.40 (26)
003	3	584.20 (23)	021	3	660.40 (26)
004	6	584.20 (23)	022	6	660.40 (26)
005	8	584.20 (23)	023	8	660.40 (26)
006	10	584.20 (23)	024	10	660.40 (26)
007	12	584.20 (23)	025	12	660.40 (26)
008	15	584.20 (23)	026	15	660.40 (26)
009	20	584.20 (23)	027	20	660.40 (26)
010	25	584.20 (23)	028	25	660.40 (26)
011	30	548.20 (23)	029	30	660.40 (26)
012	40	584.20 (23)	030	40	660.40 (26)
013	50	584.20 (23)	031	50	660.40 (26)
014	65	584.20 (23)	032	65	660.40 (26)
015	80	584.20 (23)	033	80	660.40 (26)
016	100	584.20 (23)	034	100	660.40 (26)
017	140	584.20 (23)	035	140	660.40 (26)
018	200	584.20 (23)	036	200	660.40 (26)

Quality assurance provisions.

Responsibility for inspection. Unless otherwise specified in the contract or purchase order, the contractor is responsible for the performance of all inspection, examination, and test requirements specified herein. Except as otherwise specified in the contract or purchase order, the contractor may use his own or any other facilities suitable for the inspection requirements specified herein, unless disapproved by the Government. The Government reserves the right to perform any of the inspections, examinations, or tests set forth in this description where such inspections, examinations, and tests are deemed necessary to assure supplies and services conform to prescribed requirements.

Contractor certification statement. The contractor shall certify and maintain objective quality evidence that the product offered meets the requirements of this CID, and that the product conforms to the producer's own drawings, specifications, standards, quality assurances practices, and is the same as the product provided as a bid sample. The Government reserves the right to require proof of such conformance prior to the first delivery and thereafter as may be otherwise provided for under the provisions of the contract.

Certificate of compliance. A certificate of compliance shall accompany all fuse links supplied to this CID. The letter of certification shall state that the fuse link meets all the requirements of ANSI C37.42, and all requirements of this CID.

Packaging.

Preservation, packaging, packing, labeling, and marking. Preservation, packaging, packing, labeling, and marking shall be as specified in the contract or purchase order.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.

Referenced documents. The following documents, of the issue in effect on date of invitation for bids for request for proposal, form a part of this CID to the extent specified herein.

Other Publication

AMERICAN NATIONAL STANDARDS INSTITUTE (ANSI)

ANSI C37.42 - Distribution Cutouts and Fuse Links - Specifications.

(Applications for copies should be addressed to the American National Standards Institute, 11 West 42nd Street, New York, NY 10036-8002).

Notes. This section contains relevant information which is useful to buyers, users, and suppliers in the process of acquiring the item, but is not mandatory.

Ordering data. The contract or purchase order shall specify the following:

a. CID document number and revision and CID PIN.

b. Quality assurance provisions.

c. Packaging requirements.

Comments. Comments on this CID should be directed to Defense Electronics Supply Center, ATTN: DESC-ELDM, 1507 Wilmington Pike, Dayton, OH 45444-5765, or telephone (513) 296-6189, or facsimile (FAX) (513) 296-8868.

Suggested sources of supply. Suggested sources of supply are listed herein. Additional sources will be added as they become available.

CID dash number (see table I) A-A-55497-	Vendor commercial PIN CAGE 32841	Vendor commercial PIN CAGE 71400	Vendor commercial PIN CAGE 75569
001	31001	---	CM1K23
002	31002	---	CM2K23
003	31003	---	CM3K23
004	31006	---	CM6K23
005	31008	FL12K8	CM8K23
006	31010	FL12K10	CM10K23
007	31012	FL12K12	CM12K23
008	31015	FL12K15	CM15K23
009	31020	FL12K20	CM20K23
010	31025	FL12K25	CM25K23
011	31030	FL12K30	CM30K23
012	31040	FL12K40	CM40K23
013	31050	FL12K50	CM50K23
014	31065	FL12K65	CM65K23
015	31080	FL12K80	CM80K23
016	31100	FL12K100	CM100K23

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.

CID dash number (see table I) A-A-55497-	Vendor commercial PIN CAGE 32841	Vendor commercial PIN CAGE 71400	Vendor commercial PIN CAGE 73569
017	31140	---	CM140K23
018	31200	---	CM200K23
019	31001-29	---	CM1K26
020	31002-29	---	CM2K26
021	31003-29	---	CM3K26
022	31006-29	---	CM6K26
023	31008-29	---	CM8K26
024	31010-29	---	CM10K26
025	31012-29	---	CM12K26
026	31015-29	---	CM15K26
027	31020-29	---	CM20K26
028	31025-29	---	CM25K26
029	31030-29	---	CM30K26
030	31040-29	---	CM40K26
031	31050-29	---	CM50K26
032	31065-29	---	CM65K26
033	31080-29	---	CM80K26
034	31100-29	---	CM100K26
035	311040-29	---	CM140K26
036	31200-29	---	CM200K26

Vendor CAGE number	Vendor name and address
32841	Kearney Division of Kearney National, Incorporated 1928 Montreal Road Tucker, GA 30084-5201 (404) 939-6011
71400	Bussmann P.O. Box 14460 St. Louis, MO 63178-4460 (314) 527-1253
73569	A.B. Chance Company 210 N. Allen Street Centralia, MO 65240-1395 (314) 682-8502

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.

CIVIL AGENCY COORDINATING ACTIVITY:

GSA - 7FXE

PREPARING ACTIVITY:

DLA-ES

Project 5920-0220

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.