
COMMERCIAL ITEM DESCRIPTION

FUSE LINK, ELECTRICAL, TYPE T (SLOW)

The General Services Administration has authorized the use of this commercial item description (CID).

Abstract. This CID covers the general requirements for a type T (slow) fuse link. Fuse links covered by this CID are intended for commercial/industrial applications.

Part or Identifying Number (PIN). The PIN for the CID shall be as shown in the following example:

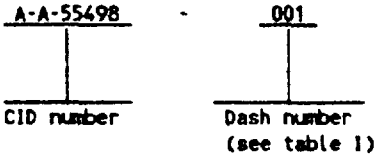

Salient characteristics.

Design and construction. Fuse links supplied to this CID shall be as specified herein and shall meet the requirements of ANSI C37.42 for type T (slow) fuse links and as specified on figure 1.

Ampere rating. The ampere rating shall be as specified in table I.

Voltage rating. The voltage rating shall be 27 kilovolts ac maximum.

Melting-time-current characteristics. The melting-time-current characteristics shall be in accordance with ANSI C37.42 for type T fuse links.


Minimum overall length. The minimum overall length shall be as specified in table I.

Marking. Fuse links supplied to this CID shall be marked with the manufacturer's standard commercial PIN.

Regulatory requirements. This section is not applicable to this CID.

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.

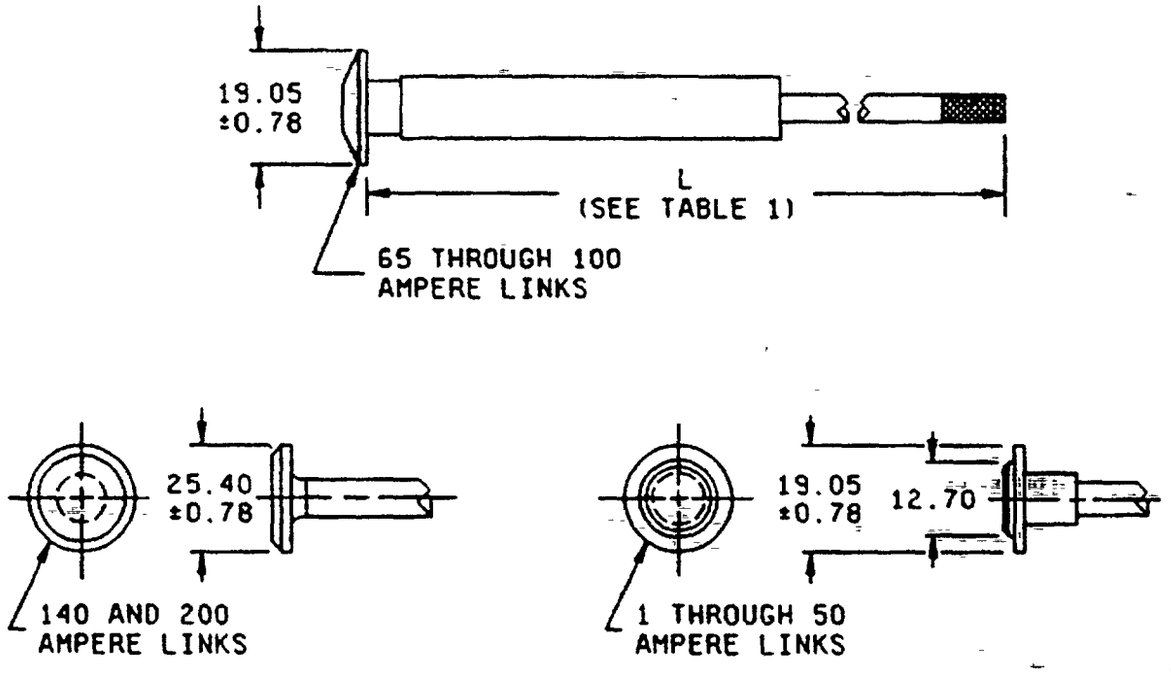

mm	Inches
0.78	.030
12.70	.500
19.05	.750
25.40	1.000

NOTES:
1. Dimensions are in millimeters.
2. Tolerance is ± 0.13 mm (.005 inch).
3. The US government preferred system of measurement is the metric SI system. However, this item was originally designed using inch-pound units of measurement. In the event of conflict between the metric and inch-pound units, the inch-pound units shall take precedence.

Figure 1. Configuration and dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.

TABLE I. Characteristics.

A-A-55498-	Ampere rating	Minimum overall length L mm (inches)	A-A-55498-	Ampere rating	Minimum overall length L mm (inches)
001	1	584.20 (23)	019	1	660.40 (26)
002	2	584.20 (23)	020	2	660.40 (26)
003	3	584.20 (23)	021	3	660.40 (26)
004	6	584.20 (23)	022	6	660.40 (26)
005	8	584.20 (23)	023	8	660.40 (26)
006	10	584.20 (23)	024	10	660.40 (26)
007	12	584.20 (23)	025	12	660.40 (26)
008	15	584.20 (23)	026	15	660.40 (26)
009	20	584.20 (23)	027	20	660.40 (26)
010	25	584.20 (23)	028	25	660.40 (26)
011	30	548.20 (23)	029	30	660.40 (26)
012	40	584.20 (23)	030	40	660.40 (26)
013	50	584.20 (23)	031	50	660.40 (26)
014	65	584.20 (23)	032	65	660.40 (26)
015	80	584.20 (23)	033	80	660.40 (26)
016	100	584.20 (23)	034	100	660.40 (26)
017	140	584.20 (23)	035	140	660.40 (26)
018	200	584.20 (23)	036	200	660.40 (26)

Quality assurance provisions.

Responsibility for inspection. Unless otherwise specified in the contract or purchase order, the contractor is responsible for the performance of all inspection, examination, and test requirements specified herein. Except as otherwise specified in the contract or purchase order, the contractor may use his own or any other facilities suitable for the inspection requirements specified herein, unless disapproved by the Government. The Government reserves the right to perform any of the inspections, examinations, or tests set forth in this description where such inspections, examinations, and tests are deemed necessary to assure supplies and services conform to prescribed requirements.

Contractor certification statement. The contractor shall certify and maintain objective quality evidence that the product offered meets the requirements of this CID, and that the product conforms to the producer's own drawings, specifications, standards, quality assurances practices, and is the same as the product provided as a bid sample. The Government reserves the right to require proof of such conformance prior to the first delivery and thereafter as may be otherwise provided for under the provisions of the contract.

Certificate of compliance. A certificate of compliance shall accompany all fuse links supplied to this CID. The letter of certification shall state that the fuse link meets all the requirements of ANSI C37.42, and all requirements of this CID.

Packaging.

Preservation, packaging, packing, labeling, and marking. Preservation, packaging, packing, labeling, and marking shall be as specified in the contract or purchase order.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.

Referenced documents. The following documents, of the issue in effect on date of invitation for bids for request for proposal, form a part of this CID to the extent specified herein.

Other Publication

AMERICAN NATIONAL STANDARDS INSTITUTE (ANSI)

ANSI C37.42 - Distribution Cutouts and Fuse Links - Specifications.

(Applications for copies should be addressed to the American National Standards Institute, 11 West 42nd Street, New York, NY 10036-8002).

Notes. This section contains relevant information which is useful to buyers, users, and suppliers in the process of acquiring the item, but is not mandatory.

Ordering data. The contract or purchase order shall specify the following:

a. CID document number and revision and CID PIN.

b. Quality assurance provisions.

c. Packaging requirements.

Comments. Comments on this CID should be directed to Defense Electronics Supply Center, ATTN: DESC-ELDM, 1507 Wilmington Pike, Dayton, OH 45444-5765, or telephone (513) 296-6189, or facsimile (FAX) (513) 296-8868.

Suggested sources of supply. Suggested sources of supply are listed herein. Additional sources will be added as they become available.

CID dash number (see table I) A-A-55498-	Vendor commercial PIN CAGE 32841	Vendor commercial PIN CAGE 71400	Vendor commercial PIN CAGE 73569
001	51001	---	CM1T23
002	51002	---	CM2T23
003	51003	---	CM3T23
004	51006	FL11T6	CM6T23
005	51008	FL11T8	CM8T23
006	51010	FL11T10	CM10T23
007	51012	FL11T12	CM12T23
008	51015	FL11T15	CM15T23
009	51020	FL11T20	CM20T23
010	51025	FL11T25	CM25T23
011	51030	FL11T30	CM30T23
012	51040	FL11T40	CM40T23
013	51050	FL11T50	CM50T23
014	51065	FL11T65	CM65T23
015	51080	FL11T80	CM80T23
016	51100	FL11T100	CM100T23

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.

CID dash number (see table I) A-A-55498-	Vendor commercial PIN CAGE 32841	Vendor commercial PIN CAGE 71400	Vendor commercial PIN CAGE 73569
017	51140	FL11T140	CM140T23
018	51200	FL11T200	CM200T23
019	51001-29	---	CM1T26
020	51002-29	---	CM2T26
021	51003-29	---	CM3T26
022	51006-29	---	CM6T26
023	51008-29	---	CM8T26
024	51010-29	---	CM10T26
025	51012-29	---	CM12T26
026	51015-29	---	CM15T26
027	51020-29	---	CM20T26
028	51025-29	---	CM25T26
029	51030-29	---	CM30T26
030	51040-29	---	CM40T26
031	51050-29	---	CM50T26
032	51065-29	---	CM65T26
033	51080-29	---	CM80T26
034	51100-29	---	CM100T26
035	511040-29	---	CM140T26
036	51200-29	---	CM200T26

Vendor CAGE number	Vendor name and address
32841	Kearney Division of Kearney National, Incorporated 1928 Montreal Road Tucker, GA 30084-5201 (404) 939-6011
71400	Bussmann P.O. Box 14460 St. Louis, MO 63178-4460 (314) 527-1253
73569	A.B. Chance Company 210 N. Allen Street Centralia, MO 65240-1395 (314) 682-8502

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.

CIVIL AGENCY COORDINATING ACTIVITY:

GSA - 7FXE

PREPARING ACTIVITY:

DLA-ES

Project 5920-D221

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:49Z
Check the source to verify that this is the current version before use.