
COMMERCIAL ITEM DESCRIPTION

FUSEHOLDER, BLOCK, 30 AMPERE (A), 250 VOLTS (V) AC, 1 THROUGH 12 POLE, ACCOMMODATES 5AG OR 5AB TYPE FUSE CARTRIDGES

The General Services Administration has authorized the use of this commercial item description (CID) for all federal agencies

1 SCOPE This CID covers the general requirements for fuseholder blocks with 1 through 12 poles which accommodates 5AG or 5AB type fuse cartridges Fuseholder blocks covered by this CID are intended for commercial/industrial applications

2 CLASSIFICATION This CID uses a classification system which is included in the Part or Identification Number (PIN) The PIN shall be AA55518/04- (plus a dash number from table I) Complete PIN example AA55518/04-002 (see 6 1)

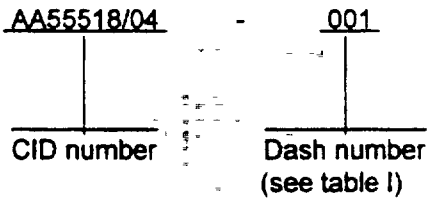

3 SALIENT CHARACTERISTICS

3 1 Design and construction Fuseholder blocks supplied to this CID shall be as specified

3 2 Ampere rating The ampere rating shall be 30 A maximum

3 3 Voltage rating The voltage rating shall be 250 V ac maximum


3 4 Fuse accommodation This fuseholder accepts 5AG or 5AB type fuse cartridges with dimensions of 10 31 mm x 38 10 mm (406 inch x 1 50 inch)


Beneficial comments, recommendations, additions, deletions, clarifications, etc , and any data which may improve this document should be sent to Defense Electronics Supply Center, ATTN DESC-ELDM, 1507 Wilmington Pike, Dayton, OH 45444-5765, or telephone (513) 296-6189, or facsimile (FAX) (513) 296-8868


AMSC N/A FSC 5920

DISTRIBUTION STATEMENT A Approved for public release, distribution is unlimited

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:50Z
Check the source to verify that this is the current version before use.

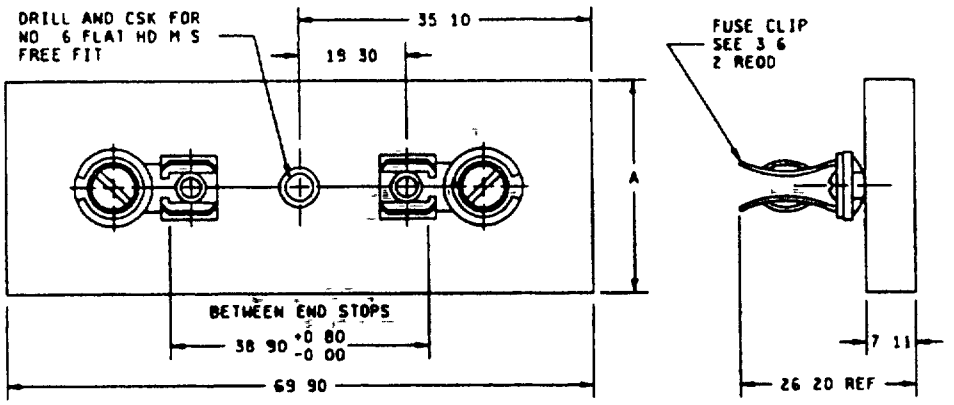

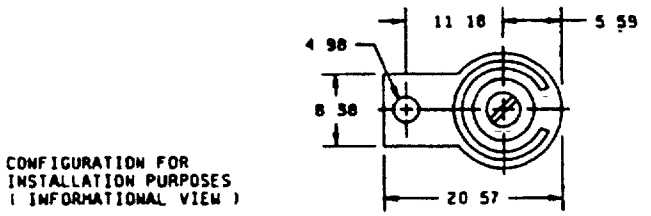

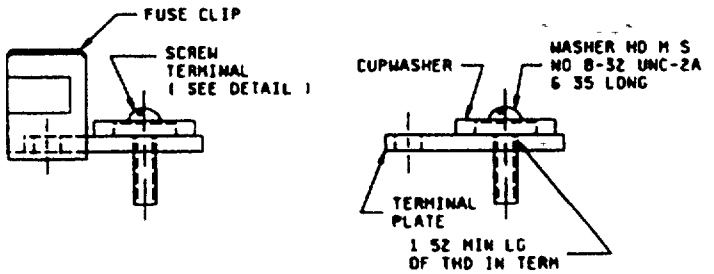

mm	Inches	mm	Inches
0 80	030	11 18	440
1 52	060	19 30	760
4 98	196	20 57	810
5 59	220	26 20	1 030
6 35	250	35 10	1 380
7 11	280	38 90	1 530
8 38	330	69 90	2 750

NOTES

1 Dimensions are in millimeters
2 Tolerance is ±0 13 mm (005 inch), unless otherwise specified
3 The following notes apply to width A of the fuseholders (see table I)
   a The longitudinal centerline of single pole and outer pairs of fuse clips on multiple pole fuseholders shall be located 9.9 mm (39 inch) from the edge of the fuseholder block
   b The distance between longitudinal centerlines of adjacent pairs of fuse clips shall be 23 1 mm (91 inch)
   c A minimum of two mounting holes shall be provided on multiple pole fuseholders These holes shall be one each centrally located between the fuse clips on the longitudinal centerline of the outer pairs of fuse clips
4 The US government preferred system of measurement is the metric SI system However, this item was originally designed using inch-pound units of measurement In the event of conflict between the metric and inch-pound units, the inch-pound units shall take precedence

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:50Z
Check the source to verify that this is the current version before use.

Figure 1 Configuration and dimensions (screw terminals)

TABLE I Characteristics

CID dash number AA55518/04-	Number of poles	Dimension A (see figure 1)	CID dash number AA55518/04-	Number of poles	Dimension A (see figure 1)
001	1	21 3 (84)	007	7	169 2 (6 66)
002	2	46 0 (1 81)	008	8	193 5 (7 62)
003	3	70 6 (2 78)	009	9	218 2 (8 59)
004	4	95 3 (3 75)	010	10	242 8 (9 56)
005	5	119 9 (4 72)	011	11	267 5 (10 53)
006	6	144.5 (5 69)	012	12	292 1 (11 50)

3 5 Fuseholder base The fuseholder base shall be molded or laminated plastic

3 6 Fuse clips This fuseholder shall be supplied with Commercial Item Description (CID) number AA55507/01-03 fuse clips

3 7 Marking Fuseholder blocks supplied to this CID shall be marked with the manufacturer's standard commercial PIN

4 QUALITY ASSURANCE PROVISIONS Quality assurance provisions shall be as specified in A-A-55518

5 PACKAGING Packaging shall be as specified in A-A-55518

6 NOTES

6 1 PIN The PIN should be used for Government purposes to buy commercial products to this CID See section 2 for PIN format

6 2 CAGE code For ordering purposes, inventory control, and submission of these instruments to DESC under the Military Parts Control Advisory Group (MPCAG) evaluation program, CAGE code 58536 should be used

6 3 Source of documents

Commercial Item Description

A-A-55518 - Fuseholder, Block, General Requirements

A-A-55507/01 - Clip, Electrical, Fuse, 30 and 60 Ampere, For Fuse Diameters 1/4" Thru 13/16"

(Copies of commercial item descriptions are available from the Defense Printing Service Detachment Office, Building 4D (Customer Service), 700 Robbins Avenue, Philadelphia, PA 19111-5094)

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:50Z
Check the source to verify that this is the current version before use.

6 4 Ordering data Ordering data shall be as specified in A-A-55518

6 5 Commercial products As part of the market analysis and research effort, this CID was coordinated with the following manufacturers of commercial products At the time of CID preparation and coordination, these manufacturers were known to have commercial products that would meet the requirements of this CID (NOTE This information should not be considered as a list of approved manufacturers or be used to restrict procurement to only the manufacturers shown)

MFGR's CAGE	MFGR's name and address
71400	Bussmann P O Box 14460 St Louis, MO 63178-4460 (314) 527-1253
75915	Littelfuse, Incorporated 800 E Northwest Highway Des Plaines, IL 60016-3096 (312) 824-1188

6 6 Part number (P/N) supersession data This CID supersedes the following manufacturer's P/Ns as shown This information is being provided to assist in reducing proliferation in the government inventory system

Dash number (see table I) AA55518/04-	MFGR CAGE	MFGR P/N 1/	MFGR CAGE	MFGR P/N 1/
001	71400	FH25AM	75915	556001
002	71400	FH25BM	75915	556002
003	—	—	75915	556003
004	—	—	75915	556004
005	—	—	75915	556005
006	71400	FH25HM	75915	556006
007	—	—	75915	556007
008	71400	FH25KM	75915	556008
009	—	—	75915	556009
010	—	—	75915	556010
011	—	—	75915	556011
012	71400	FH25PM	75915	556012

1/ The manufacturer's P/N shall not be used for procurement to the requirements of this CID At the time of preparation of this CID, the aforementioned commercial products were reviewed and could be replaced by the CID PIN shown

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:50Z
Check the source to verify that this is the current version before use.

6.7 Government users To acquire information on obtaining these fuseholder blocks from the Government inventory system, contact Defense Electronics Supply Center, ATTN DESC-EOM, 1507 Wilmington Pike, Dayton, OH 45444-5519, or telephone (513) 296-5106

MILITARY INTERESTS

Custodians
Army - ER
Navy - SH
Air Force - 85

Review Activities
Army - AR, AT, EA, MI
Navy - AS, CG, EC
Air Force - 17, 19, 99

CIVIL AGENCY COORDINATING ACTIVITY

GSA - 7FXE

Preparing Activity

DLA - ES

Project 5920-0534-04

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T09:50Z
Check the source to verify that this is the current version before use.