MIL-L-26311B(ASG)
10 AUGUST 1959
Superseding
MIL-L-26311A(USAF)
20 March 1959

MILITARY SPECIFICATION

LIGHTING SYSTEM, AIRPORT APPROACH, CONDENSER DISCHARGE, SEQUENCE FLASHING, GENERAL REQUIREMENTS FOR

This specification has been approved by the Department of the Air Force and by the Navy Bureau of Aeronautics.

1. SCOPE

1.1 This specification covers the general requirements for a 240V condenser discharge sequence flashing approach lighting system with mechanical multiwire control, which has been specifically modified for use on Air Force bases with standard control tower and vault circuits. On joint Air Force and civil bases, the Federal Aviation Agency approach lighting system shall be used, since Federal Aviation Agency requirements will be applicable in lieu of this specification.

2. APPLICABLE DOCUMENTS

2.1 The following documents, of the issue in effect on date of invitation for bids, form a part of this specification:

SPECIFICATIONS

Federal

W-P-131	Panelboards; Equipped With Automatic-Circuit-Breakers
W-T-631	Transformers, Power, Distribution
PPP-B-566	Boxes, Folding, Paperboard
PPP-B-585	Boxes, Wood, Wirebound
PPP-B-591	Boxes, Fiberboard, Wood-Cleated
PPP-B-601	Boxes, Wood, Cleated-Plywood
PPP-B-621	Boxes, Wood, Nailed and Lock-Corner
PPP-B-636	Boxes, Fiber
PPP-B-665	Boxes; Paperboard, Metal Stayed (Including Stay Material)
PPP-B-676	Boxes, Set-Up, Paperboard
PPP-T-60	Tape; Pressure Sensitive Adhesive, Waterproof - for Packaging and Sealing

FSC 6210

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T09:26Z
Check the source to verify that this is the current version before use.

Military

JAN-P-100	Packaging and Packing for Overseas Shipment, General Specification
MIL-P-116	Preservation, Methods of
MIL-V-173	Varnish, Moisture- and Fungus-Resistant, for the Treatment of Communications, Electronic, and Associated Electrical Equipment
MIL-C-7989	Covers, Light-Transmitting, for Aeronautical Lights
MIL-B-10377	Box, Wood, Cleated, Veneer, Paper Overlaid
MIL-L-10547	Liners, Case, Waterproof
MIL-L-26202	Light, Flush Approach, Runway, and Taxiway, General Requirements for
MIL-D-70327	Drawings, Engineering and Associated Lists

STANDARDS

Military

MIL-STD-129	Marking for Shipment and Storage
MIL-STD-130	Identification Marking of U. S. Military Property
MS24526	Base, Airport Marker Light

(Copies of documents required by contractors in connection with specific procurement functions should be obtained from the procuring activity or as directed by the contracting officer.)

2.2 Other publications.- The following documents form a part of this specification. Unless otherwise indicated, the issue in effect on date of invitation for bids shall apply.

Federal Aviation Agency

Drawings

C-5225	Adapter Plates for L-837 Lamp Bases
CAA-L-809	Airport Marker Light Base and Transformer Housing
CAA-L-837	Large-Size Light Base, And Transformer Housing
CAA-1106	Condenser-Discharge Sequenced Flashing Light System

(Copies of FAA documents may be obtained from the Federal Aviation Agency, Washington 25, D. C.)

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T09:26Z
Check the source to verify that this is the current version before use.

3. REQUIREMENTS

3.1 Qualification.- The lighting system and individaul components furnished under this specification shall be products which have been tested and have passed the qualification tests specified herein.

3.2 Components.- The lighting system shall consist of the components as shown in table I.

TABLE I

Components

Item No.	Description	Requirement
1	Elevated lights	3.7.1
2	Flush lights	3.7.2
3	Master timer assembly	3.8
4	Distribution transformer	3.9
5	Panelboard	3.10
6	Spare parts trunk	3.11
7	Junction boxes	3.12
8	Monitoring equipment	3.13

3.2.1 Component layout and circuits.- Figure 1 illustrates the typical component layout and circuits to be utilized at Air Force bases for a full-length lighting system. Figure 1 does not show the required monitoring equipment and circuitry. Unless otherwise specified, the distribution transformer, panelboard, junction boxes, wiring, and other auxiliary materials shall be furnished through the installation contract and not with systems procured for stock.

3.2.2 Unless otherwise specified, the following components in the quantities indicated shall be furnished with systems procured for stock. The quantities include one spare elevated light and one spare flush light for maintenance purposes:

Elevated lights	22
Flush lights	8
Master timer assembly	1
Spare parts trunk	1
Remote control monitor panel	1

3.3 Materials.-

3.3.1 Fungus-proof materials.- Materials that are nutrients for fungi shall not be used where it is practicable to avoid them. Where used and not hermetically sealed, they shall be treated with a fungicidal agent acceptable to the procuring activity. However, if they will be used in a hermetically sealed enclosure, fungicidal treatment will not be necessary.

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T09:26Z
Check the source to verify that this is the current version before use.

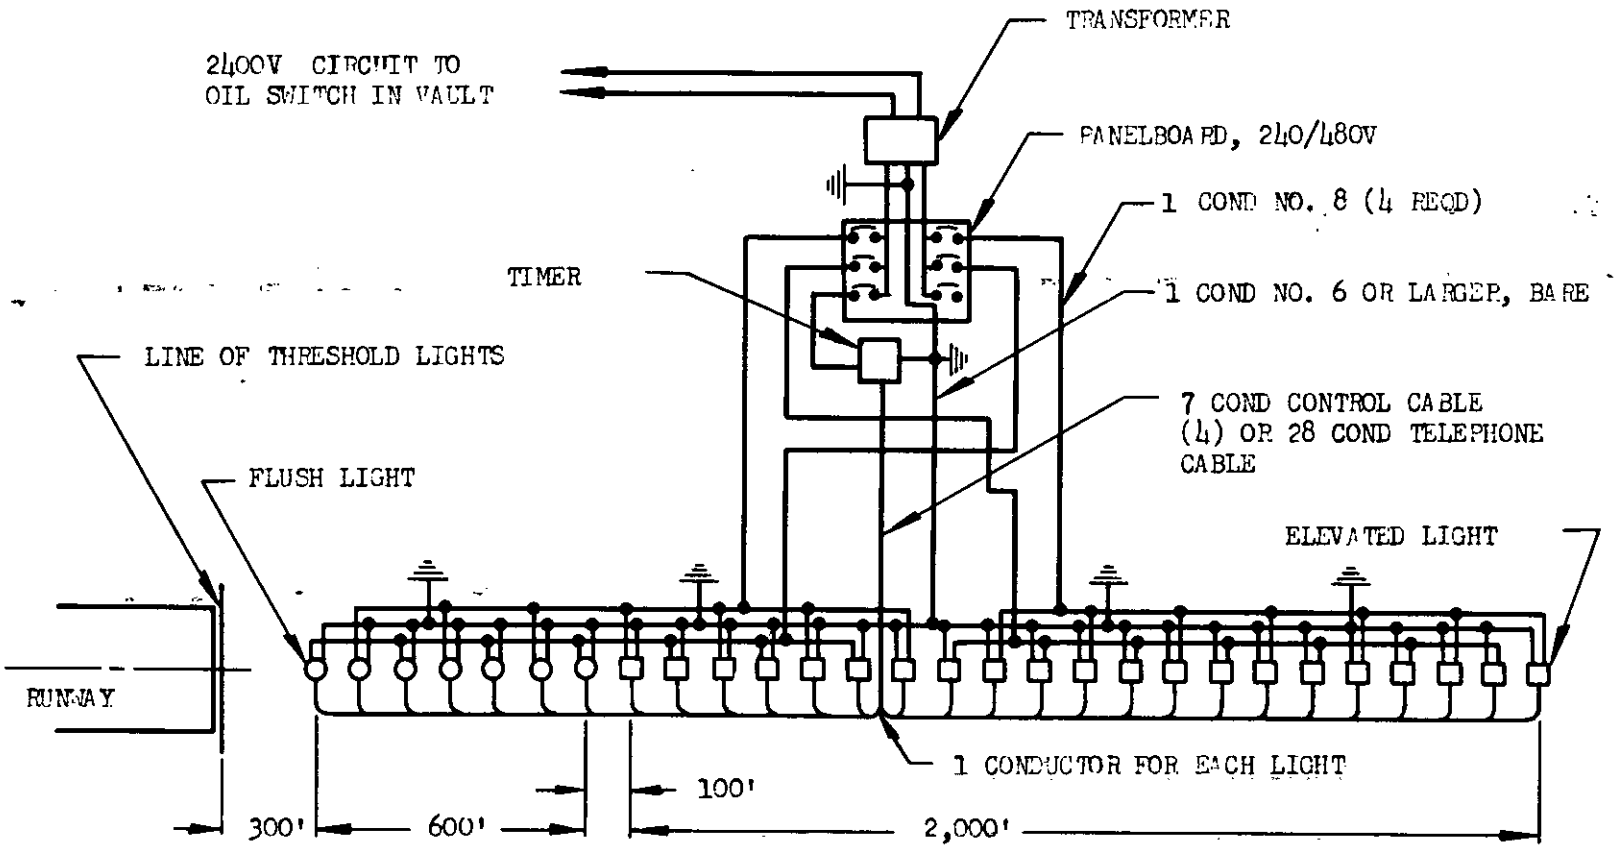


FIGURE 1. Wiring diagram-condenser discharge approach lighting system

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T09:26Z
Check the source to verify that this is the current version before use.

3.3.2 Metals.- Metals shall be of the corrosion-resistant type or suitably treated to resist corrosion from fuels, salt spray, or atmospheric conditions as may be encountered in storage or normal service.

3.3.3 All gaskets and other materials utilized in a light shall be of a type that will not emit smoke or vapor during rated-current operation within the specified temperature range.

3.3.4 Lenses and filters.- Any lense and filter utilized in a light shall be of class B glass or class D plastic conforming to Specification MIL-C-7989.

3.3.5 Reflectors.- All reflectors utilized in a light shall be provided with a finish of high specular reflectivity, and shall be protected from dirt, tarnishing, and corrosion.

3.4 Selection of specifications and standards.- Specifications and standards for necessary commodities and services not specified herein shall be selected in accordance with Specification MIL-D-70327, except as provided in 3.4.1 and 3.4.2.

3.4.1 Commercial parts.- Commercial parts having suitable properties may be used where, on the date of invitation for bids, there are no suitable standard parts. In any case, commercial utility parts, such as screws, bolts, nuts, and cotter pins having suitable properties may be used provided:

(a) They can be replaced by the standard parts (MS or AN) without alteration.

(b) The corresponding standard part numbers are referenced in the parts list and, if practicable, on the contractor's drawings.

3.4.2 Standard parts.- With the exception in 3.4.1, MS and AN standard parts shall be used where they suit the purpose. They shall be identified on the drawings by their part numbers.

3.5 Design and construction.- All components of the lighting system shall be so designed and constructed that no parts will work loose in service. All components shall withstand the strains, jars, vibrations, and other conditions incident to shipping, storage, installation, and service.

3.5.1 All components of the system shall be in accordance with Specification CAA-1106, type CD-100 with the exceptions and additions specified herein.

3.5.2 Adjustment and repairs.- All components shall be so constructed that adjustment and repairs can be easily made by the personnel of operating units and overhaul bases with tools normally available commercially.

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T09:26Z
Check the source to verify that this is the current version before use.

3.5.3 Reliability.- The lighting system shall be so designed as to provide reliable operation throughout its normal life under any condition to which it may be subjected.

3.5.4 Maintenance provisions.- All repairs, cleaning, and testing of elevated and flush lights will normally be accomplished in the maintenance shop, using the simplified timer from the spare parts trunk. Elevated and flush lights shall be so designed that a light can be exchanged for a spare light by disconnecting the waterproof connector, removing holddown bolts, and lifting the light from alinement pins without opening its sealed housing.

3.5.4.1 Elevated and flush lights shall be so designed and constructed that replacement of tubes, lamps, fuses, and other plug-in components can be readily made in the field.

3.6 Performance.-

3.6.1 Life.- The master timer, elevated lights, and flush lights shall be capable of 500 hours of operation as specified in 4.3.6.

3.7 Lights.-

3.7.1 Elevated lights.- The performance of elevated lights shall be in accordance with Specification CAA-1106, except that the beam width and height shall be increased to not less than 10° each side of the beam axis at 10,000 effective candles, and the allowable maximum effective candlepower shall be raised from 17,000 to 20,000.

3.7.1.1 The housing of the elevated light shall be sufficiently watertight to pass the water immersion test specified in 4.3.4. Cable entrances of the watertight compression type shall be provided. Either a hinged door or a removable bolted or clamped cover may be supplied. Either a door lock or a method for applying a padlock (not supplied with the housing) shall be provided. The chassis shall be securely clamped or bolted in place, and need not be of the pull-out type. Tubes, lamp, and all parts requiring frequent replacement shall be readily accessible without removing the chassis. The beam elevation shall be set at 10°, and no adjustment need be provided. The housing shall be designed for mounting on a flat, level concrete pad or wooden platform with four 3/8-inch mounting bolts (without nuts) whose centers form a rectangle 11 by 26 inches, with the 11-inch dimension parallel to the extended runway conterline. When so mounted, the center of the light beam shall be within ±2° of a line perpendicular to the front of the housing, except elevated 10° above the horizontal. Two handles shall be provided to facilitate lifting the assembly.

3.7.2 Flush lights.- Flush lights shall be in accordance with the following classes. Unless otherwise specified, class B flush lights shall be furnished. (See 6.2.)

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T09:26Z
Check the source to verify that this is the current version before use.

3.7.2.1 Class A.- Each class A flush light shall be constructed with completely flush permanent parts and an expendable plastic dome, and shall be in accordance with Specification MIL-L-26202, class A2, except that a condenser discharge light source shall be substituted for the incandescent lamp.

3.7.2.2 Class B.- Each class B flush light shall be constructed with a sloped prismatic top extending not more than 1 inch above pavement level, and shall be in accordance with Specification MIL-L-26202, class B2, except that a condenser discharge light source shall be substituted for the incandescent lamp.

3.7.2.3 Class C.- Each class C light shall be constructed with an open grid top, and shall be in accordance with Specification MIL-L-26202, class C3, except that a condenser discharge light source shall be substituted for the three incandescent lamps and transformers, and the C3 grid may be altered as required to accommodate the condenser discharge light.

3.7.2.4 Flush lights shall meet all elevated light performance requirements, except that beam dimensions and minimum effective candlepower values shall be as shown in table II.

TABLE II

Candlepower values and beam dimensions

Class	Minimum effective candlepower	Total beam width (° horiz)	Beam height (° vert)
Elevated	10,000	20	0 to 20
A	1,000	20	0 to 15
B	120	20	0 to 15
C	300	6	2 to 10

3.7.2.5 Containers.- The components of each flush light shall be housed in either a single watertight container or in two watertight containers connected by cable and waterproof connectors. The containers shall be sufficiently watertight to pass a 2-psi internal air pressure test. The containers shall be equipped with readily removable covers to permit lamp and tube replacement and provide access to all components. Lifting handles or loops shall be provided on containers or subassemblies that cannot be readily handled.

3.7.2.5.1 Class A and class B light containers.- The single container for class A and class B lights shall not exceed 7-3/4 inches in diameter and 12 inches in height. The container shall be designed for installation in a base conforming to Standard MS24526.

3.7.2.5.1.1 When two containers are utilized, the lamp container shall include the lamp, reflector, and trigger coil. The dimensions and installation requirements shall be as specified in 3.7.2.5.1. The second powerpack container shall be designed for installation within the base below the lamp container or in the concrete handhole of the cable duct system adjacent to the base. The second

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T09:26Z
Check the source to verify that this is the current version before use.

powerpack container, including handles and all other projections, shall not exceed 12-5/16 inches in diameter and 13 inches in height.

3.7.2.5.1.2 The design of both lamp and powerpack containers shall be such as to meet the following methods of installation:

(a) Lamp container in a small base conforming to Standard MS24526 or Specification CAA-L-809 and the powerpack container in an adjacent concrete handhole or large base conforming to Specification CAA-L-837.

(b) Both lamp and powerpack containers in the large base conforming to Specification CAA-L-837, using an adapter place in accordance with CAA Drawing C-5225.

3.7.2.5.2 Class C light containers.- The single container for class C lights shall be designed for installation within the lamp compartment of the grid assembly. When two containers are utilized, the second powerpack container shall be equal to and interchangeable with the powerpack container requirements specified in 3.7.2.5.1.

3.7.3 Circuits and components.- Elevated and flush lights shall be electrically interchangeable. Insofar as practicable, the same circuits and components shall be used for both flush and elevated lights. When it is necessary to utilize different circuits and components in a one-container flush light, the circuits and components shall be capable of operating satisfactorily for periods of time equal to those in elevated lights. Lightning arresters, trouble lights, and input voltage taps may be omitted from flush lights.

3.7.4 Safety interlocks.- Each container for flush and elevated lights shall include an interlock circuit that will immediately de-energize the light and completely discharge all components within 30 seconds after the container is opened or the high voltage cable is disconnected or cut. Within 5 seconds, all components shall be discharged to 300V or less. Both the inside and outside of each container shall be plainly marked: DANGER - HIGH VOLTAGE.

3.7.5 Focusing and aiming.- The complete optical system of each light shall be of the fixed prefocus type and shall require no adjustment at initial installation or after lamp replacement. Design and construction shall be such as to minimize the possibility of improper assembly, after disassembly for maintenance. The beam center of each light shall be within ±2° of a line parallel to the runway centerline when the lights are installed as follows:

(a) Elevated lights: Housing level, and front of housing perpendicular to runway centerline.

(b) Class A and class B lights: Top level, and alinement arrow parallel to runway centerline.

(c) Class C lights: Grid assembly level, and parallel to runway centerline.

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T09:26Z
Check the source to verify that this is the current version before use.

3.7.6 Power consumption.- Each light shall consume not more than 500 va at 240V when measured with thermal meters giving a steady needle deflection. The surge current at each flash shall not exceed 9 amp (rms) at 240V.

3.7.7 Wiring diagram.- A wiring diagram, including internal voltages, coding of wires and terminals, and complete identification of expendable parts, such as tubes and lamp, shall be permanently and legibly mounted inside each container.

3.7.8 Input cable assemblies.- Elevated lights and the single or powerpack container shall be equipped with a 4-conductor, No. 12 AWG, type SO, 600V color-coded input cable assembly. The color coding shall be as follows:

White - Ground
Black - 240V power
Green - 120V trigger (momentarily on)
Red - Monitor

3.7.8.1 The input cable shall be attached to a terminal block inside the container, pass through a watertight squeeze grommet, and extend 2 feet outside the container. The outer end shall terminate in a watertight, polarized, molded-rubber male connector.

3.7.8.2 A similar 5-foot length of 4-conductor, No. 12 AWG, type SO, 600V cable terminating in a mating, molded-rubber female connector shall be furnished with each light for splicing into the feeder cables at installation.

3.7.8.3 The molded-rubber male connector shall be equal to and interchangeable with Joy Manufacturing Company Part No. X8510-47, or equivalent. A sealing cap shall be provided on the connector.

3.7.8.4 The molded-rubber female connector shall be equal to and interchangeable with Joy Manufacturing Company Part No. X8510-46, or equivalent. A sealing cap shall be provided on the connector.

3.7.9 High-voltage cable assemblies.- When two containers are used for flush lights, they shall be connected by a high-voltage color-coded cable assembly that will readily pass through a 2-inch conduit.

3.7.9.1 The lamp container shall be equipped with a cable assembly. The cable assembly shall be attached to terminals inside the container, pass through a watertight squeeze grommet located in or near the bottom of the container, and terminate in a watertight, molded-rubber male connector.

3.7.9.2 The powerpack container shall be equipped with a similar cable assembly. The cable assembly shall be attached to terminals inside the container, pass through a watertight squeeze grommet, extend 10 feet beyond the container, and terminate in a watertight, molded-rubber female connector that mates with the male connector of the lamp container cable assembly.

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T09:26Z
Check the source to verify that this is the current version before use.

3.7.9.3 The male and female connectors shall be equal to and interchangeable with Joy Manufacturing Company Part No. X8411-6 and X8411-13 or equivalent, respectively. The extra conductor of this six-pole assembly shall be connected in parallel with the ground conductor. Sealing caps shall be provided for both male and female connectors.

3.7.10 Grounding.- The ground conductor in the input- and high-voltage cables shall be positively connected to the chasis and container or elevated lights, flush light lamp units, and flush light powerpacks.

3.8 Master timer assembly.- The master timer assembly shall be in accordance with Specification CAA-1106, except that it shall operate on 240V as shown on figure 1; the interior panel need not be removable; the dead front plate need not be provided; and the applicable AN connectors may be omitted. The assembly shall include a 240/120V transformer, a 120V timer that provides a momentary 120V trigger impulse to each light in the proper sequence, a trouble light and switch, and all necessary terminal blocks, lightning arresters, and wiring. An elapsed time meter shall be provided. The housing shall be weatherproof.

3.9 Distribution transformer.- The transformer shall be a completely self-protected, 15 kva, 2,400V primary, 240/480V secondary, 60-cycle, single-phase transformer with standard high-voltage winding taps, in accordance with Specification W-T-631, type III, with class A insulation.

3.10 Panelboard.- The panelboard shall be housed in a weatherproof cabinet and shall be 3-wire, 240/480V main, using solid neutral bus, with six 2-wire 240V branches (single-pole, 240V, 20-amp breakers), in accordance with Specification W-P-131, class 1.

3.11 Spare parts trunk.- One spare parts trunk containing items essentially as listed below shall be provided. The trunk shall be designed to house and protect the items during shipment and storage. The trunk shall be fabricated from 3/8-inch Douglas fir plywood, laminated on each side with 0.02-inch-thick vulcanized fiber, and olive drab in color. Hardware shall be brass-plated steel and shall include heavy gage steel corners, three hinges, handles at each end, tongue and groove molding around closure and bumpers on the bottom surface. The trunk shall be varnished inside and out with fungicidal varnish conforming to Specification MIL-V-173.

(a) One hundred percent spare lamps.
(b) Twenty-five percent spare tubes.
(c) Ten percent spare trigger relays.
(d) Ten percent spare flash capacitors.
(e) One trigger coil of each type used.
(f) One power transformer of each type used.
(g) Ten fuses (minimum).
(h) One simplified timer assembly (see 3.11.1).
(i) Two instruction manuals (see 6.2).
(j) An instruction plate (see 3.11.2).

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T09:26Z
Check the source to verify that this is the current version before use.

3.11.1 Simplified timer.- A simplified timer assembly shall be provided. It shall be capable of operating and flashing a single light in the repair shop. The timer shall be provided with an input transformer for operation from a single-phase, 120V power source. The secondary winding of the transformer shall be isolated from the primary winding.

3.11.2 Instruction plate.- An instruction plate shall be mounted on the inside of the trunk lid. The plate shall include a wiring diagram for the system, an internal-wiring diagram for each component, abbreviated operating and trouble-shooting instructions, identification and ratings for all components, and specified internal voltages to permit checking internal circuits while troubleshooting.

3.12 Junction boxes.- Junction boxes for the lighting system shall normally be supplied by the installing contractor. All junction boxes shall be of a high-grade commercial type. Junction boxes utilized with flush lights shall be of watertight construction.

3.13 Monitoring equipment.- Necessary monitoring equipment shall be provided with each system. The monitoring equipment and circuitry shall be in accordance with that specified in CAA-1106, except that the flasher and monitor sectionalizer shall not be included. A remote control panel shall be provided.

3.14 Wiring.- System wiring shall be as shown on figure 1. Each light and timer shall be completely wired internally at the factory, so that only the external wires shown on figure 1 need be connected during installation.

3.15 Interchangeability.- All parts having the same manufacturer's part number shall be functionally and dimensionally interchangeable. The drawing number requirements of Specification MIL-D-70327 shall govern changes in the manufacturer's part numbers.

3.16 Dimensions and weight.- The size and weight of each component shall be the minimum consistent with reliability, long life, and good commercial practice.

3.17 Identification of product.- All components shall be marked for identification in accordance with Standard MIL-STD-130, except that the serial number need not be included.

3.18 Workmanship.- The components, including all parts and accessories, shall be fabricated and finished in a thoroughly workmanlike manner. Particular attention shall be given to freedom from blemishes, defects, marking of parts and assemblies; thoroughness of soldering, welding, brazing, painting, wiring, and riveting; alinement of parts and tightness of assembly screws, and bolts, et cetera.

3.18.1 Cleaning.- The components shall be thoroughly cleaned, and loose, spattered, or excess solder, metal chips, and other foreign material removed during and after final assembly.

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T09:26Z
Check the source to verify that this is the current version before use.

4. QUALITY ASSURANCE PROVISIONS

4.1 Unless otherwise specified herein, the supplier is responsible for the performance of all inspection requirements prior to submission for Government inspection and acceptance. Except as otherwise specified, the supplier may utilize his own facilities or any commercial laboratory acceptable to the Government. Inspection records of the examinations and tests shall be kept complete and available to the Government as specified in the contract or order.

4.2 Classification of tests.- The inspection and testing of the approach lighting system shall be classified as follows:

(a)	Qualification tests	(4.3)
(b)	Acceptance tests	(4.4)

4.3 Qualification tests.-

4.3.1 Sampling instructions.- Qualification test samples shall consist of one master timer, one spare parts trunk, one elevated light, and one flush light. Samples shall be identified with the manufacturer's own part number and any additional identification required by the letter of authorization.

4.3.2 Qualification required.- Prior to actual procurement, the product this specification covers shall pass the qualification tests specified herein. If the product is later modified in any way, the modified form shall be subjected to and shall pass the same qualification tests.

4.3.3 Qualification tests.- Qualification tests shall consist of all tests described under 4.5.

4.4 Acceptance tests.- The acceptance tests shall consist of individual tests.

4.4.1 Individual tests.- Each item shall be subjected to the following tests as described under 4.5:

(a) Operation (4.5.1)
(b) Tests listed in Specification CAA-1106 under production tests (4.5.2)
(c) Internal air pressure or water immersion (4.5.3, 4.5.4)

4.5 Test methods.-

4.5.1 Operation.- Each item shall be examined and tested to demonstrate proper operation.

4.5.2 Each item shall be tested as required in Specification CAA-1106 under production tests.

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T09:26Z
Check the source to verify that this is the current version before use.

4.5.3 Internal air pressure.- The flush light shall be subjected to an internal air pressure test of 2 psi for 5 minutes. There shall be no leakage during this test.

4.5.4 Water immersion.- One elevated light from each lighting system shall be completely immersed in water to a depth at least 2 inches above the top of the unit. The unit shall remain immersed for 4 hours. At the end of the 4-hour period, the unit shall be removed from the water and external surfaces dried. The unit shall then be opened to determine if any water entered the housing. If a measurable amount of water entered the housing, it shall be drained and measured. If the amount of water measures 1 pint or more, the water seal shall be considered unsatisfactory. Two additional units from the system shall then be subjected to the same test. If either of the two additional units fail the test, each unit in the system shall be individually tested.

4.5.5 Each item shall be tested as required in Specification CAA-1106 under preproduction sample tests.

4.5.6 Life.- The timer, elevated light, and flush light shall be operated for 500 hours without failure of any part, and there shall be no indication that any part, except the lamp, is approaching the end of life. If the lamp fails prior to 500 hours, the test shall be repeated with a new lamp. Failure of the second lamp prior to 500 hours shall be regarded as evidence that operating conditions within the light are not satisfactory for the lamps.

5. PREPARATION FOR DELIVERY

5.1 Preservation and packaging.-

5.1.1 Level A.- Each item shall be preserved in accordance with Specification MIL-P-116, method III, and separately packaged in containers conforming to Specification PPP-B-566, PPP-B-636, PPP-B-665, or PPP-B-676.

5.1.2 Level C.- Each item shall be separately preserved and packaged in accordance with the manufacturer's commercial practice.

5.1.3 Each item shall be packaged completely assembled, with lenses installed.

5.2 Packing.-

5.2.1 Level A.- Items preserved and packaged as specified in 5.1.1 shall be packed in exterior-type shipping containers conforming to Specification PPP-B-585, PPP-B-591, PPP-B-601, PPP-B-621, PPP-B-636, or MIL-B-10377. Insofar as practicable, exterior shipping containers shall be of uniform shape and size, of minimum cube and tare consistent with the protection required, and shall contain identical quantities. The gross weight of each pack shall be limited to approximately 200 pounds. Containers shall be closed and strapped in accordance with the

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T09:26Z
Check the source to verify that this is the current version before use.

applicable container specification or appendix thereto. Containers shall be provided with a case liner conforming to Specification MIL-L-10547 and shall be sealed in accordance with the appendix thereto. The case liner shall not be required when the unit, intermediate, or exterior shipping container conforms to Specification PPP-B-636, and is sealed at all joints and seams, including manufacturer's joint, with tape conforming to Specification PPP-T-60.

5.2.2 Level B.- Items preserved and packaged as specified in 5.1.1 shall be packed in domestic-type exterior shipping containers conforming to Specification PPP-B-585, PPP-B-591, PPP-B-601, PPP-B-621, PPP-B-636, or MIL-B-10377. Exterior shipping containers shall be of minimum cube and tare consistent with the protection required. Insofar as practicable, exterior shipping containers shall be of uniform shape and size and shall contain identical quantities. The gross weight of each pack shall be limited to approximately 500 pounds. Containers shall be closed and strapped in accordance with the applicable container specification or appendix thereto. When fiberboard containers are used, the fiberboard shall conform to Specification PPP-B-636.

5.2.3 Level C.- Packages which require overpacking for acceptance by the carrier shall be packed in exterior-type shipping containers in a manner that will insure safe transportation at the lowest rate to the point of delivery. Containers shall meet Consolidated Freight Classification Rules, or regulations of other common carriers as applicable to the mode of transportation.

5.3 Physical protection.- Cushioning, blocking, bracing, and bolting as required shall be in accordance with Specification JAN-P-100, except that waterproofing requirements for cushioning materials and containers shall be waived for domestic shipments. The rough handling tests of Specification MIL-P-116 are applicable.

5.3.1 Cushioning, blocking, bracing, and bolting of a light shall be such as to insure that rough handling will not set up strains or stresses that might result in damage to lenses or other components of the light.

5.4 Marking of shipment.- Interior packages and exterior shipping containers shall be marked in accordance with Standard MIL-STD-129.

6. NOTES

6.1 Intended use.- The lighting system is intended for use on Air Force bases, with standard Air Force control tower and vault circuits. The systems have been defined so that they can either be procured centrally for stock, or individually through the installation contract for a specific base.

6.2 Ordering data.- Procurement documents should specify the following:

(a) Title, number, and date of this specification.
(b) Class of flush light, if other than class B is desired (see 3.7.2).

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T09:26Z
Check the source to verify that this is the current version before use.

(c) The type of base, if any, to be furnished with flush lights (Standard MS24526, Specification CAA-L-809, or CAA-L-837 with adapter plate) (see 3.7.2.5.1.2).
(d) Levels of preservation and packaging, and packing (see section 5).
(e) That two instruction manuals will be provided in the spare parts trunk (two manuals are necessary to minimize installation and maintenance) (see 3.11).

6.3 With respect to products requiring qualification, awards will be made only for such products as have, prior to the time set for opening of bids, been tested and approved for inclusion in the applicable Qualified Products List whether or not such products have actually been so listed by that date. The attention of the suppliers is called to this requirement, and manufacturers are urged to arrange to have the products that they propose to offer to the Federal Government, tested for qualification in order that they may be eligible to be awarded contracts or orders for the products covered by this specification. The activity responsible for the Qualified Products List is Wright Air Development Center, Wright-Patterson Air Force Base, Ohio, and information pertaining to qualification of products may be obtained from that activity.

NOTICE: When Government drawings, specifications, or other data are used for any purpose other than in connection with a definitely related Government procurement operation, the United States Government thereby incurs no responsibility nor any obligation whatsoever; and the fact that the Government may have formulated, furnished, or in any way supplied the said drawings, specifications, or other data is not to be regarded by implication or otherwise as in any manner licensing the holder or any other person or corporation, or conveying any rights or permission to manufacture, use, or sell any patented invention that may in any way be related thereto.

Custodians:
Navy - Bureau of Aeronautics
Air Force

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T09:26Z
Check the source to verify that this is the current version before use.

SPECIFICATION ANALYSIS SHEET

Form Approved
Budget Bureau No. 119-R004

INSTRUCTIONS

This sheet is to be filled out by personnel either Government or contractor, involved in the use of the specification in procurement of products for ultimate use by the Department of Defense. This sheet is provided for obtaining information on the use of this specification which will insure that suitable products can be procured with a minimum amount of delay and at the least cost. Comments and the return of this form will be appreciated. Fold on lines on reverse side, staple in corner, and send to preparing activity *(as indicated on reverse hereof)*.

SPECIFICATION

ORGANIZATION *(Of submitter)*

CITY AND STATE

CONTRACT NO.

QUANTITY OF ITEMS PROCURED

DOLLAR AMOUNT
$

MATERIAL PROCURED UNDER A

☐ DIRECT GOVERNMENT CONTRACT ☐ SUBCONTRACT

1. HAS ANY PART OF THE SPECIFICATION CREATED PROBLEMS OR REQUIRED INTERPRETATION IN PROCUREMENT USE?

A. GIVE PARAGRAPH NUMBER AND WORDING.

B. RECOMMENDATIONS FOR CORRECTING THE DEFICIENCIES.

2. COMMENTS ON ANY SPECIFICATION REQUIREMENT CONSIDERED TOO RIGID

3. IS THE SPECIFICATION RESTRICTIVE?

☐ YES ☐ NO IF "YES", IN WHAT WAY?

4. REMARKS *(Attach any pertinent data which may be of use in improving this specification. If there are additional papers, attach to form and place both in an envelope addressed to preparing activity)*

SUBMITTED BY *(Printed or typed name and activity)*

DATE

DD, FORM 1 APR 63 1426 REPLACES NAVSHIPS FORM 4863, WHICH IS OBSOLETE C-8279

Source: https://assist.dla.mil -- Downloaded: 2026-10-20T09:26Z
Check the source to verify that this is the current version before use.