INCH-POUND
MIL-C-17361/10A(SH)
17 August 1994
SUPERSEDING
MIL-C-17361/10(SH)
10 March 1989

MILITARY SPECIFICATION SHEET


CIRCUIT BREAKERS, AIR, ELECTRIC, INSULATED HOUSING (SHIPBOARD USE) TYPE AQB - LL400 QS


This specification is approved for use by the Naval Sea Systems Command, Department of the Navy, and is available for use by all Departments and Agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and the issue of the following specification listed in that issue of the Department of Defense Index of Specifications and Standards (DoDISS) specified in the solicitation: MIL-C-17361.


AMSC N/A
FSC 5925
DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

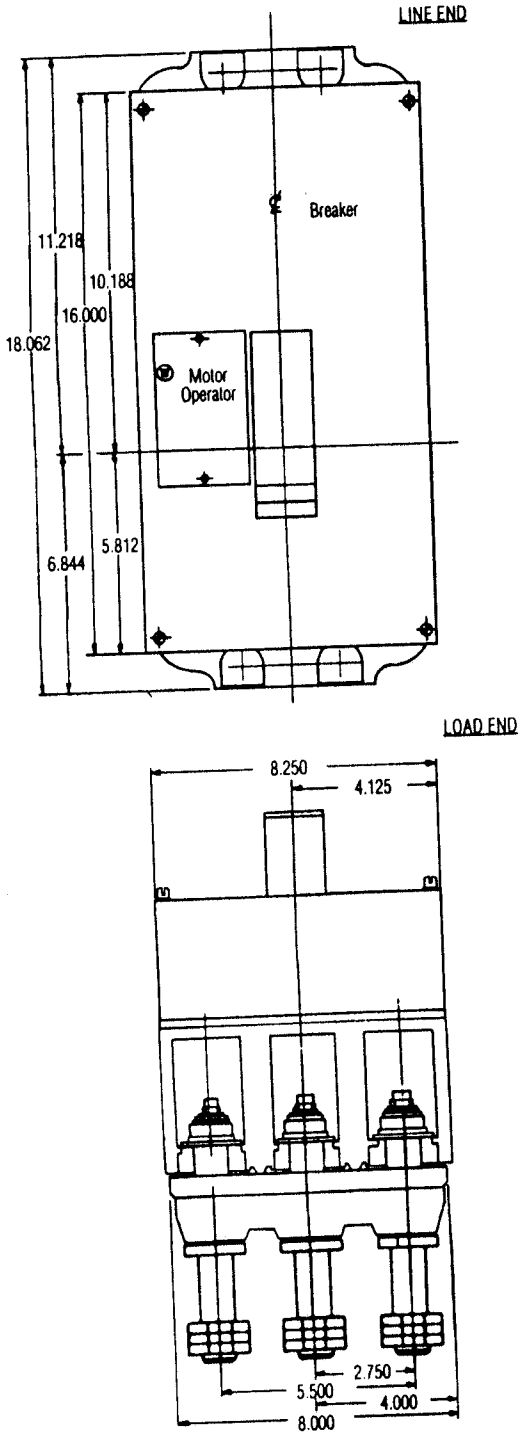


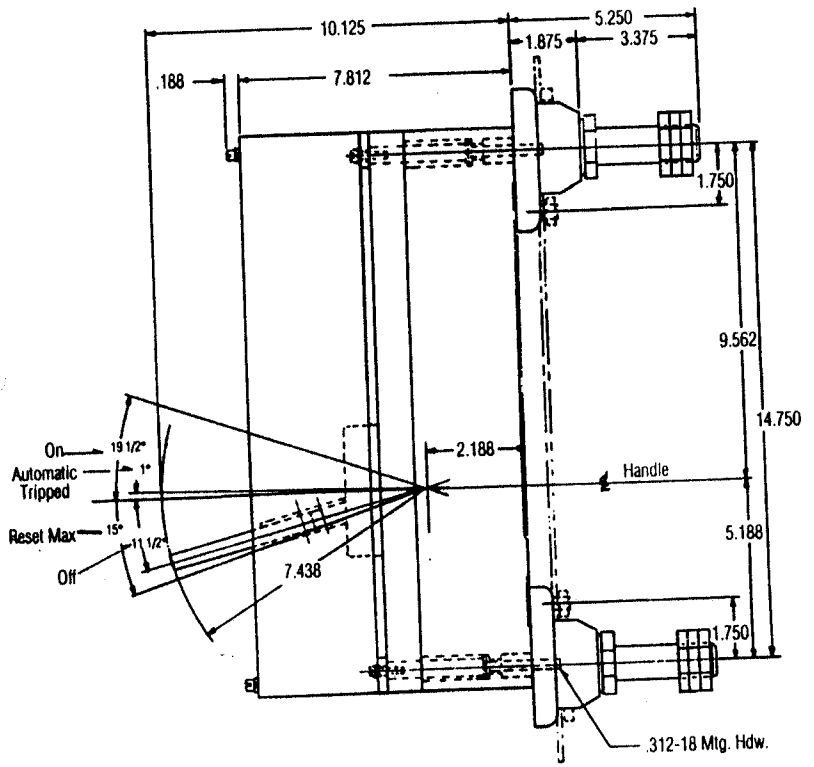

MOTOR OPERATOR

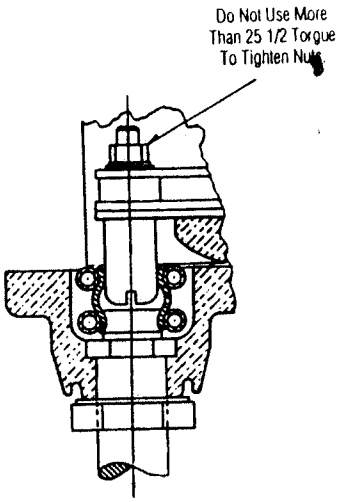


DRAWOUT STUD ASSY

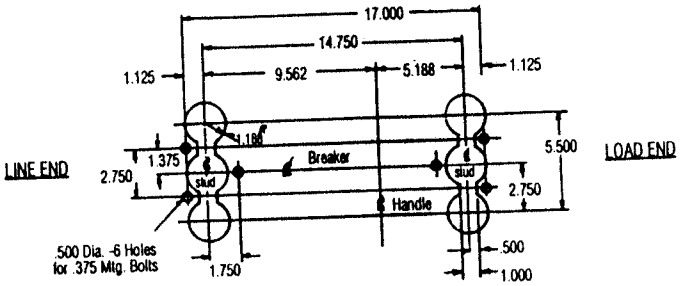


DRILLING PLAN FOR MOUNTING PANEL

FIGURE 1. Circuit Breaker type AQB-LL400, outline and mounting dimensions.


Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

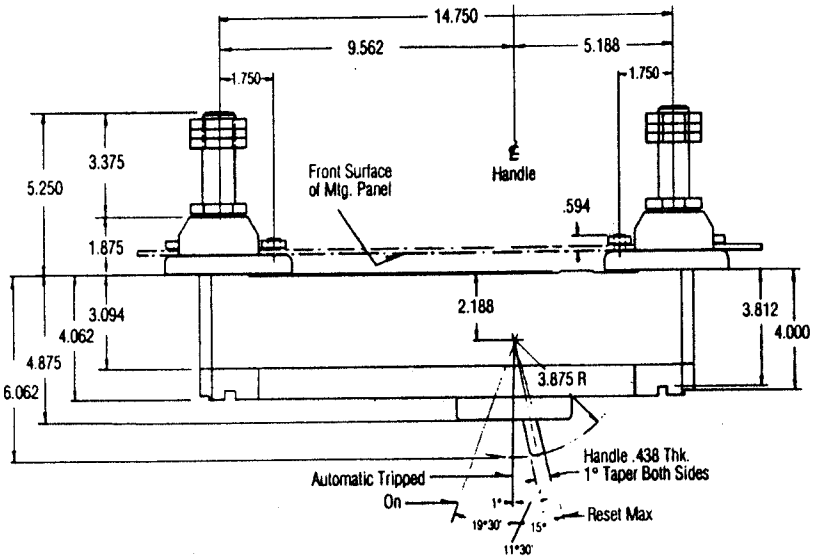




AQB Breaker with Overcurrent and Short Circuit Trip Protection


For 2-Pole Breakers Use Two Outside Poles

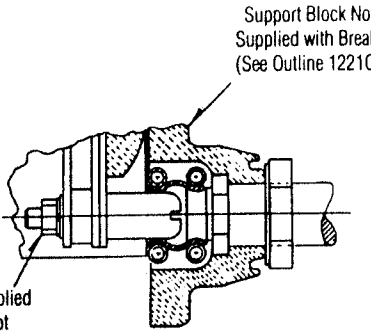



DRAWOUT STUD ASSEMBLY

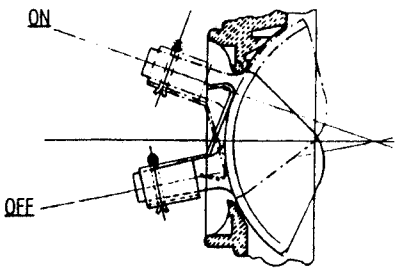

HANDLE LOCKING DEVICE
(not supplied with breaker)

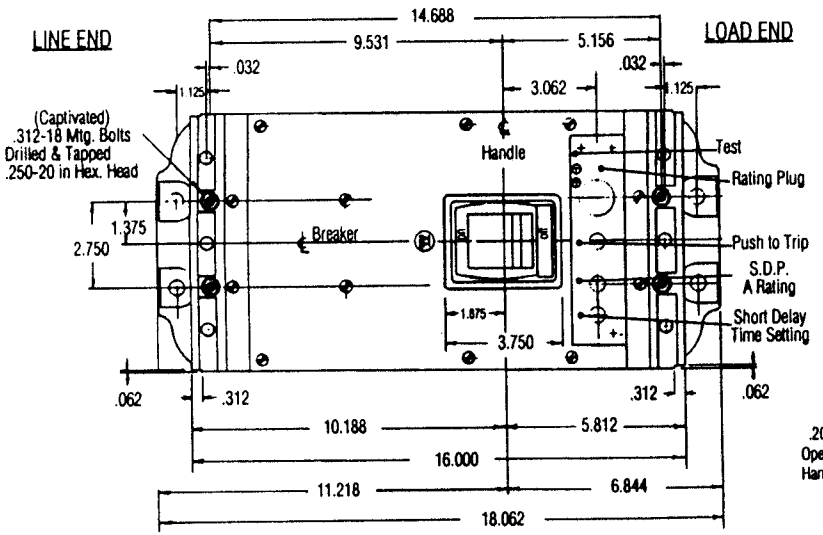

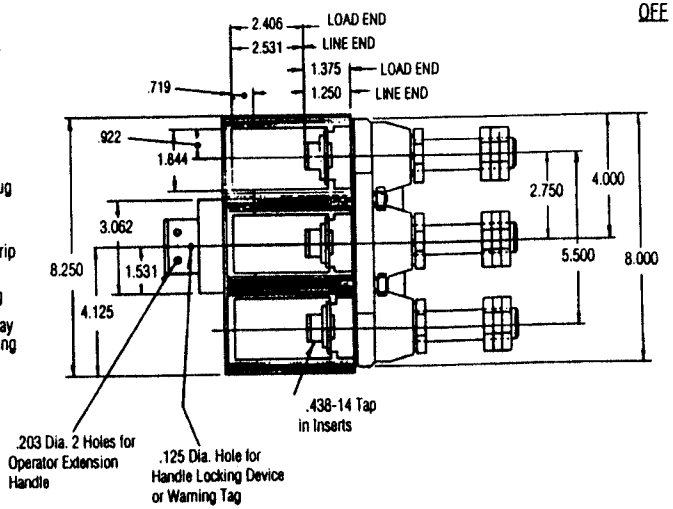

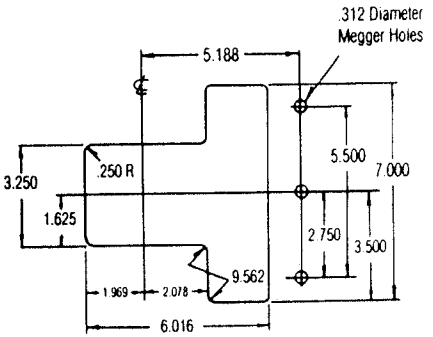


LOAD END FRONT COVER CUTOUT

NOTE: Dimensions 6.016, 3.500 and 7.000 may be omitted if it is desirable not to expose the trip unit adjustments and rating plug.

FIGURE 1. Circuit Breaker type AQB-LL400, outline and mounting dimensions - continued.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

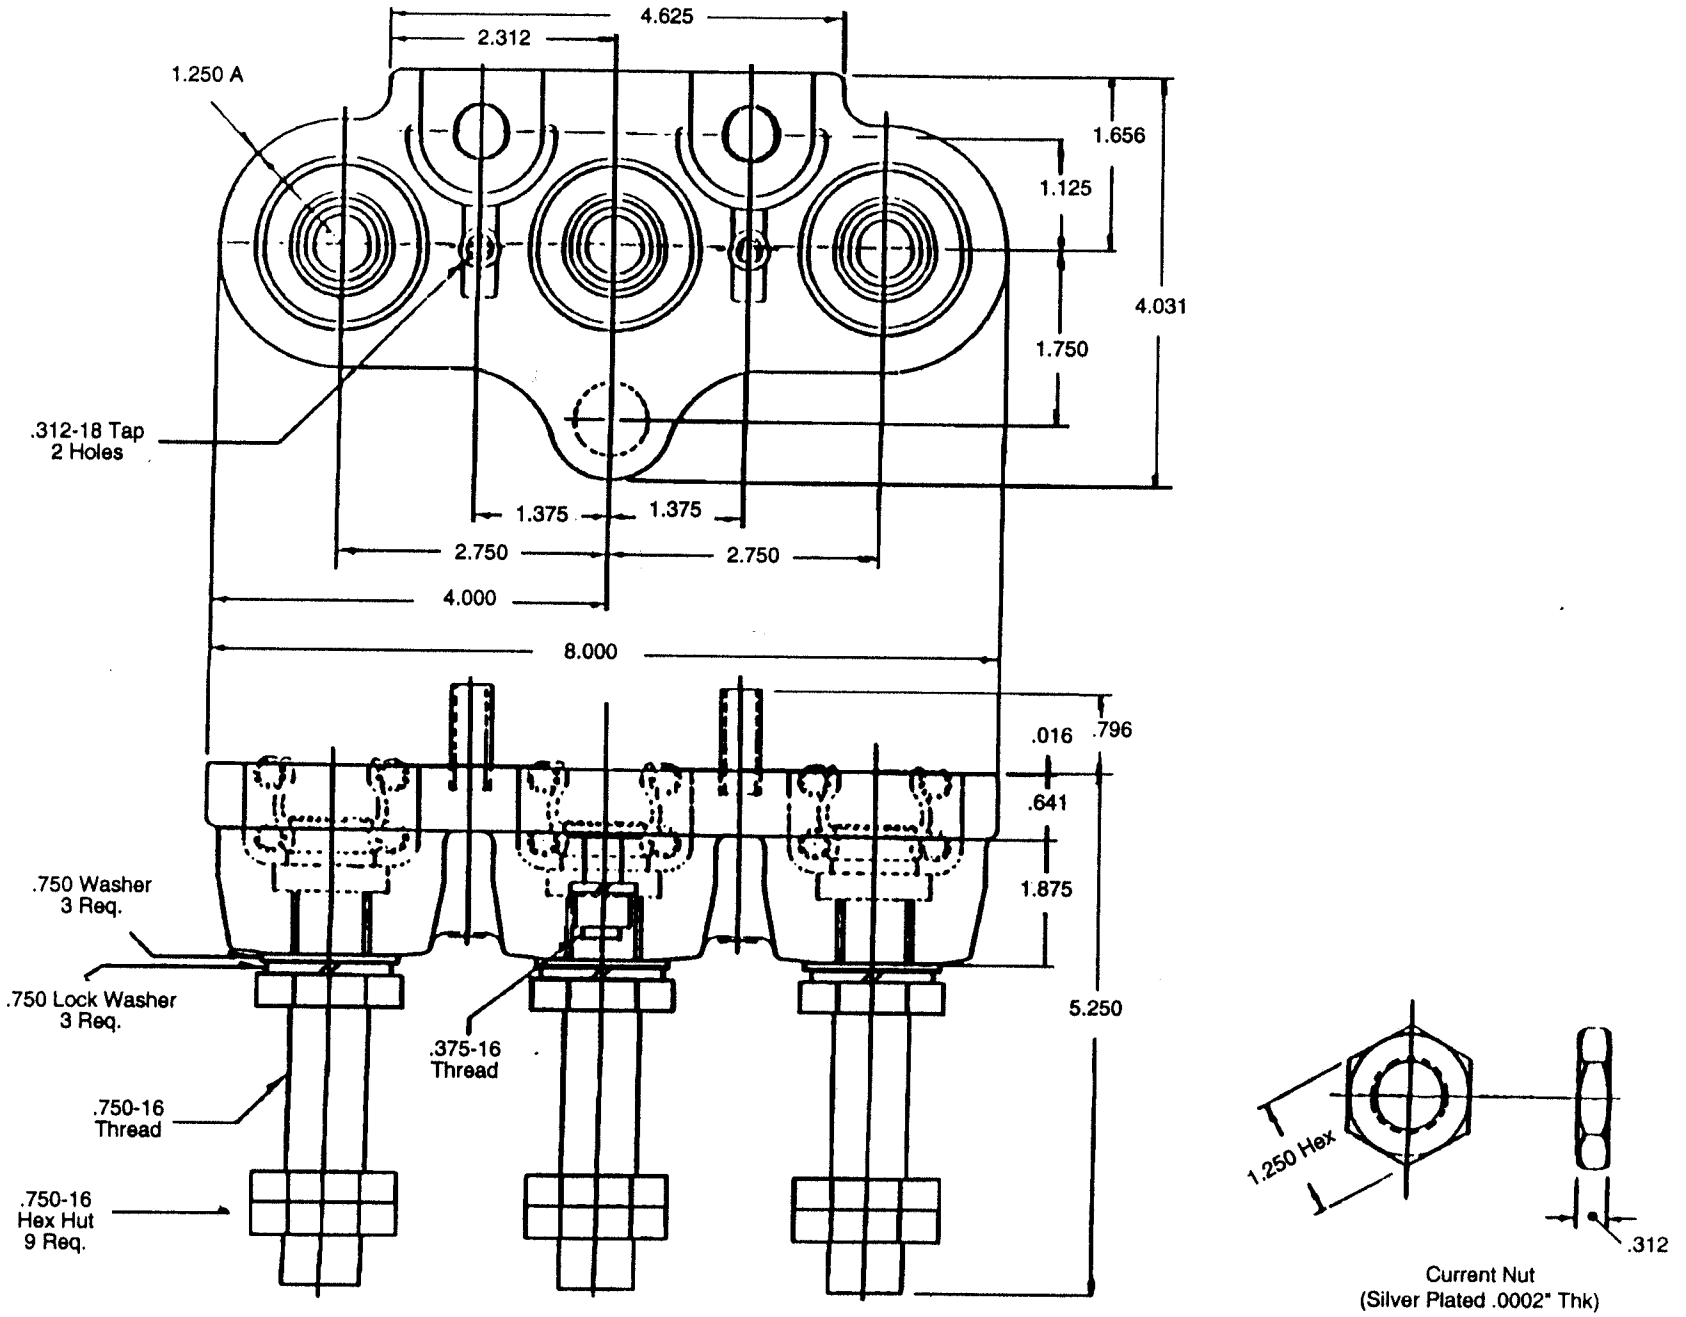

NOTE: All required hardware supplied.

FIGURE 2. Circuit Breaker type AQB-LL400, mounting block.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.



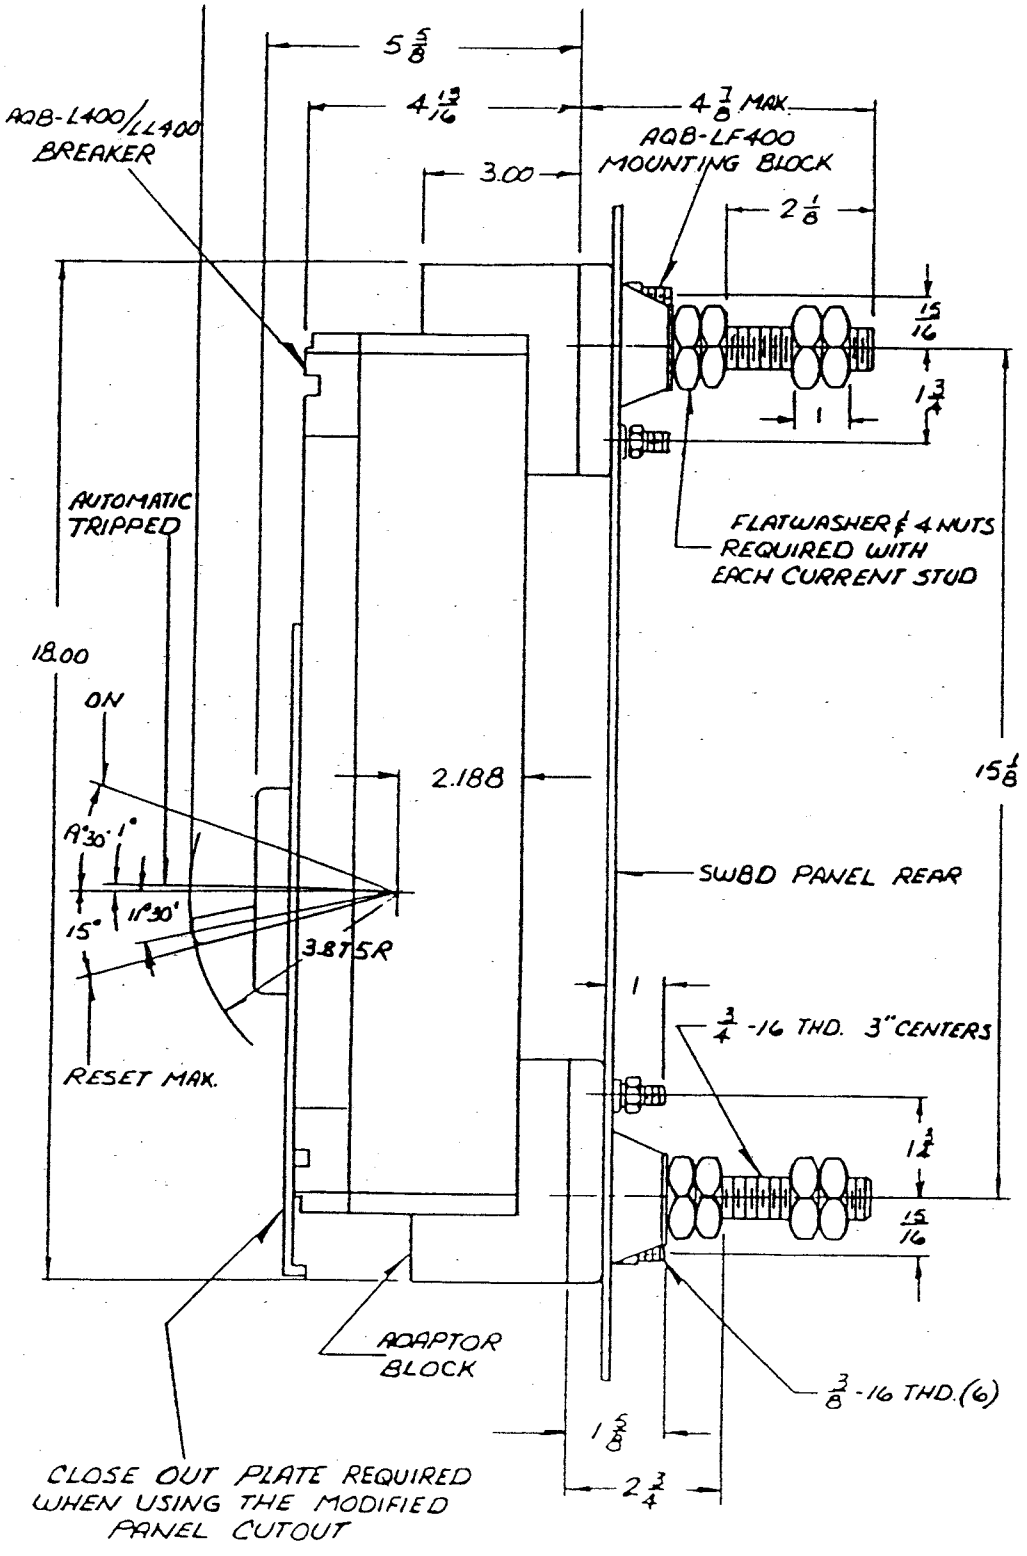


FIGURE 3. Sideview of breaker and mounting blocks, retrofit package.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

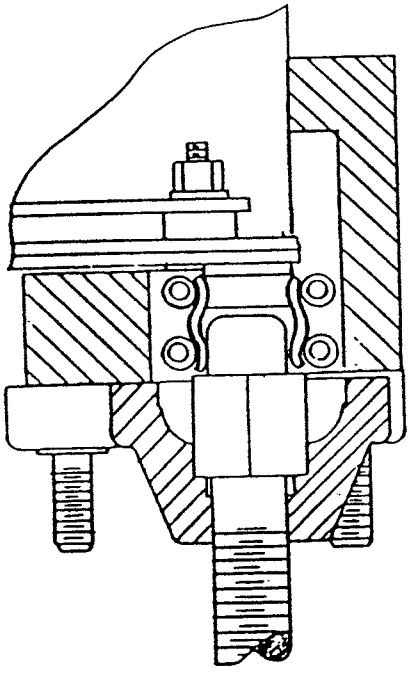

DRAWOUT STUD ASSY.

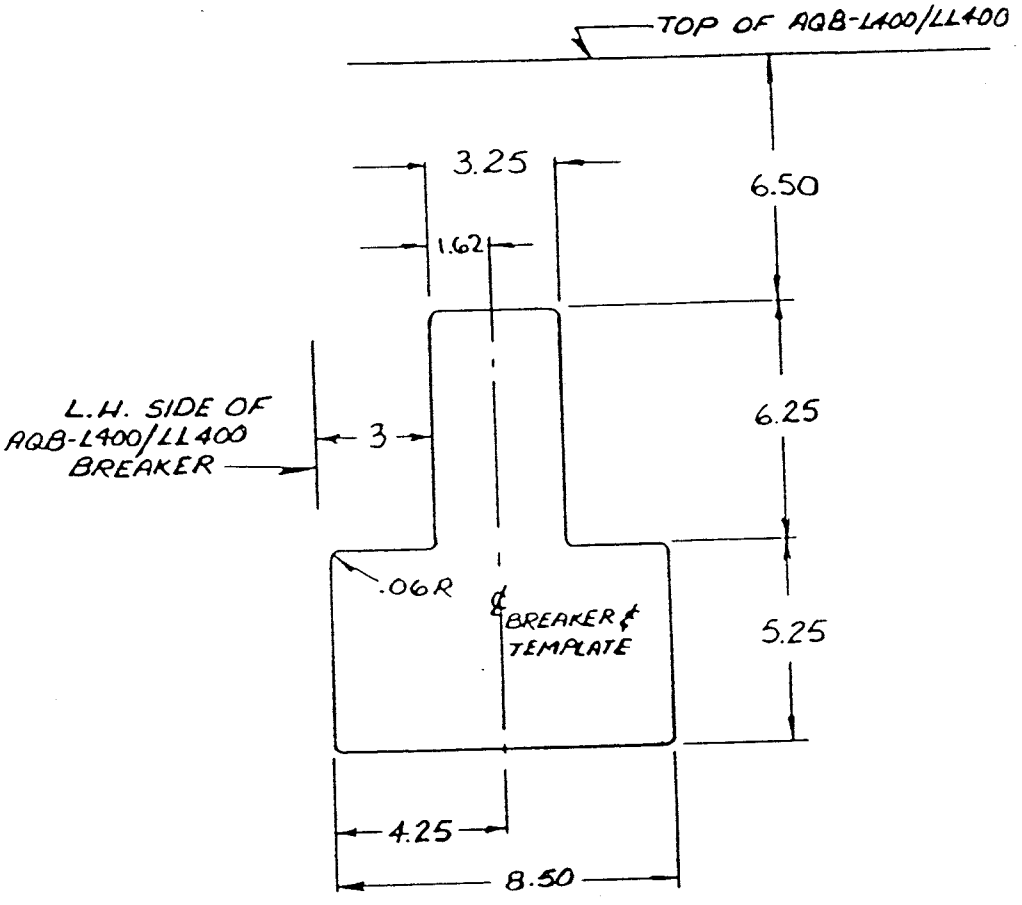

PANEL CUTOUT DIMENSIONS
USE WHEN REPLACING AQB-LF400 WITH AQB-L400/LL400 BREAKERS

FIGURE 4. Drawout stud assembly/panel cutout dimensions - retrofit package.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

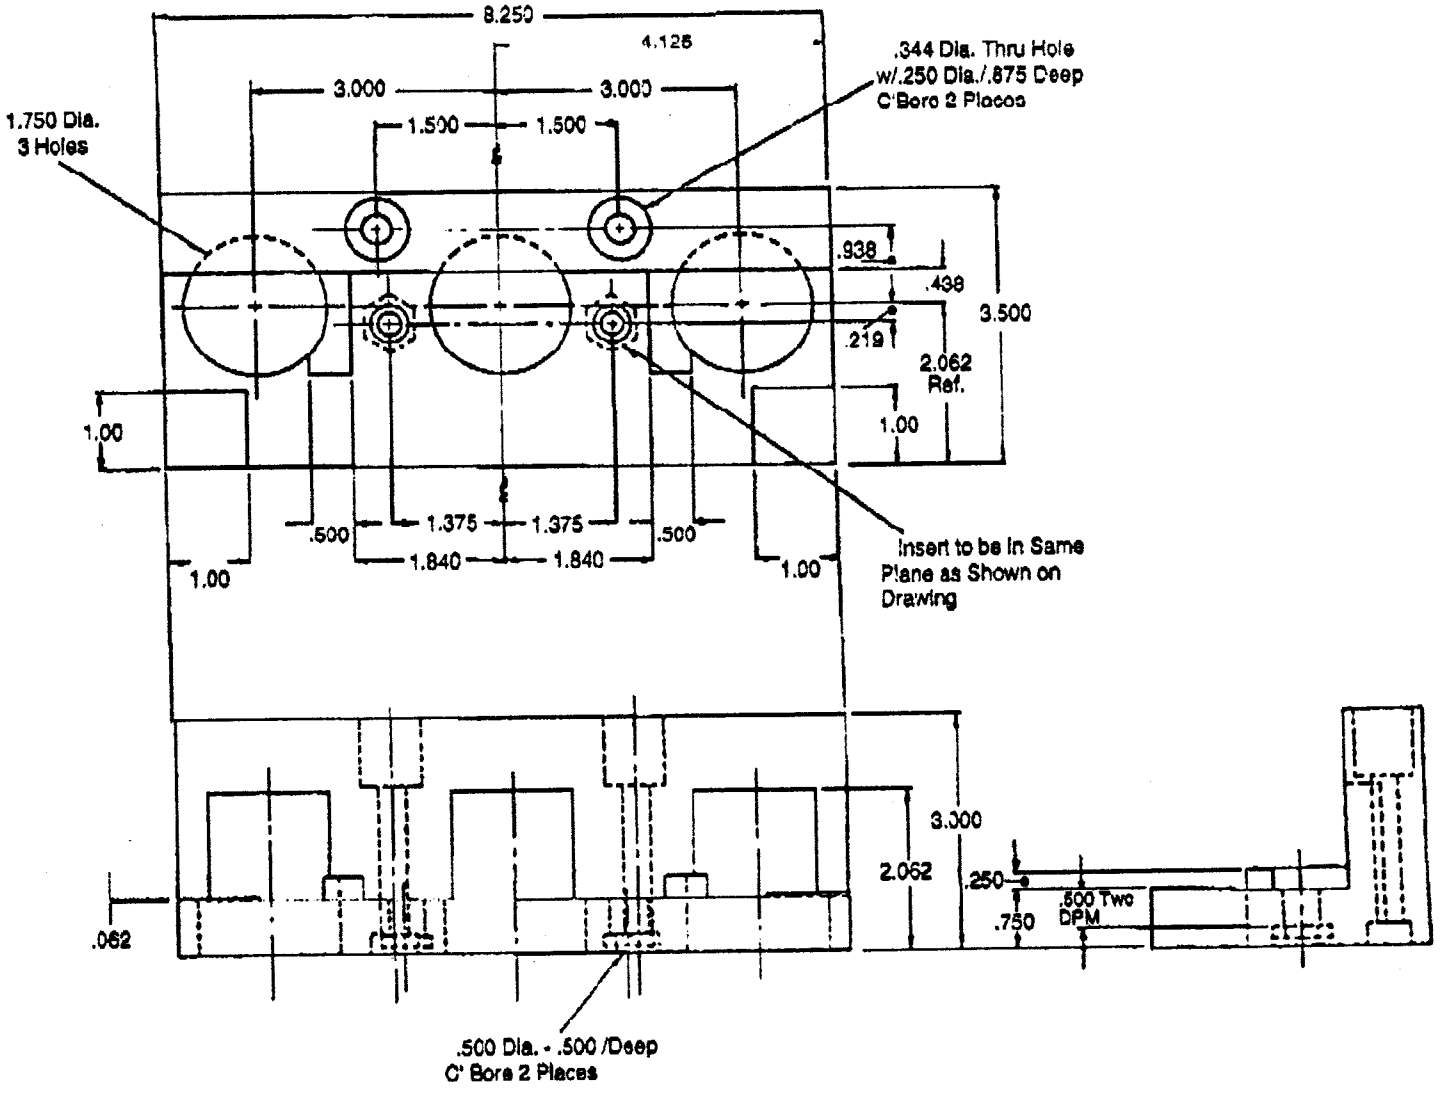


FIGURE 5. Adaptor block - retrofit package.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Dimensions: See figures 1 and 2.

Retrofit package: An alternate retrofit package may be supplied to meet the mounting requirements for an AQB-LF400. This retrofit package shall consist of 2 adaptor blocks, 6 terminal assemblies, and 1 close out plate. Refer to figures 3, 4, and 5.

Maximum rated continuous current: 400 amperes.

Voltage and frequency: 500 Vac, 60 Hz.

Interrupting rating: 100,000 amperes.

Peak let-through current: 45,000 amperes.

Trip unit: Interchangeable rating plug for continuous ampere trip. Adjustable short-time pickup and short-time delay on frame; short-time delay range is a function of rating plug type.

Trip unit rating (amperes): See table I.

Protection: LTD, STP, instantaneous and current limiting action within current limiting range.

LTD calibration: See table II.

Instantaneous calibration: See table I.

Short delay pickup: See table III.

(NOTE: The inherent impedance of the circuit breaker shall be sufficient to limit fault current.)

Current limiting fuse: Not applicable.

Type of connections: Back (removable mtg.).

Electric operator: Available.

Undervoltage trip or shunt trip: Either available. Excluding 28 Vdc shunt trip and 33 Vdc undervoltage.

(NOTE: 33 Vdc shall not be applicable for undervoltage tripping device.)

Auxiliary switch: Two (a) contacts; two (b) contacts.

Handle lock: Group 3. (Figure 1 of MIL-C-17361)

Handle boot: Not available.

Electrical test: The rate of operation shall be 5 operations per minute for a total of 4000 close-open operations.

Temperature rise tests: See table IV.

NOTE: NQB circuit breakers shall consist of an AQB type without trip unit and a modification kit of metallic parts.

Source: https://assist.dla.mil -- Downloaded: 20261O-18T10:02Z
Check the source to verify that this is the current version before use.

TABLE I. Instantaneous trip amperes and applicable rating plugs.

Frame type 1/	Interchangeable ampere rating plug types 1/	Instant pickup	Maximum time (seconds) 3/
AQB-LL400QS	250 Q 300 350 Q 400 Q	6300	0.032

1/ The suffix letters have the following denotations:
Q - electronic device trip devise.
S - frame type for special applications.
2/ Rating plugs of the same designation are the same.
3/ Confirmation for qualification test only, not for routine calibration. The tolerance for instantaneous pickup amperes shall not exceed plus or minus 10 percent.

TABLE II. Tripping characteristics - long-time delay.

LTD trip element percent current	Tripping time 60 Hz ac trip element
130	Not less than 1 hour
225	Less than 1 hour
600	Between 20 and 32 seconds

TABLE III. Adjustable short-time pickup and delay trip setting.

Complete breaker designation 1/	Short-time pickup (amps) 2/					Short-time delay	
	LO	#2	#3	#4	HI	Min.3/	Max.3/
AQB-LL250QS	3600	4100	4600	5200	5800	.043	.073
AQB-LL300QS	3600	4100	4600	5200	5800	.049	.091
AQB-LL350QS	3600	4100	4600	5200	5800	.055	.113
AQB-LL400QS	3600	4100	4600	5200	5800	.061	.138

1/ A complete breaker designation consists of a frame type plus an applicable rating plug type. For example: A type AQB-L350QS breaker consists of a type AQB-LL400QS frame, and a type 350Q rating plug; a type AQB-LL400QS breaker consists of a type AQB-LL400QS frame, and a type 400Q rating plug.
2/ Tolerances for each ampere setting shall not exceed plus or minus 10 percent.
3/ Maximum clearing times at the indicated settings, at the #3 short-time pickup setting. Confirmation for qualification test only.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

TABLE IV. Size of cable and bus bars for temperature rise tests.

Copper rating-amperes	Cable size	Copper bus size (inch)
400	Two AWG 000	1-1/2 x 1/8

Preparing activity:
Navy - SH
(Project 5925-N155)

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.