INCH-POUND

MIL-DTL-17361/10B(SH)
19 September 2006

SUPERSEDING
MIL-C-17361/10A(SH)
17 August 1994

DETAIL SPECIFICATION SHEET

CIRCUIT BREAKERS, AIR, ELECTRIC, INSULATED HOUSING (SHIPBOARD USE) TYPE AQB-LL400 QS

This specification is approved for use by the Naval Sea Systems Command and is available for use by all Departments and Agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and MIL-DTL-17361.

LIST OF TABLES

TABLE I. Requirements. 2
TABLE II. Instantaneous trip amperes and applicable rating plugs. 2
TABLE III. Tripping characteristics – long-time delay (LTD). 3
TABLE IV. Adjustable short-time pickup and delay trip settings. 3
TABLE V. Test requirements. 3

LIST OF FIGURES

FIGURE 1. Circuit breaker type AQB-LL400, outline and mounting dimensions. 4
FIGURE 2. Circuit breaker type AQB-LL400, mounting block. 6
FIGURE 3. Side view of circuit breaker and mounting blocks – retrofit package. 7
FIGURE 4. Drawout stud assembly/panel cutout dimensions – retrofit package. 8
FIGURE 5. Adaptor block – retrofit package. 9
FIGURE 6. Circuit breaker type AQB-L400QS with 250-amp rating plug time-current response. 10
FIGURE 7. Circuit breaker type AQB-L400QS with 300-amp rating plug time-current response. 11
FIGURE 8. Circuit breaker type AQB-L400QS with 350-amp rating plug time-current response. 12
FIGURE 9. Circuit breaker type AQB-L400QS with 400-amp rating plug time-current response. 13

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

TABLE I. Requirements.

Retrofit package	An alternate retrofit package may be supplied to meet the mounting requirements for an AQB-LF400. This retrofit package shall consist of 2 adaptor blocks, 6 terminal assemblies, and 1 close out plate. Refer to Figures 3, 4, and 5.
Maximum rated continuous current	400 amperes
Voltage and frequency	500 VAC, 60 Hz
Interrupting rating	100,000 amperes
Peak let-through current	45,000 amperes
Trip unit	Interchangeable rating plug for continuous ampere rating. Adjustable short-time pickup and short-time delay (STD) on frame; STD range is a function of rating plug type.
Current limiting fuses	Not applicable
Type of connections	Back (removable mtg.)
Electric operator	Available
Undervoltage trip or shunt trip	Either available. Excluding 28 VDC shunt trip and 33 VDC undervoltage. (Note: 33 VDC shall not be applicable for undervoltage tripping device.)
Auxiliary switch	Two (a) contacts; two (b) contacts
Handle lock	Group 3 (Figure 1 of MIL-DTL-17361)
Handle boot	Not available

TABLE II. Instantaneous trip amperes and applicable rating plugs.

Frame type /1	**Interchangeable ampere rating plug types /2**	**Instant pickup**	**Maximum time (seconds) /3**
AQB-LL400QS	250 Q 300 350 Q 400 Q	6300	0.032

NOTES:

/1 The suffix letters have the following denotations:
Q – electronic device trip device.
S – frame type for special applications.

/2 Rating plugs of the same designation are the same.

/3 Confirmation for qualification test only, not for routine calibration. The tolerance for instantaneous pickup amperes shall not exceed ±10%.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

TABLE III. Tripping characteristics – long-time delay (LTD).

Current as multiple of trip element rating	Tripping time 60-Hz AC trip element
1.30	Not less than 1 hour
2.25	Less than 1 hour
6.00	Between 20 and 32 seconds

TABLE IV. Adjustable short-time pickup and delay trip settings.

Complete circuit breaker designation /1	Short-time pickup (amp) /2					STD	
	LO	#2	#3	#4	HI	Min. /3	Max. /3
AQB-LL250QS	3600	4100	4600	5200	5800	0.043	0.073
AQB-LL300QS	3600	4100	4600	5200	5800	0.049	0.091
AQB-LL350QS	3600	4100	4600	5200	5800	0.055	0.113
AQB-LL400QS	3600	4100	4600	5200	5800	0.061	0.138

NOTES:

/1 A complete circuit breaker designation consists of a frame type plus an applicable rating plug type. For example: A type AQB-L350QS circuit breaker consists of a type AQB-LL400QS frame and a type 350Q rating plug; a type AQB-LL400QS circuit breaker consists of a type AQB-LL400QS frame and a type 400Q rating plug.

/2 Tolerances for each ampere setting shall not exceed ±10%.

/3 Maximum clearing times at the indicated settings, at the #3 short-time pickup setting. Confirmation for qualification test only.

TABLE V. Test requirements.

Electrical endurance test	The rate of operation shall be 5 operations per minute for a total of 4000 close-open operations.		
Temperature rise tests	Size of cable and bus bars for temperature rise tests		
	Copper rating-amperes	Cable size	Copper bus size (inch)
	400	Two (2) AWG 000	1-1/2 x 1/8

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

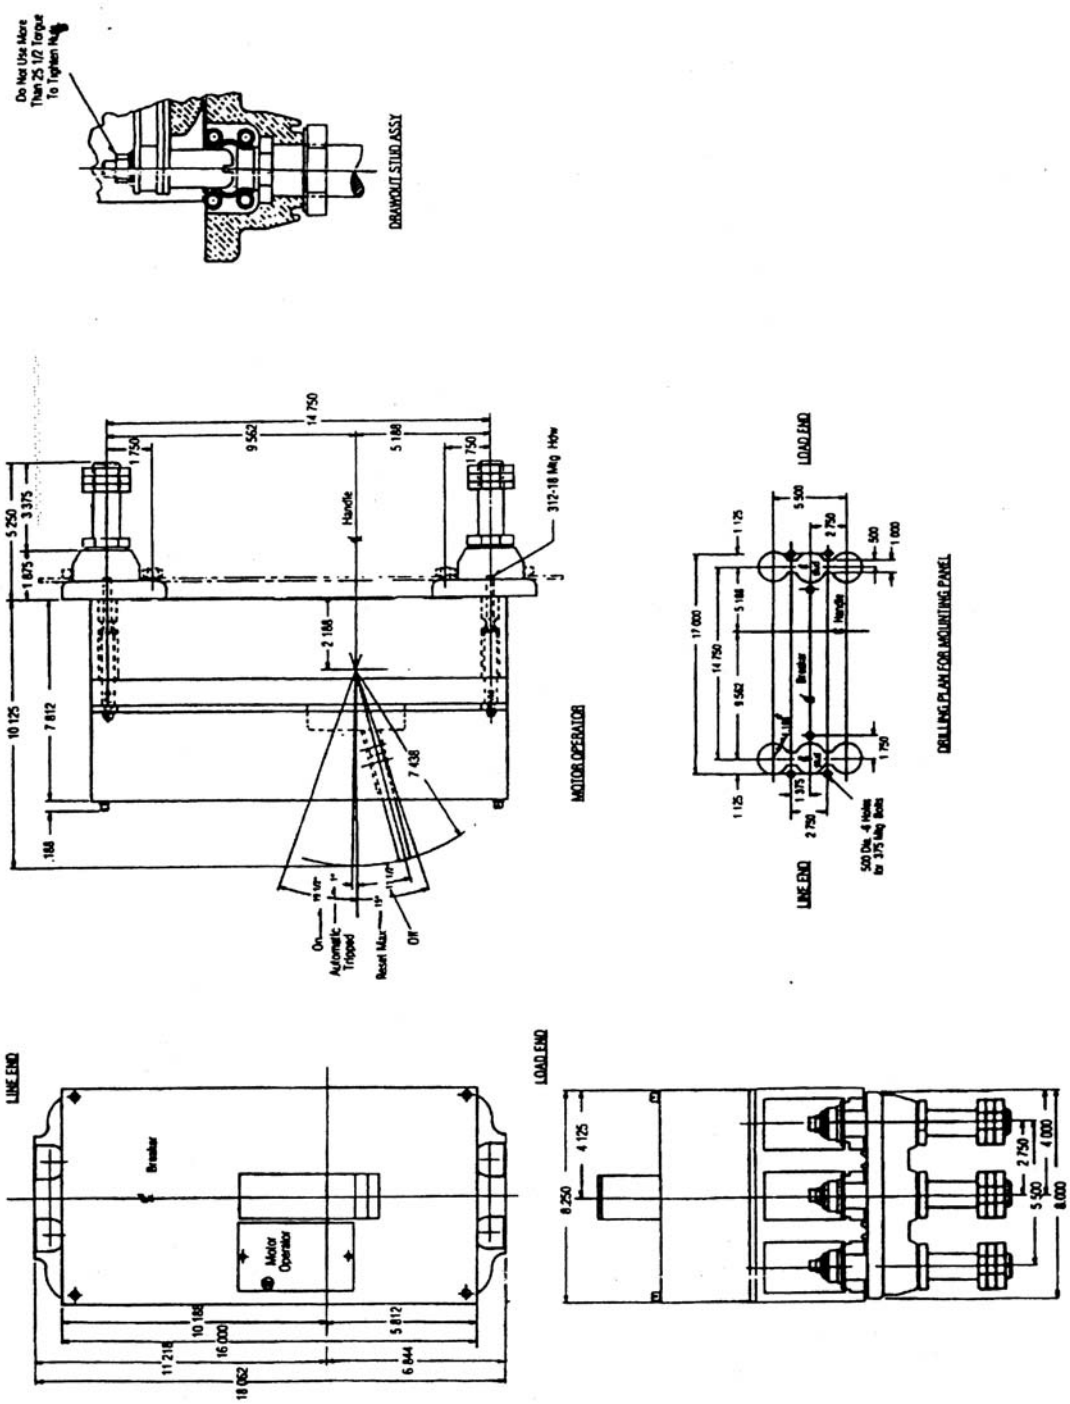


FIGURE 1. Circuit breaker type AQB-LL400, outline and mounting dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

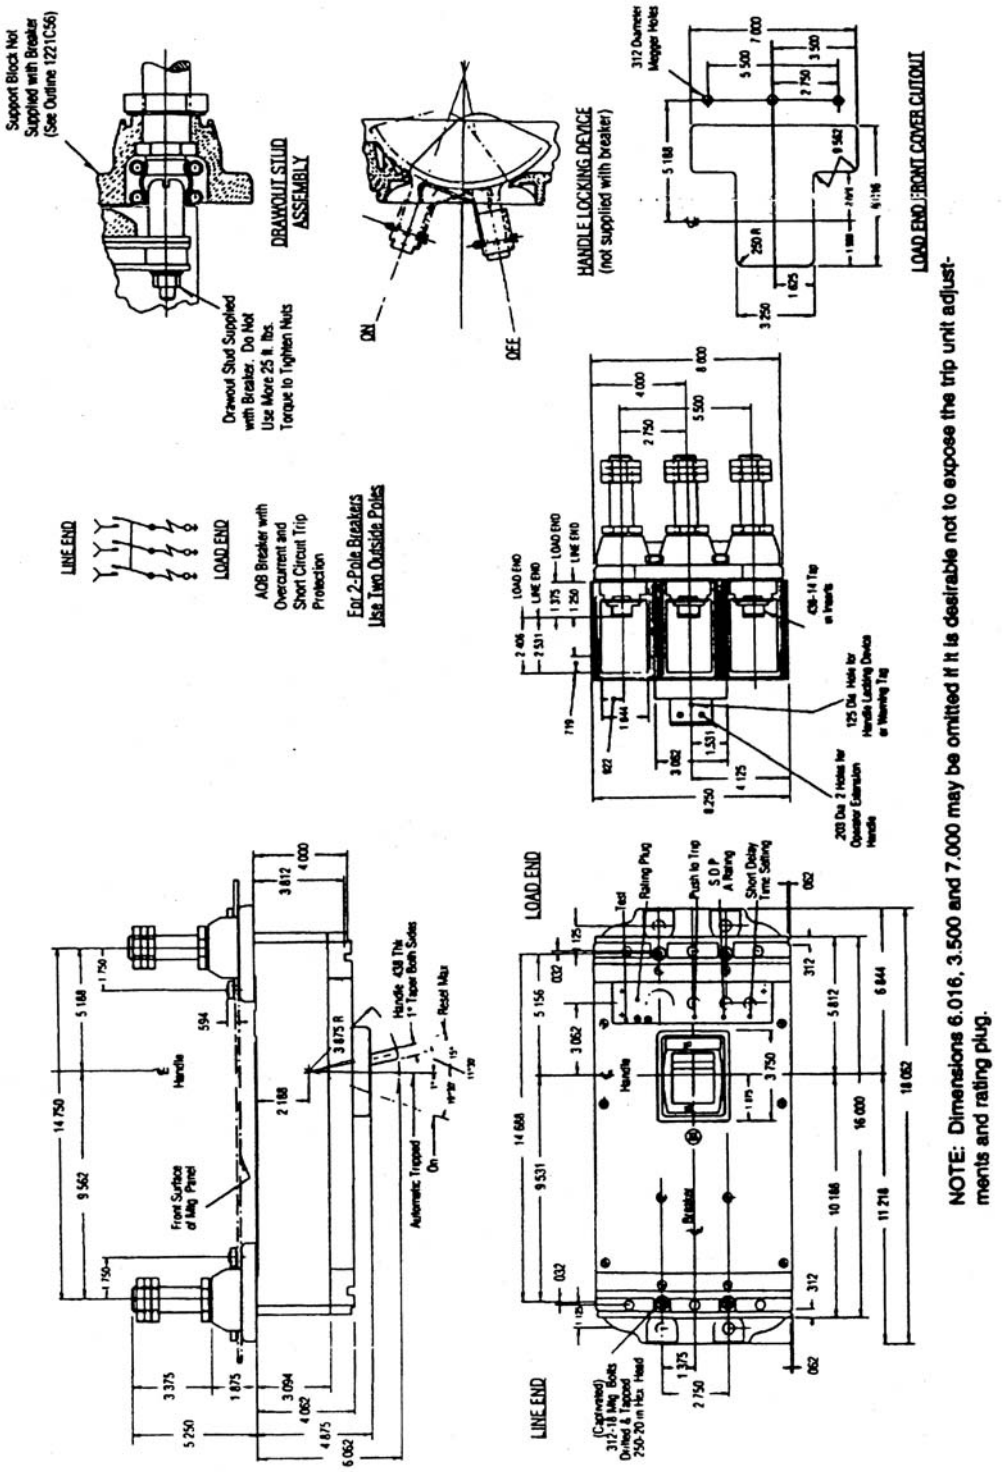


FIGURE 1. Circuit breaker type AQB-LL400, outline and mounting dimensions - Continued.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

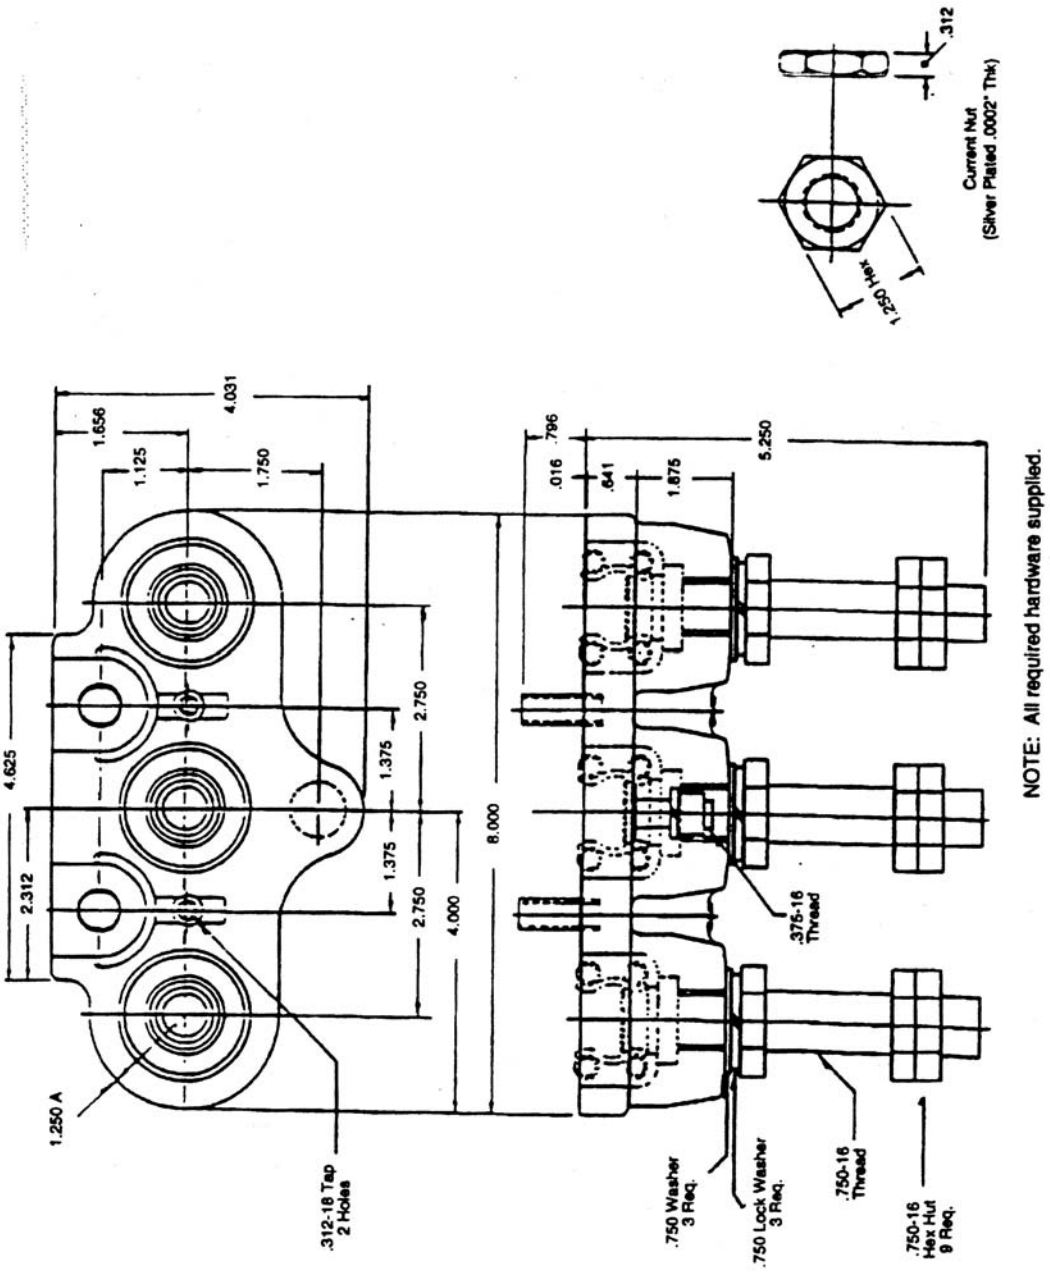


FIGURE 2. Circuit breaker type AQB-LL400, mounting block.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

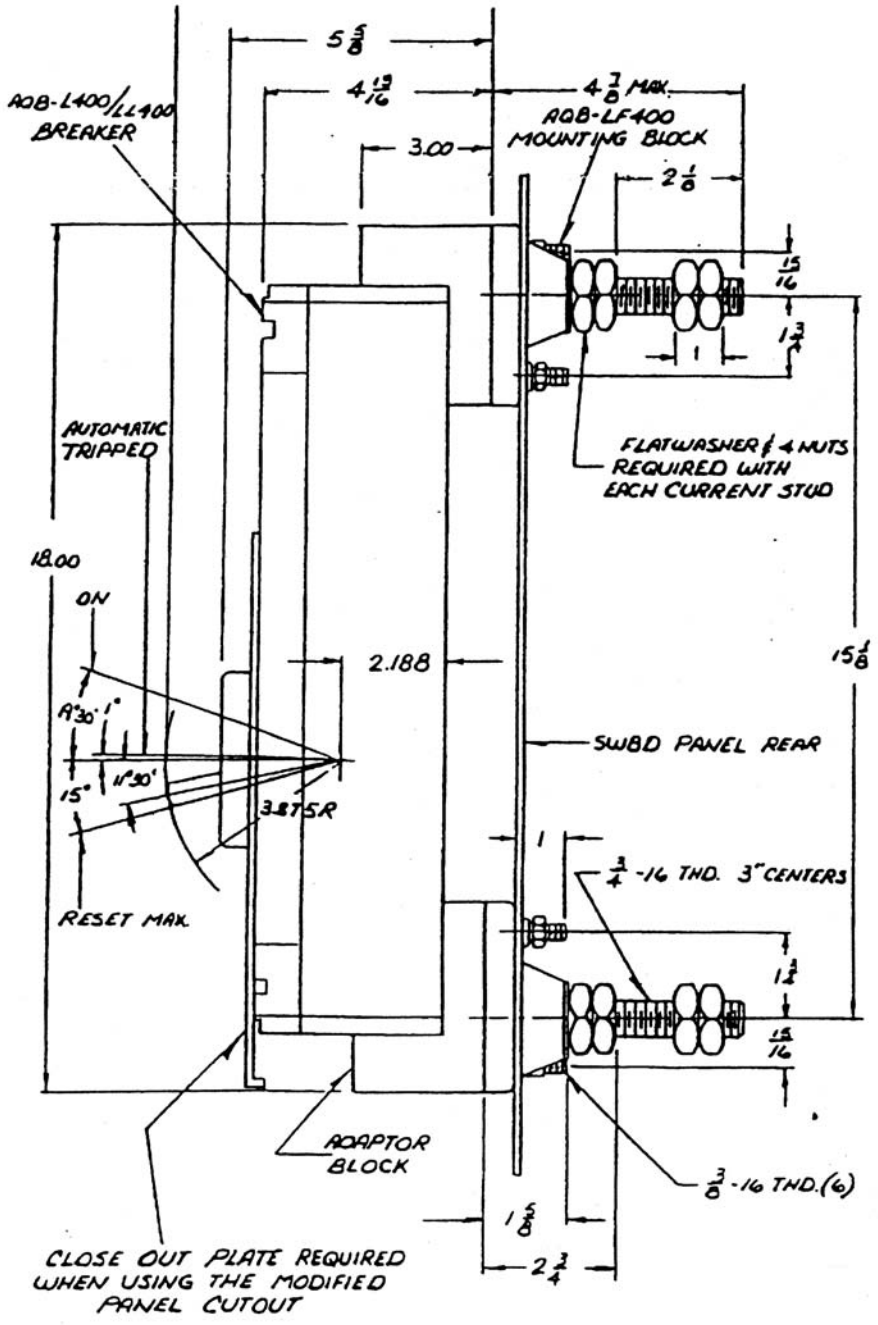


FIGURE 3. Side view of circuit breaker and mounting blocks – retrofit package.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

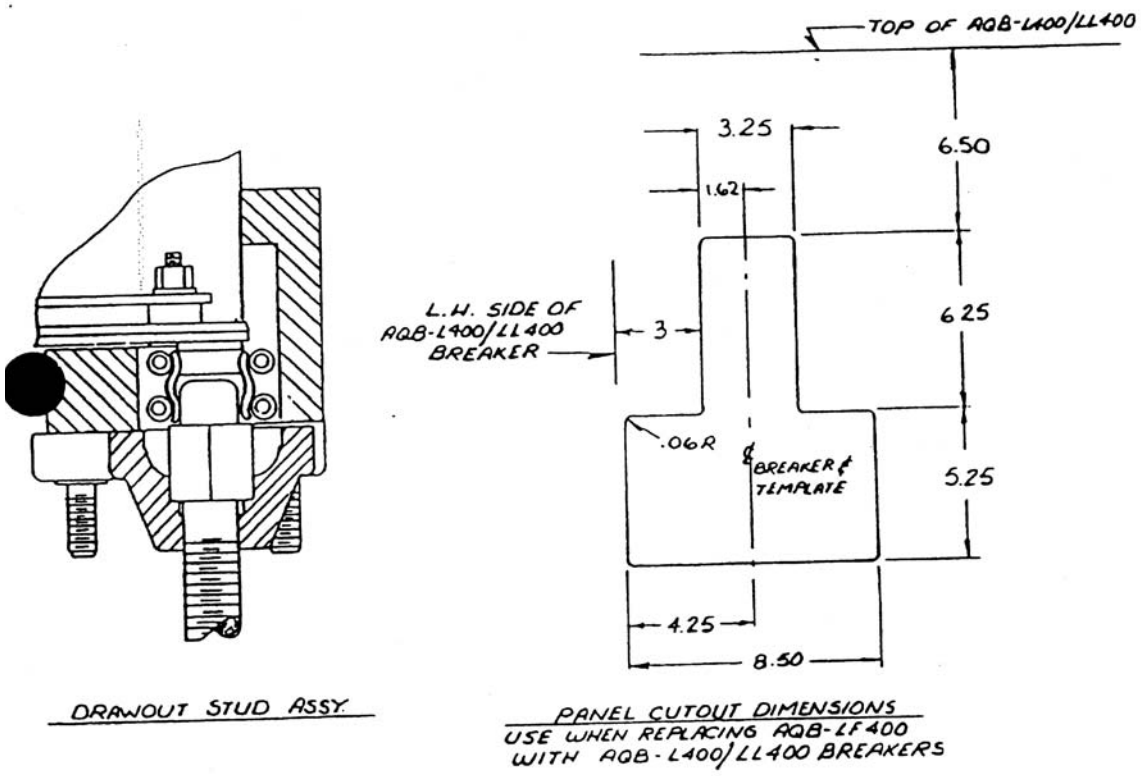


FIGURE 4. Drawout stud assembly/panel cutout dimensions – retrofit package.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

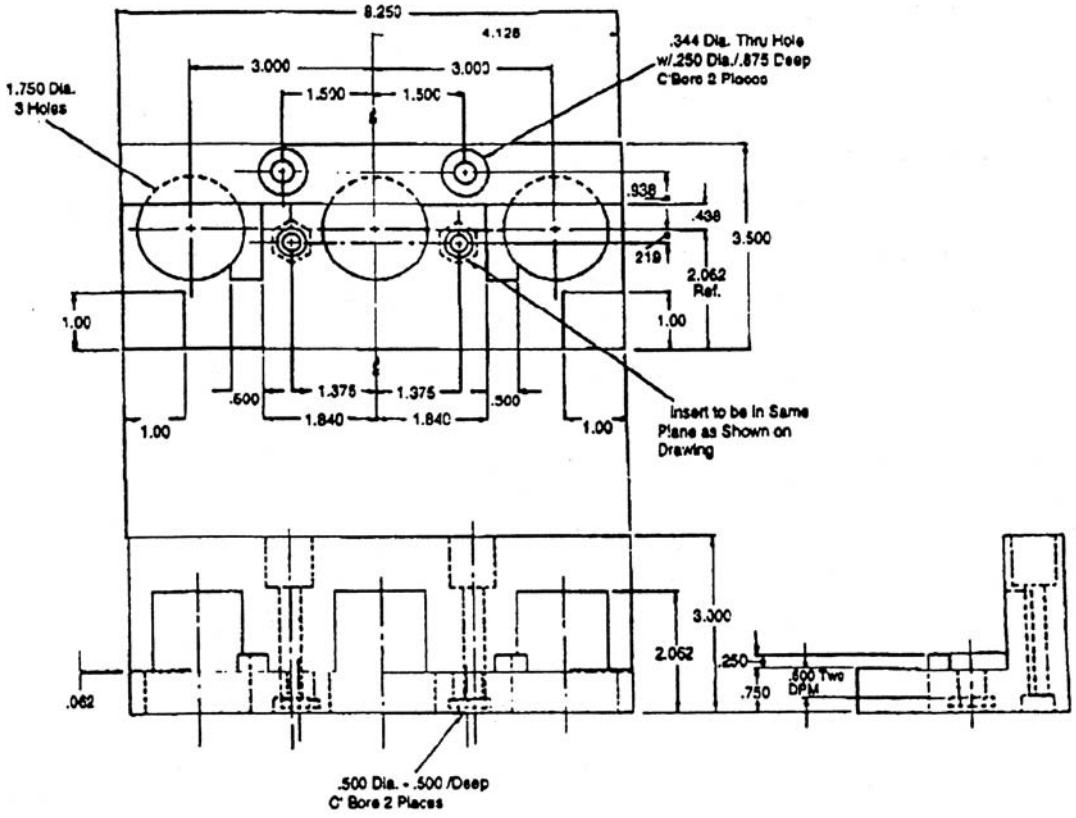


FIGURE 5. Adaptor block – retrofit package.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

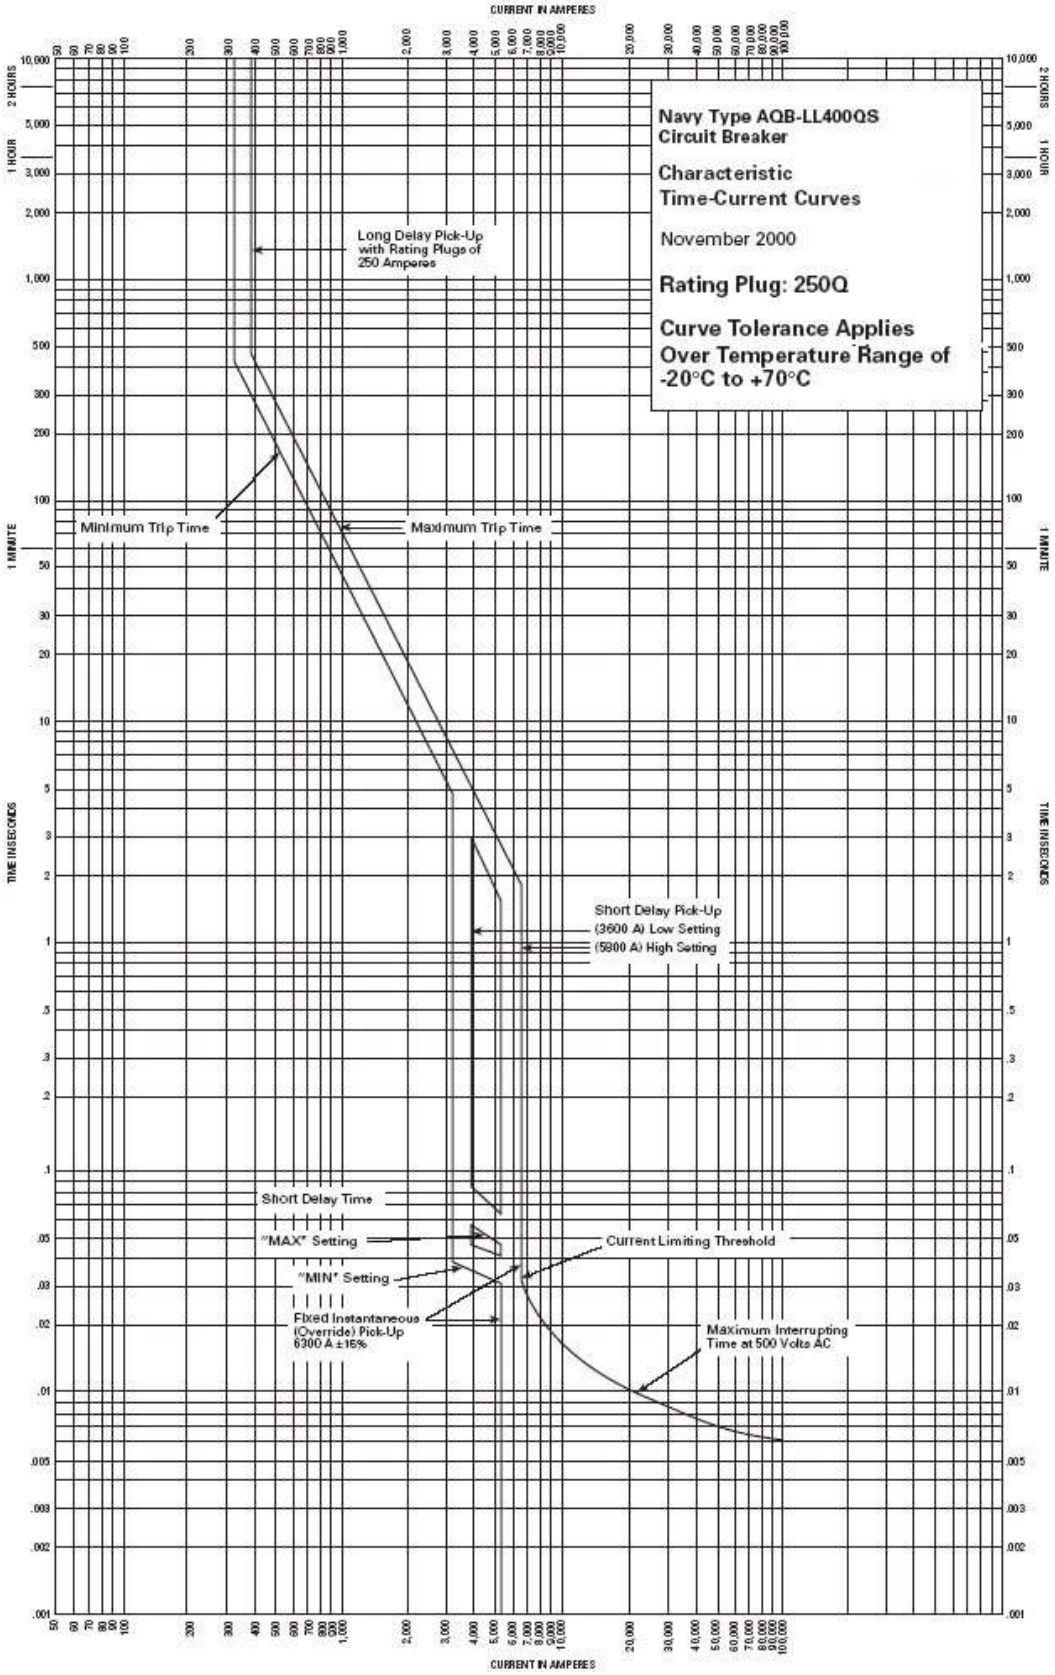


FIGURE 6. Circuit breaker type AQB-L400QS with 250-amp rating plug time-current response.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

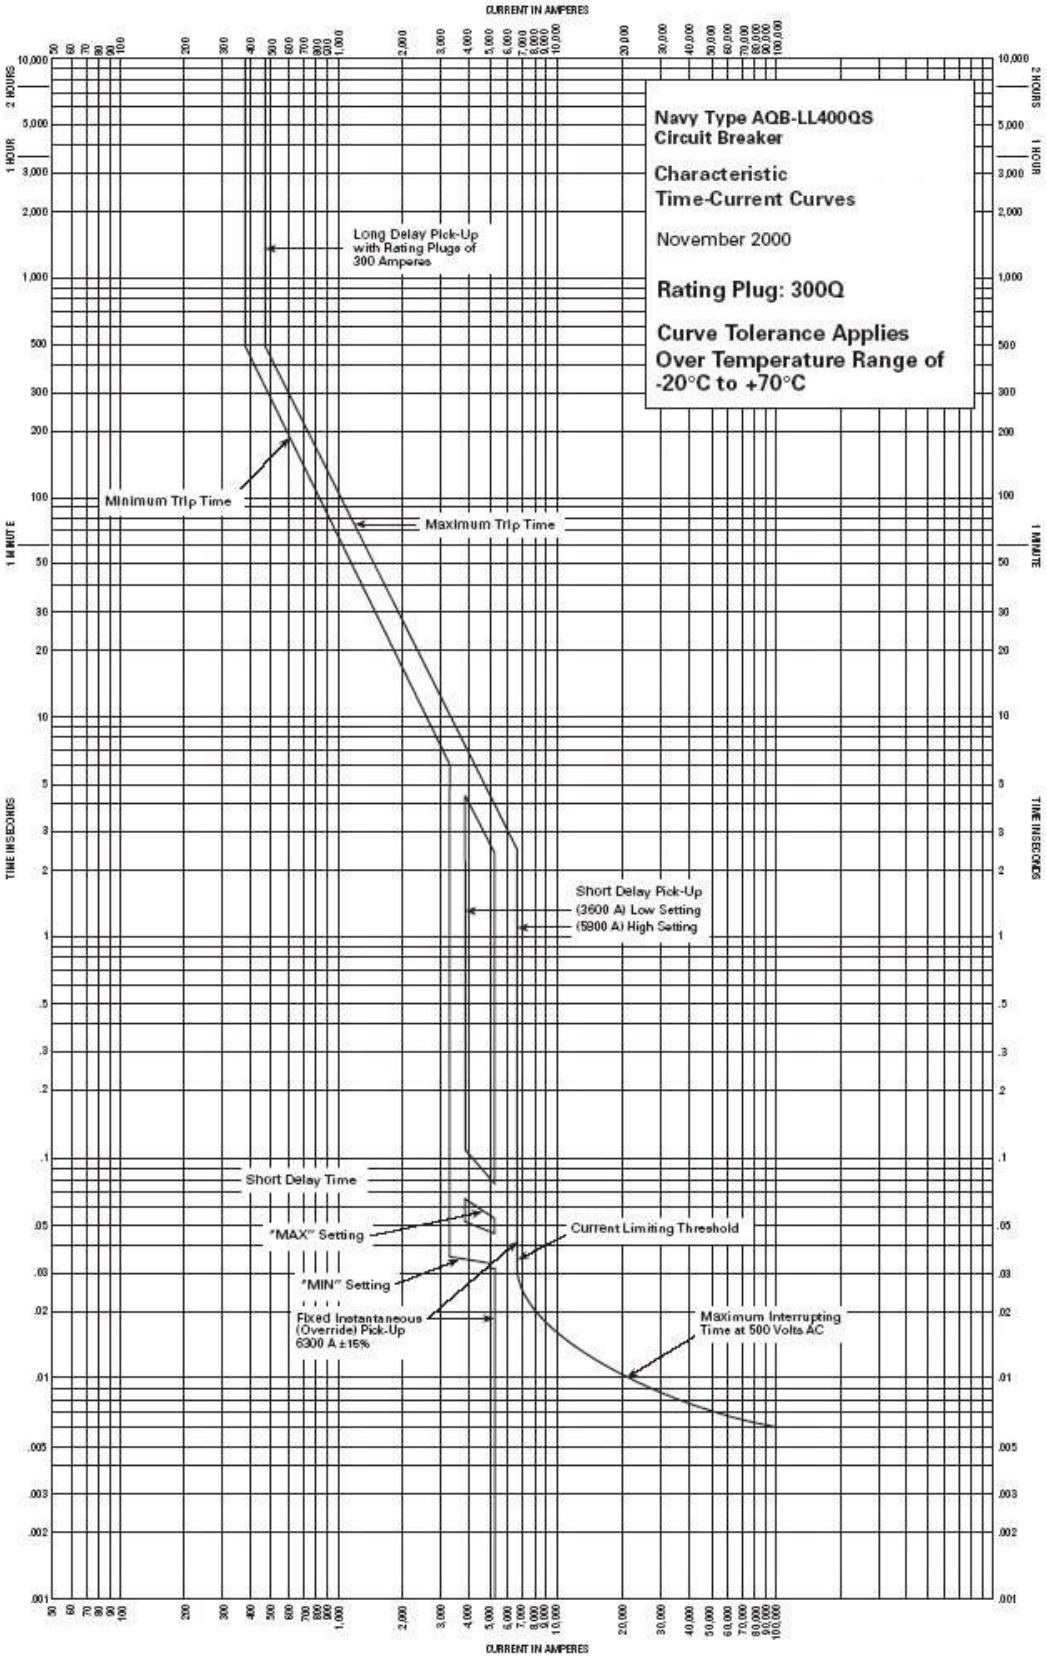


FIGURE 7. Circuit breaker type AQB-L400QS with 300-amp rating plug time-current response.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

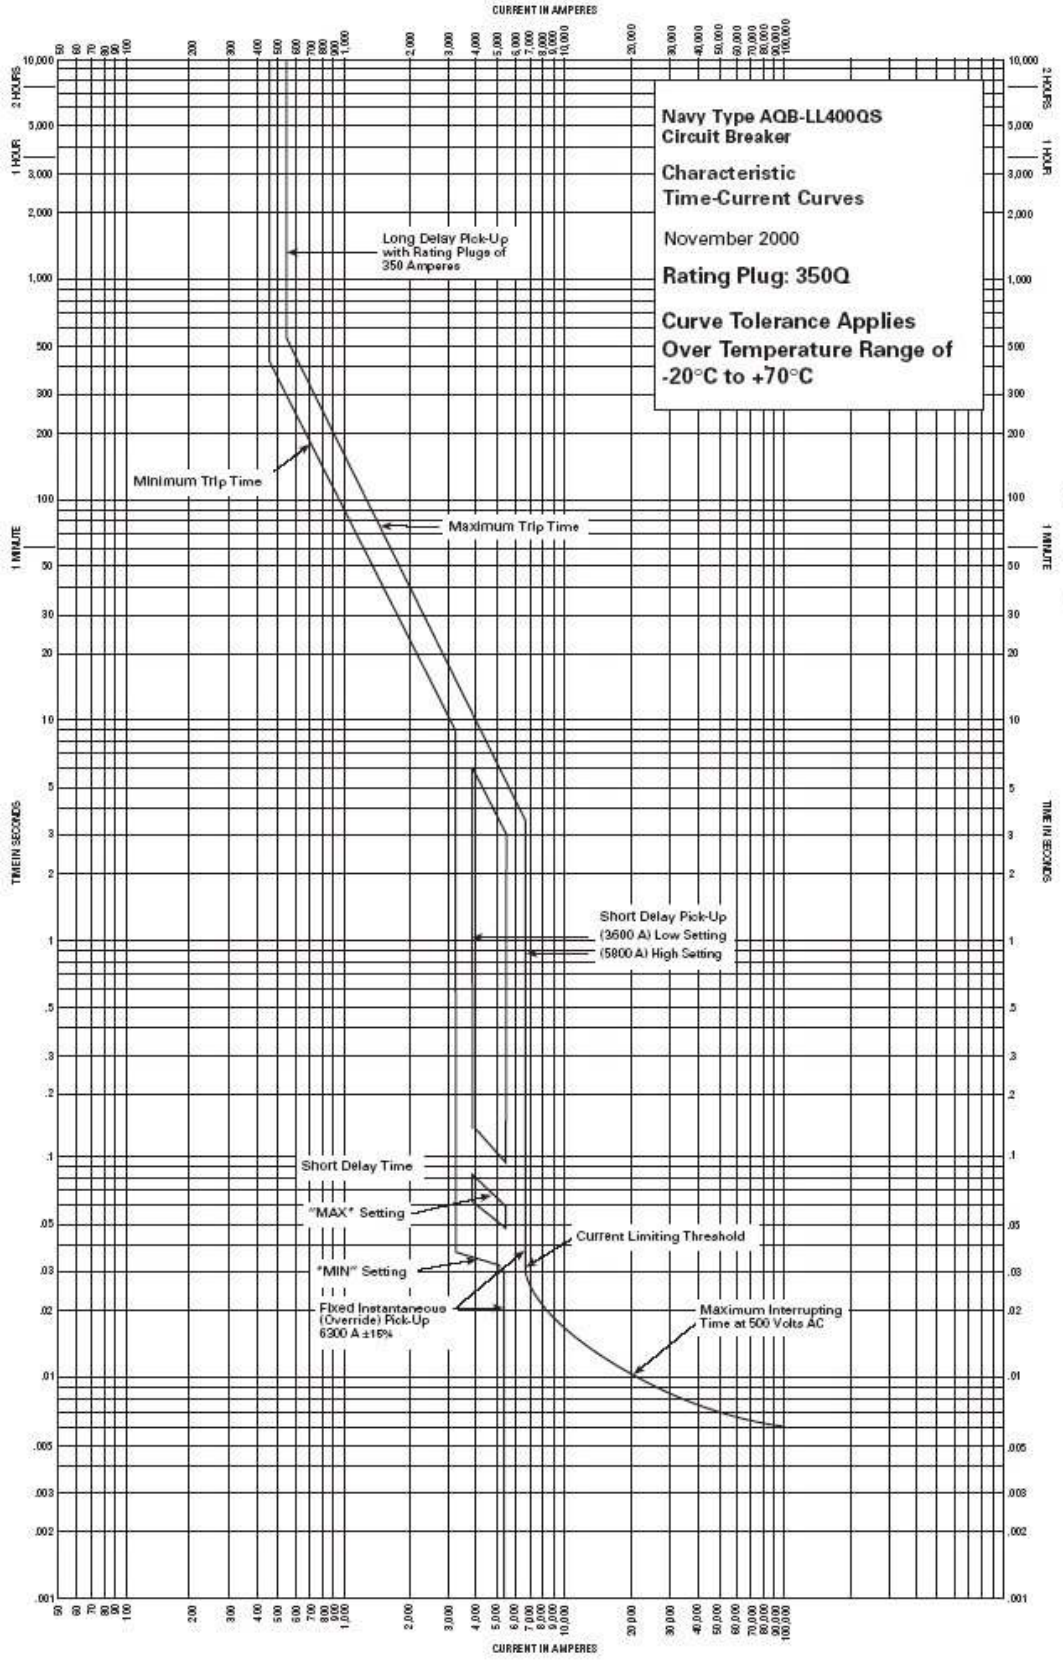


FIGURE 8. Circuit breaker type AQB-L400QS with 350-amp rating plug time-current response.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

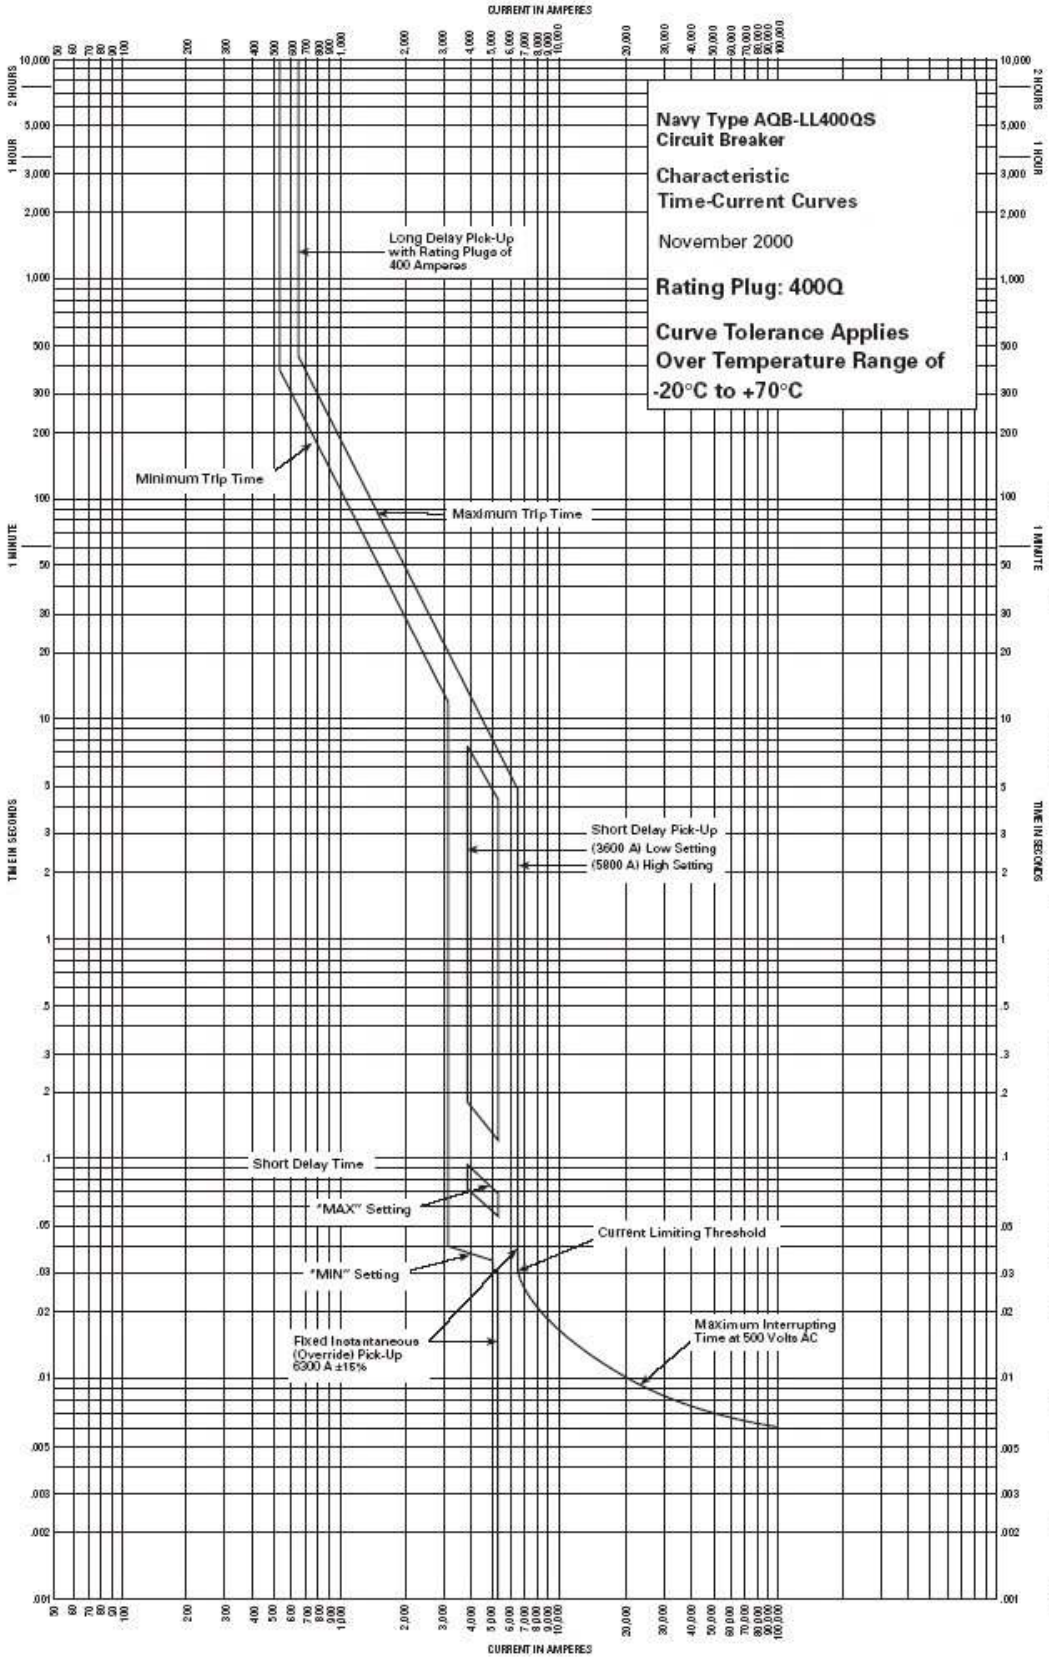


FIGURE 9. Circuit breaker type AQB-L400QS with 400-amp rating plug time-current response.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

CHANGES FROM PREVIOUS ISSUE: Marginal notations are not used in this revision to identify changes with respect to the previous issue due to the extent of the changes.

Preparing Activity:
Navy – SH
(Project 5925-N185-010)

NOTE: The activities listed above were interested in this document as of the date of this document. Since organizations and responsibilities can change, you should verify the currency of the information above using the ASSIST Online database at http://assist.daps.dla.mil.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.