INCH-POUND
MIL-C-17361/12A(SH)
13 March 1995
SUPERSEDING
MIL-C-17361/12(SH)
10 March 1989

MILITARY SPECIFICATION SHEET


CIRCUIT BREAKERS, AIR, ELECTRIC, INSULATED HOUSING (SHIPBOARD USE) TYPE AQB - A800, AQB - A800Y, AQB - A802, AND NQB - A800

This specification is approved for use by the Naval Sea Systems Command, Department of the Navy, and is available for use by all Departments and Agencies of the Department of Defense

The requirements for acquiring the product described herein shall consist of this specification sheet and the issue of the following specification listed in that issue of the Department of Defense Index of Specifications and Standards (DoDISS) specified in the solicitation MIL-C-17361


AMSC N/A FSC 5925
DISTRIBUTION STATEMENT A Approved for public release, distribution is unlimited

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

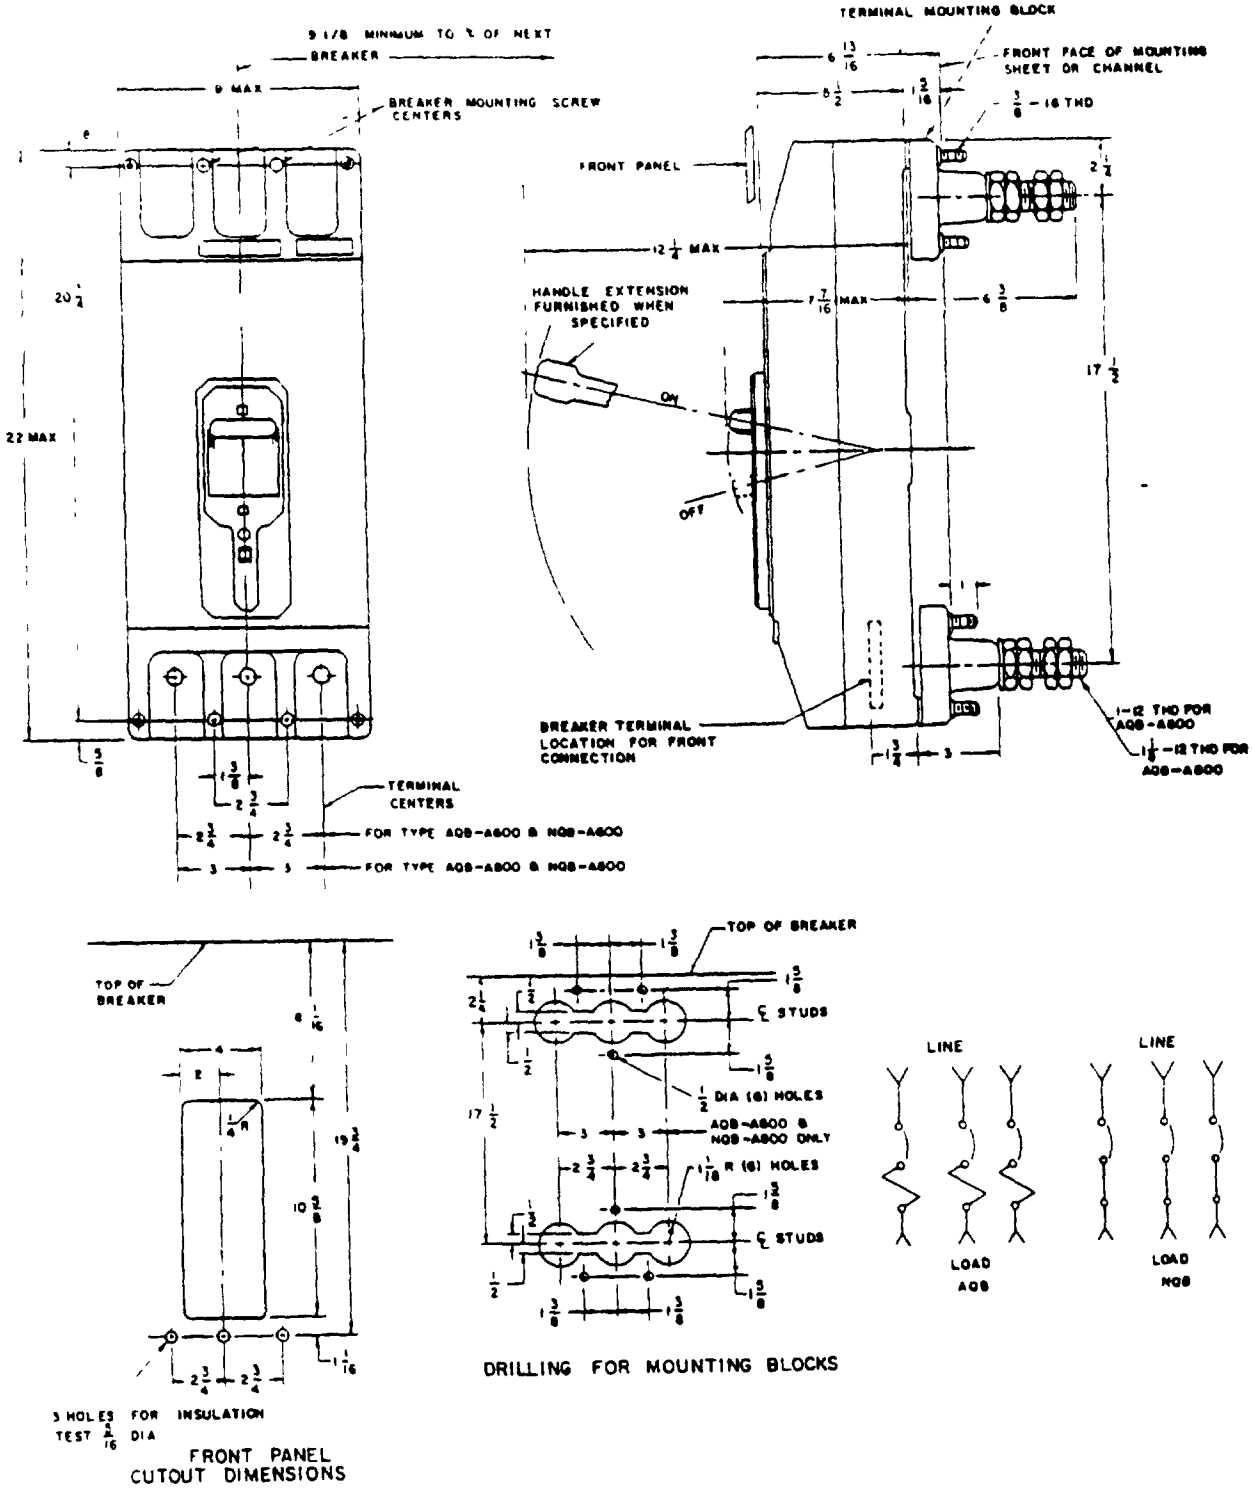


* FIGURE 1. Circuit breaker type AQB-A800, AQB-A800Y, AQB-802, and NQB-A800 outline and mounting dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

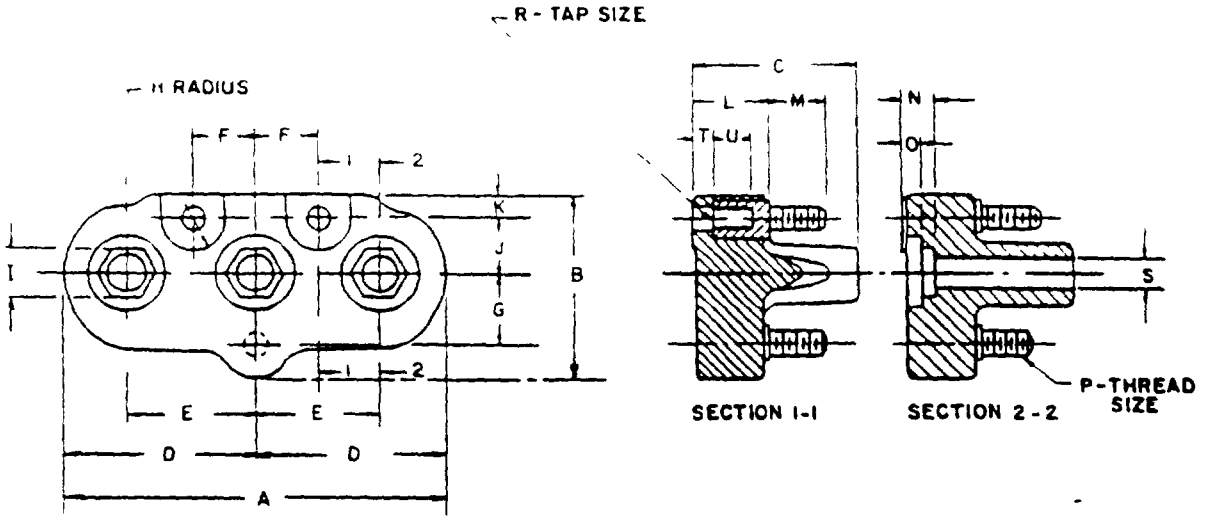

BLOCK	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	R	S	T	U
AQB-A600	8 3/16	4 1/2	3	4 3/32	2 3/4	1 3/8	1 6/8	11/16	1.406	1 6/8	6/8	1 6/16	1	3/4	7/16	3/8-16	3/8-16	1 1/32	7/16	3/4
AQB-A800	8 11/16	4 1/2	3	4 11/32	3	1 3/8	1 5/8	11/16	1.405	1 3/8	8/8	1 6/16	1	3/4	5/16	3/8-16	3/8-16	1 3/32	7/16	3/4

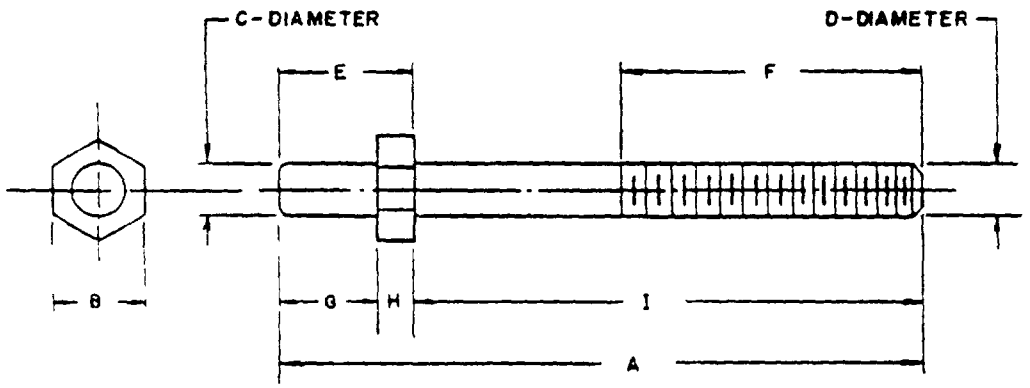

DIMENSIONS IN INCHES

TERMINAL	A	B	C	D	E	F	G	H	I	THREAD SIZE
AQB-A600	7	1 3/8	3/4	1	1 3/8	3 1/2	1	3/8	5 6/8	1 - 12
AQB-A800	7	1 3/8	1	1 1/8	16/16	3 3/4	3/4	3/16	6 1/16	1 1/8 - 12

FIGURE 2. Mounting block for circuit breaker type AQB-A800, AQB-A800Y, AQB-A802, and NQB-A800.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

REQUIREMENTS

Dimensions See figures 1 and 2
Maximum rated continuous current 800 amperes
Voltage and frequency 500 Vac, 60 Hz
500 Vac, 400 Hz
Interrupting rating 50,000 amperes (60 Hz)
10,000 amperes (400 Hz)
Peak let-through current 50,000 amperes
Trip unit Interchangeable
Protection (for trip unit types AQB-A800 and AQB-A800Y where applicable)
Trip unit rating (amperes) See table I.
LTD and adjustable instantaneous, all 3 poles
LTD calibration See table II
Instantaneous calibration See table I
Protection (for trip units type AQB-A802 only)
Frame rating 800 amperes (ac only, no dc rating)
Continuous current settings (CCS) 400, 500, 600, 700, and 800 amperes
LTD, STD, and Instantaneous, all 3 poles
LTD calibration See table IIa
STD calibration The short time delay pickup settings shall be 2X, 3X, 4X, 6X, 8X, and 10X the continuous current settings The short time delay "delay settings" shall be as specified in Table IIb
Instantaneous calibration The instantaneous pickup settings shall be 3X, 4X, 5X, 6X, 8X, 10X, 12X, 15X, 20X, and 30X the frame rating Production units shall be calibrated at the 8X setting Opening time shall be 0 025 seconds or less when tested at 3X the instantaneous pickup (for qualification tests only, not for routine calibration)
Time characteristics curves (TCC) TCC shall be developed and provided Test points listed for LTD, STD, and Instantaneous shall comply with the TCC.
Current limiting fuse Not applicable
Type of connections Back (removable mtg)
Electric operator Available
Undervoltage trip or shunt trip Either available
Auxiliary switch Two (a) contacts, two (b) contacts
Handle lock Group 4
Handle boot Not available
Electrical test The test may be conducted in groups of 100 load operations
The rate of operation shall be 4 operations per minute for a total of 4000 close-open operations
Temperature rise tests See table III
Mechanical tests Mechanical (no-load) operations may be conducted between groups of load operations The circuit breaker shall be subjected to 1000 close-open operations

NOTE NQB circuit breakers shall consist of an AQB type without trip unit and a modification kit of metallic parts

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

TABLE I Adjustable instantaneous trip settings amperes/maximum time 1/

Element rating 2/	LO 4/	2	3	4	Hi	Seconds 3/
	Ac	Ac	Ac	Ac	Ac	60 Hz ac
400U	1900	2300	2700	3100	3500	
400UM	3200	3600	4100	5100	5600	
500U	1900	2300	2700	3100	3500	
500UG	3200	3600	4100	5100	5600	
500UM	3200	3600	4100	5100	5600	
600U	1900	2300	2700	3100	3500	0 028
600UM	3200	3600	4100	5100	5600	
700U	1900	2300	2700	3100	3500	
700UM	3200	3600	4100	5100	5600	
800U	3200	3600	4100	5100	5600	
800UM	5000	6100	6700	7400	8000	

1/ The tolerance for each ampere setting shall not exceed plus or minus 10 percent

2/ Identification marking of trip units
Numerals indicate continuous current rating of the specific trip unit
Letter "G" denotes special calibration for use as generator or transformer protection
Letter "M" denotes calibration for applications having a high inrush current
Letter "U" denotes that the trip units are applicable to AQB-A800

3/ Time shall be measured at three times pick-up current of instantaneous setting For qualification tests only, not for routine calibration

4/ The LO and HI settings only are calibrated Others are approximate

TABLE II Tripping characteristics - long time delay (for trip units type AQB-A800 only)

LTD trip element percent current	Tripping time 60 Hz ac trip element
135	----
150	Not less than 1 hour
225	Less than 1 hour
600	Between 20 and 32 seconds
	Trip unit with "G" marking 1/
150	Not less than 20 minutes
200	Between 5 and 15 minutes
300	Between 60 and 120 seconds

1/ Letter "G" denotes special calibration for use as generator protection

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

TABLE IIa Tripping characteristics - long time delay (for trip units type AQB-A802 only)

LTD in Multiples of CCS	Tripping Time 60 Hz and 400 Hz ac
1.35	Not less than 1 hour
1.65	Less than 1 hour
4.0	Between 35 and 55 seconds
6.0	Between 20 and 32 seconds

TABLE IIb Adjustable Short-Time Delay "Delay Settings" in Seconds (for trip units type AQB-A802 only)

Short-Time Delay Pickup Setting	Short-Time Delay "Delay Setting"		
	1	2	3
All Settings	.025 - .055 1/	.065 - .095	.105 - .135

1/ Time delay with 2X short-time delay pickup settings shall be .025 to .065 seconds

TABLE III Size of cable and bus bars for temperature rise tests

Copper rating-amperes	Cable size	Copper bus size (inch)
800	Two 400 MCM	2 x 1/4

Preparing activity
Navy - SH
(Project 5925-N171)

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.