INCH-POUND

MIL-DTL-17361/12B(SH)
19 September 2006

SUPERSEDING
MIL-C-17361/12A(SH)
13 March 1995

DETAIL SPECIFICATION SHEET

CIRCUIT BREAKERS, AIR, ELECTRIC, INSULATED HOUSING (SHIPBOARD USE) TYPES AQB-A800, AQB-A802, NQB-A800, NQB-A802, AND NQB-A803

This specification is approved for use by the Naval Sea Systems Command and is available for use by all Departments and Agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and MIL-DTL-17361.

LIST OF TABLES

TABLE I. Requirements. 2
TABLE II. Continuous current settings (for trip unit types AQB-A802 only).....3
TABLE III. Adjustable instantaneous trip settings amperes/maximum time (all 3 poles). 4
TABLE IV. Adjustable short-time delay pickup (STDPU) settings in amperes (STD) (all 3 poles) (for trip unit types AQB-A802 only). 5
TABLE V. Adjustable short-time delay (STD) settings in seconds (for trip unit types AQB-A802 only). 5
TABLE VI. Tripping characteristics – long-time delay (LTD) (all 3 poles). 6
TABLE VII. Test requirements.....6

LIST OF FIGURES

FIGURE 1. Circuit breaker types AQB-A800, AQB-A802, NQB-A800, and NQB-A802 outline dimensions. 7
FIGURE 2. Circuit breaker types AQB-A800, AQB-A802, NQB-A800, and NQB-A802 outline and mounting block dimensions. 8
FIGURE 3. Circuit breaker types AQB-A800, AQB-A802, NQB-A800, and NQB-A802 mounting dimensions...9
FIGURE 4. Circuit breaker types AQB-A800, AQB-A802, NQB-A800, and NQB-A802 typical wiring diagram, handle locking device, and mounting block outline dimensions.....10
FIGURE 5. Circuit breaker type AQB-A802 time-current response. 11
FIGURE 6. Circuit breaker type NQB-A803 outline dimensions. 12

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

TABLE I. Requirements.

Maximum rated continuous current	800 amperes, 60 Hz, AC 650 amperes, 400 Hz, AC (NQB-A803 only)
Voltage and frequency	500 VAC, 60 Hz 500 VAC, 400 Hz (NQB-A803 only)
Interrupting rating	50,000 amperes, 60 Hz, AC 10,000 amperes, 400 Hz, AC
Trip unit	Interchangeable
Current limiting fuses	Not applicable
Type of connections	Back (removable mtg.)
Electric operator	Available
Undervoltage trip or shunt trip	Either available
Auxiliary switch	Two (a) contacts; two (b) contacts
Handle lock	Group 4 (Figure 1 of MIL-DTL-17361)
Handle boot	Not available

NOTE: NQB circuit breakers shall consist of an AQB type without trip unit and a modification kit of metallic parts.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

TABLE II. Continuous current settings (for trip unit types AQB-A802 only).

AQB-A800 trip units only															
Element rating /1															
400 U	400 UM	400 UH	500 U	500 UH	500 UG	500 UGH	500 UM	600 U	600 UH	600 UGH	600 UM	700 U	700 UM	800 U	800 UM
AQB-A802 trip units only															
Continuous current setting (amperes)															
400			500					600				700		800	

NOTE:

/1 Identification marking of trip units:

Numerals indicate continuous current rating of the specific trip unit.
Letter “G” denotes special calibration for use as generator or transformer protection.
Letter “M” denotes calibration for applications having a high inrush current.
Letter “U” denotes that the trip units are applicable to AQB-A800.
Letter “H” denotes calibration for 400-Hz applications.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

TABLE III. Adjustable instantaneous trip settings amperes/maximum time (all 3 poles).

AQB-A800 trip units only /1						
Element rating	**LO /3**	**2**	**3**	**4**	**HI /3**	**Seconds /2**
	AC	**AC**	**AC**	**AC**	**AC**	**60 Hz AC**
400U	1900	2300	2700	3100	3500	0.028
400UH	1900	2300	2700	3100		
400UM	3200	3600	4100	5100	5600	
500U	1900	2300	2700	3100	3500	
500UH	1900	2300	2700	3100		
500UG	3200	3600	4100	5100	5600	
500UGH	3200	3600	4100	5100	5600	
500UM	3200	3600	4100	5100	5600	
600U	1900	2300	2700	3100	3500	
600UH	1900	2300	2700	3100	3500	
600UGH	3200	3600	4100	5100	5600	
600UM	3200	3600	4100	5100	5600	
700U	1900	2300	2700	3100	3500	
700UM	3200	3600	4100	5100	5600	
800U	3200	3600	4100	5100	5600	
800UM	5000	6100	6700	7400	8000	

AQB-A802 trip units only /1 /5										
Frame rating	**3X**	**4X**	**5X**	**6X**	**8X**	**10X**	**12X /5**	**15X /5**	**20X /4**	**30X /4**
800	2400	3200	4000	4800	6400	8000	9600	12000	16000	24000

NOTES:

/1 The tolerance for each ampere setting shall not exceed ±10%.

/2 Time shall be measured at three times pickup current of instantaneous setting. For qualification tests only, not for routine calibration.

/3 The LO and HI settings only are calibrated. Others are approximate.

/4 Applicable for 60 Hz only.

/5 Opening time shall be 0.025 seconds or less when tested at the 3X instantaneous pickup (for qualification tests only, not for routine calibration).

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

TABLE IV. Adjustable short-time delay pickup (STDPU) settings in amperes (STD) (all 3 poles) (for trip unit types AQB-A802 only).

Continuous current setting	2X	3X	4X	6X	8X	10X
400	800	1200	1600	2400	3200	4000
500	1000	1500	2000	3000	4000	5000
600	1200	1800	2400	3600	4800	6000
700	1400	2100	2800	4200	5600	7000
800	1600	2400	3200	4800	6400	8000

TABLE V. Adjustable short-time delay (STD) settings in seconds (for trip unit types AQB-A802 only).

STD “delay setting”		
1	2	3
0.025–0.055 /1	0.065–0.095	0.105–0.135

NOTE:

/1 Time delay with 2X STDPU settings shall be 0.020–0.060 seconds.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

TABLE VI. Tripping characteristics – long-time delay (LTD) (all 3 poles).

AQB-A800 trip units only	
Current as multiple of trip element rating	**Tripping time 60-Hz AC trip element**
1.35	----
1.50	Not less than 1 hour
2.25	Less than 1 hour
6.00	Between 20 and 32 seconds
	Trip unit with "G" marking /1
1.50	Not less than 20 minutes
2.00	Between 5 and 15 minutes
3.00	Between 60 and 120 seconds
AQB-A802 trip units only	
Current as multiple of CCS	**Tripping time 60 Hz and 400 Hz AC**
1.35	Not less than 1 hour
1.65	Less than 1 hour
4.0	Between 35 and 55 seconds
6.0	Between 20 and 32 seconds

NOTE:

/1 Letter "G" denotes special calibration for use as generator or transformer protection.

TABLE VII. Test requirements.

Mechanical tests	Mechanical (no-load) operations may be conducted between groups of load operations. The circuit breaker shall be subjected to 1000 close-open operations.		
Electrical endurance test	The test may be conducted in groups of 100 load operations. The rate of operation shall be 4 operations per minute for a total of 4000 close-open operations.		
Temperature rise tests	Size of cable and bus bars for temperature rise tests		
	Copper rating-amperes	Cable size	Copper bus size (inch)
	800	Two (2) 400 MCM	2-1/2 x 1/4

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

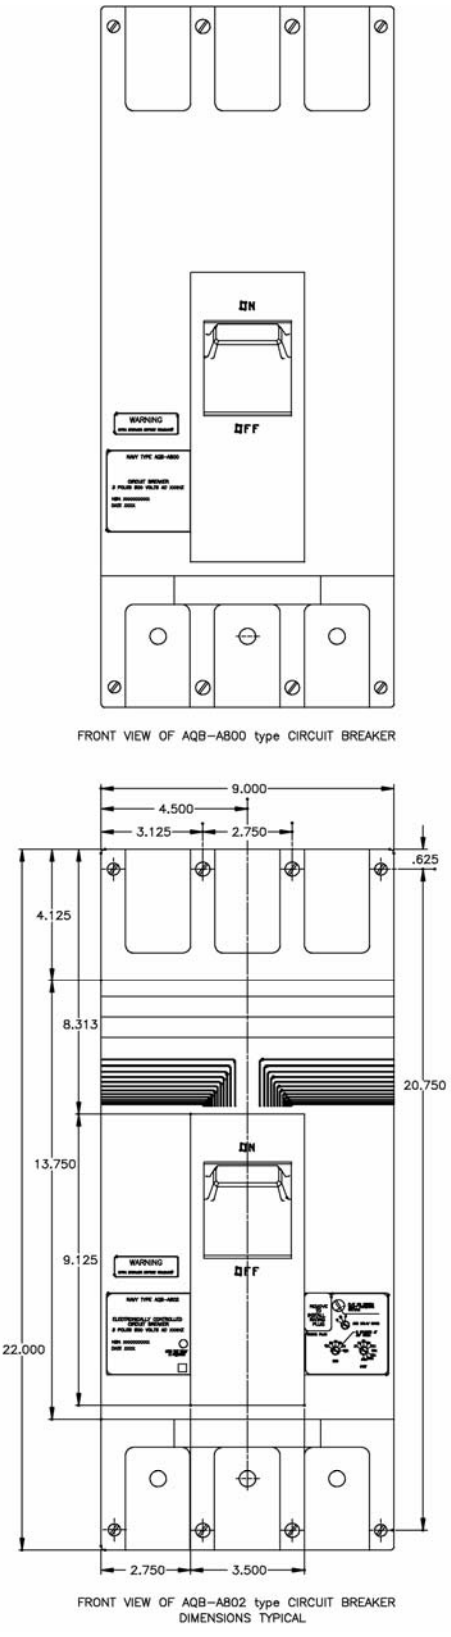


FIGURE 1. Circuit breaker types AQB-A800, AQB-A802, NQB-A800, and NQB-A802 outline dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

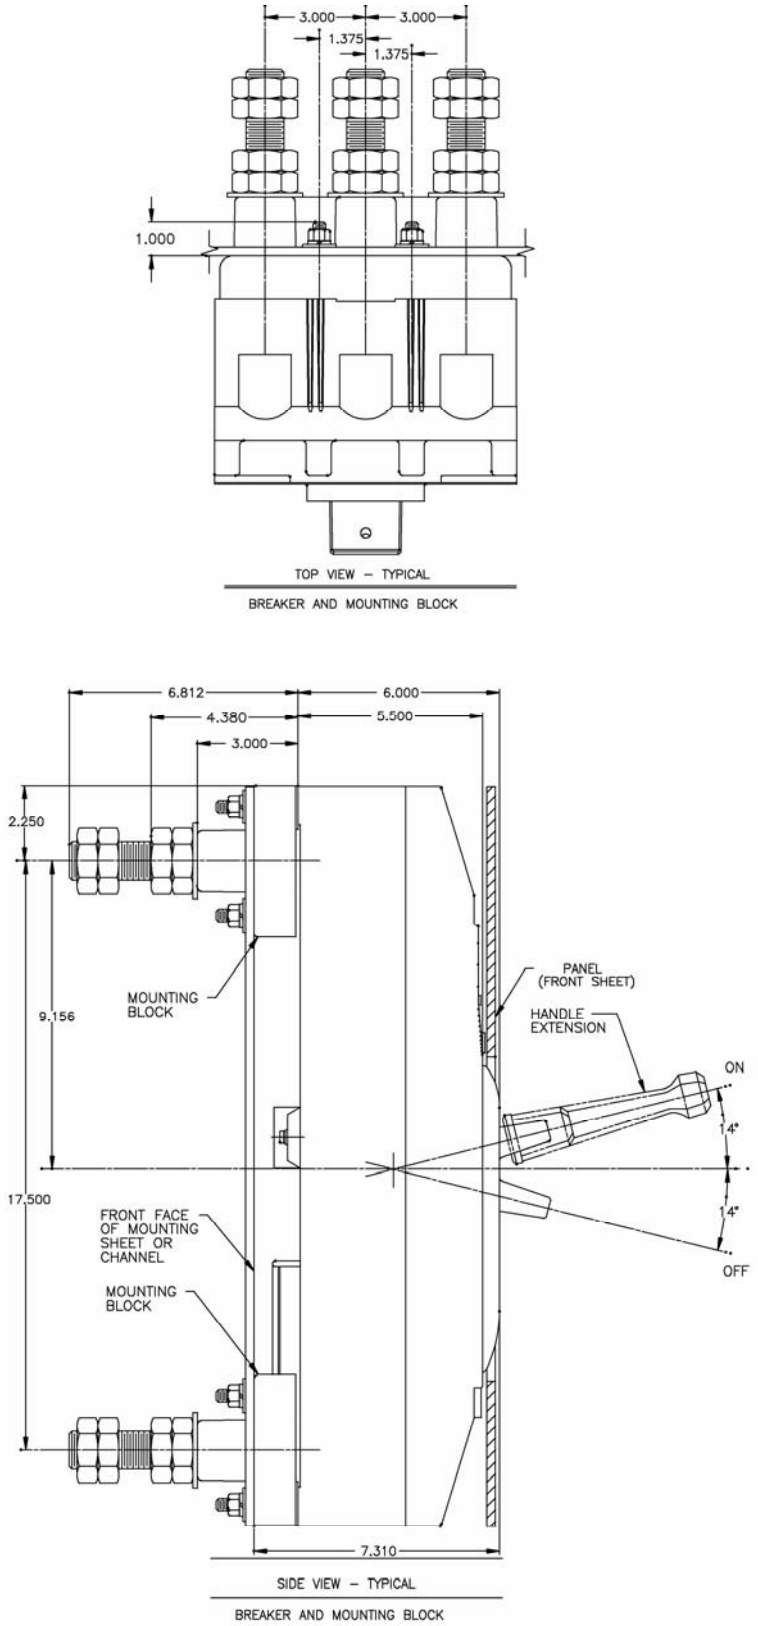


FIGURE 2. Circuit breaker types AQB-A800, AQB-A802, NQB-A800, and NQB-A802 outline and mounting block dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

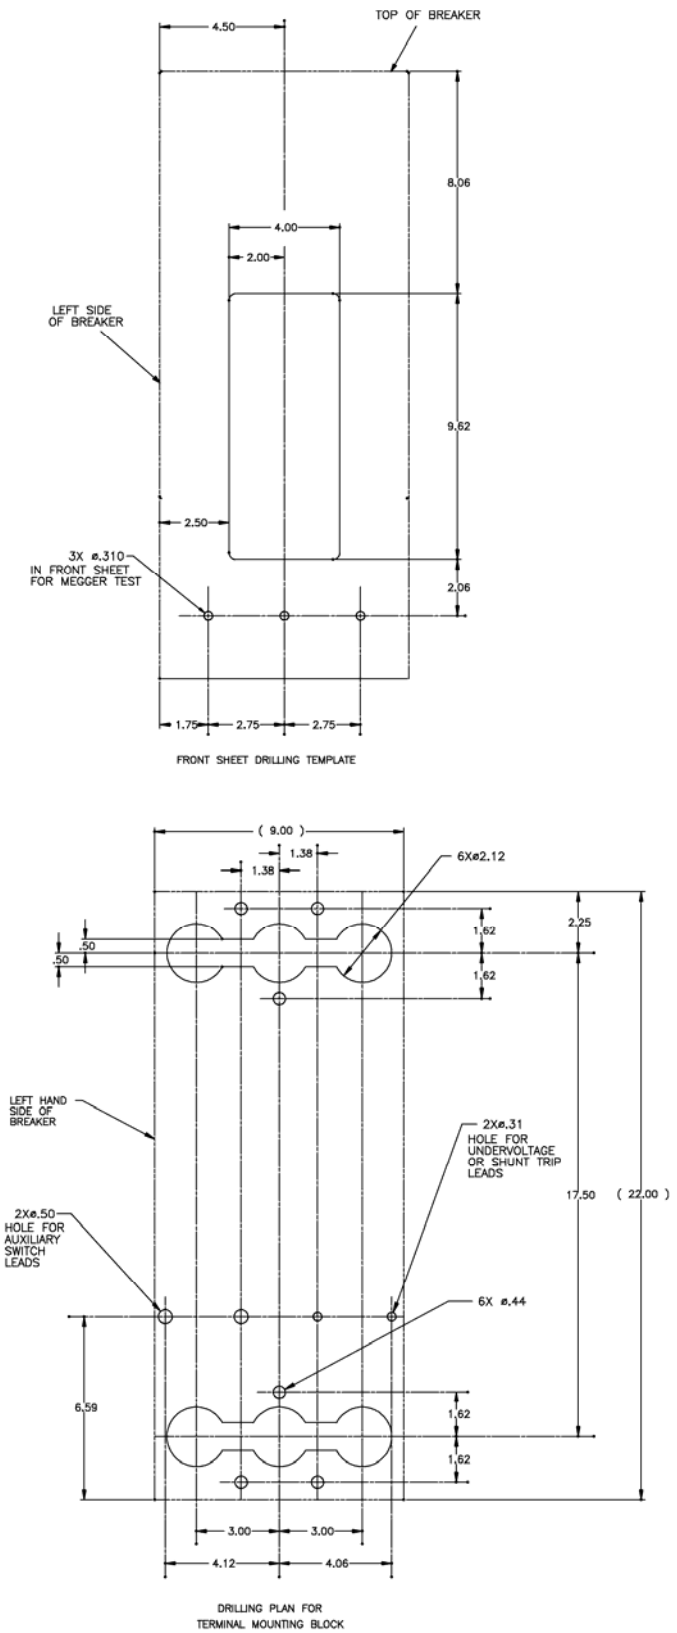


FIGURE 3. Circuit breaker types AQB-A800, AQB-A802, NQB-A800, and NQB-A802 mounting dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

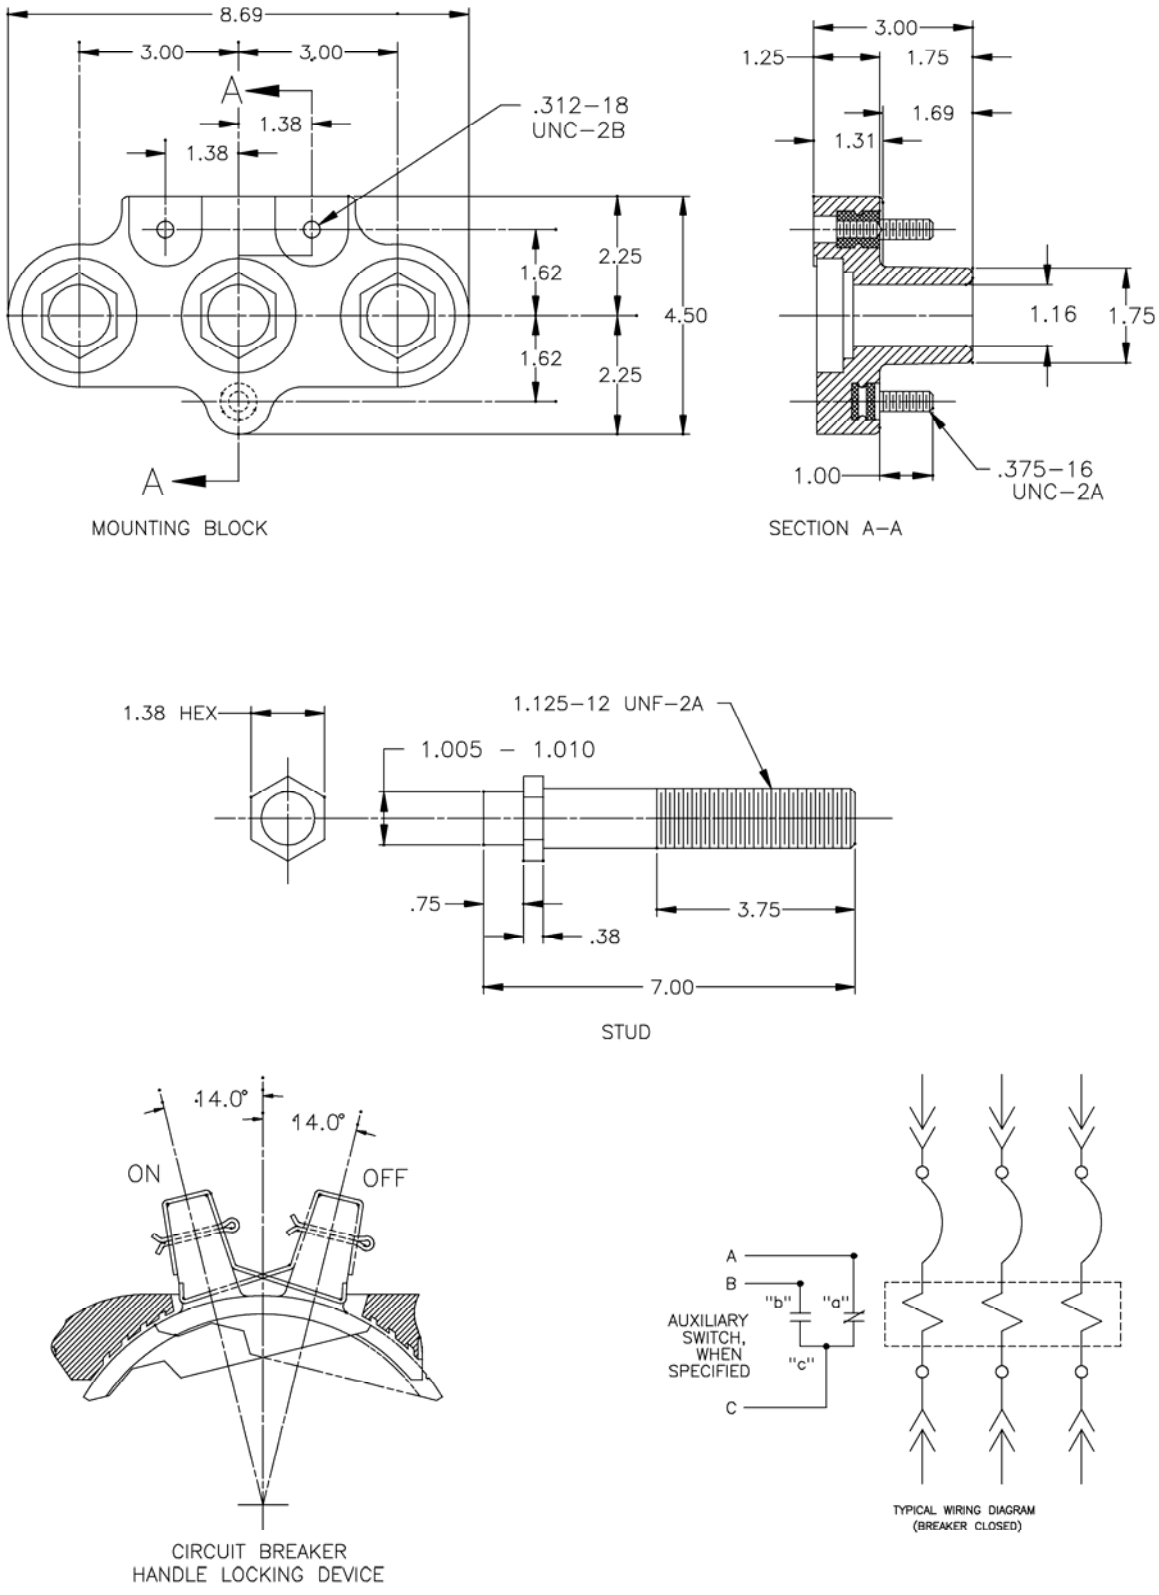


FIGURE 4. Circuit breaker types AQB-A800, AQB-A802, NQB-A800, and NQB-A802 typical wiring diagram, handle locking device, and mounting block outline dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

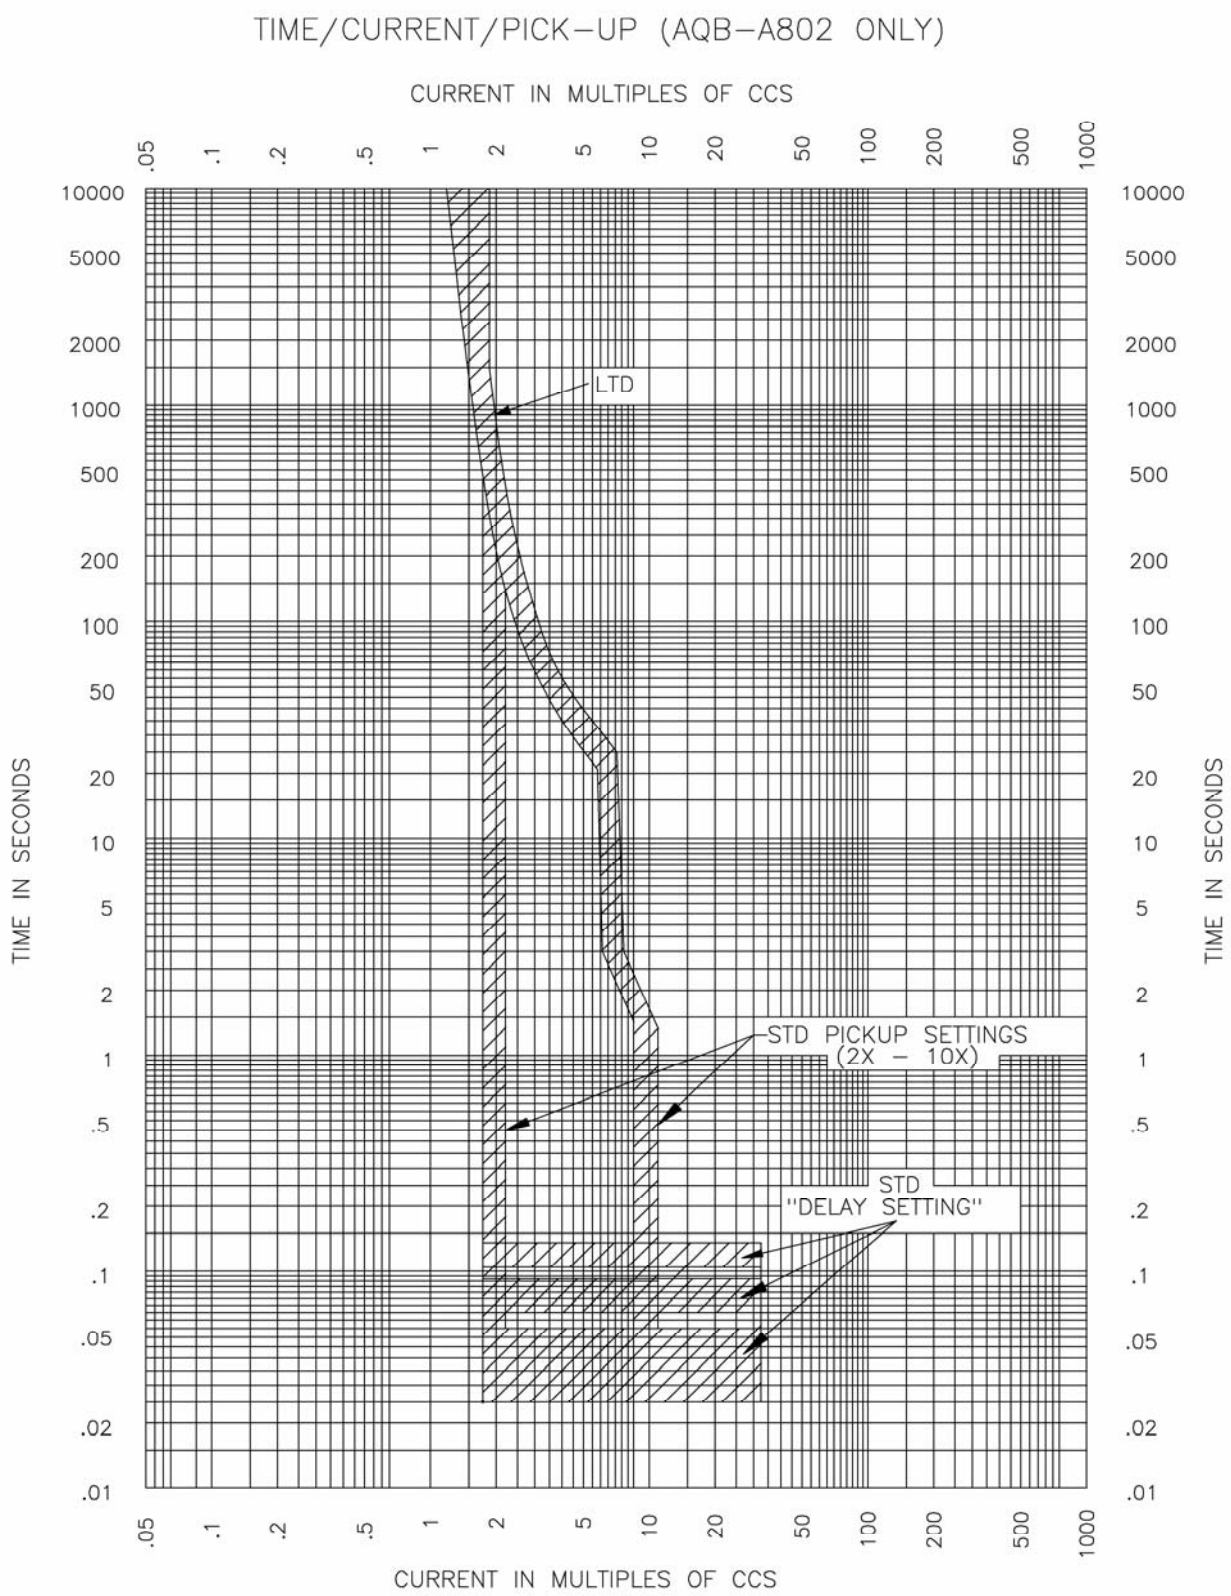


FIGURE 5. Circuit breaker type AQB-A802 time-current response.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

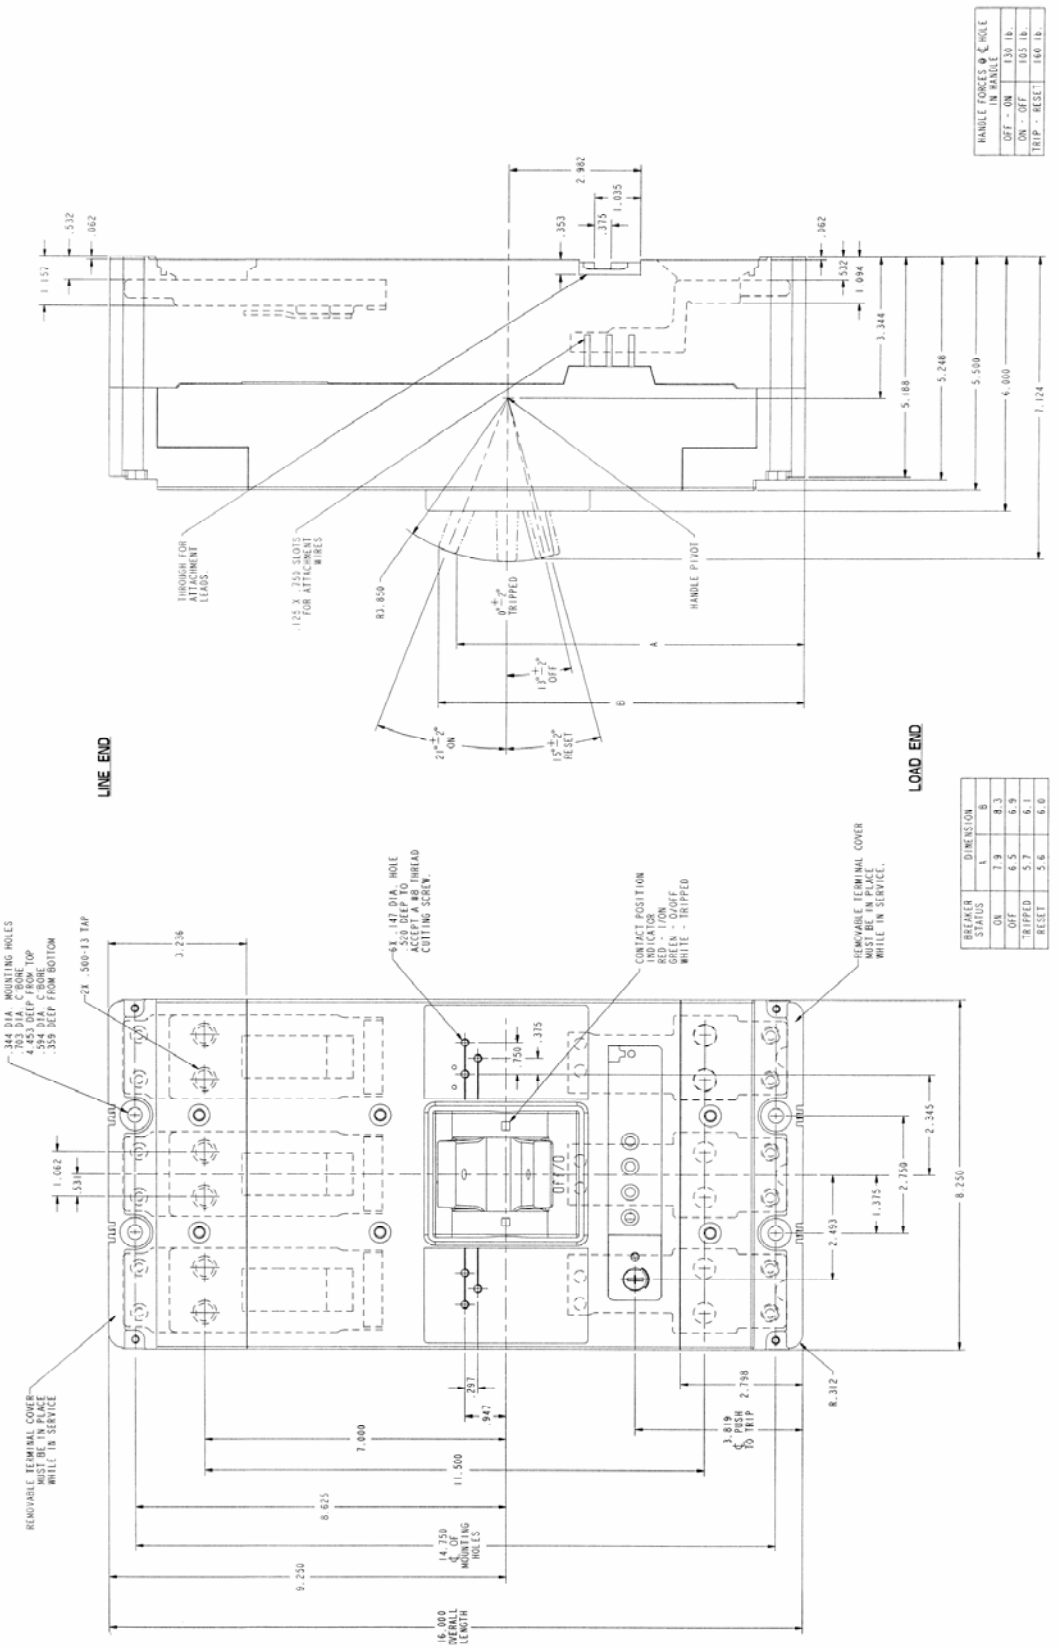


FIGURE 6. Circuit breaker type NQB-A803 outline dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

CHANGES FROM PREVIOUS ISSUE: Marginal notations are not used in this revision to identify changes with respect to the previous issue due to the extent of the changes.

Preparing Activity:
Navy – SH
(Project 5925-N185-012)

NOTE: The activities listed above were interested in this document as of the date of this document. Since organizations and responsibilities can change, you should verify the currency of the information above using the ASSIST Online database at http://assist.daps.dla.mil.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.