INCH-POUND

MIL-DTL-17361/14A(SH)
19 September 2006

SUPERSEDING
MIL-C-17361/14(SH)
10 March 1989

DETAIL SPECIFICATION SHEET

CIRCUIT BREAKERS, AIR, ELECTRIC, INSULATED HOUSING (SHIPBOARD USE) TYPES AQB-A1601 AND NQB-A1601

This specification is approved for use by the Naval Sea Systems Command and is available for use by all Departments and Agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and MIL-DTL-17361.

LIST OF TABLES

TABLE I. Requirements. 2
TABLE II. Adjustable instantaneous trip settings amperes/maximum time (all 3 poles) /1. 3
TABLE III. Tripping characteristics – long-time delay (LTD) (all 3 poles). 3
TABLE IV. Test requirements....3

LIST OF FIGURES

FIGURE 1. Circuit breaker types AQB-A1601 and NQB-A1601, outline and mounting dimensions. 4
FIGURE 2. Standard mounting fixtures for shock testing of type AQB-A1601 circuit breakers. 6

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

TABLE I. Requirements.

Maximum rated continuous current	1600 amperes
Voltage and frequency	500 VAC, 60 Hz
Interrupting rating	75,000 amperes, 60 Hz, AC
Trip unit	Interchangeable
Current limiting fuses	Not applicable
Type of connections	Back (removable mtg.)
Electric operator	Available
Undervoltage trip or shunt trip	Either available. NOTE: 33 VDC shall not be applicable for undervoltage tripping device.
Auxiliary switch	Any even numbered combination of “a” and “b” contacts for a combined total of no more than eight.
Handle lock	Not available
Handle boot	Not available

NOTE: NQB circuit breakers shall consist of an AQB type without trip unit and a modification kit of metallic parts.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

TABLE II. Adjustable instantaneous trip settings amperes/maximum time (all 3 poles) /1.

Element rating /2	LO /4	2	3	4	HI /4	Seconds /3
	AC	AC	AC	AC	AC	60 Hz AC
600X	2000	3600	4000	4800	6000	0.032
600XM	4000	7500	8500	10000	12000	
800X	2000	3600	4000	4800	6000	
1000X	2000	3600	4000	4800	6000	
1200X	2000	3600	4000	4800	6000	
1400X	4000	7500	8500	10000	12000	
1600X	4000	7500	8500	10000	12000	

NOTES:

/1 The tolerance for each ampere setting shall not exceed ±10%.

/2 Identification marking of trip units:
Numerals indicate continuous current rating of the specific trip unit.
Letter “X” denotes that the trip units are applicable to AQB-A1601.
Letter “M” denotes calibration for applications having a high inrush current.

/3 Time shall be measured at three times pickup current of instantaneous coil. For qualification tests only, not for routine calibration.

/4 The LO and HI settings only are calibrated. Others are approximate.

TABLE III. Tripping characteristics – long-time delay (LTD) (all 3 poles).

Current as multiple of trip element rating	Tripping time 60-Hz AC trip element
1.50	Not less than 1 hour
2.25	Less than 1 hour
6.00	Between 20 and 32 seconds

TABLE IV. Test requirements.

Mechanical endurance test	Mechanical (no-load) operations may be conducted between groups of load operations. The circuit breaker shall be subjected to 1000 close-open operations.		
Electrical endurance test	The test may be conducted in groups of 100 load operations. The rate of operation shall be 4 operations per minute for a total of 4000 close-open operations.		
Temperature rise tests	Size of cable and bus bars for temperature rise tests		
	Copper rating-amperes	Cable size	Copper bus size (inch)
	1600	Four (4) 400 MCM	Two (2) 3 x 1/4

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

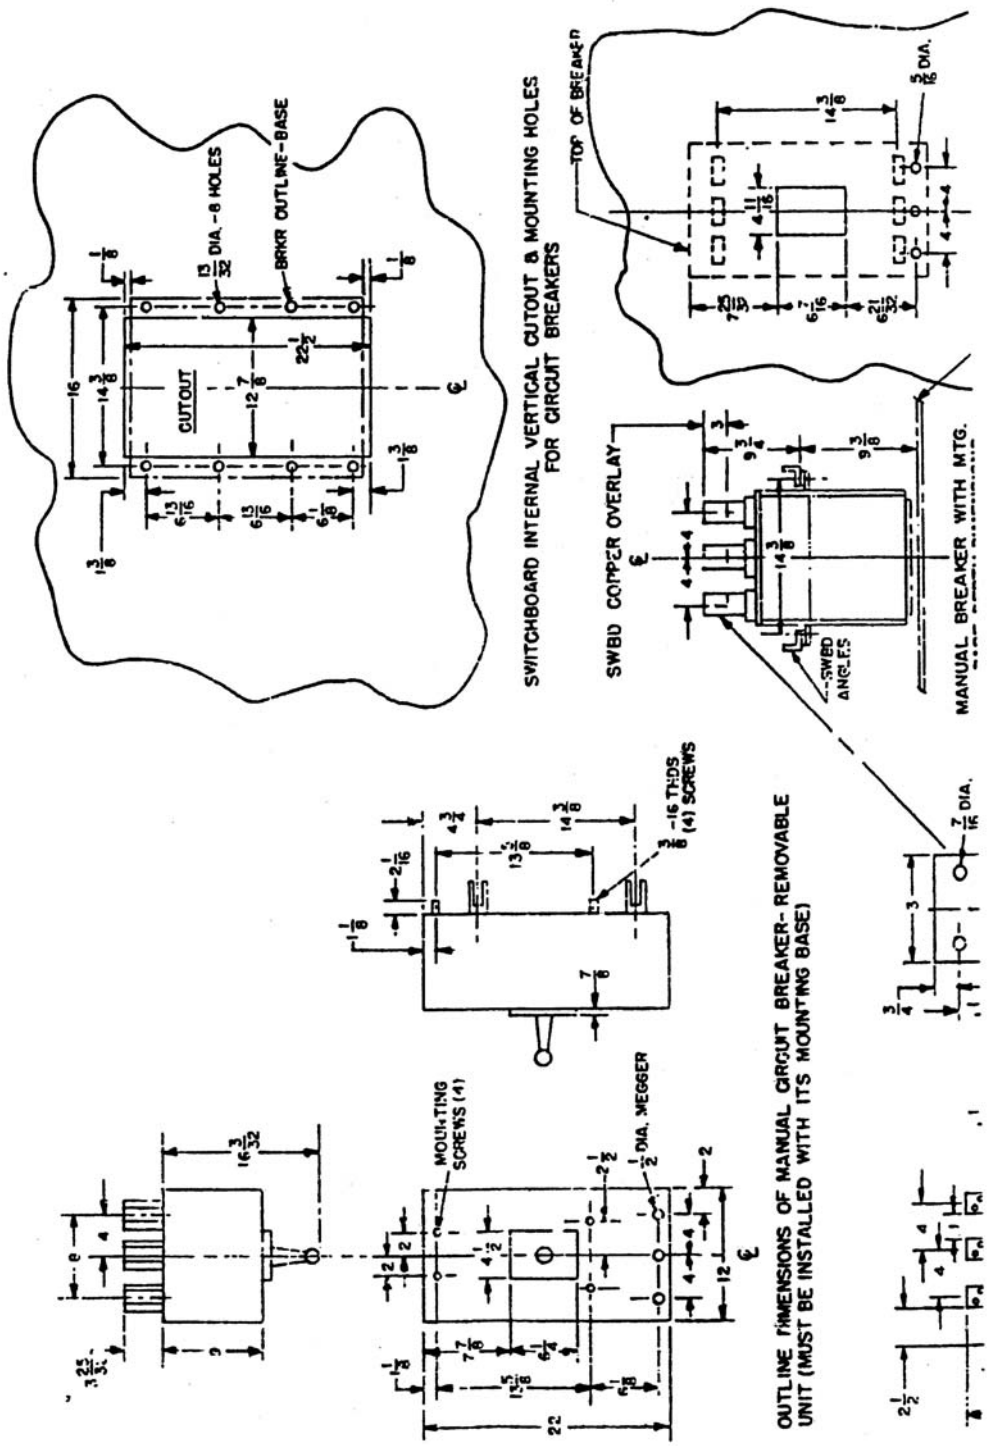


FIGURE 1. Circuit breaker types AQB-A1601 and NQB-A1601, outline and mounting dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

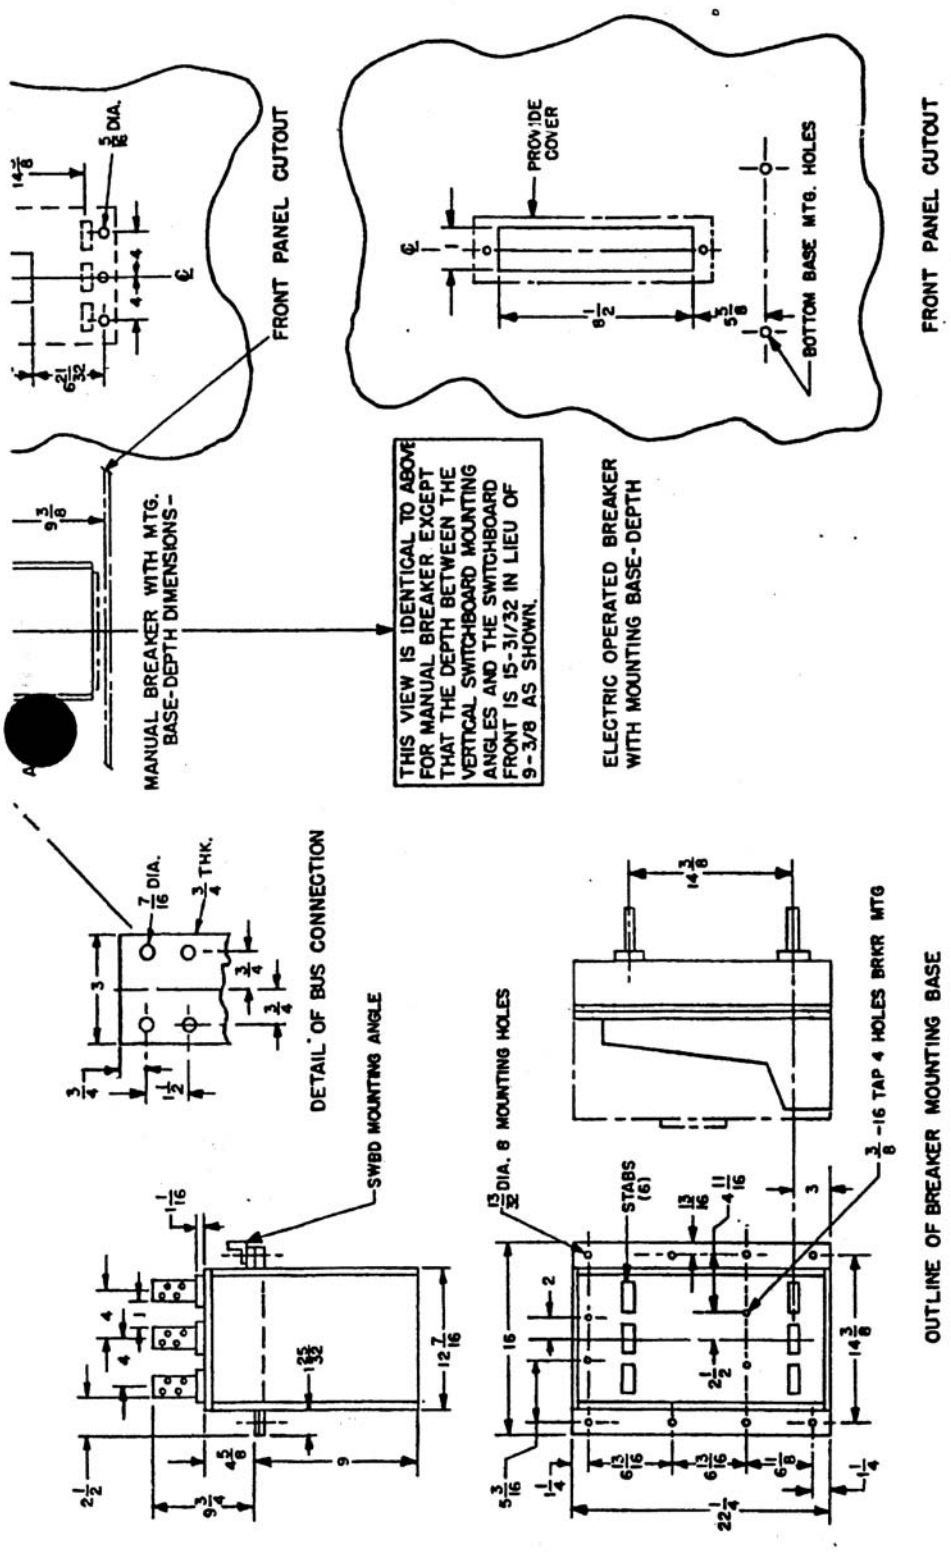


FIGURE 1. Circuit breaker types AQB-A1601 and NQB-A1601, outline and mounting dimensions - Continued.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

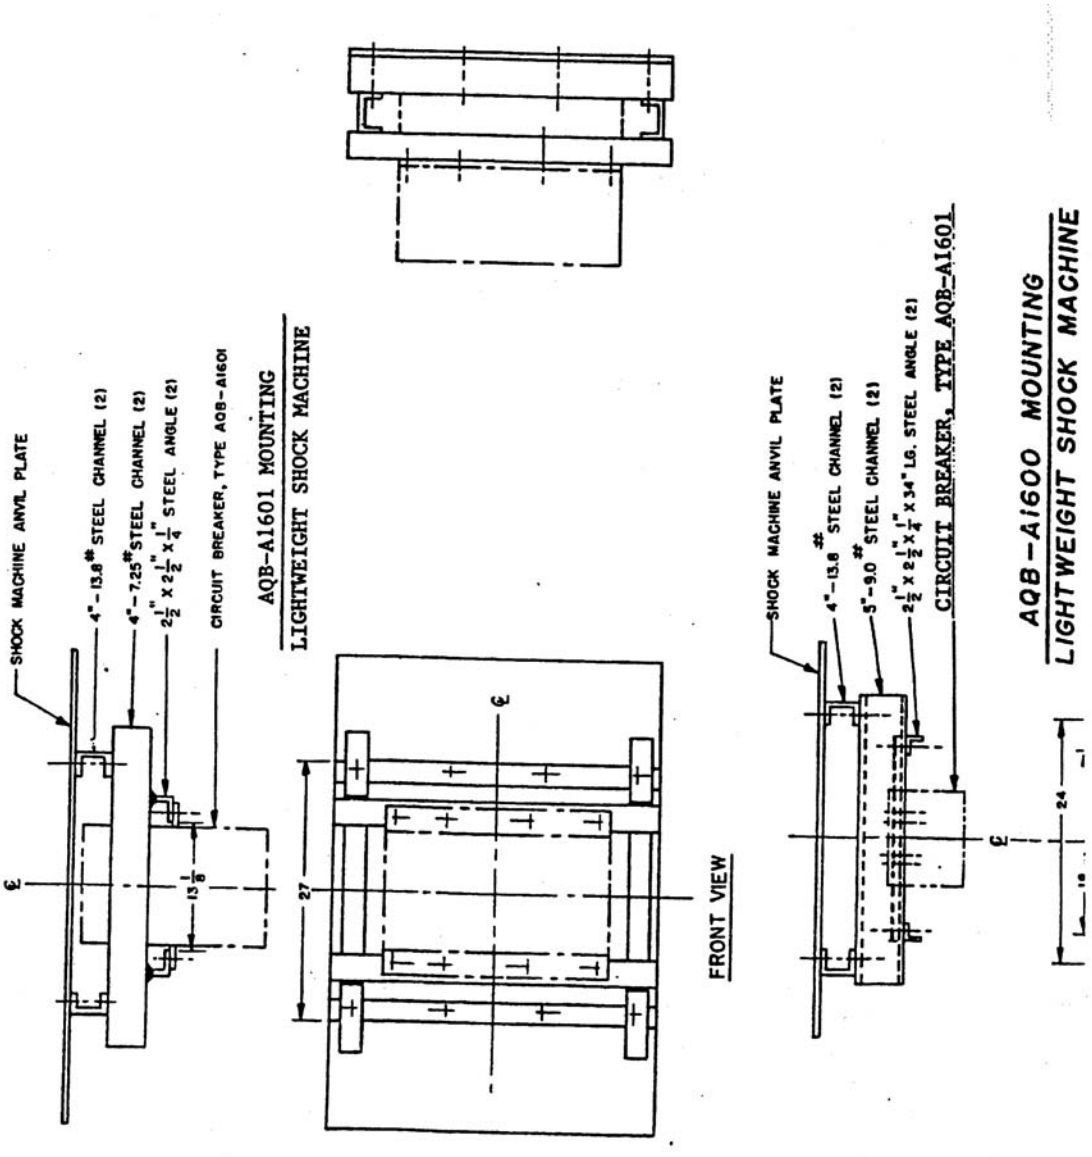


FIGURE 2. Standard mounting fixtures for shock testing of type AQB-A1601 circuit breakers.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

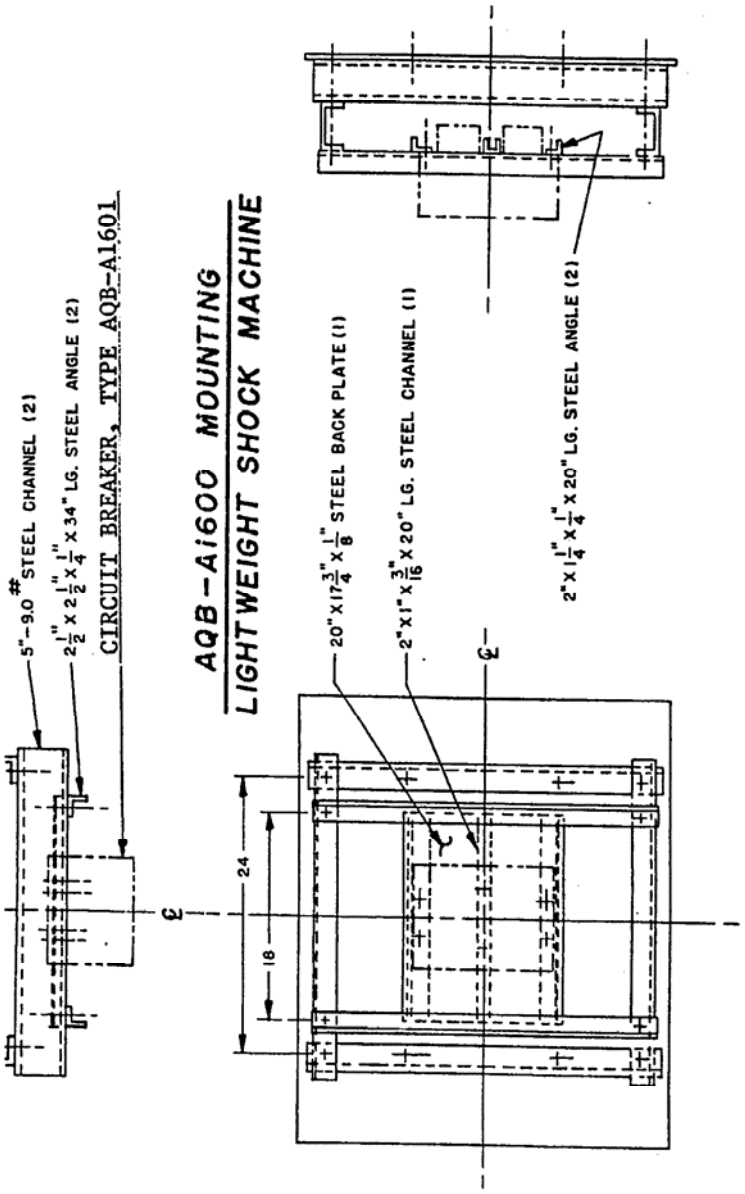


FIGURE 2. Standard mounting fixtures for shock testing of type AQB-A1601 circuit breakers - Continued.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

CHANGES FROM PREVIOUS ISSUE: Marginal notations are not used in this revision to identify changes with respect to the previous issue due to the extent of the changes.

Preparing Activity:
Navy – SH
(Project 5925-N185-014)

NOTE: The activities listed above were interested in this document as of the date of this document. Since organizations and responsibilities can change, you should verify the currency of the information above using the ASSIST Online database at http://assist.daps.dla.mil.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.