INCH-POUND
MIL-C-17361/15(SH)
10 March 1989

MILITARY SPECIFICATION SHEET

CIRCUIT BREAKERS, AIR, ELECTRIC, INSULATED HOUSING (SHIPBOARD USE) TYPE AQB - A1602 AND NQB - A1602


This specification is approved for use by the Naval Sea Systems Command, Department of the Navy, and is available for use by all Departments and Agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and the issue of the following specification listed in that issue of the Department of Defense Index of Specifications and Standards (DoDISS) specified in the solicitation: MIL-C-17361.

AMSC N/A FSC 5925

DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.


Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

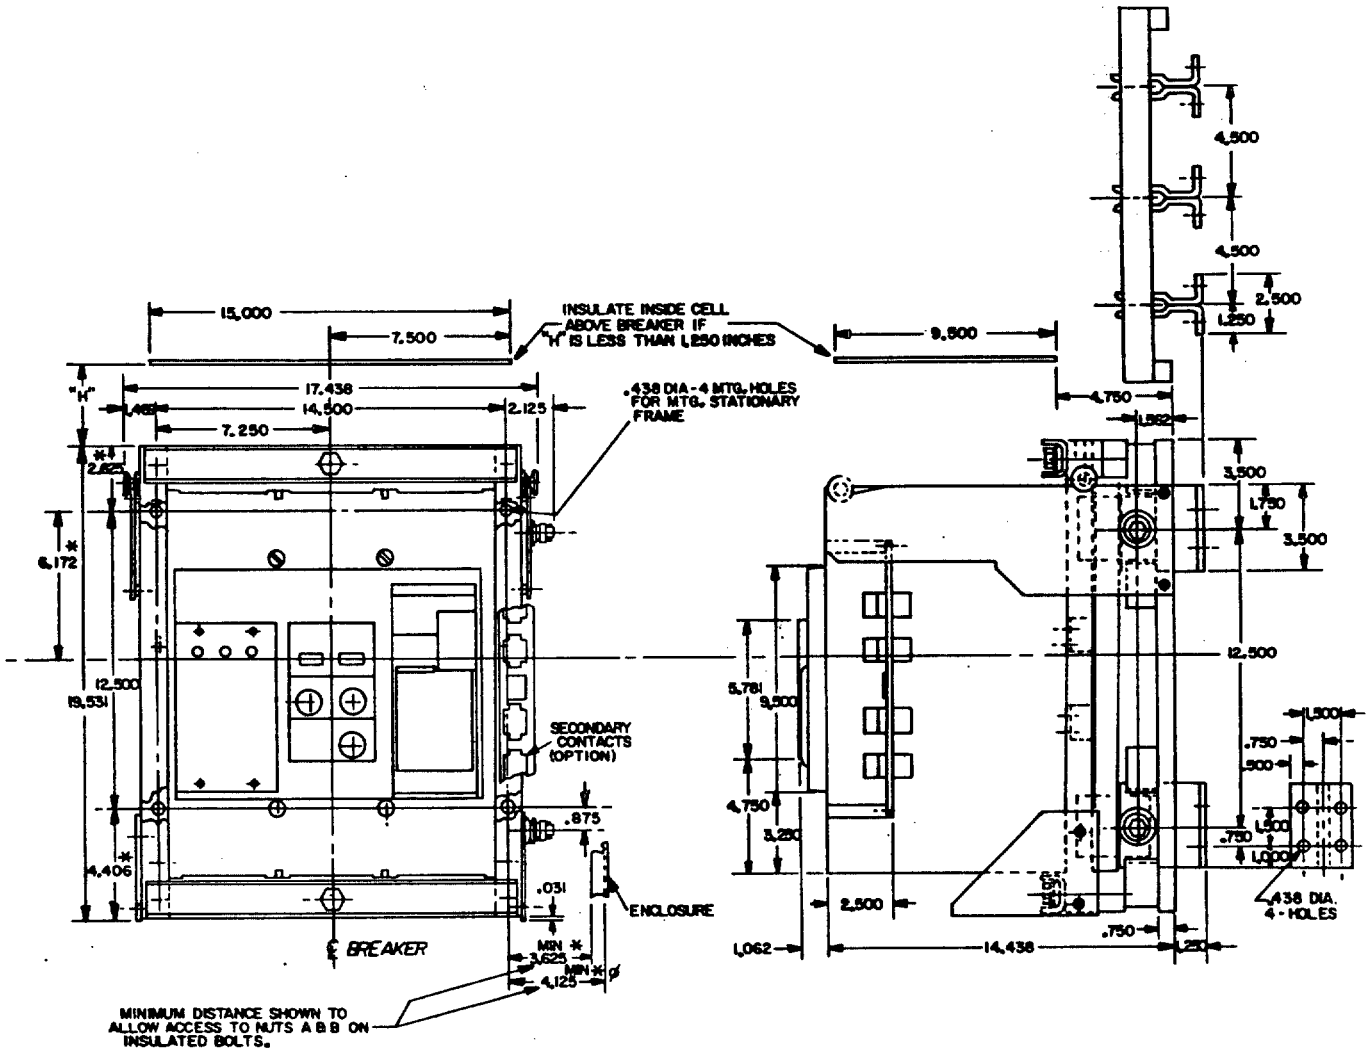

SH 10534

FIGURE 1. Circuit breaker type AQB-A1602 and NQB-A1602, outline and mounting dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

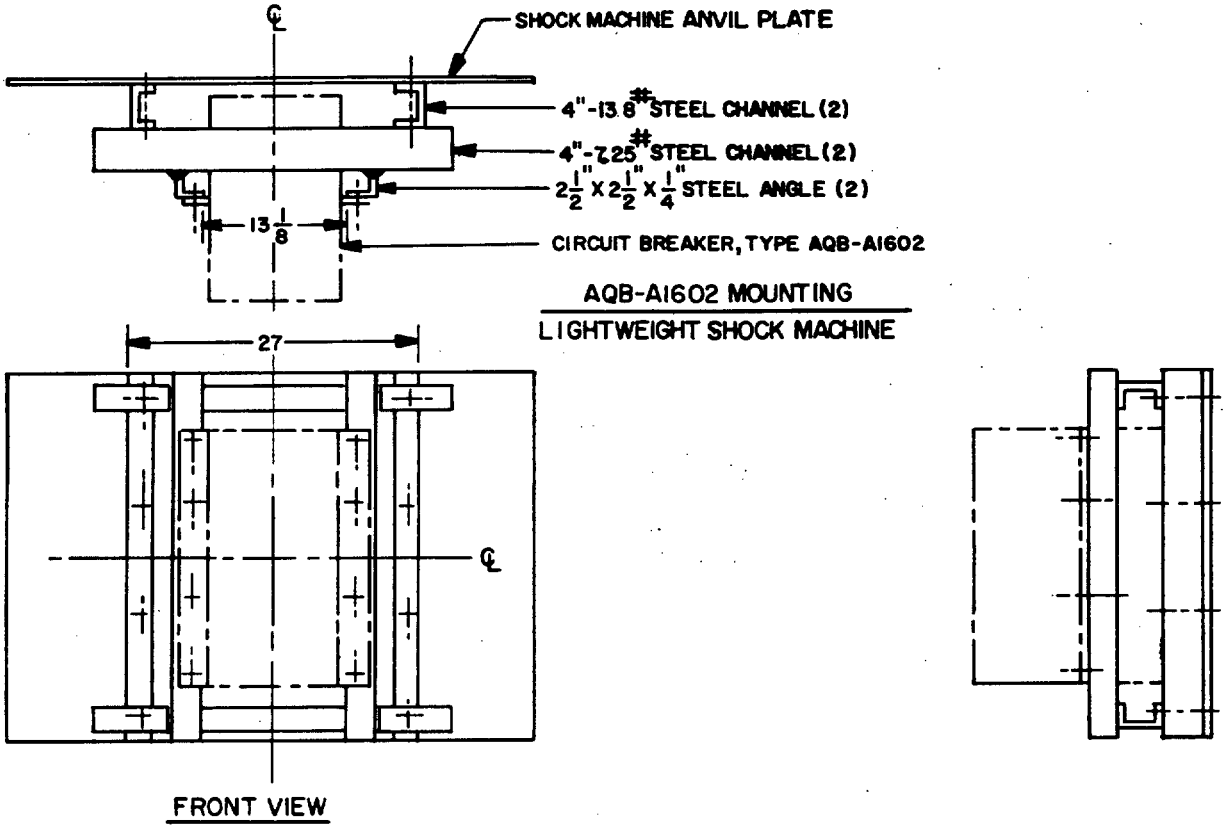

SH 10535

FIGURE 2. Standard mounting fixtures for shock testing of type AQB-A1602 circuit breakers.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Dimensions: See figure 1.
Rated continuous current: 1,600 amperes.
Voltage and frequency: 500 Vac, 60 Hz.
Interrupting rating: 150,000 amperes.
Peak let-through current: Not applicable.
Trip unit: Interchangeable.
Trip unit rating (amperes): See table I.
Protection: LTD and adjustable instantaneous, all 3 poles.
LTD calibration: See table II.
Instantaneous calibration: See table I.
Current limiting fuse: Not applicable.
Type of connections: Back (removable mtg.).
Electric operator: Available.
Undervoltage trip or shunt trip: Either available.
(NOTE: 33 Vdc shall not be applicable for undervoltage tripping device.)
Auxiliary switch: Any even numbered combination of "a" and "b" contacts for a combined total of no more than eight.
Handle lock: Not available.
Handle boot: Not available.
Electrical test: The test may be conducted in groups of 100 load operations. The rate of operation shall be 4 operations per minute for a total of 4000 close-open operations.
Temperature rise tests: See table II and 3.7.8.
Mechanical tests: Mechanical (no-load) operations may be conducted between groups of load operations. The circuit breaker shall be subjected to 1000 close-open operations.

Note: NQB circuit breakers shall consist of an AQB type without trip unit and a modification kit of metallic parts.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

TABLE I. Rating and current settings for overcurrent features.

Sensor rating	Long-time delay		Short-time delay		Instantaneous
	Pick-up	Band	Pick-up	Band	
480, 560, 640, 800 960, 1200, 1600	0.95X, 1.05X 1.15X and 1.25X The Sensor Rating Tolerance ±10%	Max-18 sec @ 6X Int-6 sec @ 6X Min-2 sec @ 6X GENL-18 sec @ 1.5X GENH-64 sec @ 1.5X Tolerance ±20%	2X, 2.5X, 3X 4X and 5X The Sensor Rating Tolerance ±10%	Spec. 0.5-0.3 sec Max 0.3-0.225 sec Int 0.225-0.15 sec MW 0.15-0.075 sec	Adj. Inst- 5X, 6X, 7X 8X, 9X, and 10X The Sensor Rating Fixed Inst-Trip Set at 90% withstand Tolerance ±10%

A PC board or front panel switch jumper shall be provided which will allow selection of either the adjustable instantaneous function or a fixed instantaneous trip setting of 90% of the short time rating.

Another jumper or switch may be provided for "selective override" if this function is required.

TABLE III. Size of cable and bus bars for temperature rise tests.

Copper rating-amperes	Cables size	Copper bus size (inches)
1600	Four 400 MCM	Two 3 x 1/4

Preparing activity:
Navy - SH
(Project 5925-N103-15)

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.