INCH-POUND
MIL-C-17361/15B
1 March 1994
SUPERSEDING
MIL-C-17361/15A(SH)
11 September 1992

MILITARY SPECIFICATION SHEET

CIRCUIT BREAKERS, AIR, ELECTRIC, INSULATED HOUSING (SHIPBOARD USE) TYPE AQB - A1602 AND NQB - A1602

This specification is approved for use by the Naval Sea Systems Command, Department of the Navy, and is available for use by all Departments and Agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and the issue of the following specification listed in that issue of the Department of Defense Index of Specifications and Standards (DoDISS) specified in the solicitation: MIL-C-17361.

AMSC N/A FSC 5925
DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

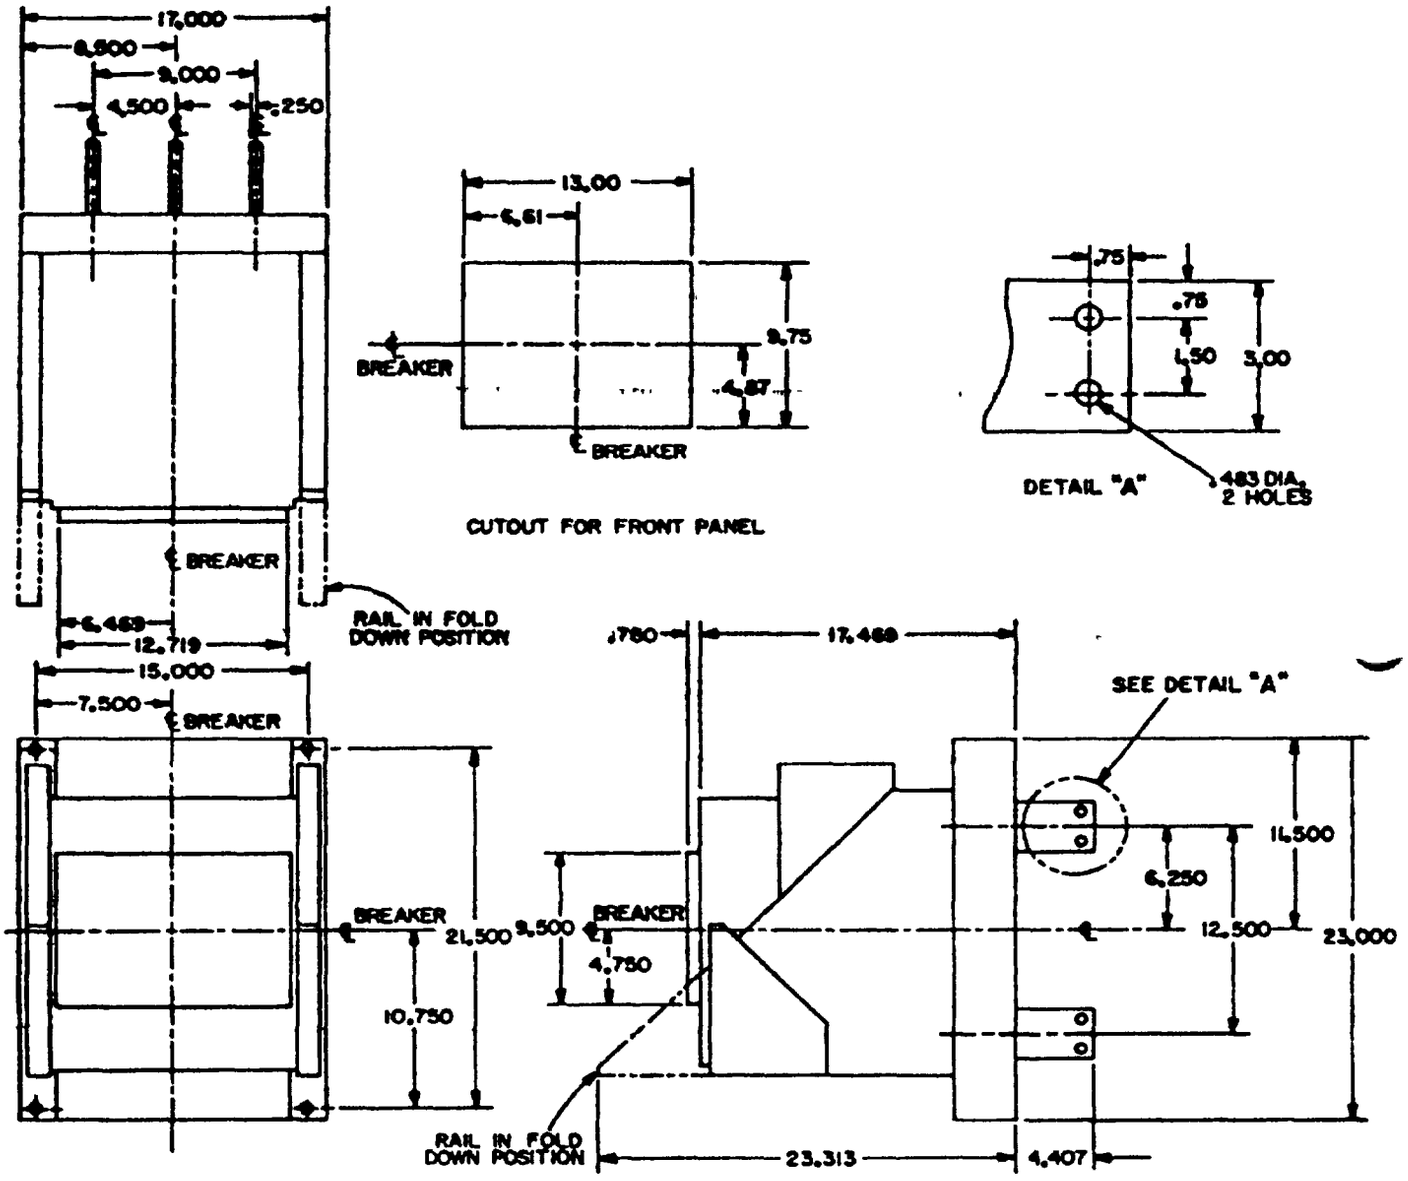


FIGURE 1 Circuit breaker type AQB-A1602 and NQB-A1602, outline and mounting dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Dimensions: See figure 1.
Maximum rated continuous current: 1600 amperes.
Voltage and frequency: 500 Vac, 60 Hz.
Short time current rating (1/): 50,000 amps, 0.3 seconds.
Interrupting rating: 100,000 amperes, asymmetrical
(85,000 amperes, symmetrical).
Peak let-through current; Not applicable.
Trip unit: Interchangeable rating plugs (see table I).
Trip unit rating (amperes): See table I.
Protection: LTD, STD, and INST (see table I)
current sensors in all 3 poles.
Current limiting fuse: Not applicable.
Type of connections: Rear; removable mounting.
Electric operator: Available.
Undervoltage trip or shunt trip: Either or both available.
Auxiliary switches: Provided as standard to protect shunt trip and remote closing solenoids when ordered; four (4) or eight (8) additional SPDT switches optionally available.
Cell switches: one SPDT switch provided standard.
Handle lock: Not available.
Handle boot: Not available.
Endurance test: 4000 electrical operations, plus
1000 mechanical (no-load) operations.
Four operations per minute for 10 minutes;
no less than one per minute thereafter.
Temperature rise tests: See table II and 3.7.8.
Note: NQB circuit breakers shall consist of an AQB type without trip unit and a modification kit of metallic parts.
Shock test fixture: See figure 2.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

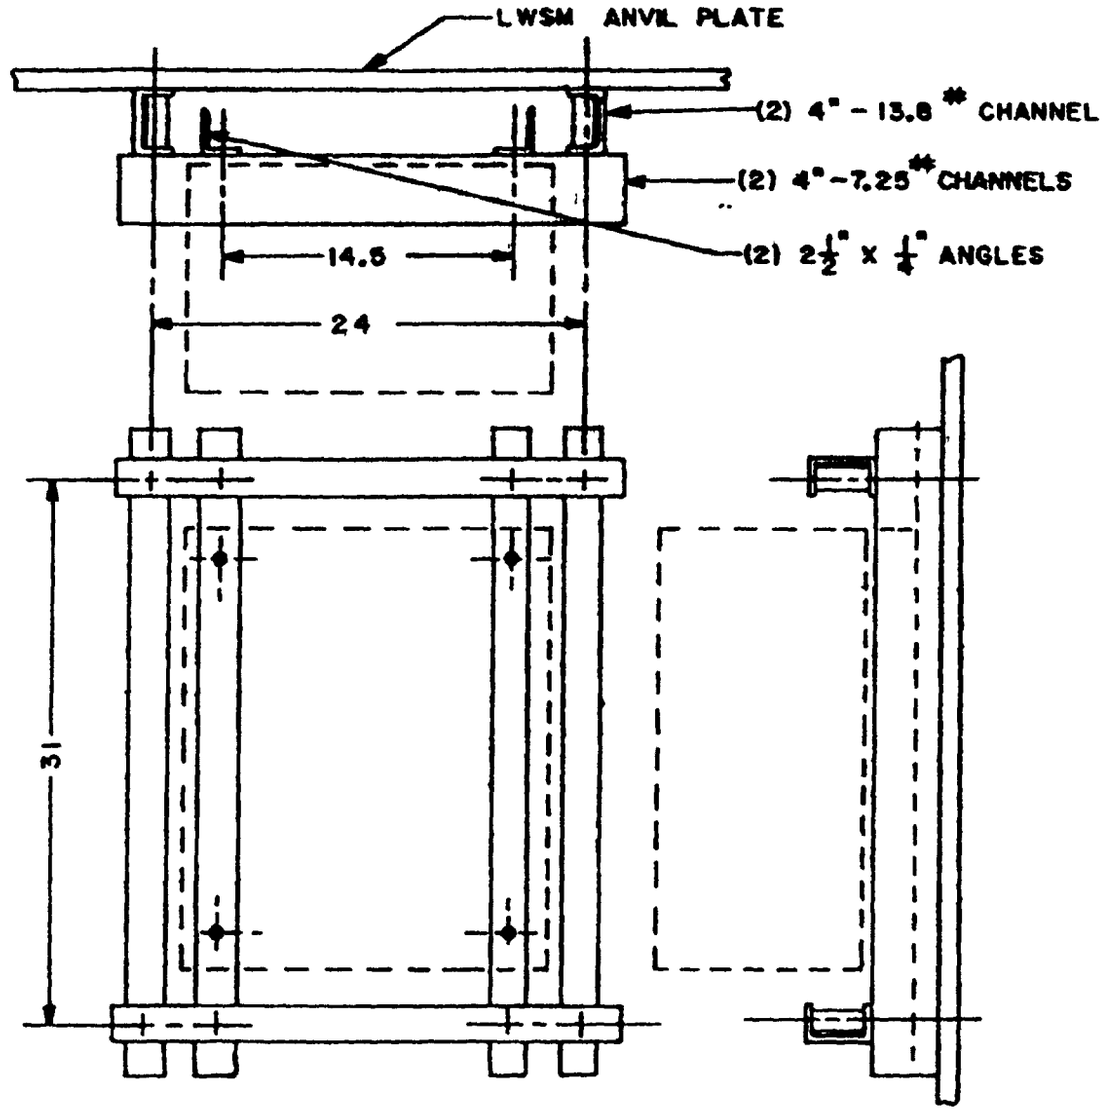


FIGURE 2. Standard mounting fixtures for shock testing of type AQB-A1602 circuit breakers.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

TABLE I. Ratings and overcurrent tripping characteristics.

Frame and sensor ratings: 1600: 1600, 1400, 1200, 1000, 900, 800 800: 800, 700, 640, 560, 480, 400
Long time delay (LTD): Pick-up setting (1/): fixed; 150% of sensor rating Delay setting (2/): fixed, 4 seconds at 600% of sensor rating (3/)
Short time delay (STD): Pick-up settings (1/): adjustable; 2, 2.5, 3, 4, 5, 6, 7, and 8 times sensor rating Delay settings (2/): adjustable; 0, 0.10, 0.20, and 0.30 seconds
Instantaneous (INST): Pick-up setting (4/): fixed at 20 times frame rating

1/ All LTD and STD pick-up current settings are accurate plus or minus 10 percent.
2/ All delay time settings are accurate plus or minus 20 percent.

3/ At other currents, delay time is inversely proportional to current squared.
4/ Instantaneous pick-up current settings are accurate plus or minus 20 percent.

TABLE II. Size of cable and bus bars for temperature rise tests.

Copper rating-amperes	Cables size	Copper bus size (inch)
1600	Four 400 MCM	Two 3 x 1/4

Preparing activity:
Navy - SH
(Project 5925-N156)

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

STANDARDIZATION DOCUMENT IMPROVEMENT PROPOSAL

INSTRUCTIONS

1. The preparing activity must complete blocks 1, 2, 3, and 8. In block 1, both the document number and revision letter should be given.
2. The submitter of this form must complete blocks 4, 5, 6, and 7.
3. The preparing activity must provide a reply within 30 days from receipt of the form.

NOTE: This form may not be used to request copies of documents, nor to request waivers, or clarification of requirements on current contracts. Comments submitted on this form do not constitute or imply authorization to waive any portion of the referenced document(s) or to amend contractual requirements.

1. DOCUMENT NUMBER	2. DOCUMENT DATE (YYMMDD)
MIL-C-17361/15B(SH)	1 March 1994

3. DOCUMENT TITLE
CIRCUIT BREAKERS, AIR, ELECTRIC, INSULATED HOUSING TYPE AQB - A1602 AND NQB - A1602

4. NATURE OF CHANGE *(Identify paragraph number and include proposed rewrite, if possible. Attach extra sheets as needed.)*

5. REASON FOR RECOMMENDATION

6. PREPARING ACTIVITY

a. NAME
COMMANDER
NAVAL SEA SYSTEMS COMMAND

b. TELEPHONE *(Include Area Code)*
(1) Commercial (2) AUTOVON
GEORGE RASICH 703-6025340 AV 332-5340

c. ADDRESS *(Include Zip Code)*
SEA 03R42
2531 JEFFERSON DAVIS HWY
ARLINGTON, VA 22242-5140

IF YOU DO NOT RECEIVE A REPLY WITHIN 45 DAYS, CONTACT:
Defense Quality and Standardization Office
5203 Leesburg Pike, Suite 1403, Falls Church, VA 22041-3466
Telephone (703) 756-2340 AUTOVON 289-2340

DD Form 1426, OCT 89 Previous editions are obsolete. 198/29

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.