MILITARY SPECIFICATION SHEET

# CIRCUIT BREAKERS, AIR, ELECTRIC, INSULATED HOUSING (SHIPBOARD USE) TYPE AQB - LF226 (For replacement only of A225 and LF225)

This specification is approved for use by the Naval Sea Systems Command, Department of the Navy, and is available for use by all Departments and Agencies of the Department of Defense

The requirements for acquiring the product described herein shall consist of this specification sheet and the issue of the following specification listed in that issue of the Department of Defense Index of Specifications and Standards (DoDISS) specified in the solicitation MIL-C-17361

AMSC N/A FSC 5925
DISTRIBUTION STATEMENT A Approved for public release, distribution is unlimited



Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

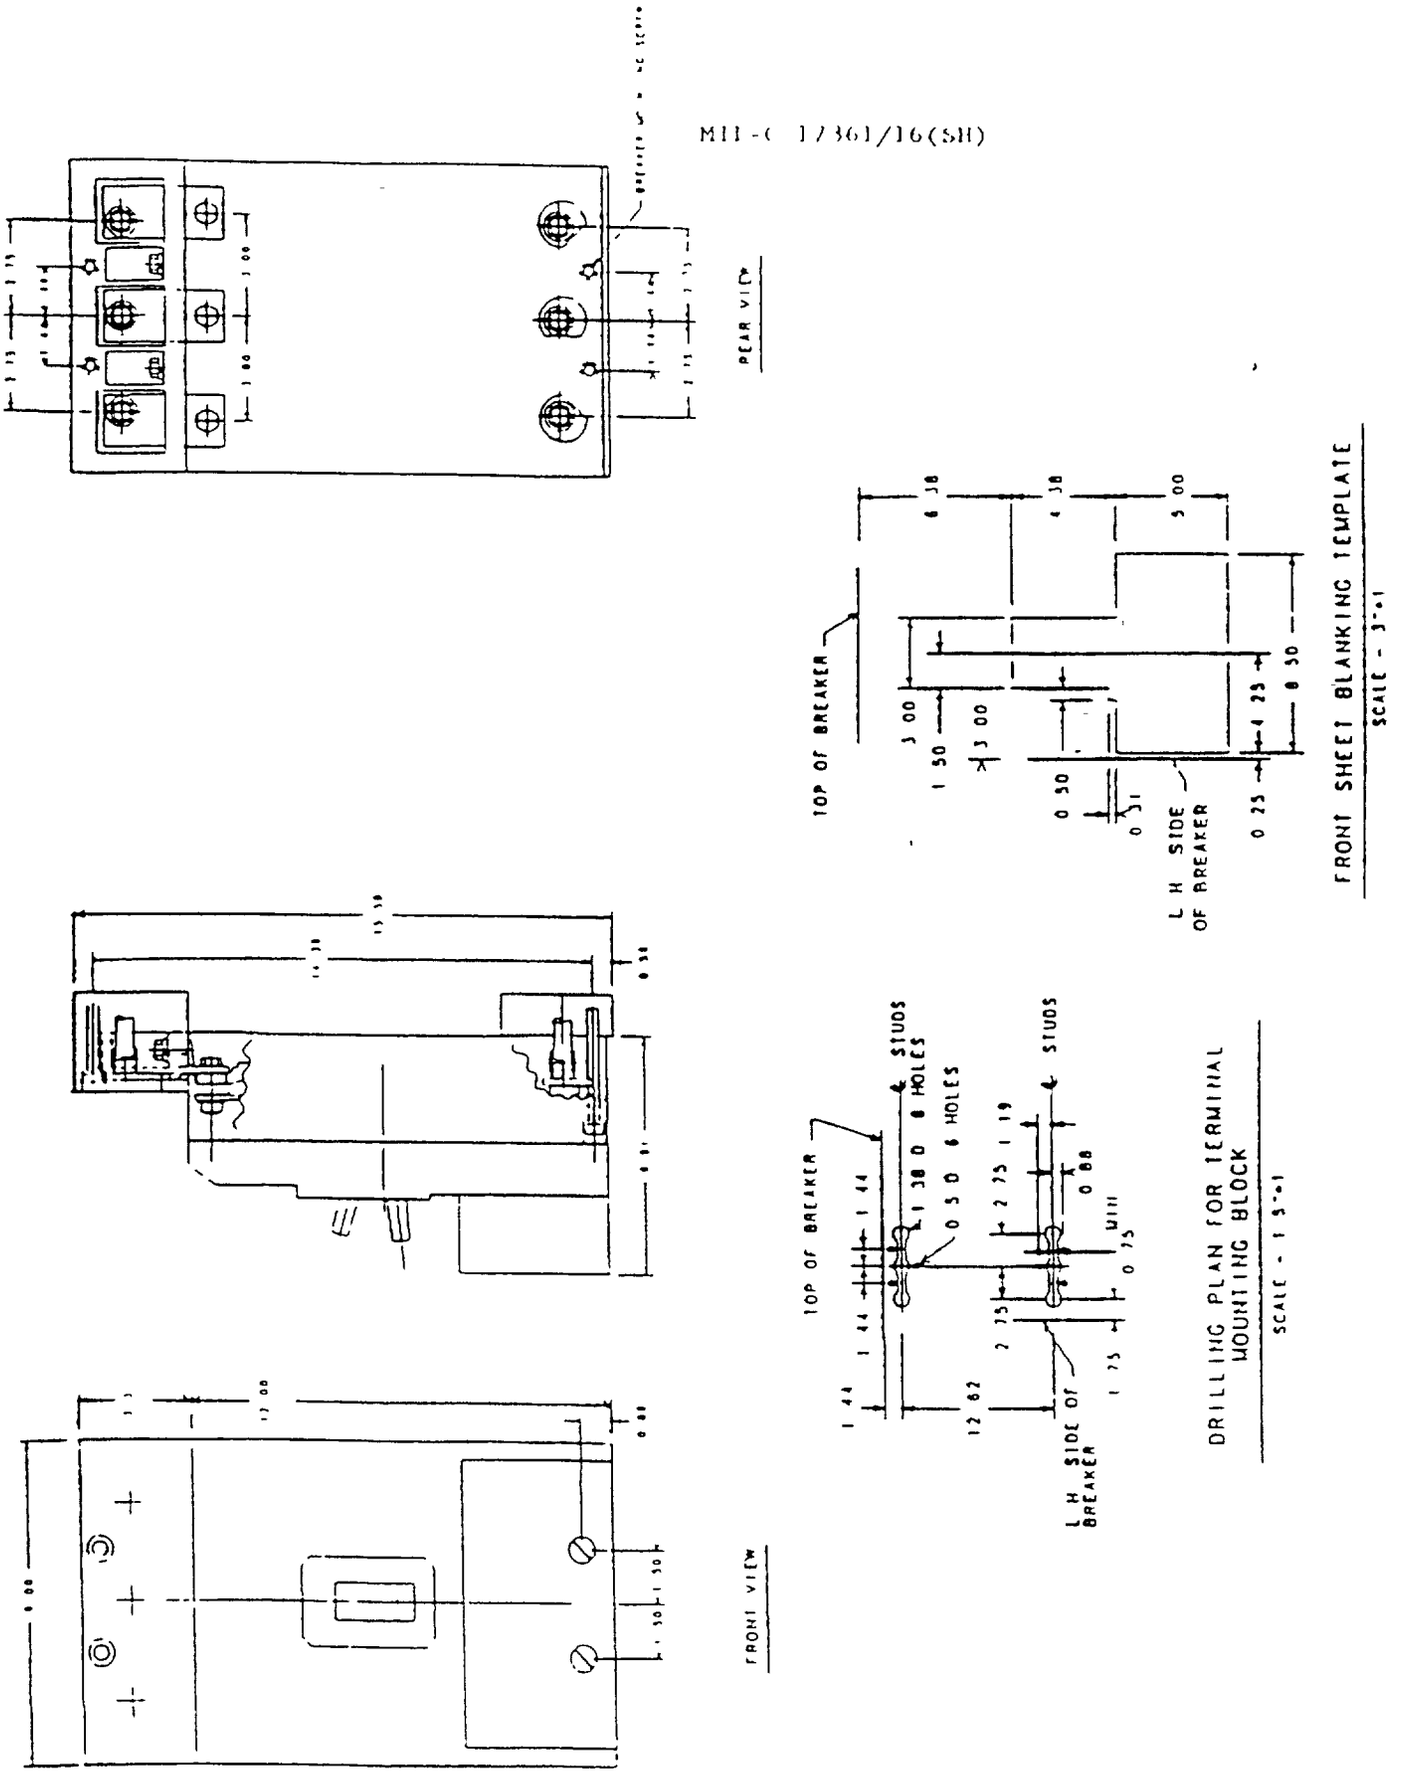
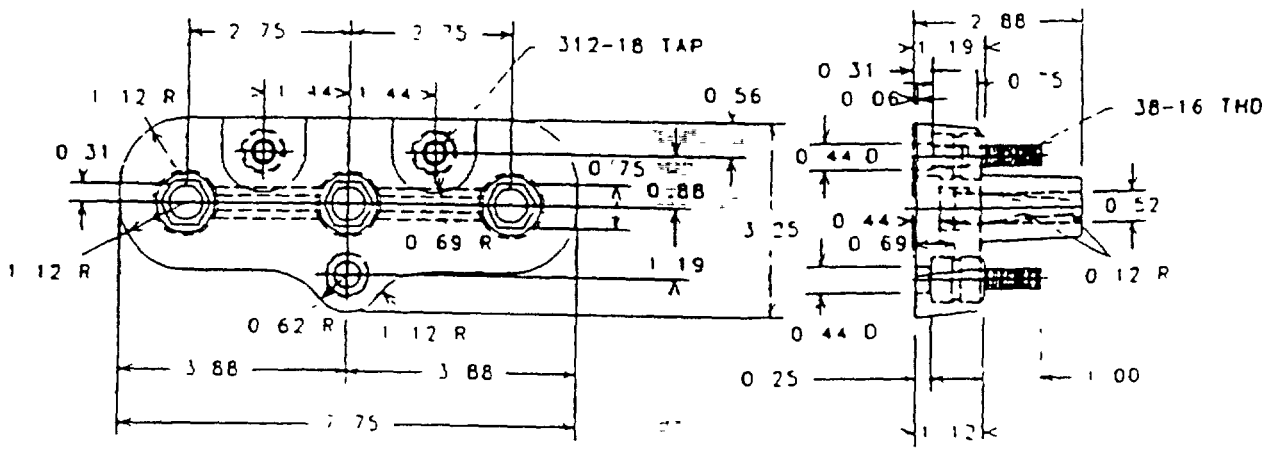


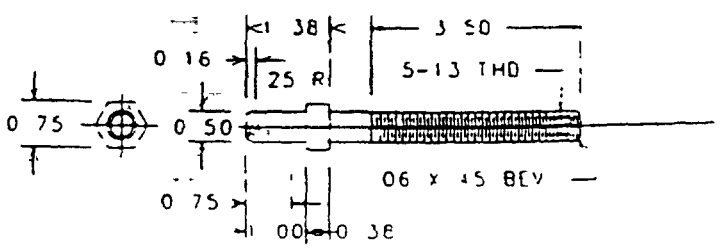

FIGURE 1 Circuit breaker type LF226, outline and mounting dimensions



Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.




MOUNTING BLOCK




CURRENT STUD (SILVER PLATED)

FIGURE 2 Mounting block for circuit breaker type AQB-LF226, outline dimensions



Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

REQUIREMENTS

Dimensions See figures 1 and 2
Maximum rated continuous current 225 amperes
Voltage and frequency 500 Vac, 60 Hz
Interrupting rating 100,000 amperes (60 Hz ac)
Peak let-through current 30,000 amperes
Trip unit Interchangeable
Trip unit rating (amperes) See table I
Protection LTD and adjustable instantaneous, all 3 poles
LTD calibration See table II
Instantaneous calibration See table I
Current limiting fuse LF5H250RD, 14,000 - 20,000 amperes
Type of connections Back (removable mtg )
Electric operator Not available
Undervoltage trip or shunt trip Either available
Auxiliary switch Two (a) contacts, two (b) contacts
Handle lock Group 3 (Figure 1 of MIL-C-17361)
Handle boot Not available
Electrical test The rate of operation shall be 5 operations per minute for a total of 4000 close-open operations
Temperature rise tests See table III
Interrupting tests See table IV
Circuit breaker interrupter, contacts, mechanism and trip unit is AQB-A250 in accordance with MIL-C-17361

NOTE NQB circuit breakers shall consist of an AQB type without trip unit and a modification kit of metallic parts

TABLE I Adjustable instantaneous trip settings amperes/maximum time 1/

| Element rating 2/ | LO 4/ | | 2 | | 3 | | 4 | | HI | | Seconds 3/ | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|
| | Ac | Dc | Ac | Dc | Ac | Dc | Ac | Dc | Ac | Dc | 60 Hz ac | Dc |
| 125L | 650 | --- | 780 | --- | 900 | --- | 1040 | --- | 1300 | --- | | |
| 125LM | 1500 | --- | 1770 | --- | 2025 | --- | 2325 | --- | 3000 | --- | | |
| 150L | 650 | --- | 780 | --- | 900 | --- | 1040 | --- | 1300 | --- | | |
| 150LM | 1500 | --- | 1770 | --- | 2025 | --- | 2325 | --- | 3000 | --- | 0 024 | 0 028 |
| 175L | 650 | --- | 780 | --- | 900 | --- | 1040 | --- | 1300 | --- | | |
| 175LM | 1500 | --- | 1770 | --- | 2025 | --- | 2325 | --- | 3000 | --- | | |
| 225L | 650 | --- | 780 | --- | 900 | --- | 1040 | --- | 1300 | --- | | |
| 225LM | 1500 | --- | 1770 | --- | 2025 | --- | 2325 | --- | 3000 | --- | | |

1/ The tolerance for each ampere setting shall not exceed plus or minus 10 percent
2/ Identification marking of trip units
Numerals indicate continuous current rating of the specific trip unit
Letter "L" denotes that the trip units are applicable to AQB-LF226
Letter "M" denotes calibration for applications having a high inrush current



Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

3/ Time shall be measured at three times the pick-up current of instantaneous coil For qualification tests only, not for routine calibration
4/ The LO and HI settings only are calibrated Others are approximate

TABLE II Tripping characteristics - long time delay

| LTD trip element percent current | Tripping time 60 Hz ac trip element |
|---|---|
| | For ac only |
| 130 | Not less than 1 hour |
| 225 | Less than 1 hour |
| 600 | Between 20 and 32 seconds |

TABLE III Size of cable and bus bars for temperature rise tests

| Copper rating-amperes | Cable size | | Copper bus size (inch) |
|---|---|---|---|
| | Ac | Dc | Ac and Dc |
| 250 | AWG 0000 | AWG 0000 | 1 x 1/8 |

TABLE IV Interrupting tests for circuit breaker type AQB-LF226 1/

| Circuit sample | Element amperes | Interrupting circuit amperes | Power factor lagging | Unit operation | See note |
|---|---|---|---|---|---|
| 1A | 225 | 100,000 | 0 15-0 20 | O-CO-CO | 2/ |
| 1A(1) | 225 | 14,000 | 0 25-0 30 | O-CO-CO | 3/ 4/ |
| 1A(1) | | 20,000 | 0 15-0 20 | O-CO-CO | 2/ 3/ |
| 1A(1) | | 75,000 | 0 15-0 20 | O-CO-CO | 2/ 3/ |
| 1B | 125 | 100,000 | 0 15-0 20 | O-CO-CO | 2/ |

1/ Oscillograms shall be taken on all interrupting tests
2/ Circuit breaker shall open and at least one fuse blow
3/ New circuit breakers may be used for tests above the standard circuit breaker rating
4/ Circuit breaker shall open on instantaneous trip and fuses shall not blow

Preparing activity
Navy - SH
(Project 5925-N173)



Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.