INCH-POUND

MIL-DTL-17361/16A(SH)
19 September 2006

SUPERSEDING
MIL-C-17361/16(SH)
13 March 1995

DETAIL SPECIFICATION SHEET

CIRCUIT BREAKERS, AIR, ELECTRIC, INSULATED HOUSING (SHIPBOARD USE) TYPE AQB-LF226 (FOR REPLACEMENT ONLY OF A225 AND LF225)

This specification is approved for use by the Naval Sea Systems Command and is available for use by all Departments and Agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and MIL-DTL-17361.

LIST OF TABLES

TABLE I. Requirements. 2
TABLE II. Adjustable instantaneous trip settings amperes/maximum time (all 3 poles) /1. 3
TABLE III. Tripping characteristics – long-time delay (LTD) (all 3 poles). 3
TABLE IV. Interruption performance test requirements /1. 4
TABLE V. Endurance and temperature rise test requirements....4

LIST OF FIGURES

FIGURE 1. Circuit breaker type AQB-LF226, outline and mounting dimensions. 5
FIGURE 2. Mounting block for circuit breaker type AQB-LF226, outline dimensions. 6

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

TABLE I. Requirements.

Maximum rated continuous current	225 amperes
Voltage and frequency	500 VAC, 60 Hz
Interrupting rating	100,000 amperes, 60 Hz, ac
Peak let-through current	30,000 amperes
Trip unit	Interchangeable
Current limiting fuses	LF5H25ORD, 14,000–20,000 amperes
Type of connections	Back (removable mtg.)
Electric operator	Not available
Undervoltage trip or shunt trip	Either available
Auxiliary switch	Two (a) contacts; two (b) contacts
Handle lock	Group 3 (Figure 1 of MIL-DTL-17361)
Handle boot	Not available

NOTE: Circuit breaker interrupter, contacts, mechanism and trip unit is AQB-A250 in accordance with MIL-DTL-17361.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

TABLE II. Adjustable instantaneous trip settings amperes/maximum time (all 3 poles) /1.

Element rating /2	LO /4		2		3		4		HI		Seconds /3	
	AC	DC	AC	DC	AC	DC	AC	DC	AC	DC	60 Hz AC	DC
125L	650	----	780	----	900	----	1040	----	1300	----	0.024	0.028
125LM	1500	----	1770	----	2025	----	2325	----	3000	----		
150L	650	----	780	----	900	----	1040	----	1300	----		
150LM	1500	----	1770	----	2025	----	2325	----	3000	----		
175L	650	----	780	----	900	----	1040	----	1300	----		
175LM	1500	----	1770	----	2025	----	2325	----	3000	----		
225L	650	----	780	----	900	----	1040	----	1300	----		
225LM	1500	----	1770	----	2025	----	2325	----	3000	----		

NOTES:

/1 The tolerance for each ampere setting shall not exceed ±10%.

/2 Identification marking of trip units:
Numerals indicate continuous current rating of the specific trip unit.
Letter “L” denotes that the trip units are applicable to AQB-LF226.
Letter “M” denotes calibration for applications having a high inrush current.

/3 Time shall be measured at three times the pickup current of instantaneous coil. For qualification tests only, not for routine calibration.

/4 The LO and HI settings only are calibrated. Others are approximate.

TABLE III. Tripping characteristics – long-time delay (LTD) (all 3 poles).

LTD trip element % current	Tripping time 60-Hz AC trip element
	For AC only
150	Not less than 1 hour
225	Less than 1 hour
600	Between 20 and 32 seconds

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

TABLE IV. Interruption performance test requirements /1.

Circuit sample	Element amperes	Interrupting circuit amperes	Power factor lagging	Unit operation	See note
1A	225	100,000	0.15–0.20	O-CO-CO	/2
1A (1)	225	14,000	0.25–0.30	O-CO-CO	/3 /4
1A (1)		20,000	0.15–0.20	O-CO-CO	/2 /3
1A (1)		75,000	0.15–0.20	O-CO-CO	/2 /3
1B	125	100,000	0.15–0.20	O-CO-CO	/2

NOTES:

/1 Oscillograms shall be taken on all interrupting tests.

/2 Circuit breaker shall open and at least one fuse blow.

/3 New circuit breakers may be used for tests above the standard circuit breaker rating.

/4 Circuit breaker shall open on instantaneous trip and fuses shall not blow.

TABLE V. Endurance and temperature rise test requirements.

<table>
<tr><td>Electrical endurance test</td><td colspan="4">The rate of operation shall be 5 operations per minute for a total of 4000 close-open operations.</td></tr>
<tr><td rowspan="3">Temperature rise tests</td><td colspan="4">Size of cable and bus bars for temperature rise tests</td></tr>
<tr><td rowspan="2">Copper rating (amperes)</td><td colspan="2">Cable size</td><td>Copper bus size (inch)</td></tr>
<tr><td>Ac</td><td>DC</td><td>AC and DC</td></tr>
<tr><td></td><td>250</td><td>AWG 0000</td><td>AWG 0000</td><td>1 X 1/8</td></tr>
</table>

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

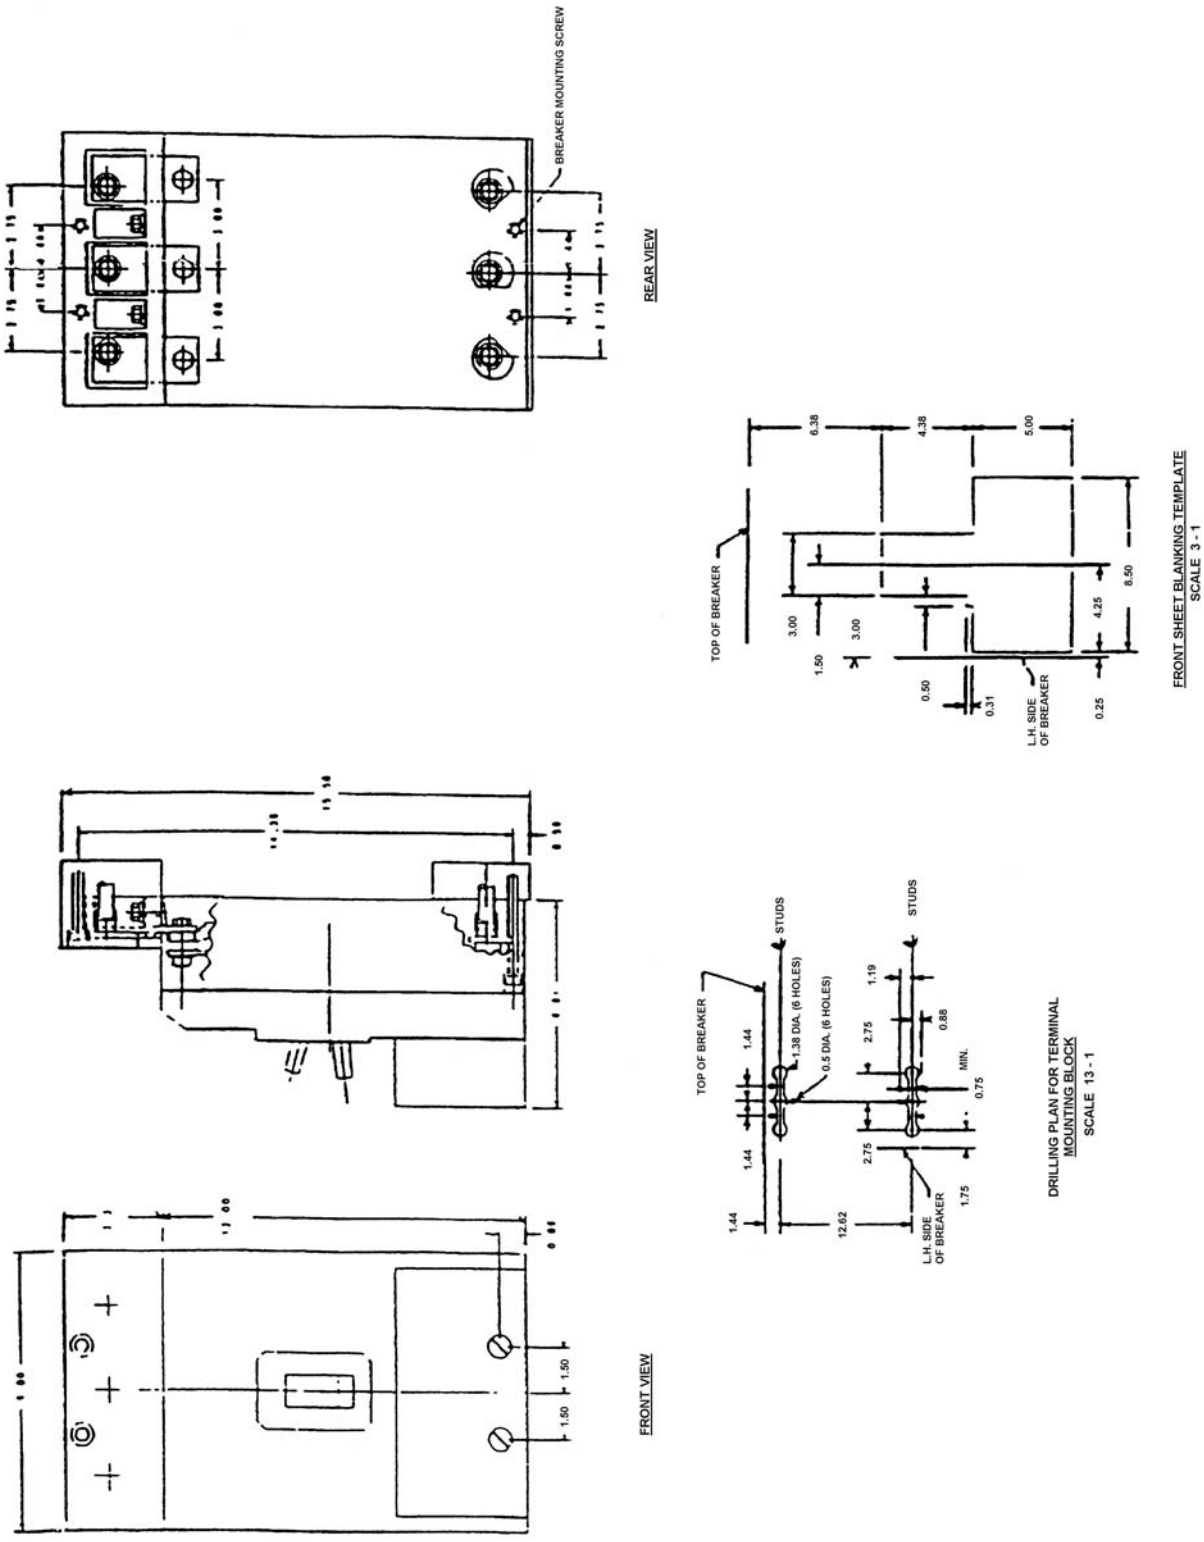


FIGURE 1. Circuit breaker type AQB-LF226, outline and mounting dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.

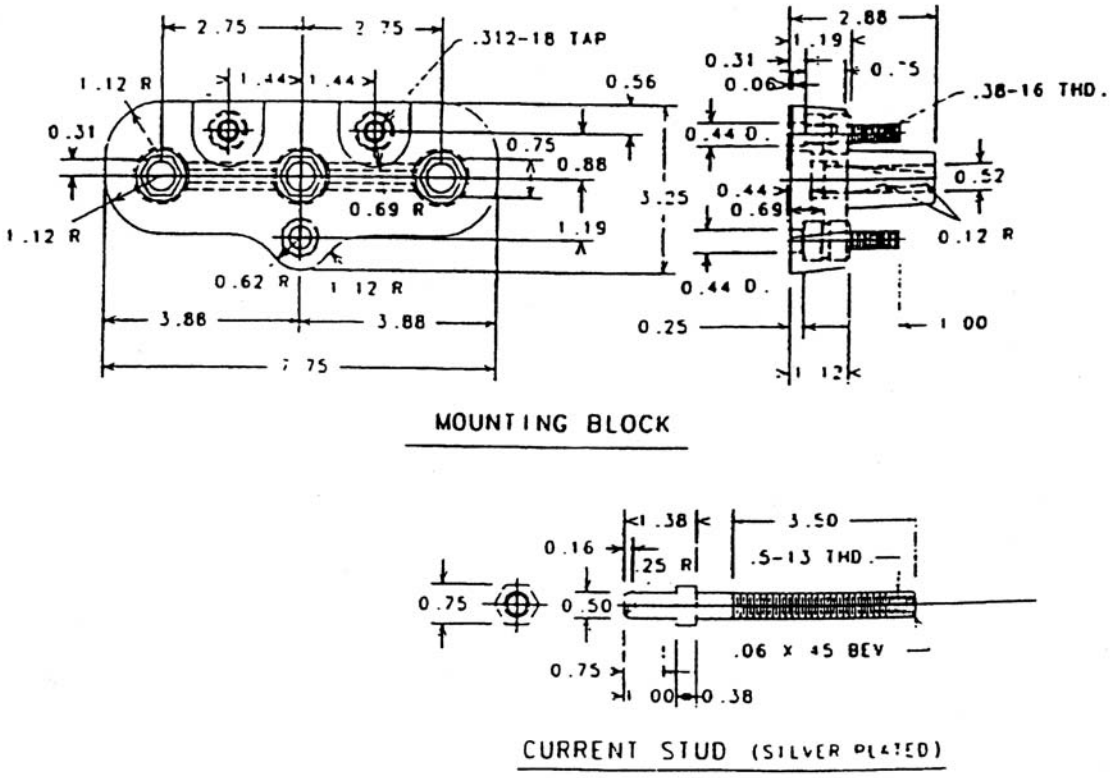


FIGURE 2. Mounting block for circuit breaker type AQB-LF226, outline dimensions.

CHANGES FROM PREVIOUS ISSUE: Marginal notations are not used in this revision to identify changes with respect to the previous issue due to the extent of the changes.

Preparing Activity:
Navy – SH
(Project 5925-N185-016)

NOTE: The activities listed above were interested in this document as of the date of this document. Since organizations and responsibilities can change, you should verify the currency of the information above using the ASSIST Online database at http://assist.daps.dla.mil.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:03Z
Check the source to verify that this is the current version before use.