INCH-POUND
MIL-C-17361/7(SH)
10 March 1989

MILITARY SPECIFICATION SHEET

CIRCUIT BREAKERS, AIR, ELECTRIC, INSULATED HOUSING (SHIPBOARD USE) TYPE AQB - LF250

This specification is approved for use by the Naval Sea Systems Command, Department of the Navy, and is available for use by all Departments and Agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and the issue of the following specification listed in that issue of the Department of Defense Index of Specifications and Standards (DoDISS) specified in the solicitation: MIL-C-17361.

AMSC N/A
FSC 5925
DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

Source: https://assist.dla.mil -- Downloaded: 2026/10-18T10:02Z
Check the source to verify that this is the current version before use.


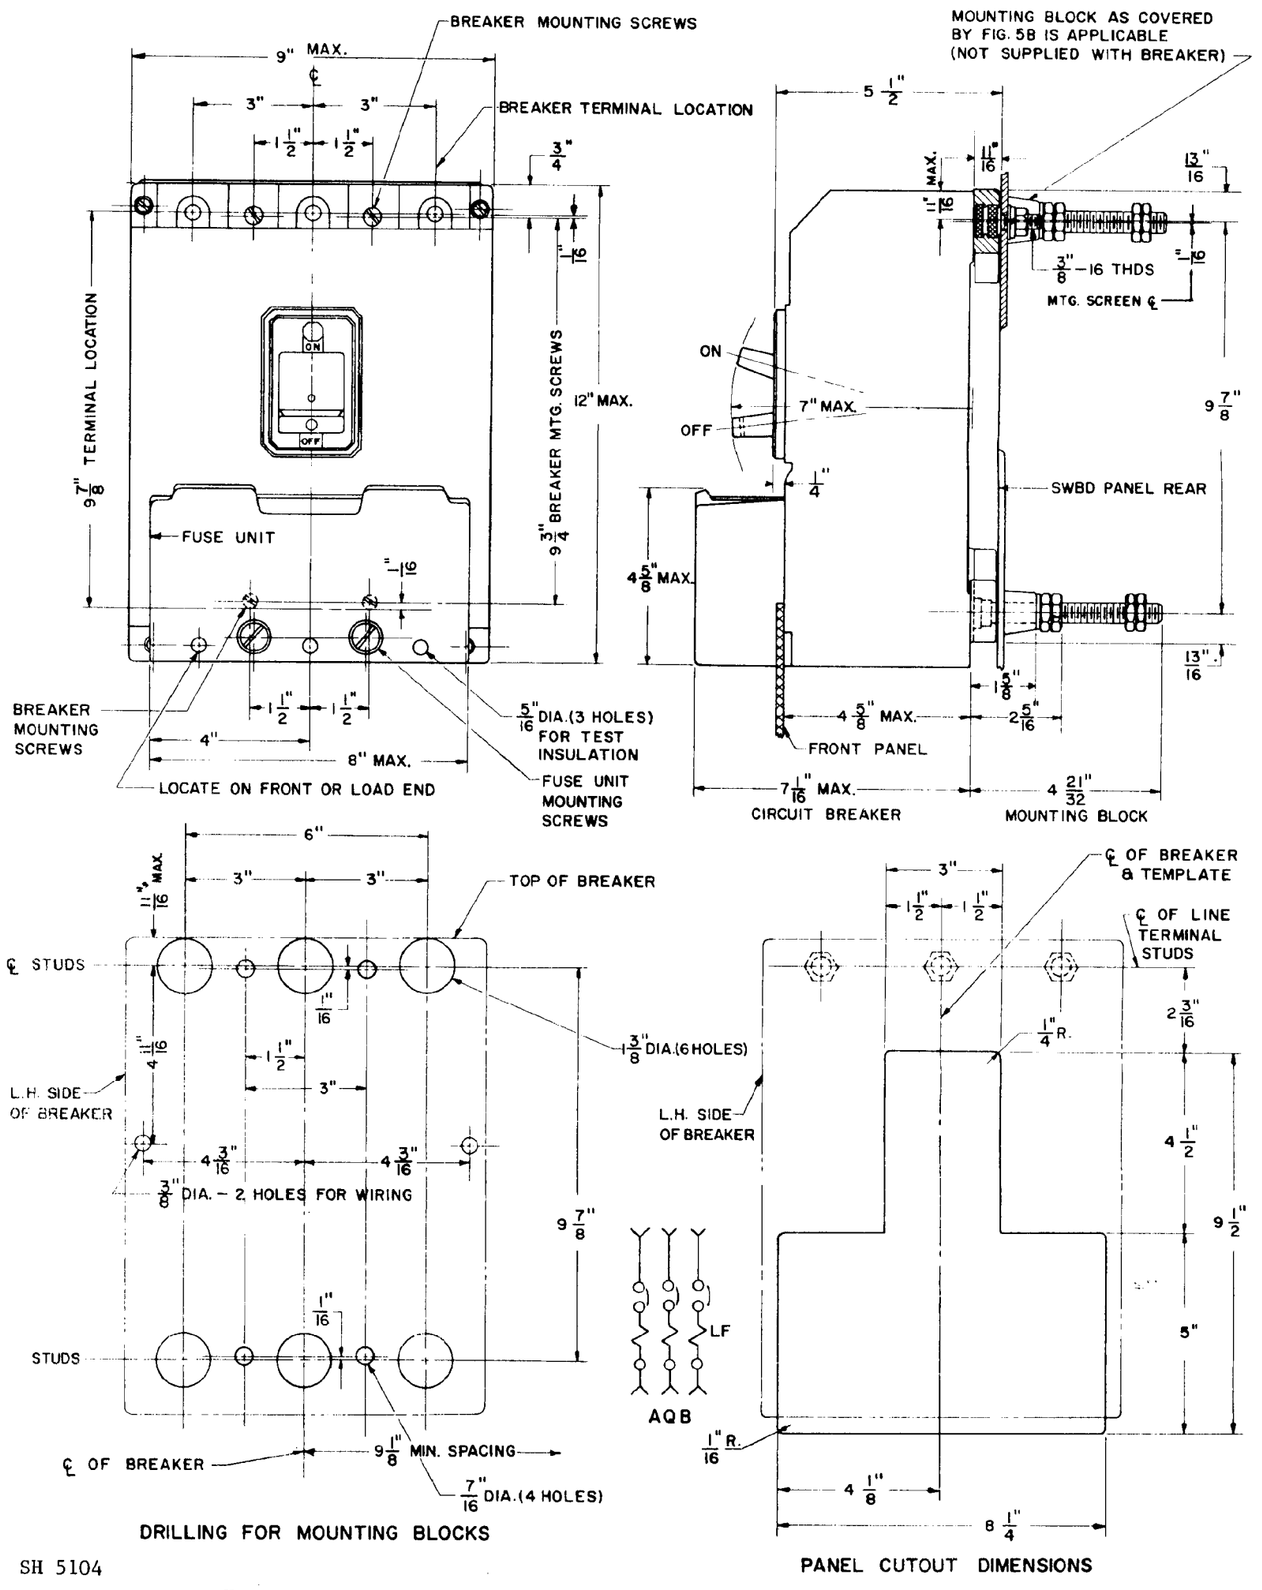


FIGURE 1. Circuit breaker type AQB-LF250, outline and mounting dimensions.

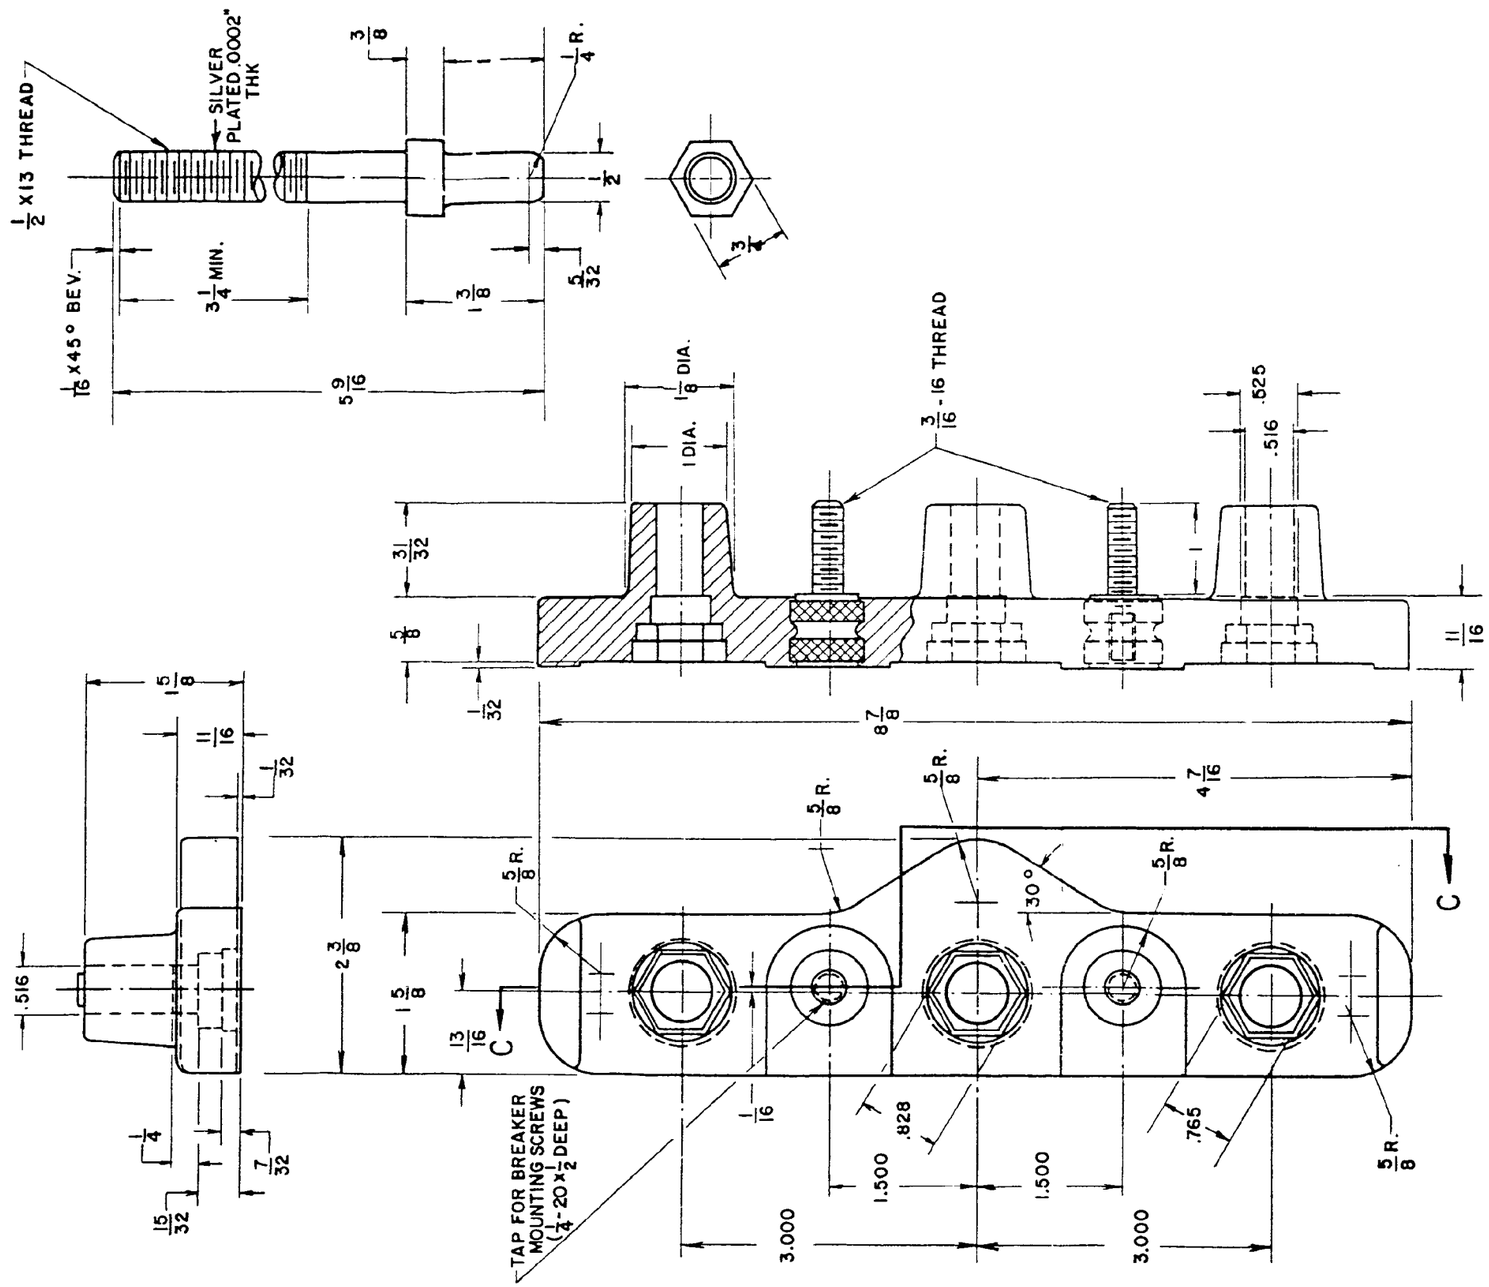

SECTION C-C

FIGURE 2. Mounting block for circuit breaker type AQB-LF250, outline dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

REQUIREMENTS :

Dimensions:	See figures 1 and 2.
Rated continuous current:	250 amperes.
Voltage and frequency:	500 Vat, 60 Hz. 355 Vdc.
Interrupting rating:	100,000 amperes (rms symmetrical) (60 Hz at). 150,000 amperes (250 Vdc). 150,000 amperes (355 Vdc).
Peak let-through current:	30,000 amperes.
Trip unit:	Interchangeable.
Trip unit rating (amperes):	See table I.
Protection:	LTD and adjustable instantaneous, all 3 poles, LTD calibration: See table II. Instantaneous calibration: See table I.
Current limiting fuse:	LF5H250RD, 14,000 - 20,000 amperes (rms symmetrical).
Type of connections:	Back (removable mtg.).
Electric operator:	Not available.
Undervoltage trip or shunt trip:	Either available.
Auxiliary switch:	Two (a) contacts; two (b) contacts.
Handle lock:	Group 3. (Figure 1 of MIL-C-17361)
Handle boot:	Not available.
Electrical test:	The rate of operation shall be 5 operations per minute for a total of 4000 close-open operations.
Temperature rise tests:	See table III.
Interrupting tests:	See table IV.

NOTE: NQB circuit breakers shall consist of an AQB type without trip unit and a modification kit of metallic parts.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

TABLE I. Adjustable instantaneous trip settings amperes/maximum time. 1/

Element rating 2/	LO 4/		2		3		4		HI		Seconds 3/	
	Ac	Dc	Ac	Dc	Ac	Dc	Ac	Dc	Ac	Dc	60 Hz ac	Dc
125L	650	---	780	---	900	---	1040	---	1300	---		
125LM	1500	---	1770	---	2025	---	2325	---	3000	---		
150L	650	---	780	---	900	---	1040	---	1300	---		
150LM	1500	---	1770	---	2025	---	2325	---	3000	---		
175L	650	---	780	---	900	---	1040	---	1300	---		
175LM	1500	---	1770	---	2025	---	2325	---	3000	---	0.024	0.028
225L	650	---	780	---	900	---	1040	---	1300	---		
225LM	1500	---	1770	---	2025	---	2325	---	3000	---		
250L	650	---	780	---	900	---	1040	---	1300	---		
250LM	1500	---	1770	---	2025	---	2325	---	3000	---		
250LG	2520	---	2960	---	3120	---	3590	---	4200	---		

1/ The tolerance for each ampere setting shall not exceed plus or minus 10 percent.

2/ Identification marking of trip units:
Numerals indicate continuous current rating of the specific trip unit.
Letter “G” denotes special calibration for use as generator or transformer protection.
Letter “L” denotes that the trip units are available to AQB-LF250.
Letter “M” denotes calibration for applications having a high inrush current.

3/ Time shall be measured at three times pick-up current of instantaneous coil. For qualification tests only, not for routine calibration.

4/ The LO and HI settings only are calibrated. Others are approximate.

TABLE II. Tripping characterisitics - long time delay.

LTD trip element percent current	Tripping time 60 Hz ac trip element
	For ac only.
130	Not less than 1 hour
225	Less than 1 hour
600	Between 20 and 32 seconds

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

TABLE III. Size of cable and bus bars for temperature rise tests.

Copper rating-amperes	Cable size		Copper bus size (inch)
	Ac	Dc	Ac and DC
250	AWG 0000	AWG 0000	1 X 1/8

TABLE IV. Interrupting tests. 1/

Circuit sample	Element amperes	Interrupting amperes	Power factor lagging	Unit operation	See note
1A	250	100,000	0.15-0.20	O-CO-CO	2/
1A(1) 1A(1) 1A(1)	250	14,000 20,000 75,000	0.25-0.30 0.15-0.20 0.15-0.20	O-CO-CO O-CO-CO O-CO-CO	3/ 4/ 2/ 3/ 2/ 3/
1B	125	100,000	0.15-0.20	O-CO-CO	2/

1/ Oscillograms shall be taken on all interrupting tests.
2/ Circuit breaker shall open and at least one fuse blow.
3/ New circuit breakers may be used for tests above the standard circuit breaker rating.
4/ Circuit breaker shall open on instantaneous trip and fuses shall not blow.

Preparing activity:
Navy - SH
(Project 5925-N103-07)

☆U.S. GOVERNMENT PRINTING OFFICE: 1989 - 604-033/12321

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.