INCH-POUND
MIL-C-17361/8A(SH)
13 March 1995
SUPERSEDING
MIL-C-17361/8(SH)
10 March 1989

MILITARY SPECIFICATION SHEET

CIRCUIT BREAKERS, AIR, ELECTRIC, INSULATED HOUSING (SHIPBOARD USE) TYPE AQB - A400, AQB - A402, AND NQB - A400


This specification is approved for use by the Naval Sea Systems Command, Department of the Navy, and is available for use by all Departments and Agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and the issue of the following specification listed in that issue of the Department of Defense Index of Specifications and Standards (DoDISS) specified in the solicitation: MIL-C-17361.

AMSC N/A FSC 5925


DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.


Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

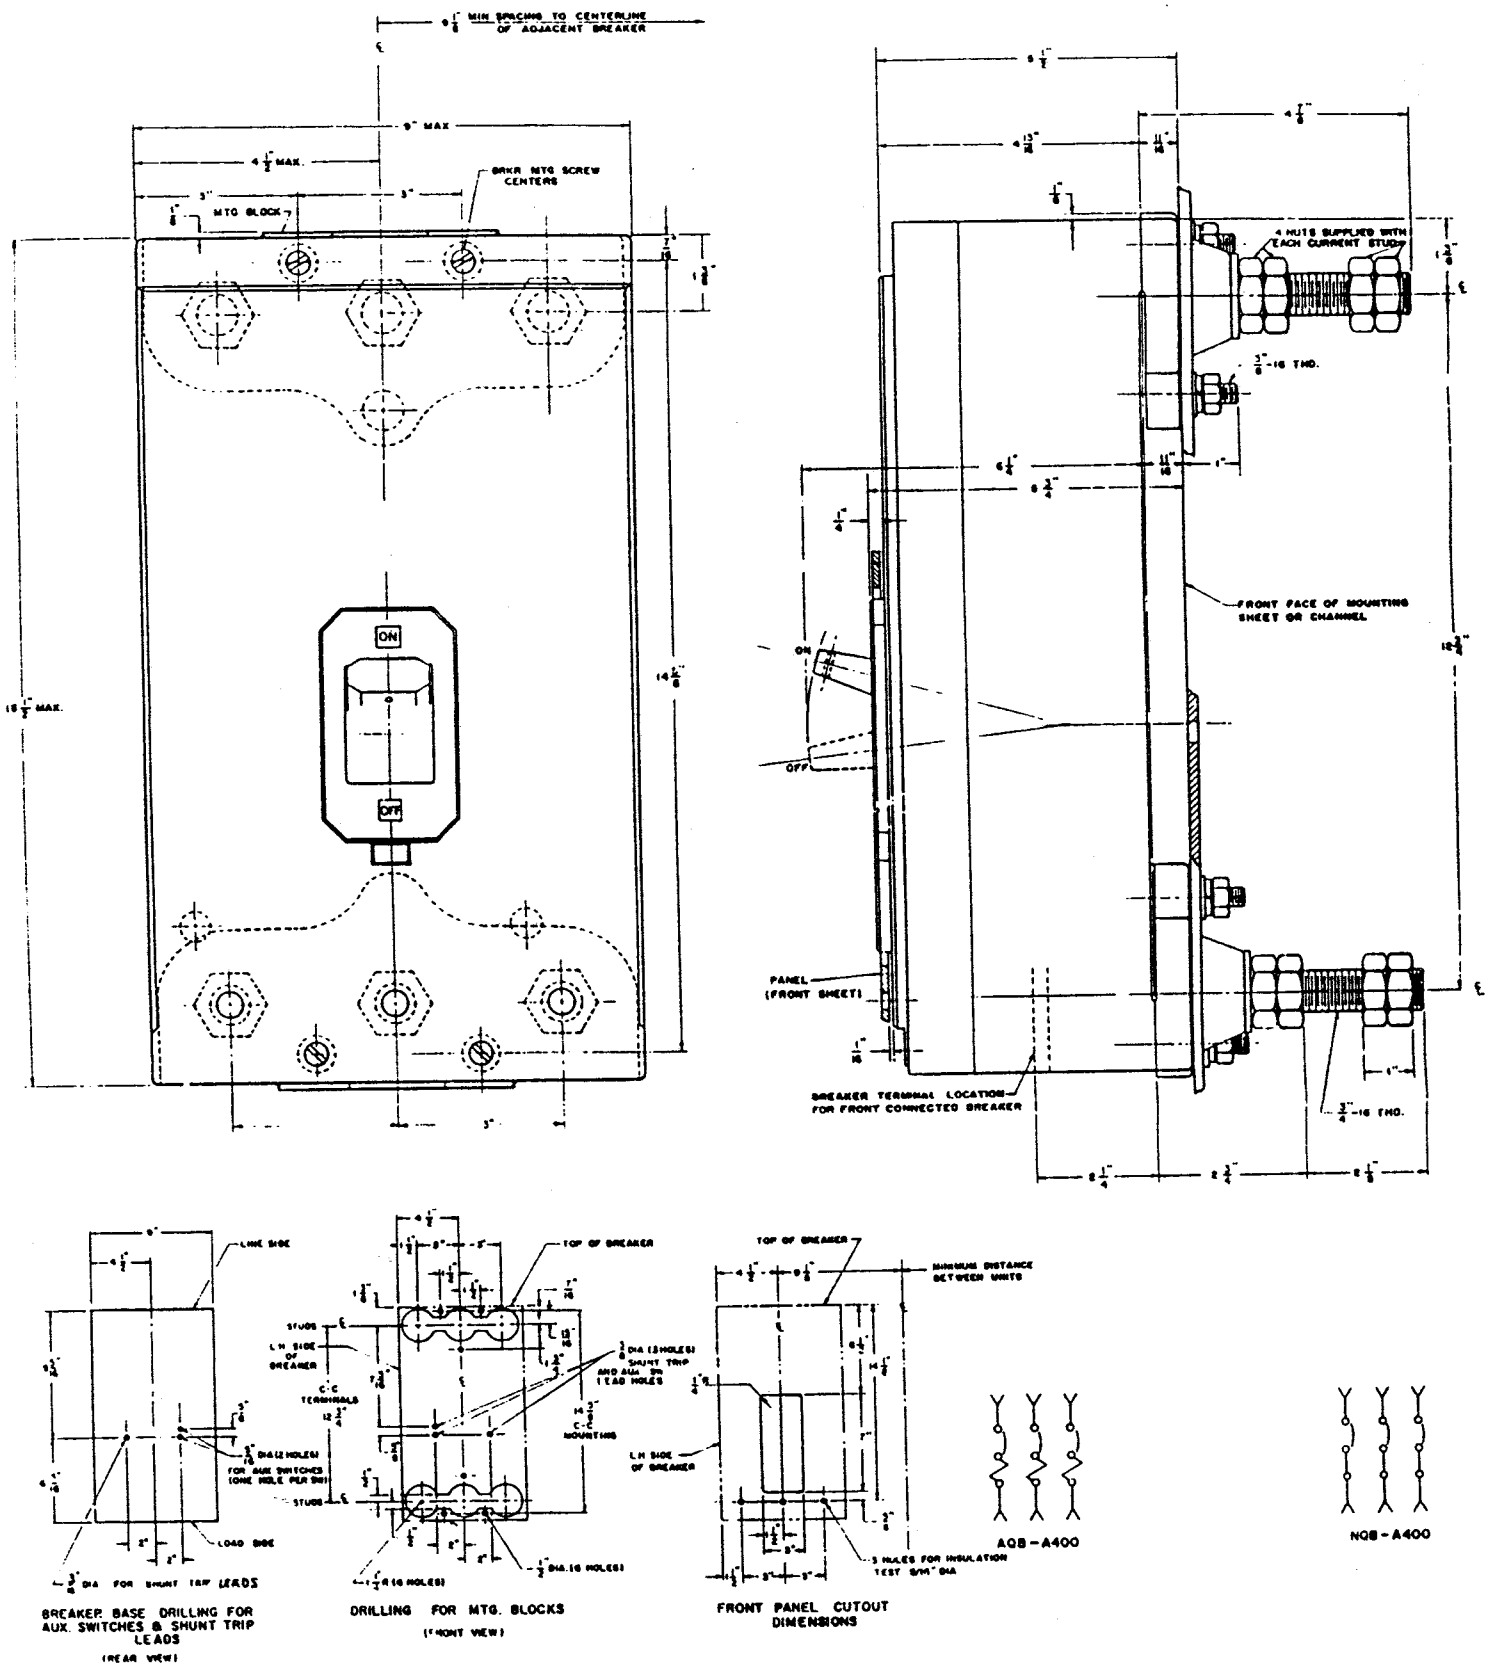



* **FIGURE 1. Circuit breaker types AQB-A400, AQB-A402 and NQB-A400, outline and mounting dimensions**

Source: https://assist.dla.mil -- Downloaded: 20261O-18T10:02Z
Check the source to verify that this is the current version before use.

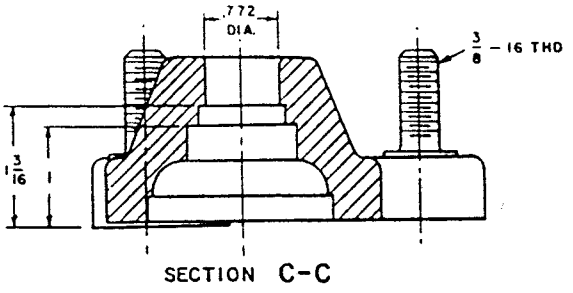

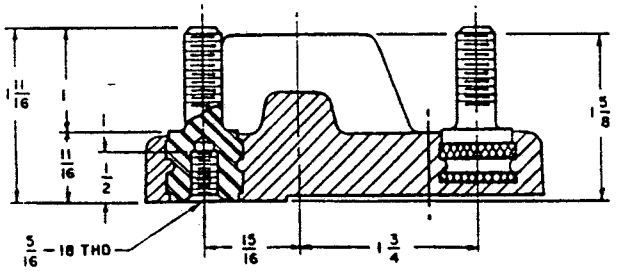

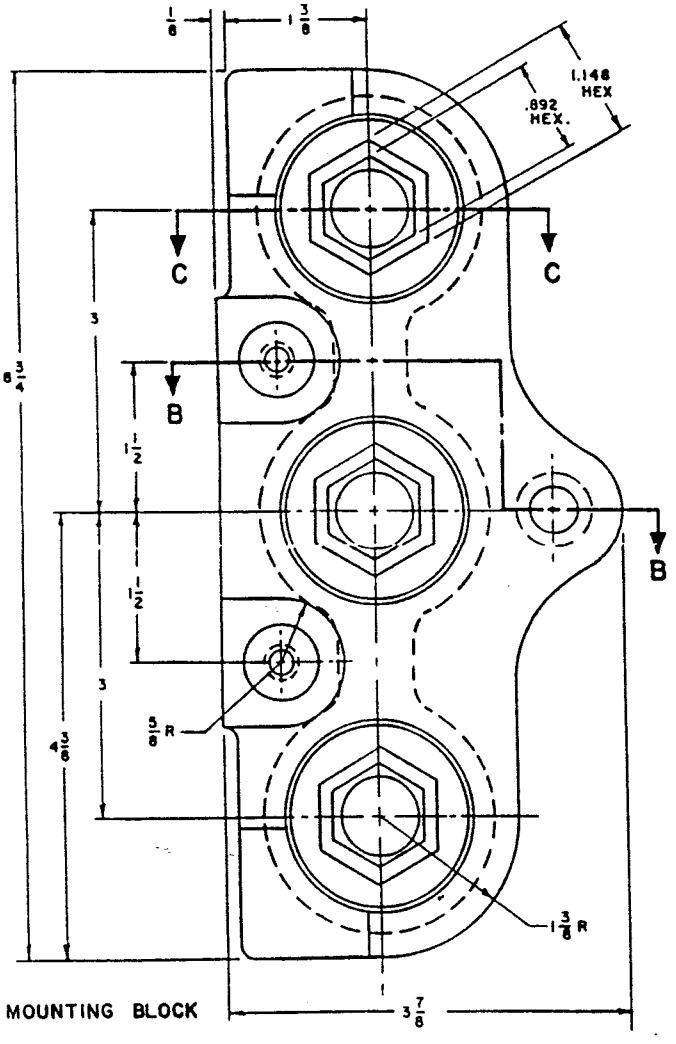

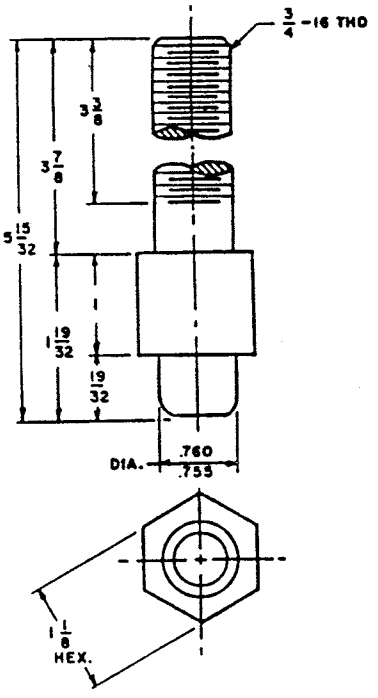

CURRENT STUD
(SILVER PLATED .0002" THK.)

*FIGURE 2. Mounting block for circuit breaker types AQB-A400, AQB-A402, and NQB-A400

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Dimensions: See figures 1 and 2.
Maximum rated continuous current: 400 amperes.
Voltage and frequency: 500 Vac, 60 Hz.
500 Vac, 400 Hz.
250 Vdc.
Interrupting rating: 30,000 amperes (60 Hz ac).
10,000 amperes (400 Hz ac).
20,000 amperes (250 Vdc).
Peak let-through current: Not applicable.
Trip unit: Interchangeable.
Protection (for trip units type AQB-A400 only):
Trip unit rating (amperes): See table I.
LTD and adjustable instantaneous, all 3 poles.
LTD calibration: See table II.
Instantaneous calibration: See table I.
Protection (for trip units type AQB-A402 only):
Frame rating: 400 amperes (ac only, no dc rating).
Continuous current settings (CCS): 250, 300, 350, and 400 amperes.
LTD, STD, and Instantaneous, all 3 poles.
LTD calibration: See table IIa.
STD calibration: The short time delay pickup settings shall be 2X, 3X, 4X, 6X, 8X, 10X, and 15X the continuous current settings. The short time delay "delay settings" shall be as specified in Table IIb.
Instantaneous calibration: The instantaneous pickup settings shall be 3X, 4X, 6X, 8X, 10X, 12X, 15X, 20X, 30X, and 40X the frame rating. Production units shall be calibrated at the 8X setting. Opening time shall be 0.025 seconds or less when tested at 3X the instantaneous pickup (for qualification tests only, not for routine calibration).
Time characteristics curves (TCC): TCC shall be developed and provided. Test points listed for LTD, STD, and Instantaneous shall comply with the TCC.
Current limiting fuse: Not applicable.
Type of connections: Front, back (removable mtg.), and combination.
Electric operator: Available.
Undervoltage trip or shunt trip: Either available.
Auxiliary switch: Two (a) contacts; two (b) contacts.
Handle lock: Group 3. (Figure 1 of MIL-C-17361)
Handle boot: Not available.
Electrical test: The rate of operation shall be 5 operations per minute for a total of 4000 close-open operations.
Temperature rise tests: See table III.

NOTE: NQB circuit breakers shall consist of an AQB type without trip unit and a modification kit of metallic parts.

Source: https://assist.dla.mil -- Downloaded: 20261-18T10:02Z
Check the source to verify that this is the current version before use.

TABLE I. Adjustable instantaneous trip settings amperes/maximum time. 1/

Element rating 2/	LO 4/		2		3		4		HI		Seconds 3/		
	Ac	Dc	Ac	Dc	Ac	Dc	Ac	Dc	Ac	Dc	60 Hz ac	400 Hz ac	Dc
250K	880	1150	1035	1200	1165	1280	1325	1505	1530	1765			
250KM	3190	3350	3725	4150	4325	4875	5175	5550	5825	6300			
250KH	2020	---	2225	---	2530	---	2840	---	3420	---			
300K	1380	1600	1610	1690	1820	1790	2035	2015	2280	2285			
300KM	3190	3350	3725	4150	4325	4875	5175	5550	5825	6300			
300KH	2020	--	2225	---	2530	---	2840	---	3420	---			
350K	1380	1600	1610	1690	1820	1790	2035	2015	2280	2285	0.024	0.028	0.028
350KM	3190	3350	3725	4150	4325	4875	5175	5550	5825	6300			
350KH	2020	---	2225	---	2530	---	2840	---	3420	---			
350KG	3190	---	3725	---	4325	---	5175	---	5825	---			
350KGH	2020	---	2225	---	2530	---	2840	---	3420	---			
400K	1380	1600	1610	1690	1820	1790	2035	2015	2280	2285			
400KM	3190	3350	3725	4150	4325	4875	5175	5550	5825	6300			
400KH	2020	---	2225	---	2530	---	2840	---	3420	---			

1/ The tolerance for each ampere setting shall not exceed plus or minus 10 percent.

2/ Identification marking of trip units:
Numerals indicate continuous current rating of the specific trip unit.
Letter "K" denotes that the trip units are applicable to AQB-A400.
Letter "G" denotes special calibration for use as generator or transformer protection.
Letter "H" denotes calibration for 400 Hz applications.
Letter "M" denotes calibration for applications having a high inrush current.

3/ Time shall be measured at three times pick-up current of instantaneous setting. For qualification tests only, not for routine calibration.

4/ The LO and HI settings only are calibrated. Others are approximate.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

TABLE II. Tripping characteristics - long time delay (for trip units type AQB-A400 only).

LTD trip element percent current	Tripping time 60 Hz ac trip element dc trip element	Tripping time 400 Hz ac trip element
135	----	Not less than 1 hour
150	Not less than 1 hour	----
225	Less than 1 hour	Less than 1 hour
600	Between 20 and 32 seconds	Between 35 to 45 seconds
	Trip unit with "G" marking1/	
150	Not less than 20 minutes	Not less than 20 minutes
200	Between 5 and 15 minutes	Between 5 and 15 minutes
300	Between 60 and 120 seconds	Between 60 and 120 seconds

1/ Letter "G" denotes special calibration for use as generator or transformer protection.

TABLE IIa. Tripping characteristics - long time delay (for trip units type AQB-A402 only).

LTD in Multiples of CCS	Tripping Time 60 Hz and 400 Hz ac
1.35	Not less than 1 hour
1.65	Less than 1 hour
4.0	Between 35 and 55 seconds
6.0	Between 20 and 32 seconds

TABLE IIb. Adjustable Short-Time Delay "Delay Settings" in Seconds (for trip units type AQB-A402 only).

Short-Time Delay Pickup Setting	Short-Time Delay "Delay Settings"		
	1	2	3
All Settings	.025 - .055 1/	.065 - .095	.105 - .135

1/ Time delay with 2X short-time delay pickup settings shall be .025 to .065 seconds.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

TABLE III. Size of cable and bus bars for temperature rise tests.

Copper rating-amperes	Cable size		Copper bus size (inch)
	Ac	Dc	Ac and Dc
400	Two AWG 000	400 MCM	1-1/2 x 1/8

Preparing activity:
Navy - SH
(Project 5925-N169)

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.