INCH-POUND

MIL-DTL-17361/8B(SH)
19 September 2006

SUPERSEDING
MIL-C-17361/8A(SH)
13 March 1995

DETAIL SPECIFICATION SHEET

CIRCUIT BREAKERS, AIR, ELECTRIC, INSULATED HOUSING (SHIPBOARD USE) TYPES AQB-A400, AQB-A402, NQB-A400, AND NQB A402

This specification is approved for use by the Naval Sea Systems Command and is available for use by all Departments and Agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and MIL-DTL-17361.

LIST OF TABLES

TABLE I. Requirements. 2
TABLE II. Continuous current ratings and settings. 3
TABLE III. Adjustable instantaneous trip settings amperes/maximum time (all 3 poles). 4
TABLE IV. Adjustable short-time delay pickup (STDPU) settings in amperes (STD) (all 3 poles) (for trip unit types AQB-A402 only). 4
TABLE V. Adjustable short-time delay (STD) settings in seconds (for trip unit types AQB-A402 only). 5
TABLE VI. Tripping characteristics – long-time delay (LTD) (all 3 poles). 5
TABLE VII. Test requirements. 5

LIST OF FIGURES

FIGURE 1. Circuit breaker types AQB-A400, AQB-A402, NQB-A400, and NQB A402 outline dimensions. 6
FIGURE 2. Circuit breaker types AQB-A400, AQB-A402, NQB-A400, and NQB-A402 outline and mounting block dimensions. 7
FIGURE 3. Circuit breaker types AQB-A400, AQB-A402, NQB-A400, and NQB-A402 mounting dimensions. ...8
FIGURE 4. Circuit breaker types AQB-A400, AQB-A402, NQB-A400, and NQB-A402 typical wiring diagram, terminal arrangements, handle locking device, and mounting block outline dimensions. 9
FIGURE 5. Circuit breaker type AQB-A402 time-current response. 10

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

TABLE I. Requirements.

Maximum rated continuous current	400 amperes
Voltage and frequency	500 VAC, 60 Hz 500 VAC, 400 Hz 250 VDC (AQB-A400 only)
Interrupting rating	30,000 amperes, 60 Hz, AC 10,000 amperes, 400 Hz, AC 20,000 amperes, 250 VDC (AQB-A400 only)
Peak let-through current	Not applicable
Trip unit	Interchangeable
Current limiting fuses	Not applicable
Type of connections	Front, back (removable mtg.), and combination
Electric operator	Available
Undervoltage trip or shunt trip	Either available
Auxiliary switch	Two (a) contacts; two (b) contacts
Handle lock	Group 3 (Figure 1 of MIL-DTL-17361)
Handle boot	Not available

NOTE: NQB circuit breakers shall consist of an AQB type without trip unit and a modification kit of metallic parts.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

TABLE II. Continuous current ratings and settings.

AQB-A400 trip units only													
Element rating /1													
250K	250 KM	250 KH	300K	300 KM	300 KH	350K	350 KM	350 KH	350 KG	350 KGH	400K	400 KM	400 KH
AQB-A402 trip units only													
Continuous current setting (amperes)													
250				300			350				400		

NOTE:

/1 Identification marking of trip units:

Numerals indicate continuous current rating of the specific trip unit.
Letter “K” denotes that the trip units are applicable to AQB-A400.
Letter “G” denotes special calibration for use as generator or transformer protection.
Letter “H” denotes calibration for 400-Hz applications.
Letter “M” denotes calibration for applications having a high inrush current.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

TABLE III. Adjustable instantaneous trip settings amperes/maximum time (all 3 poles).

AQB-A400 trip units only /1													
Element rating	LO /3		2		3		4		HI /3		Seconds /2		
	AC	DC	AC	DC	AC	DC	AC	DC	AC	DC	60 Hz AC	400 Hz AC	DC
250K	880	1150	1035	1200	1165	1280	1325	1505	1530	1765	0.024	0.028	0.028
250KM	3190	3350	3725	4150	4325	4875	5175	5550	5825	6300			
250KH	2020	---	2225	---	2530	---	2840	---	3420	---			
300K	1380	1600	1610	1690	1820	1790	2035	2015	2280	2285			
300KM	3190	3350	3725	4150	4325	4875	5175	5550	5825	6300			
300KH	2020	---	2225	---	2530	---	2840	---	3420	---			
350K	1380	1600	1610	1690	1820	1790	2035	2015	2280	2285			
350KM	3190	3350	3725	4150	4325	4875	5175	5550	5825	6300			
350KH	2020	---	2225	---	2530	---	2840	---	3420	---			
350KG	3190	---	3725	---	4325	---	5175	---	5825	---			
350KGH	2020	---	2225	---	2530	---	2840	---	3420	---			
400K	1380	1600	1610	1690	1820	1790	2035	2015	2280	2285			
400KM	3190	3350	3725	4150	4325	4875	5175	5550	5825	6300			
400KH	2020	---	2225	---	2530	---	2840	---	3420	---			

AQB-A402 trip units only /1 /4										
Frame rating	3X	4X	6X	8X	10X	12X	15X	20X	30X	40X
400	1200	1600	2400	3200	4000	4800	6000	8000	12000	16000

NOTES:

/1 The tolerance for each ampere setting shall not exceed ±10%.

/2 Time shall be measured at three times pickup current of instantaneous setting. For qualification tests only, not for routine calibration.

/3 The LO and HI settings only are calibrated. Others are approximate.

/4 Production units shall be calibrated at the 8X setting. Opening time shall be 0.025 seconds or less when tested at the 3X instantaneous pickup (for qualification tests only, not for routine calibration).

TABLE IV. Adjustable short-time delay pickup (STDPU) settings in amperes (STD) (all 3 poles) (for trip unit types AQB-A402 only).

Continuous current setting	2X	3X	4X	6X	8X	10X	15X
250	500	750	1000	1500	2000	2500	3750
300	600	900	1200	1800	2400	3000	4500
350	700	1050	1400	2100	2800	3500	5250
400	800	1200	1600	2400	3200	4000	6000

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

TABLE V. Adjustable short-time delay (STD) settings in seconds (for trip unit types AQB-A402 only).

STD "delay setting"		
1 /1	**2**	**3**
0.025–0.055 /1	0.065–0.095	0.105–0.135

NOTE:

/1 Time delay with 2X STDPU settings shall be 0.025–0.065 seconds.

TABLE VI. Tripping characteristics – long-time delay (LTD) (all 3 poles).

AQB-A400 trip units only		
Current as multiple of trip element rating	**Tripping time 60-Hz AC trip element DC trip element**	**Tripping time 400-Hz AC trip element**
1.35	----	Not less than 1 hour
1.50	Not less than 1 hour	----
2.25	Less than 1 hour	Less than 1 hour
6.00	Between 20 and 32 seconds	Between 35 to 45 seconds
	Trip unit with "G" marking /1	
1.50	Not less than 20 minutes	Not less than 20 minutes
2.00	Between 5 and 15 minutes	Between 5 and 15 minutes
3.00	Between 60 and 120 seconds	Between 60 and 120 seconds


AQB-A402 trip units only	
Current as multiple of CCS	**Tripping time 60 Hz and 400 Hz AC**
1.35	Not less than 1 hour
1.65	Less than 1 hour
4.0	Between 35 and 55 seconds
6.0	Between 20 and 32 seconds

NOTE:
/1 Letter "G" denotes special calibration for use as generator or transformer protection.


TABLE VII. Test requirements.

Electrical endurance test	The rate of operation shall be 5 operations per minute for a total of 4000 close-open operations.			
Temperature rise tests	Size of cable and bus bars for temperature rise tests			
	Copper rating-amperes	Cable size		Copper bus size (inch)
		AC	DC	AC and DC
	400	Two (2) AWG 000	400 MCM	1-1/2 x 1/8


Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

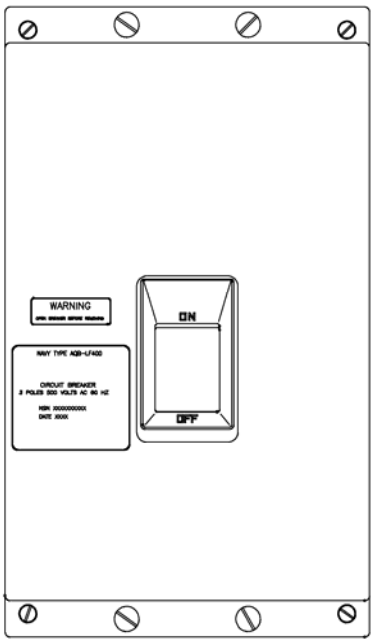

FRONT VIEW OF AQB–A400 type CIRCUIT BREAKER

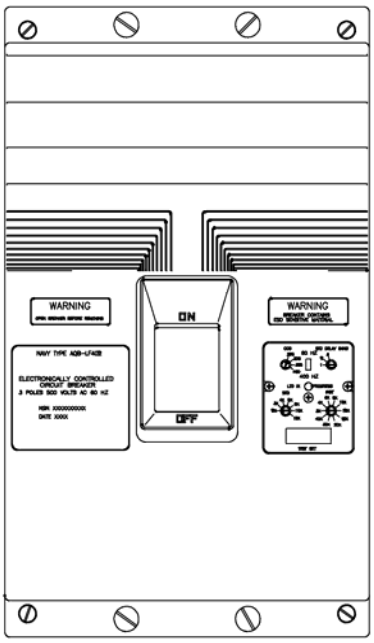

FRONT VIEW OF AQB–A402 type CIRCUIT BREAKER
WITH A CCS SWITCH AND 60/400 HZ SWITCH

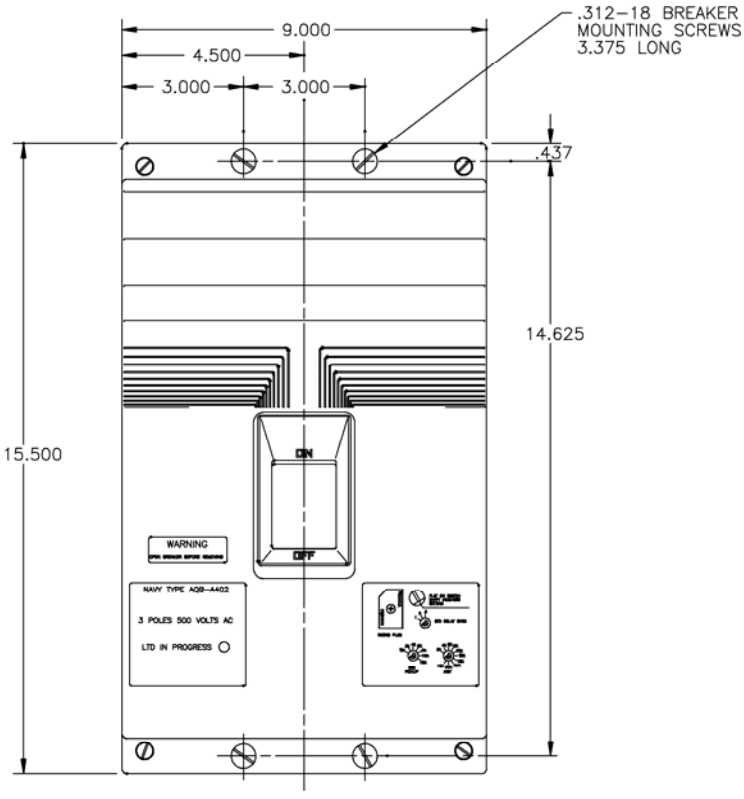

FRONT VIEW OF BREAKER
WITH RATING PLUG

DIMENSIONS TYPICAL

FIGURE 1. Circuit breaker types AQB-A400, AQB-A402, NQB-A400, and NQB A402 outline dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

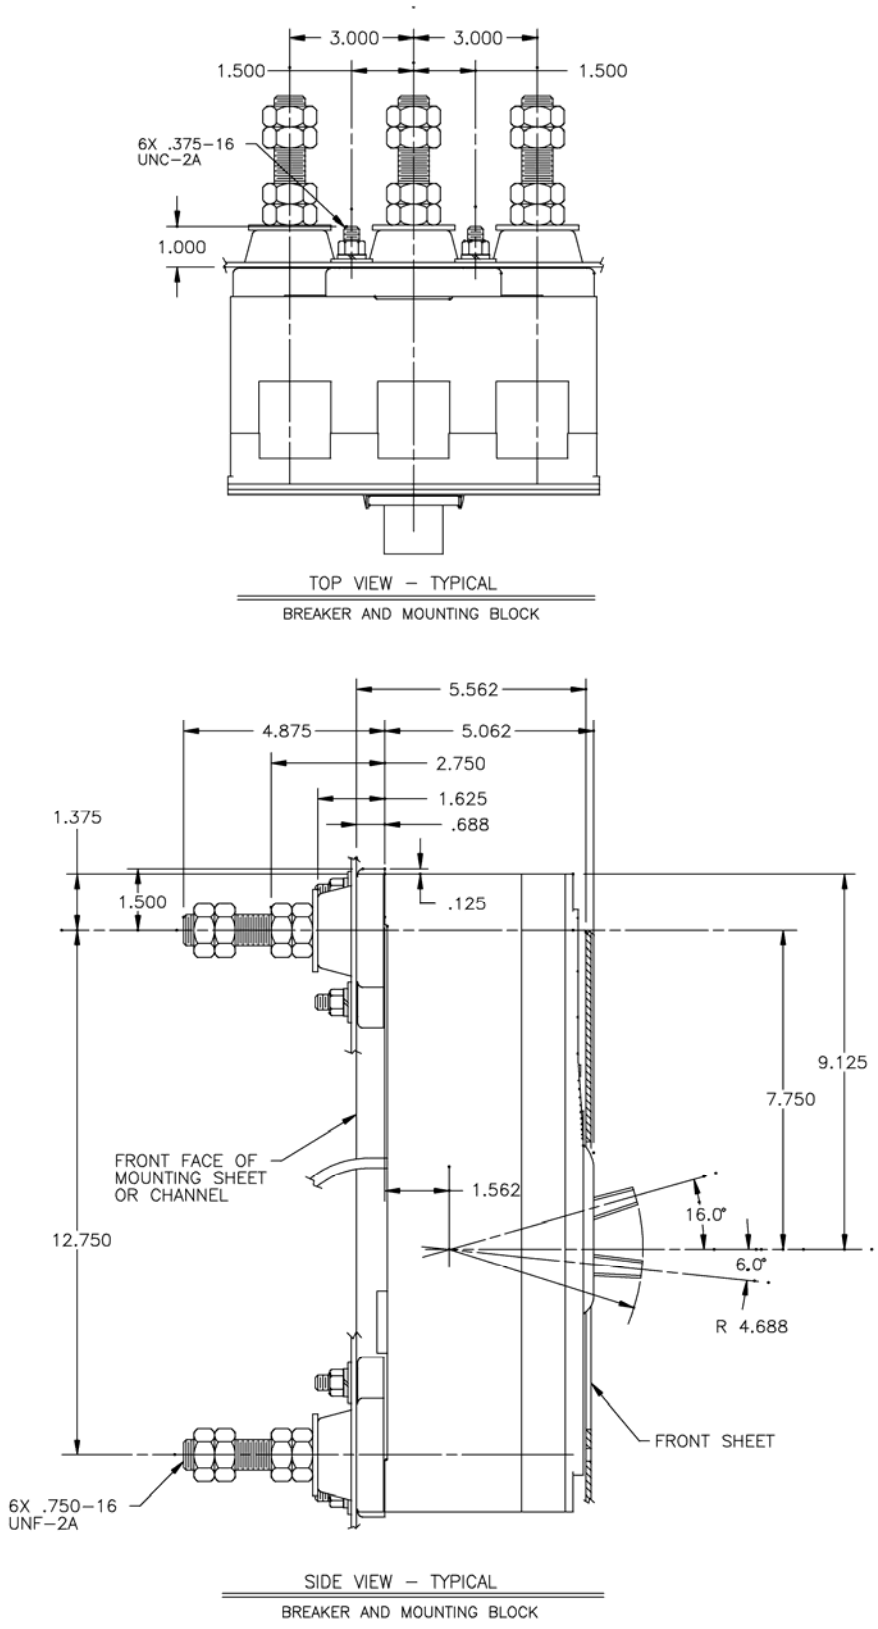


FIGURE 2. Circuit breaker types AQB-A400, AQB-A402, NQB-A400, and NQB-A402 outline and mounting block dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

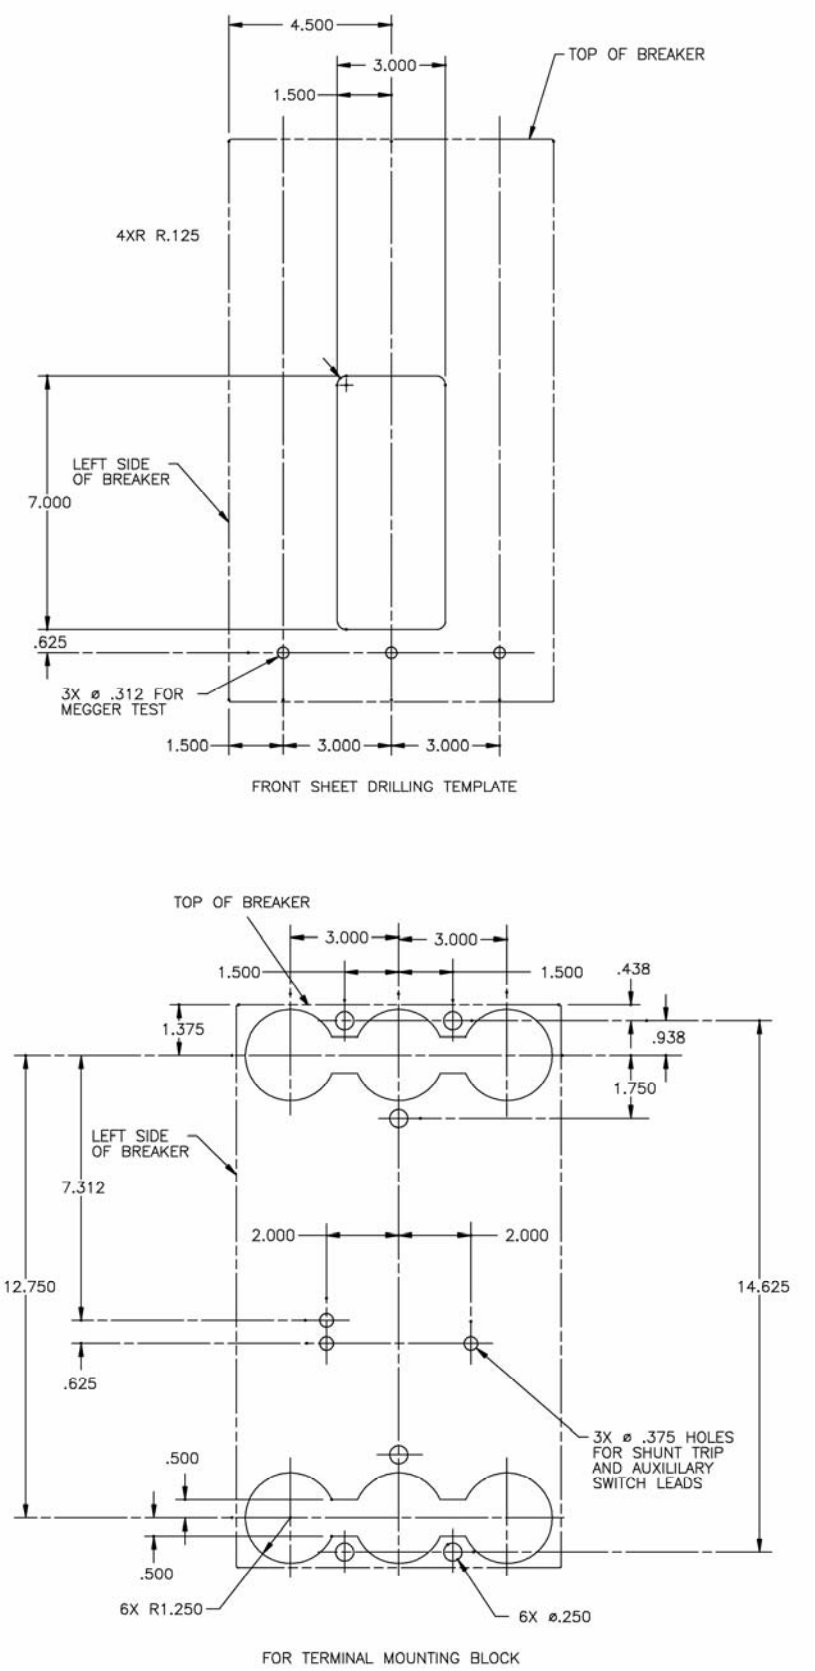


FIGURE 3. Circuit breaker types AQB-A400, AQB-A402, NQB-A400, and NQB-A402 mounting dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

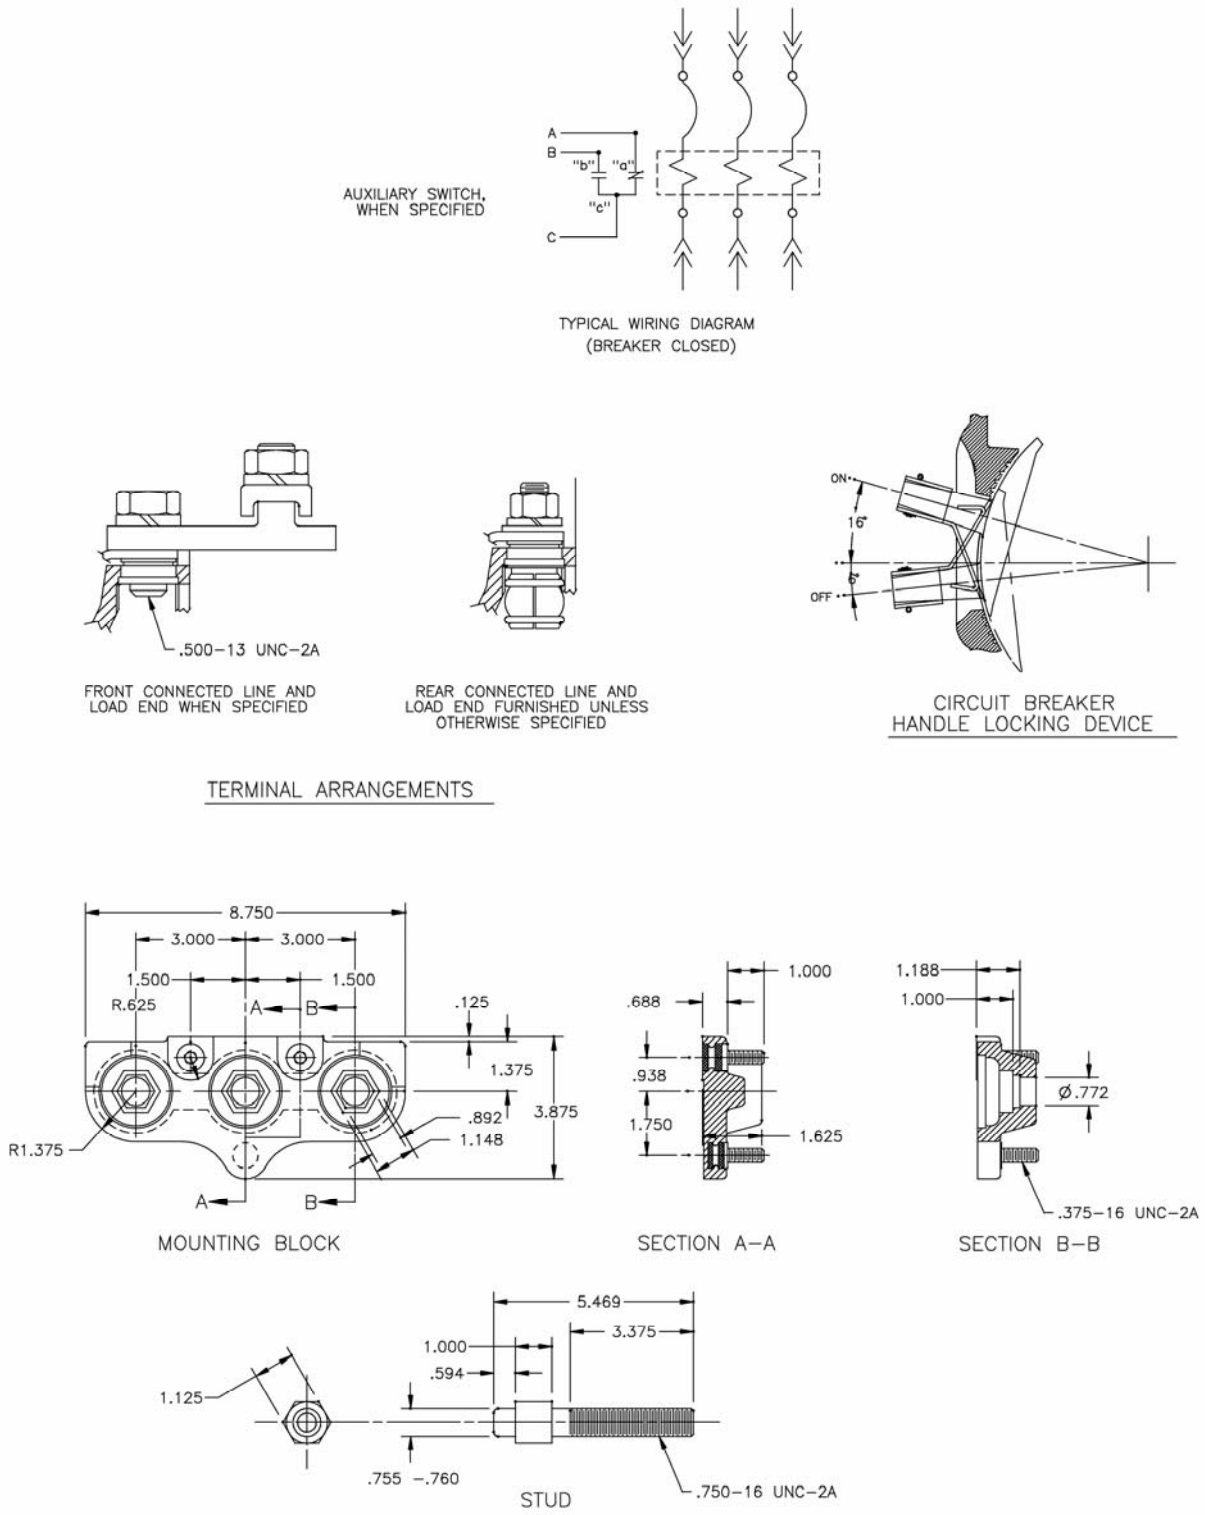


FIGURE 4. Circuit breaker types AQB-A400, AQB-A402, NQB-A400, and NQB-A402 typical wiring diagram, terminal arrangements, handle locking device, and mounting block outline dimensions.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

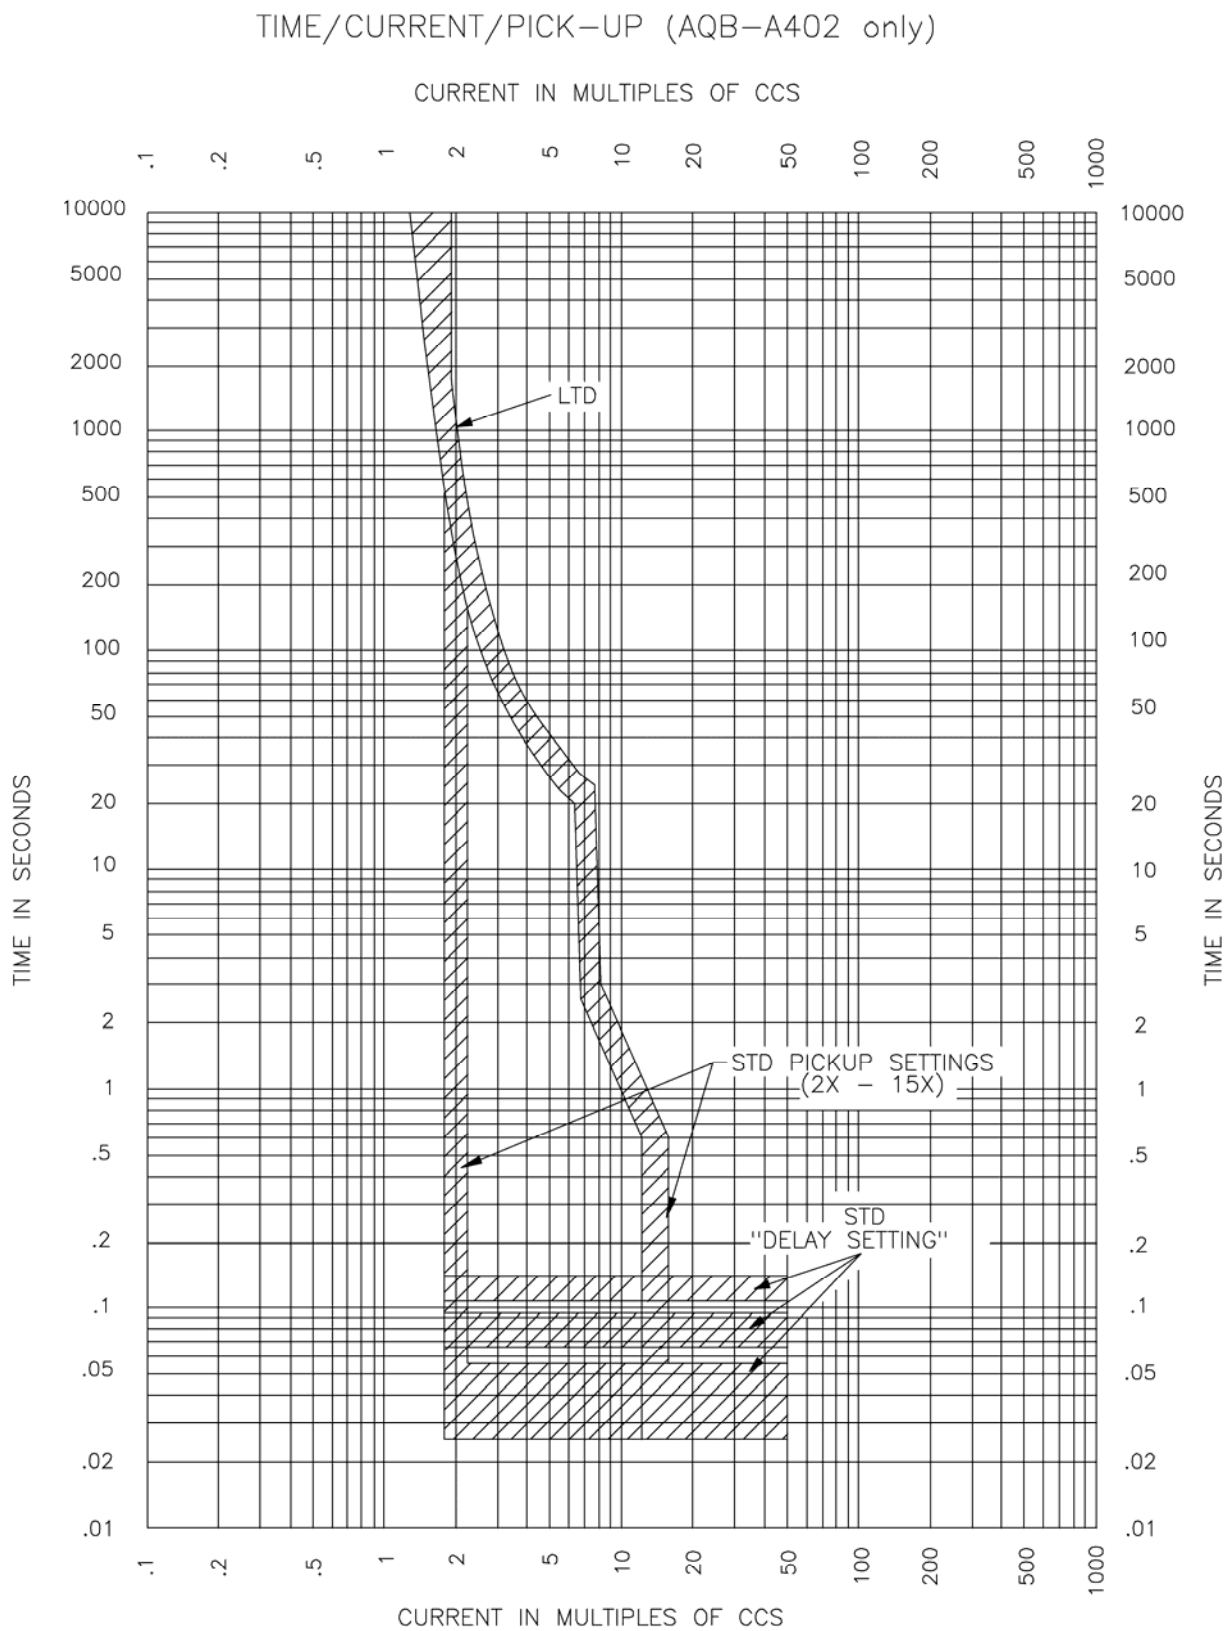


FIGURE 5. Circuit breaker type AQB-A402 time-current response.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

CHANGES FROM PREVIOUS ISSUE: Marginal notations are not used in this revision to identify changes with respect to the previous issue due to the extent of the changes.

Preparing Activity:
Navy – SH
(Project 5925-N185-008)

NOTE: The activities listed above were interested in this document as of the date of this document. Since organizations and responsibilities can change, you should verify the currency of the information above using the ASSIST Online database at http://assist.daps.dla.mil.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.