INCH-POUND
MIL-C-17361/9(SH)
10 March 1989

MILITARY SPECIFICATION SHEET

CIRCUIT BREAKERS, AIR, ELECTRIC, INSULATED HOUSING (SHIPBOARD USE) TYPE AQB - L400 QF, QM


This specification is approved for use by the Naval Sea Systems Command, Department of the Navy, and is available for use by all Departments and Agencies of the Department of Defense.


The requirements for acquiring the product described herein shall consist of this specification sheet and the issue of the following specification listed in that issue of the Department of Defense Index of Specifications and Standards (DoDISS) specified in the solicitation: MIL-C-17361.

AMSC N/A FSC 5925


DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

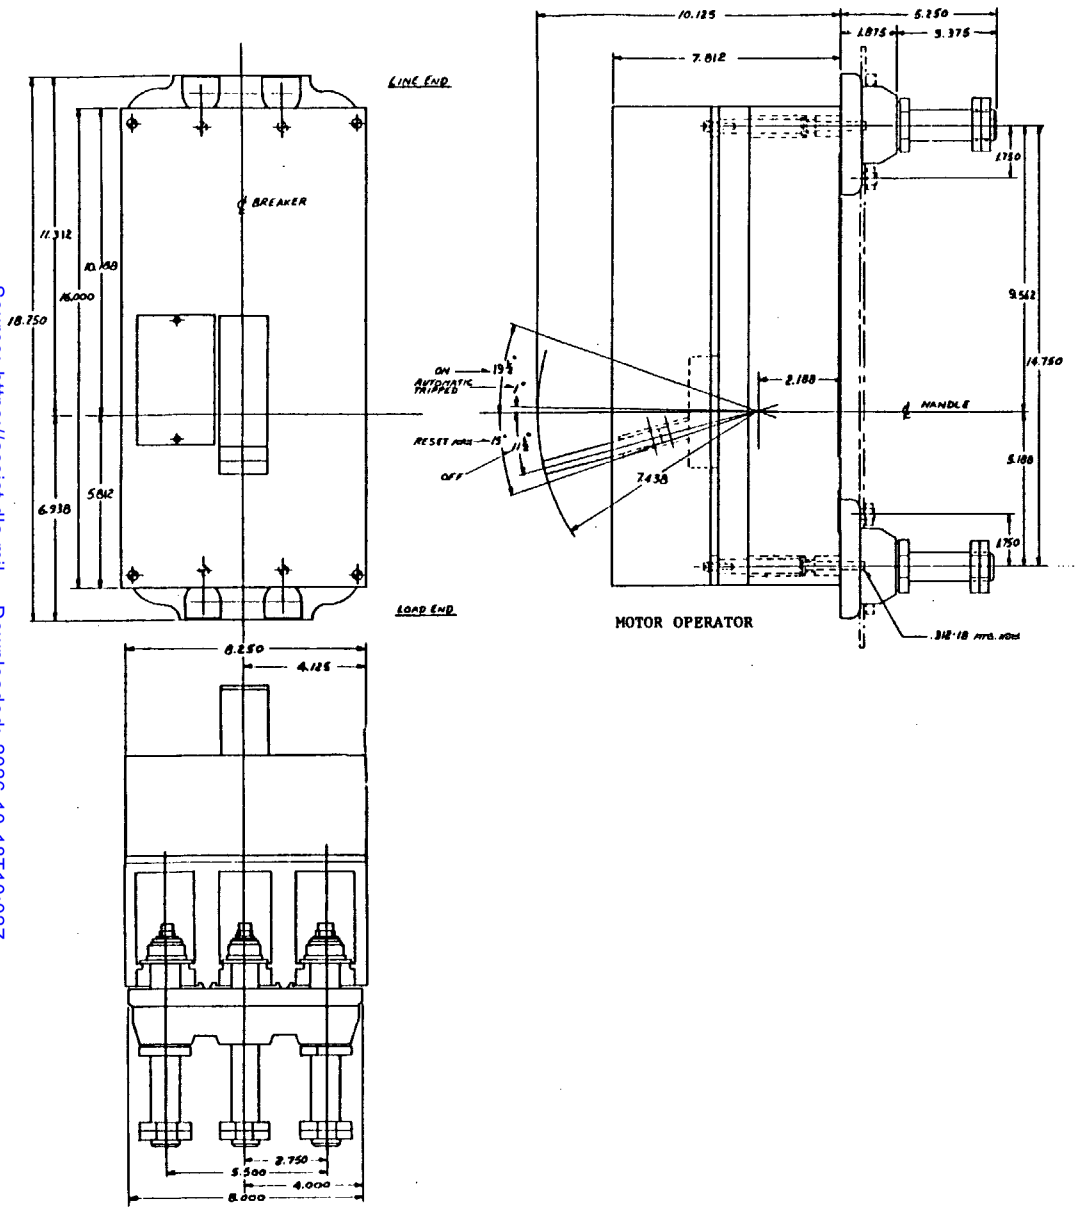

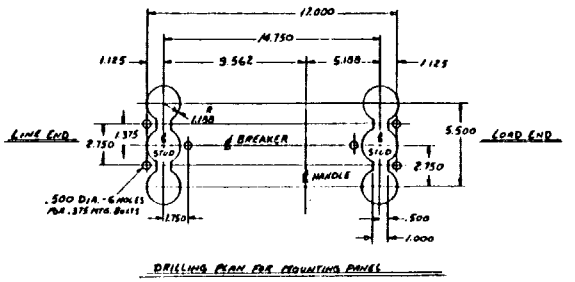

DRILLING PLAN FOR MOUNTING PANEL

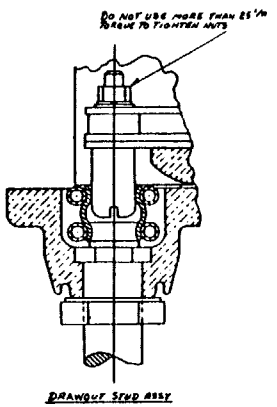

DRAWOUT STUD ASSY


MIL-C-17361/9(SH)

SH 13202360

SHEET 1 OF 2

FIGURE 1. Circuit breaker type AQB-L400, outline and mounting dimensions.


Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

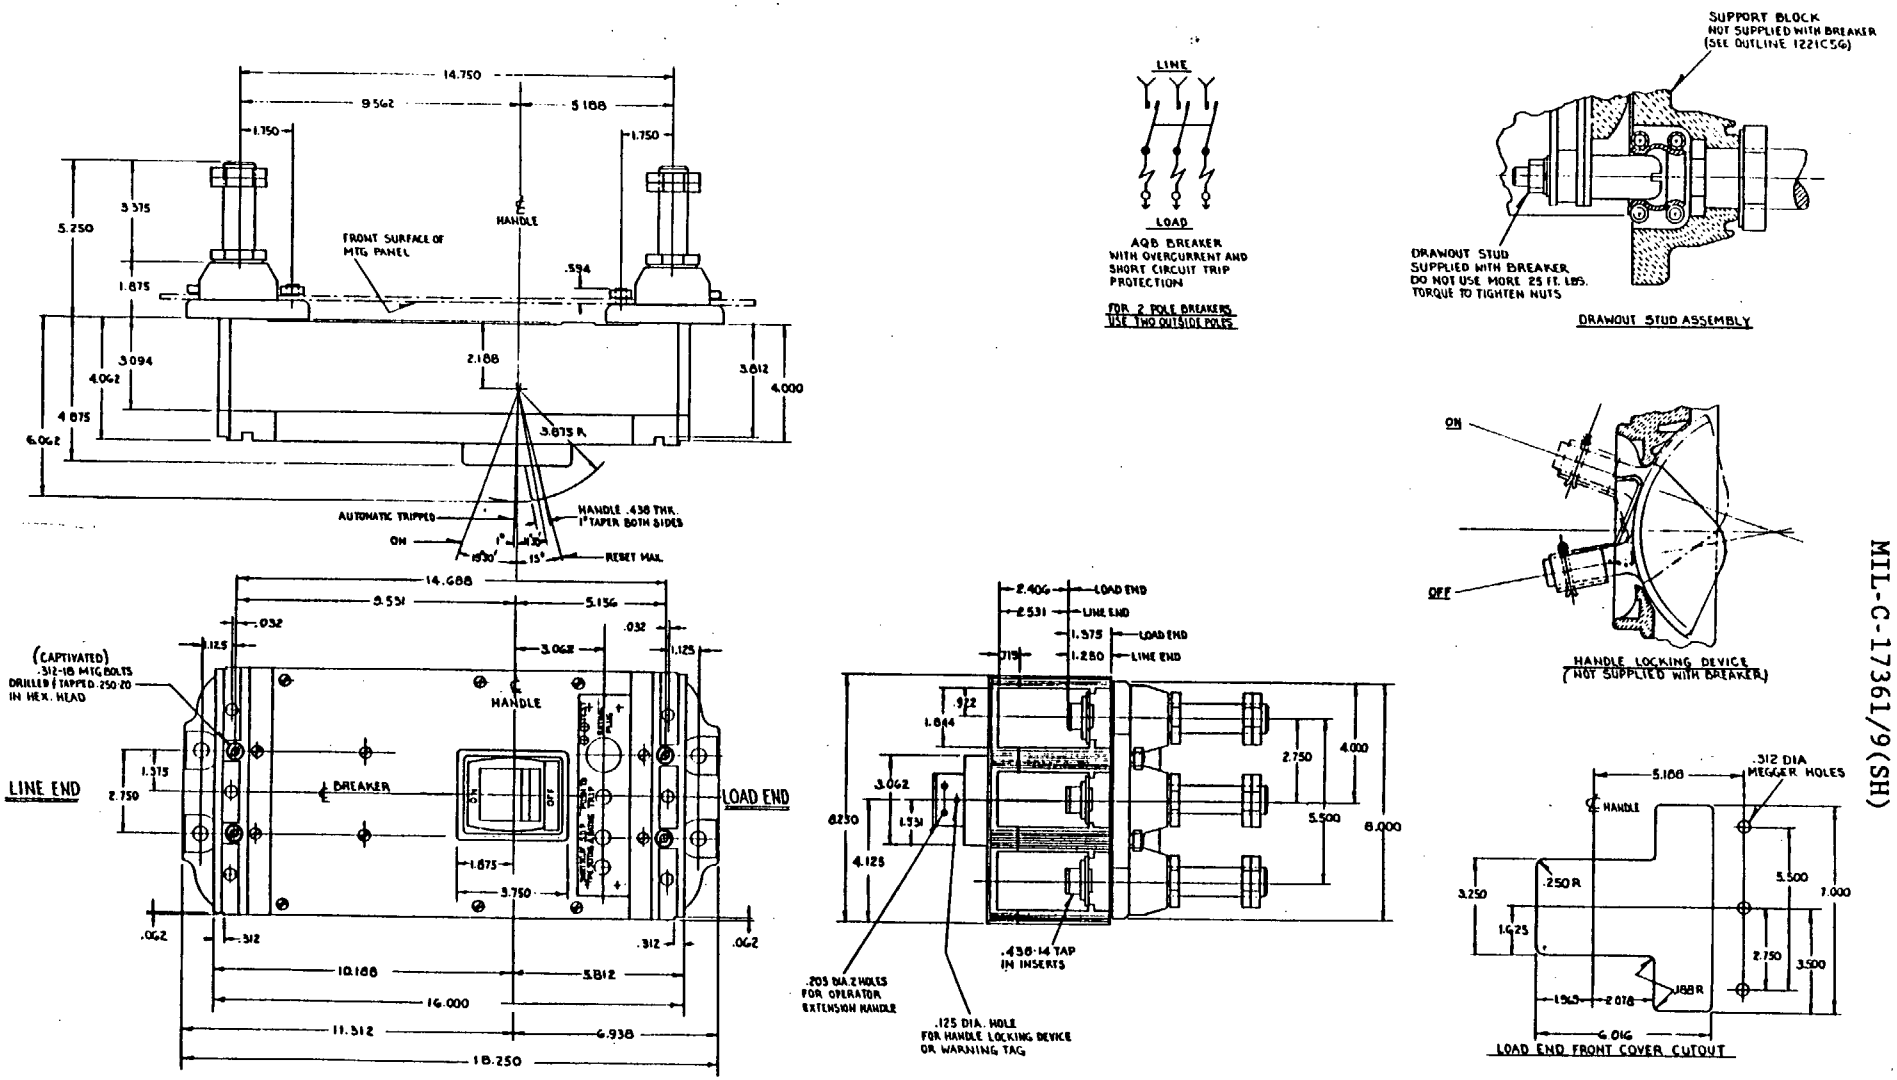

NOTE: Dimensions 6.016, 3.500 and 7.000 may be omitted if it is desirable not to expose the trip unit adjustments and rating plug.

FIGURE 1. Circuit breaker type AQB-L400, outline and mounting dimensions - Continued.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

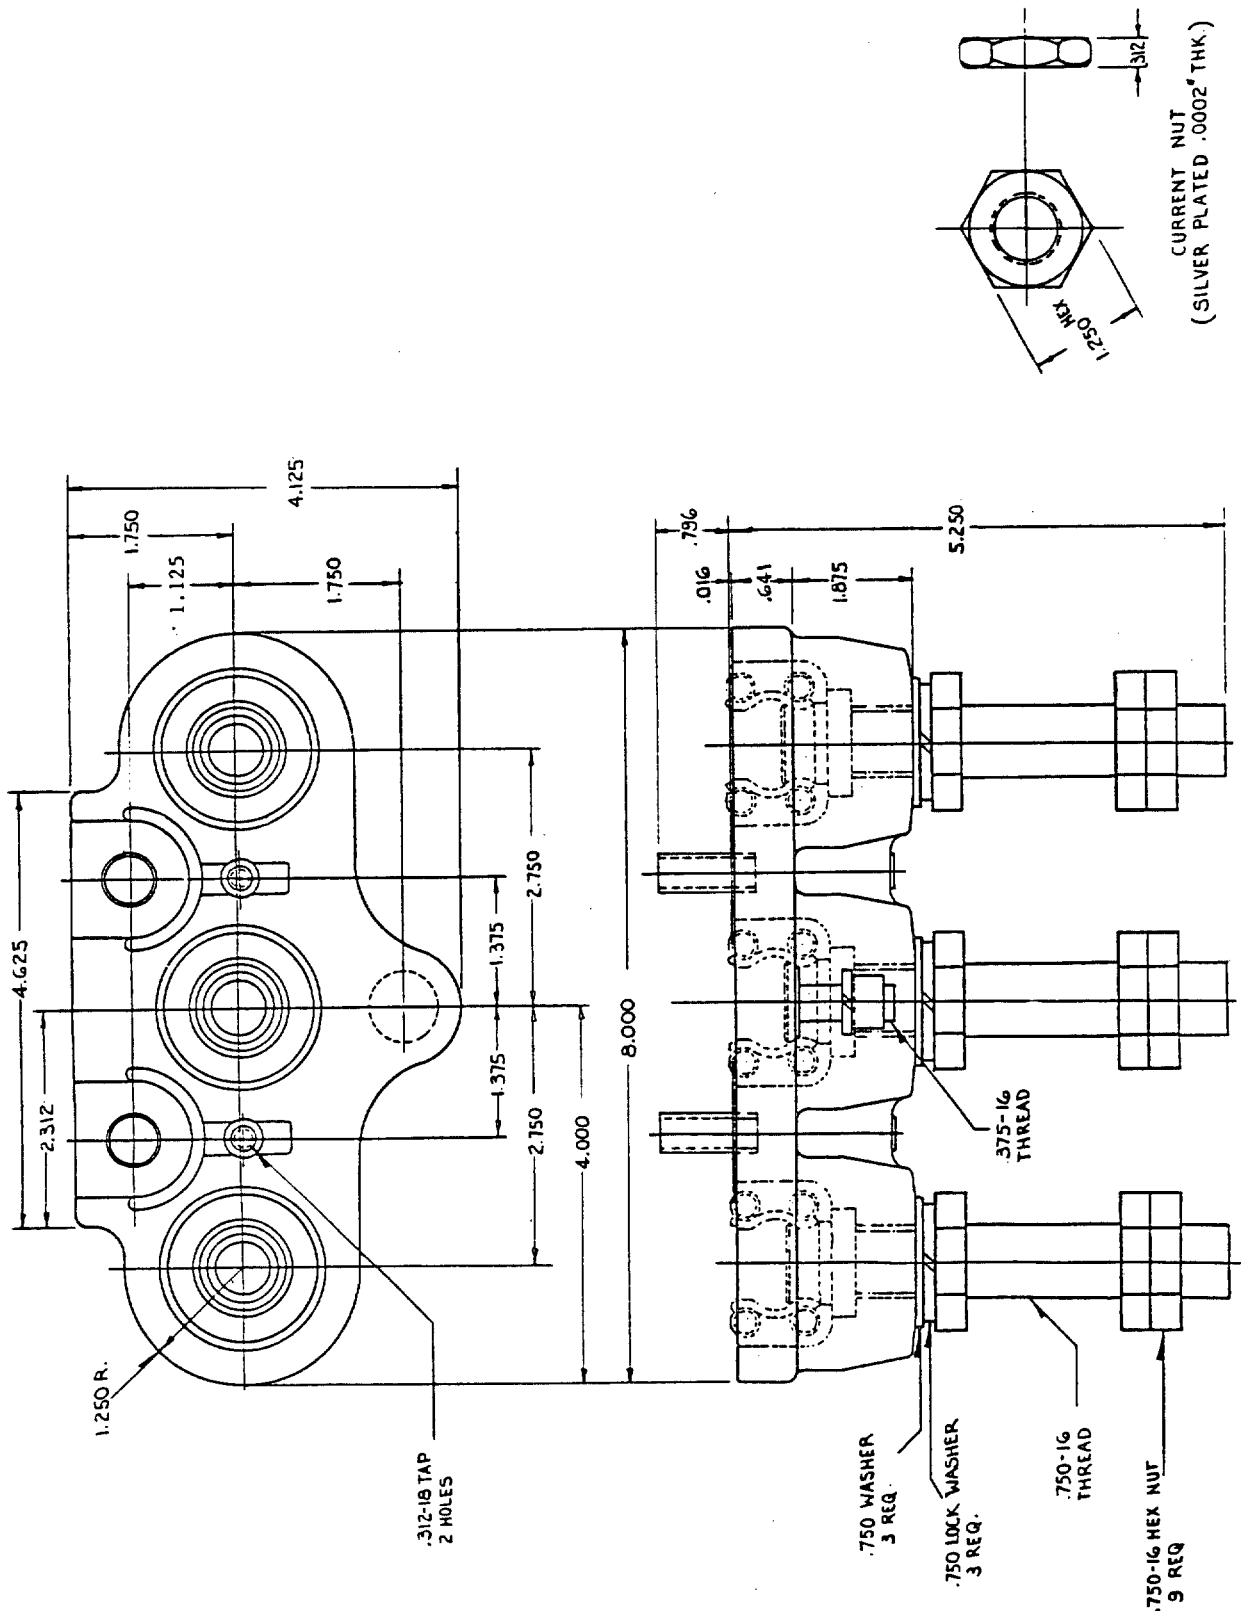

NOTE: All required hardware supplied.

FIGURE 2. Circuit breaker type AQB-L400, mounting block.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

Dimensions: See figures 1 and 2.
Rated continuous current: 400 amperes.
Voltage and frequency: 500 Vac, 60 Hz.
Interrupting rating: 150,000 amperes.
Peak let-through current: 40,000 amperes.
Trip unit: Interchangeable rating plug for continuous ampere rating.
Adjustable short-time pickup and short-time delay on frame; short-time delay range is a function of rating plug type.
Trip unit rating (amperes): See table I.
Protection: LTD, STP instantaneous and current limiting action within current limiting range.
LTD calibration: See table II.
Instantaneous calibration: See table I.
Short delay pickup: See table III.
(NOTE: The inherent impedance of the circuit breaker shall be sufficient to limit fault current.)
Current limiting fuse: Not applicable.
Type of connections: Back (removable mtg.).
Electric operator: Available.
Undervoltage trip or shunt trip: Either available. Excluding 28 Vdc shunt trip and 33 Vdc undervoltage.
(NOTE: 33 Vdc shall not be applicable for undervoltage tripping device.)
Auxiliary switch: Two (a) contacts; two (b) contacts.
Handle lock: Group 3. (Figure 1 of MIL-C-17361)
Handle boot: Not available.
Electrical test: The rate of operation shall be 5 operations per minute for a total of 4000 close-open operations.
Temperature rise tests: See table IV.

NOTE: NQB circuit breakers shall consist of an AQB type without trip unit and a modification kit of metallic parts.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

TABLE I. Instantaneous trip amperes and applicable rating plugs.

Frame type 1/	Interchangeable ampere rating plug types 1/ 2/	Instant pickup	Maximum time (seconds) 3/
AQB-L400QF	250 Q 300 Q 350 Q 400 Q	1850	0.032
AQB-L400QM	250 Q 300 Q 350 Q 400 Q	3280	.032

1/ The suffix letters have the following denotations:
Q - electronic device trip devise.
F - frame type for feeder applications.
M - frame type for high inrush applications.
2/ Rating plugs of the same designation are the same.
3/ Confirmation for qualification test only, not for routine calibration. The tolerance for instantaneous pickup amperes shall not exceed plus or minus 10 percent.

TABLE II. Tripping characteristics - long time delay.

LTD trip element percent current	Tripping time 60 Hz ac trip element
130	Not less than 1 hour
225	Less than 1 hour
600	Between 20 and 32 seconds

TABLE III. Adjustable short-time pickup and delay trip settings.

Complete breaker designation 1/	Short-time pickup (amp) 2/					Short-time delay	
	LO	#2	#3	#4	HI	Min. 3/	Max. 3/
AQB-L250QF	650	850	1050	1250	1500	0.253	0.824
AQB-L300QF	650	850	1050	1250	1500	.349	1.170
AQB-L350QF	650	850	1050	1250	1500	.464	1.580
AQB-L400QF	650	850	1050	1250	1500	.596	2.060
AQB-L250QM	1700	2050	2400	2800	3200	.074	.184
AQB-L300QM	1700	2050	2400	2800	3200	.093	.250
AQB-L350QM	1700	2050	2400	2800	3200	.115	.329
AQB-L400QM	1700	2050	1240	2800	3200	.140	.420

See footnotes at top of next page.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

1/ A complete breaker designation consists of a frame type plus an applicable rating plug type. For example: A type AQB-L350QF breaker consists of a type AQB-L400QF frame, and a type 350Q rating plug; a type AQB-L400QM breaker consists of a type AQB-L400QM frame, and a type 400Q rating plug.
2/ Tolerances for each ampere setting shall not exceed plus or minus 10 percent.
3/ Maximum clearing times at the indicated setting, at the #3 short-time pickup setting. Confirmation for qualification test only.

TABLE IV. Size of cable and bus bars for temperature rise tests.

Copper rating-amperes	Cable size	Copper bus size (inch)
250	Two AWG 000	1-1/2 x 1/8

Preparing activity:
Navy - SH
(Project 5925-N103-09)

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.