INCH-POUND
MIL-C-17361/9A(SH)
17 August 1994
SUPERSEDING
MIL-C-17361/9(SH)
10 March 1989

MILITARY SPECIFICATION SHEET

CIRCUIT BREAKERS, AIR, ELECTRIC, INSULATED HOUSING (SHIPBOARD USE) TYPE AQB - L400 QF, QM

This specification is approved for use by the Naval Sea Systems Command, Department of the Navy, and is available for use by all Departments and Agencies of the Department of Defense

The requirements for acquiring the product described herein shall consist of this specification sheet and the issue of the following specification listed in that issue of the Department of Defense Index of Specifications and Standards (DoDISS) specified in the solicitation MIL-C-17361

AMSC N/A FSC 5925
DISTRIBUTION STATEMENT A Approved for public release, distribution is unlimited

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.



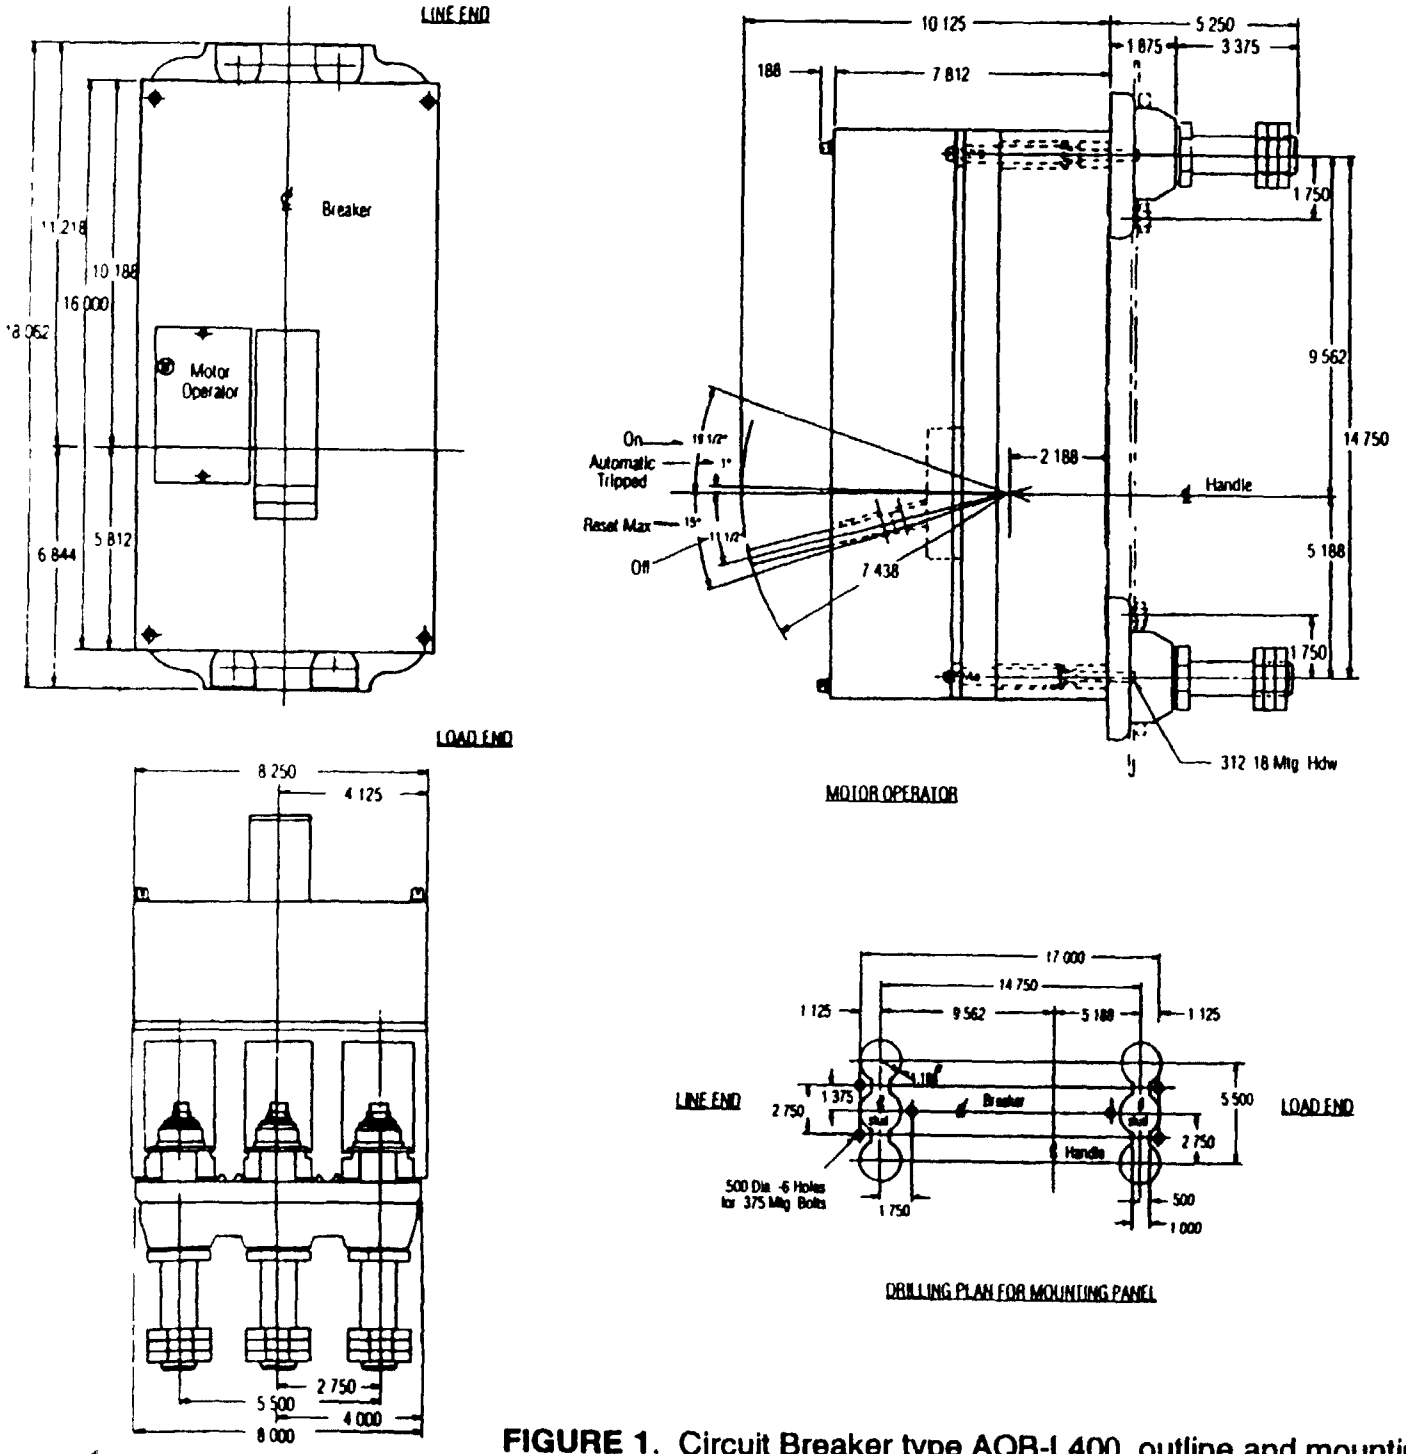


FIGURE 1. Circuit Breaker type AQB-L400, outline and mounting dimensions


Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

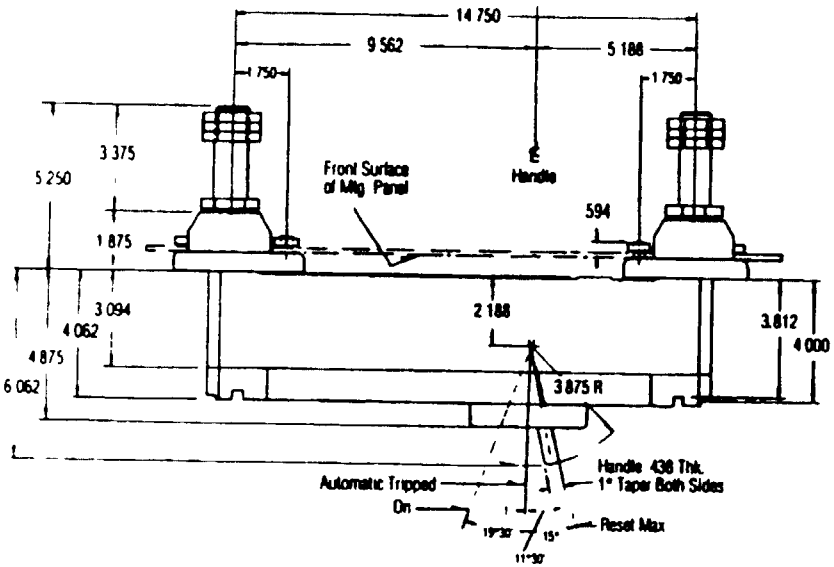




AQB Breaker with Overcurrent and Short Circu I Trip Protection


For 2-Pole Breakers Use Two Outside Poles

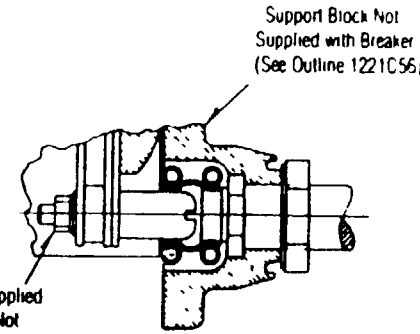



DRAWOUT STUD ASSEMBLY

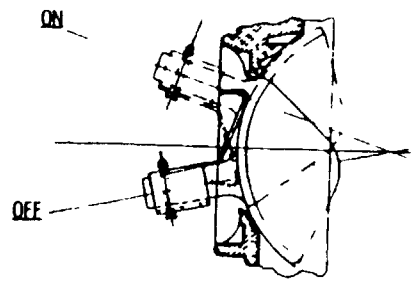

HANDLE LOCKING DEVICE
(not supplied with breaker)

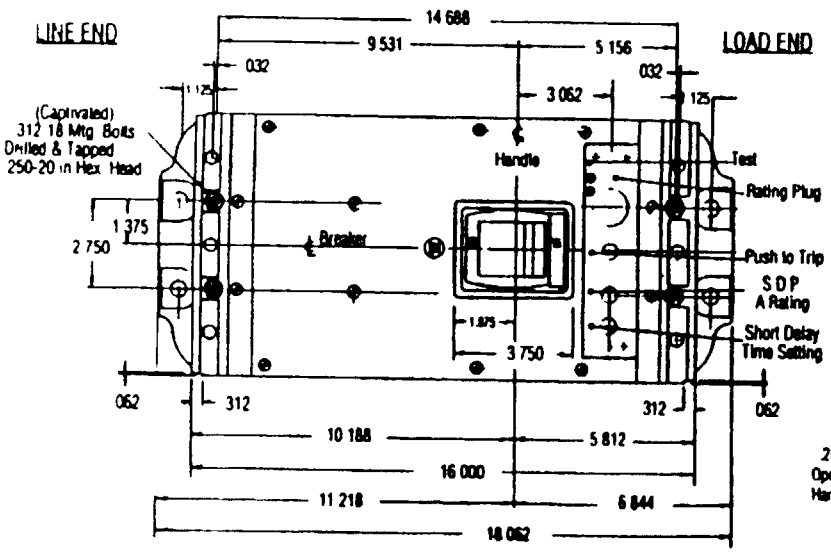

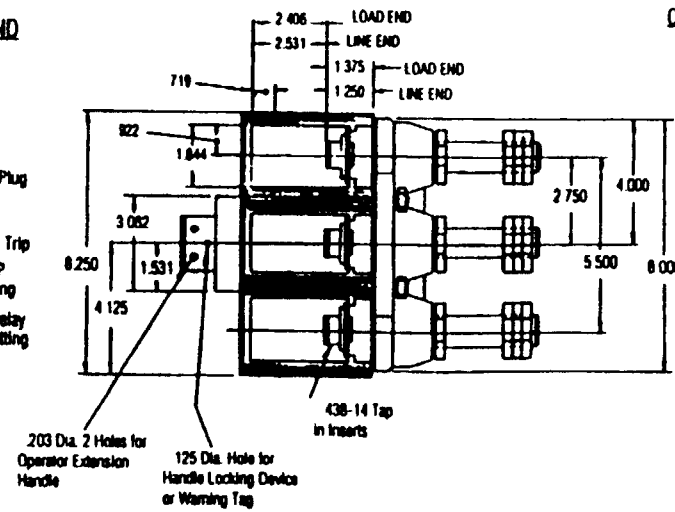

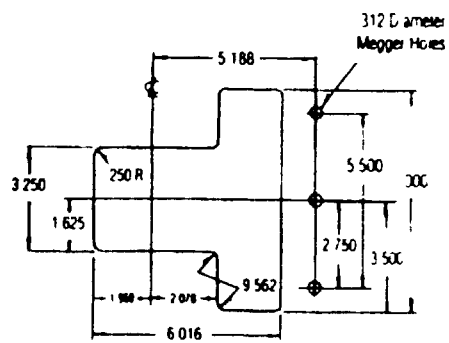


LOAD END FRONT COVER CUTOUT

NOTE Dimensions 6 016, 3 500 and 7 000 may be omitted if it is desirable not to expose the trip unit adjustments and rating plug

FIGURE 1. Circuit Breaker type AQB-L400, outline and mounting dimensions - continued

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

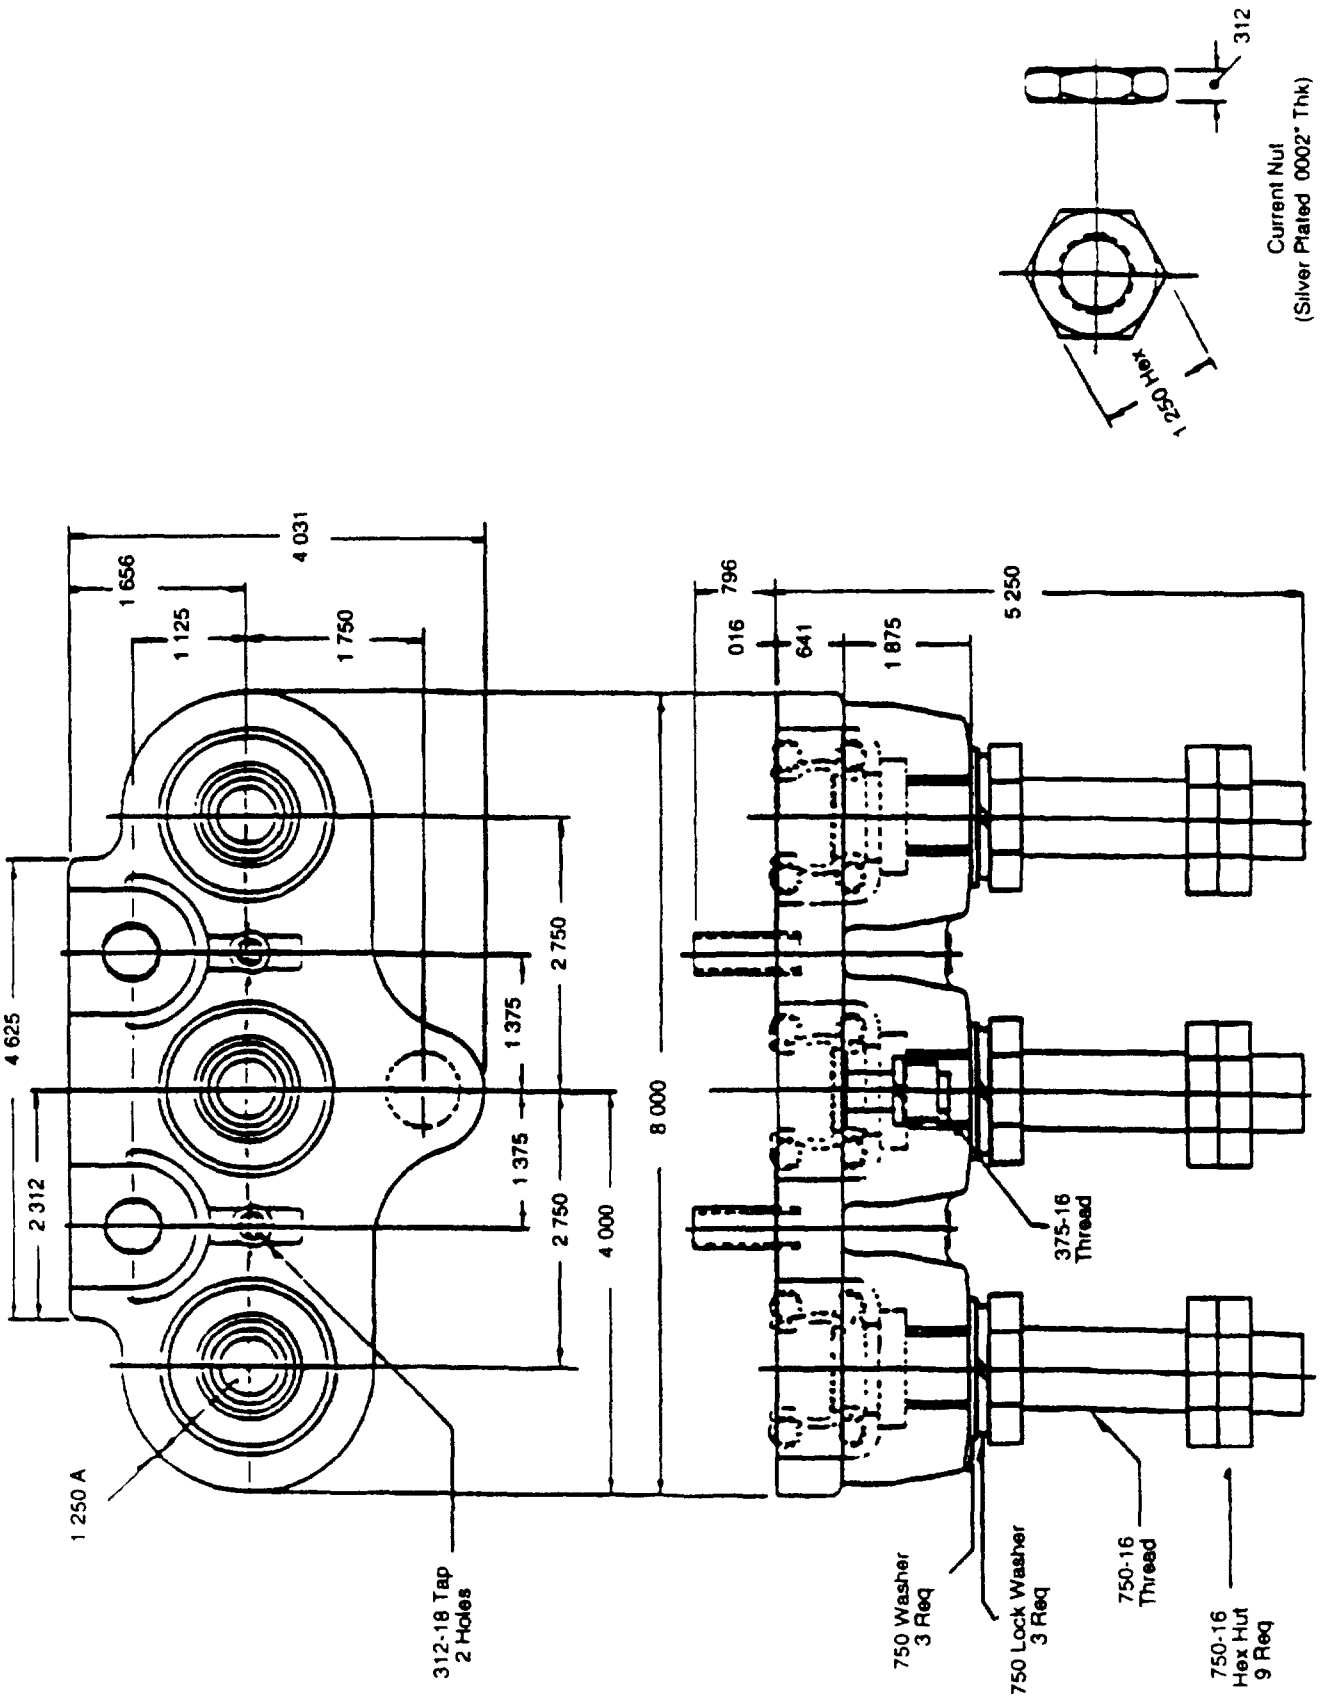

NOTE All required hardware supplied

FIGURE 2. Circuit Breaker type AQB-L400 mounting block.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.



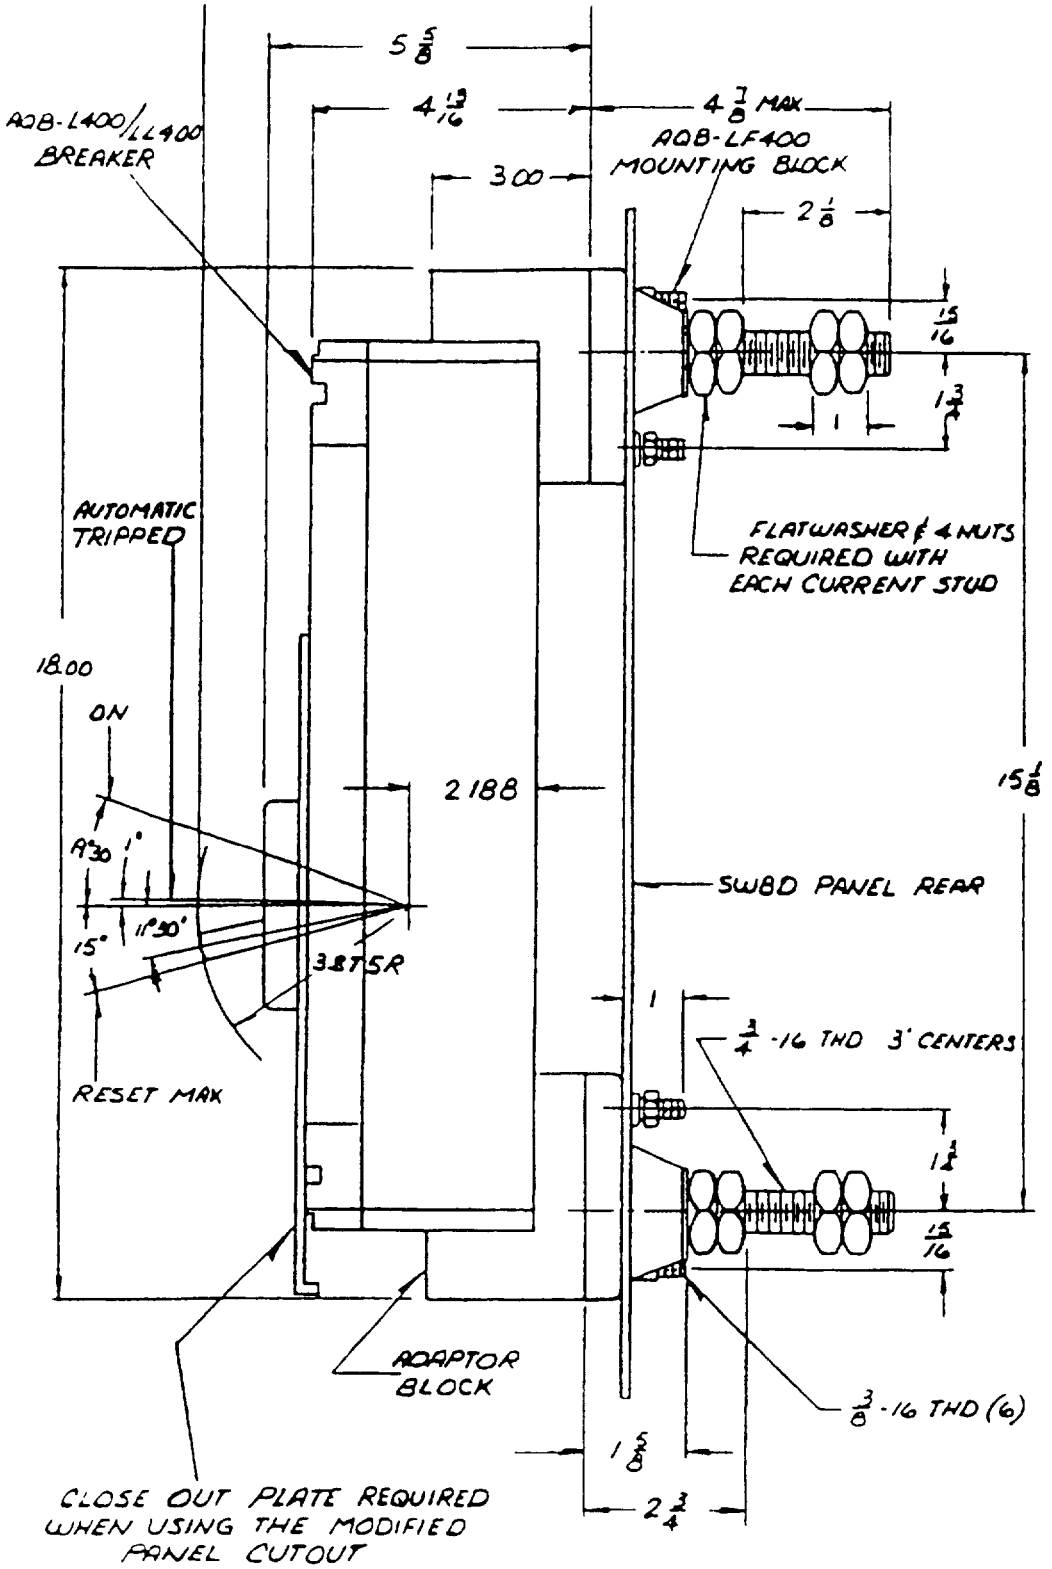


FIGURE 3 Sideview of breaker and mounting blocks, retrofit package

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

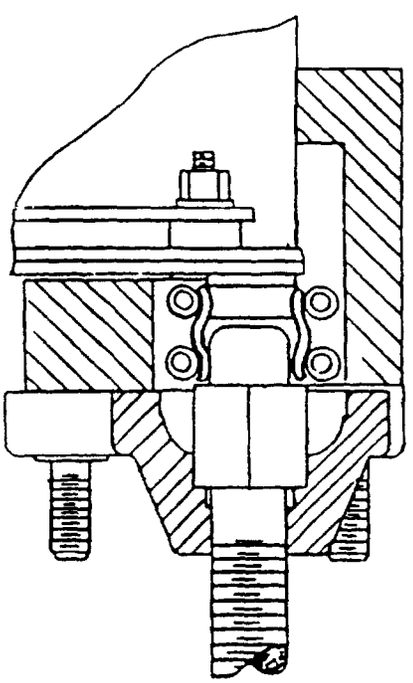

DRAWOUT STUD ASSY

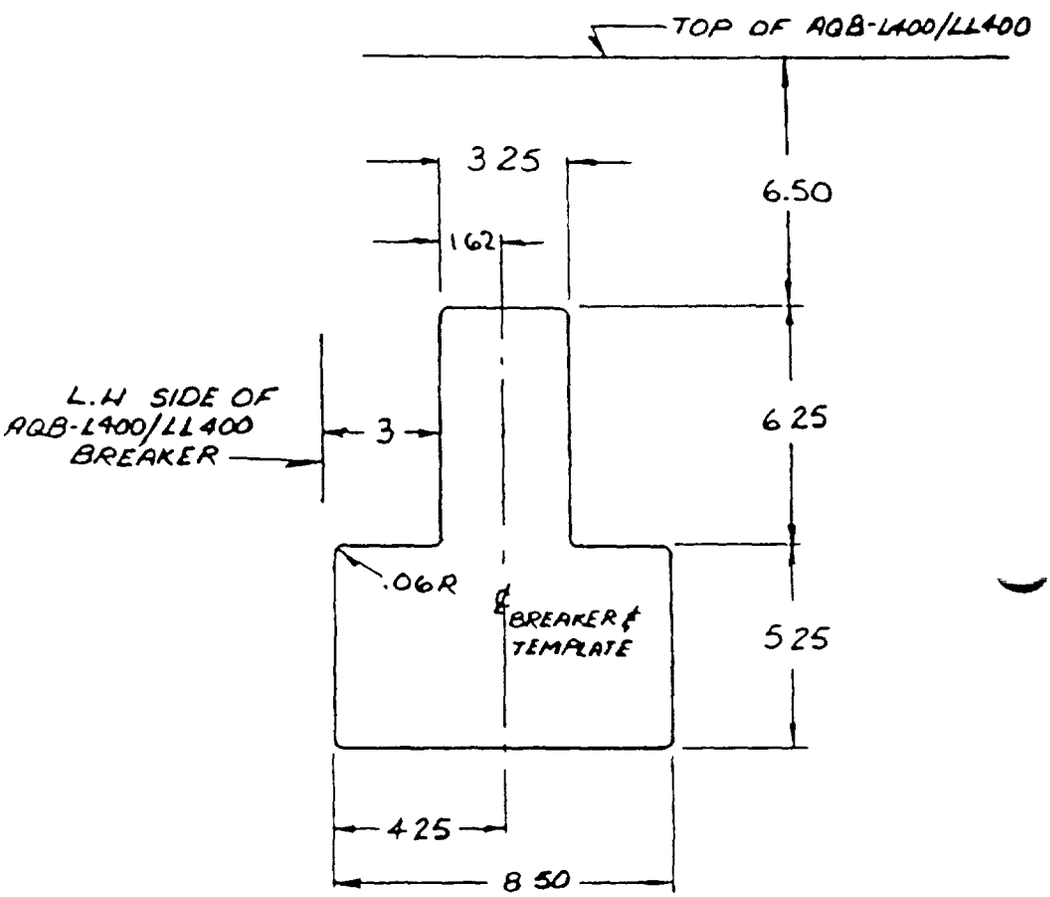

PANEL CUTOUT DIMENSIONS
USE WHEN REPLACING AQB-LF400 WITH AQB-L400/LL400 BREAKERS

FIGURE 4 Drawout stud assembly/panel cutout dimensions retrofit package

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

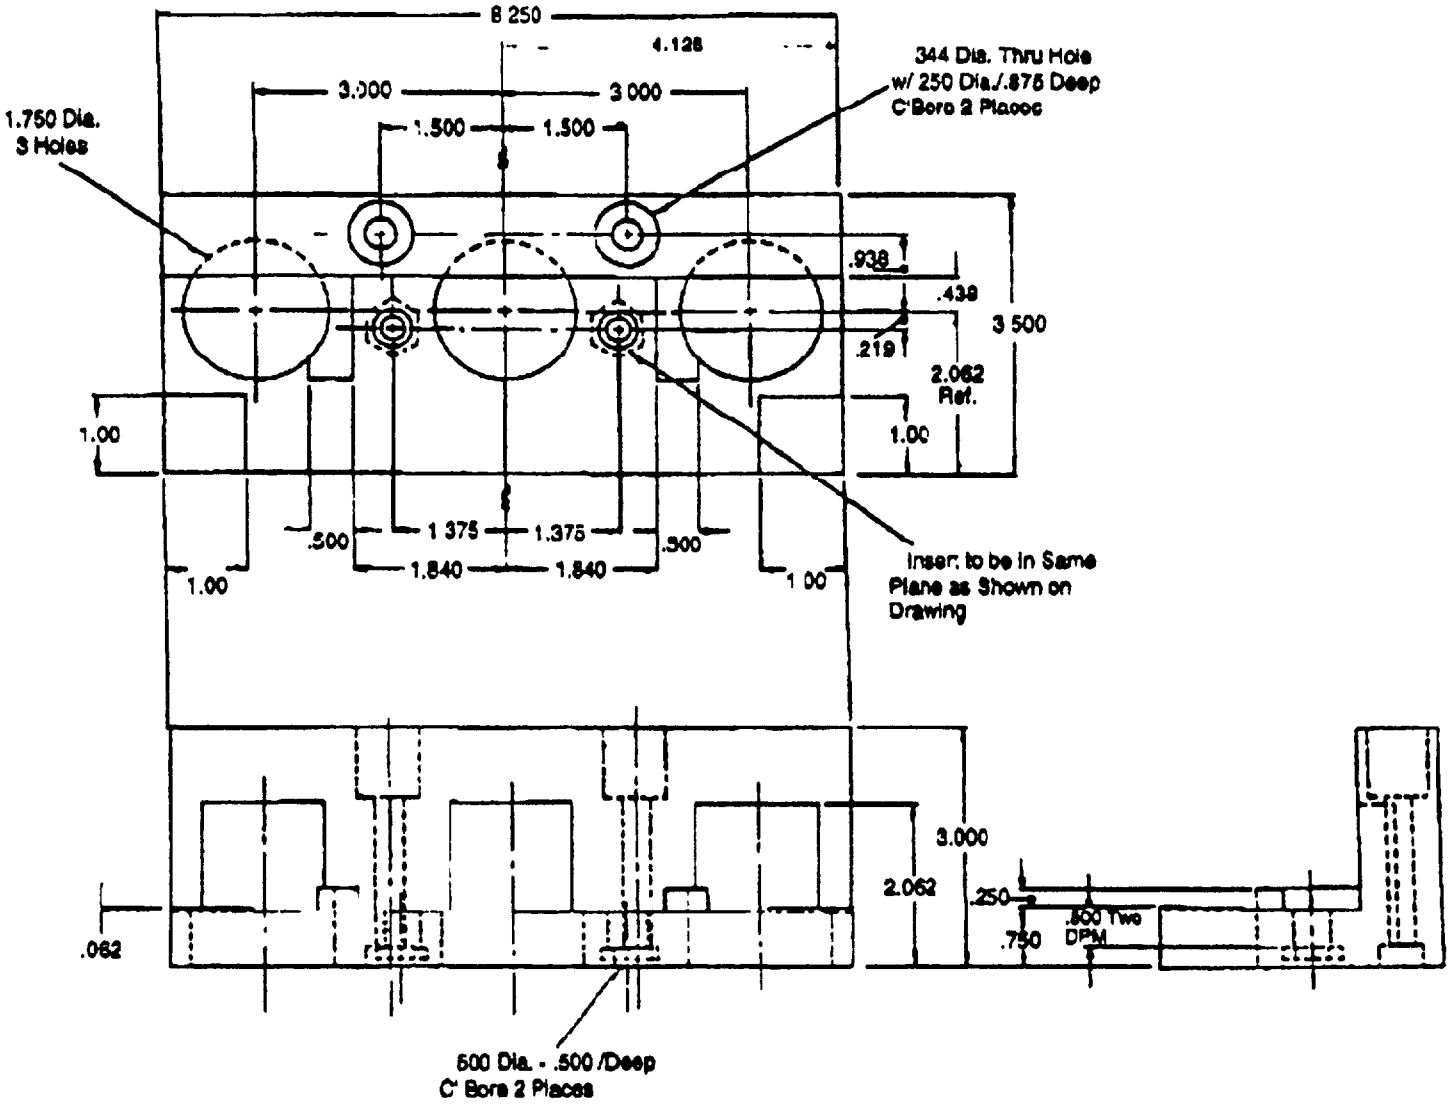


FIGURE 5. Adaptor block retrofit package

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

REQUIREMENTS

Dimensions See figures 1 and 2
Retrofit package An alternate retrofit package may be supplied to meet the mounting requirements for an AQB-LF400 This retrofit package shall consist of 2 adaptor blocks, 6 terminal assemblies, and 1 close out plate Refer to figures 3, 4, and 5
Maximum rated continuous current 400 amperes
Voltage and frequency 500 Vac, 60 Hz
Interrupting rating· 150,000 amperes
Peak let-through current 40,000 amperes.
Trip unit Interchangeable rating plug for continuous ampere rating.
Adjustable short-time pickup and short-time delay on frame, short-time delay range is a function of rating plug type
Trip unit rating (amperes) See table I
Protection LTD, STP instantaneous and current limiting action within current limiting range
LTD calibration See table II
Instantaneous calibration See table I
Short delay pickup See table III
(NOTE The inherent impedance of the circuit breaker shall be sufficient to limit fault current)
Current limiting fuse Not applicable
Type of connections Back (removable mtg)
Electric operator Available
Undervoltage trip or shunt trip· Either available Excluding 28 Vdc shunt trip and 33 Vdc undervoltage
(NOTE 33 Vdc shall not be applicable for undervoltage tripping device)
Auxiliary switch Two (a) contacts, two (b) contacts
Handle lock Group 3 (Figure 1 of MIL-C-17361)
Handle boot Not available
Electrical test The rate of operation shall be 5 operations per minute for a total of 4000 close-open operations
Temperature rise tests See table IV

NOTE NQB circuit breakers shall consist of an AQB type without trip unit and a modification kit of metallic parts

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

TABLE I Instantaneous trip amperes and applicable rating plugs

Frame type 1/	Interrupting amperes rating plug types 1/ 2/	Instant pickup	Maximum time (seconds) 3/
AQB-L400QF	250 Q 300 Q 350 Q 400 Q	1850	0 032
AQB-L400QM	250 Q 300 Q 350 Q 400 Q	3280	032

1/ The suffix letters have the following denotations.
Q - electronic device trip device
F - frame type for feeder applications
M - frame type for high inrush applications
2/ Rating plugs of the same designation are the same
3/ Confirmation for qualification test only, not for routine calibration The tolerance for instantaneous pickup amperes shall not exceed plus or minus 10 percent

TABLE II Tripping characteristics - long time delay

LTD trip element percent current	Tripping time 60 Hz ac trip element
130	Not less than 1 hour
225	Less than 1 hour
600	Between 20 and 32 seconds

TABLE III Adjustable short-time pickup and delay trip settings

Complete breaker designation 1/	Short-time pickup (amp) 2/					Short-time delay	
	LO	#2	#3	#4	HI	Min 3/	Max 3/
AQB-L250QF	650	850	1050	1250	1500	0 253	0 824
AQB-L300QF	650	850	1050	1250	1500	349	1 170
AQB-L350QF	650	850	1050	1250	1500	464	1 580
AQB-L400QF	650	850	1050	1250	1500	596	2 060
AQB-L250QM	1700	2050	2400	2800	3200	074	184
AQB-L300QM	1700	2050	2400	2800	3200	093	250
AQB-L350QM	1700	2050	2400	2800	3200	115	329
AQB-L400QM	1700	2050	1240	2800	3200	140	420

See footnotes at top of next page

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.

1/ A complete breaker designation consists of a frame type plus an applicable rating plug type For example A type AQB-L350QF breaker consists of a type AQB-L400QF frame, and a type 350Q rating plug, a type AQB-L400QM breaker consists of a type AQB-L400QM frame, and a type 400Q rating plug

2/ Tolerances for each ampere setting shall not exceed plus or minus 10 percent

3/ Maximum clearing times at the indicated setting, at the #3 short-time pickup setting. Confirmation for qualification test only

TABLE IV Size of cable and bus bars for temperature rise tests

Copper rating-amperes	Cable size	Copper bus size (inch)
400	Two AWG 000	1-1/2 x 1/8

Preparing activity
Navy - SH
(Project 5925-N154)

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T10:02Z
Check the source to verify that this is the current version before use.